



PROFILE	SURVEYED	BY	DATE
NOTE BOOK	PLOTTED		
NO.	GRADES CHECKED		
	B. M.'S. NOTED		

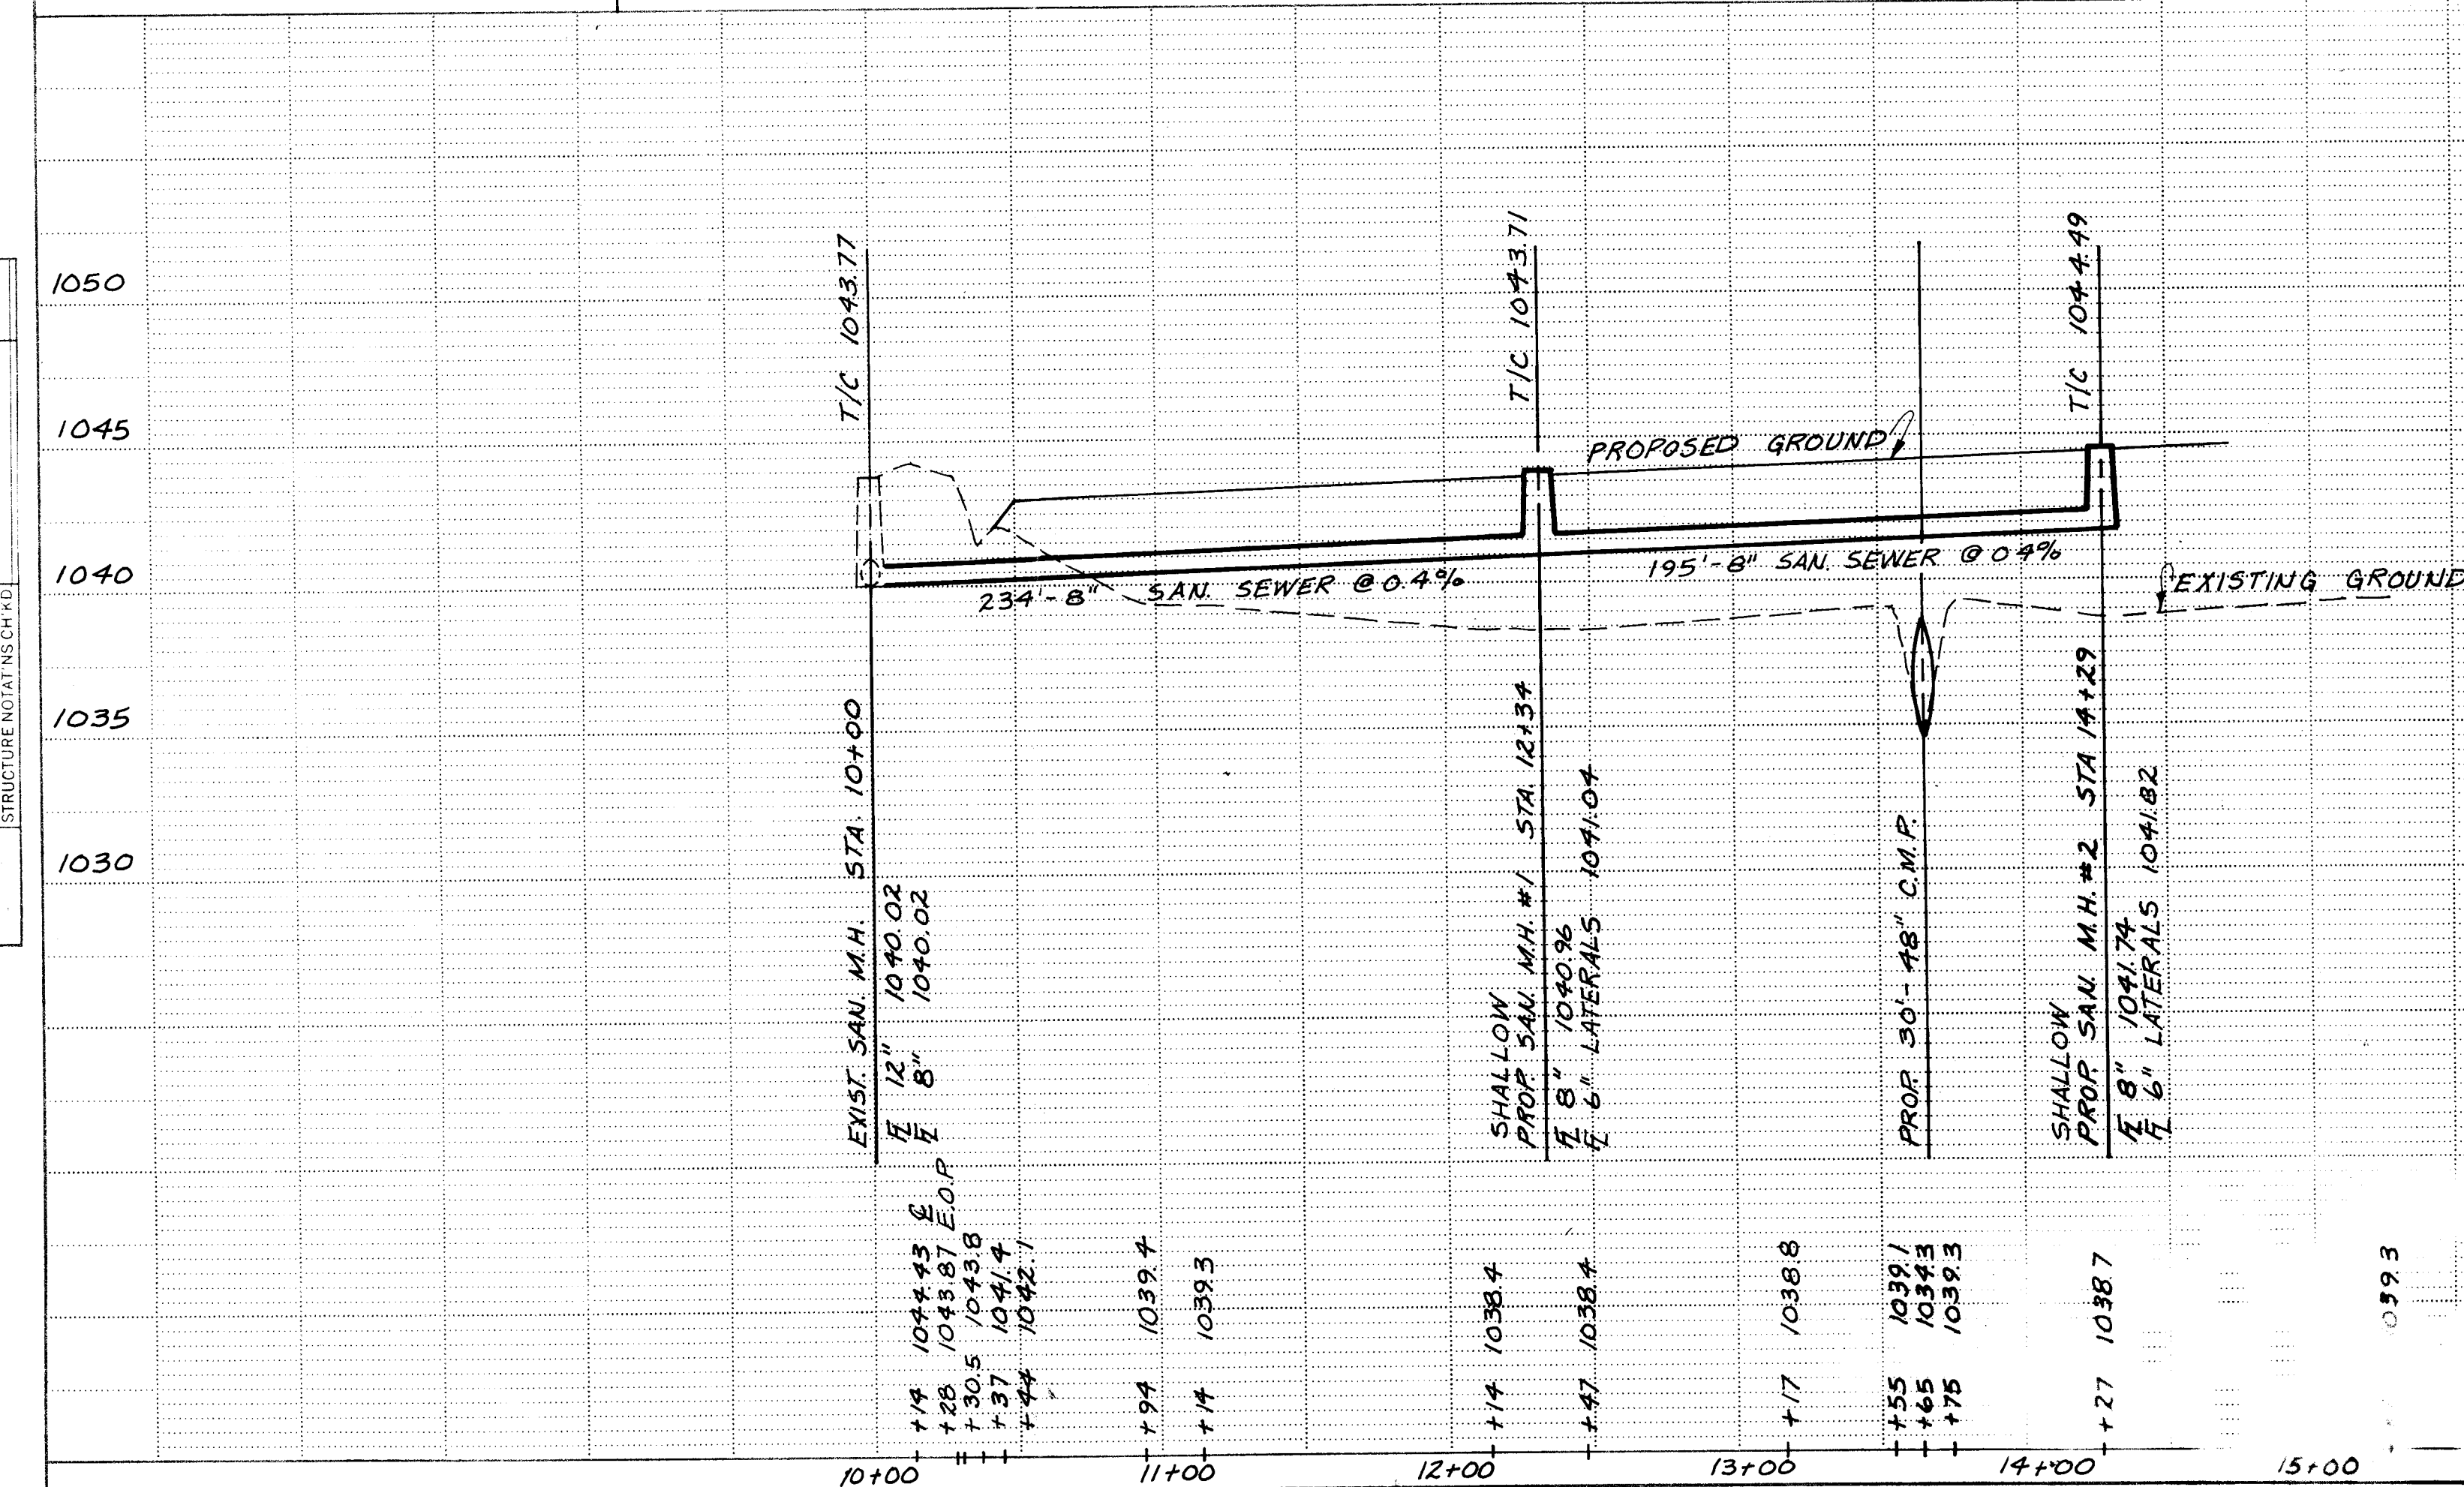

* ITEM NUMBERS REFER TO STARK COUNTY SANITARY ENGINEERING
DEPT. ITEM SPECIFICATIONS, DECEMBER 1, 1978.

APPROVED _____ DATE _____
STARK COUNTY SANITARY ENGINEER



ROOF DRAINS, FOUNDATION DRAINS AND OTHER CLEAN WATER CONNECTIONS TO THE SANITARY SEWER ARE PROHIBITED.

PRIOR TO START OF CONSTRUCTION, THE CONTRACTOR SHALL CONTACT MR. PETER PATCH OF THE SANITARY ENGINEER'S OFFICE (216-438-9303) TO SCHEDULE A PRECONSTRUCTION MEETING. A MINIMUM OF 72 HOURS NOTICE IS REQUIRED TO SCHEDULE THIS MEETING.

ALL SANITARY SEWERS & APPURTENANCES SHALL BE CONSTRUCTED ACCORDING TO STARK COUNTY SANITARY ENGINEERING DEPARTMENT SPECIFICATIONS IN EFFECT AT TIME OF CONSTRUCTION.

AS AN ALTERNATE TO PVC GRAVITY SEWER SHOWN IN QUANTITIES VITRIFIED CLAY PIPE SEWER, EXTRA STRENGTH, ASTM C-700 MAY BE USED.

ALL SANITARY SEWER LATERALS TO BE 6" DIAMETER.

A BULKHEAD MUST BE ERECTED IN THE EXISTING MANHOLE WHERE THE TAP FOR THE NEW SENER IS MADE AND REMAIN IN PLACE UNTIL THE NEW SENER IS COMPLETELY TESTED AND APPROVED.

BUILDING CONNECTIONS MAY NOT BE MADE UNTIL THE SEWER IS COMPLETE, TESTED AND APPROVED, AND ALL REQUIREMENTS OF THE SANITARY ENGINEER HAVE BEEN MET.

JUN 17 1989

HAMMONTREE & ASSOC., LTD.

[illegible]