


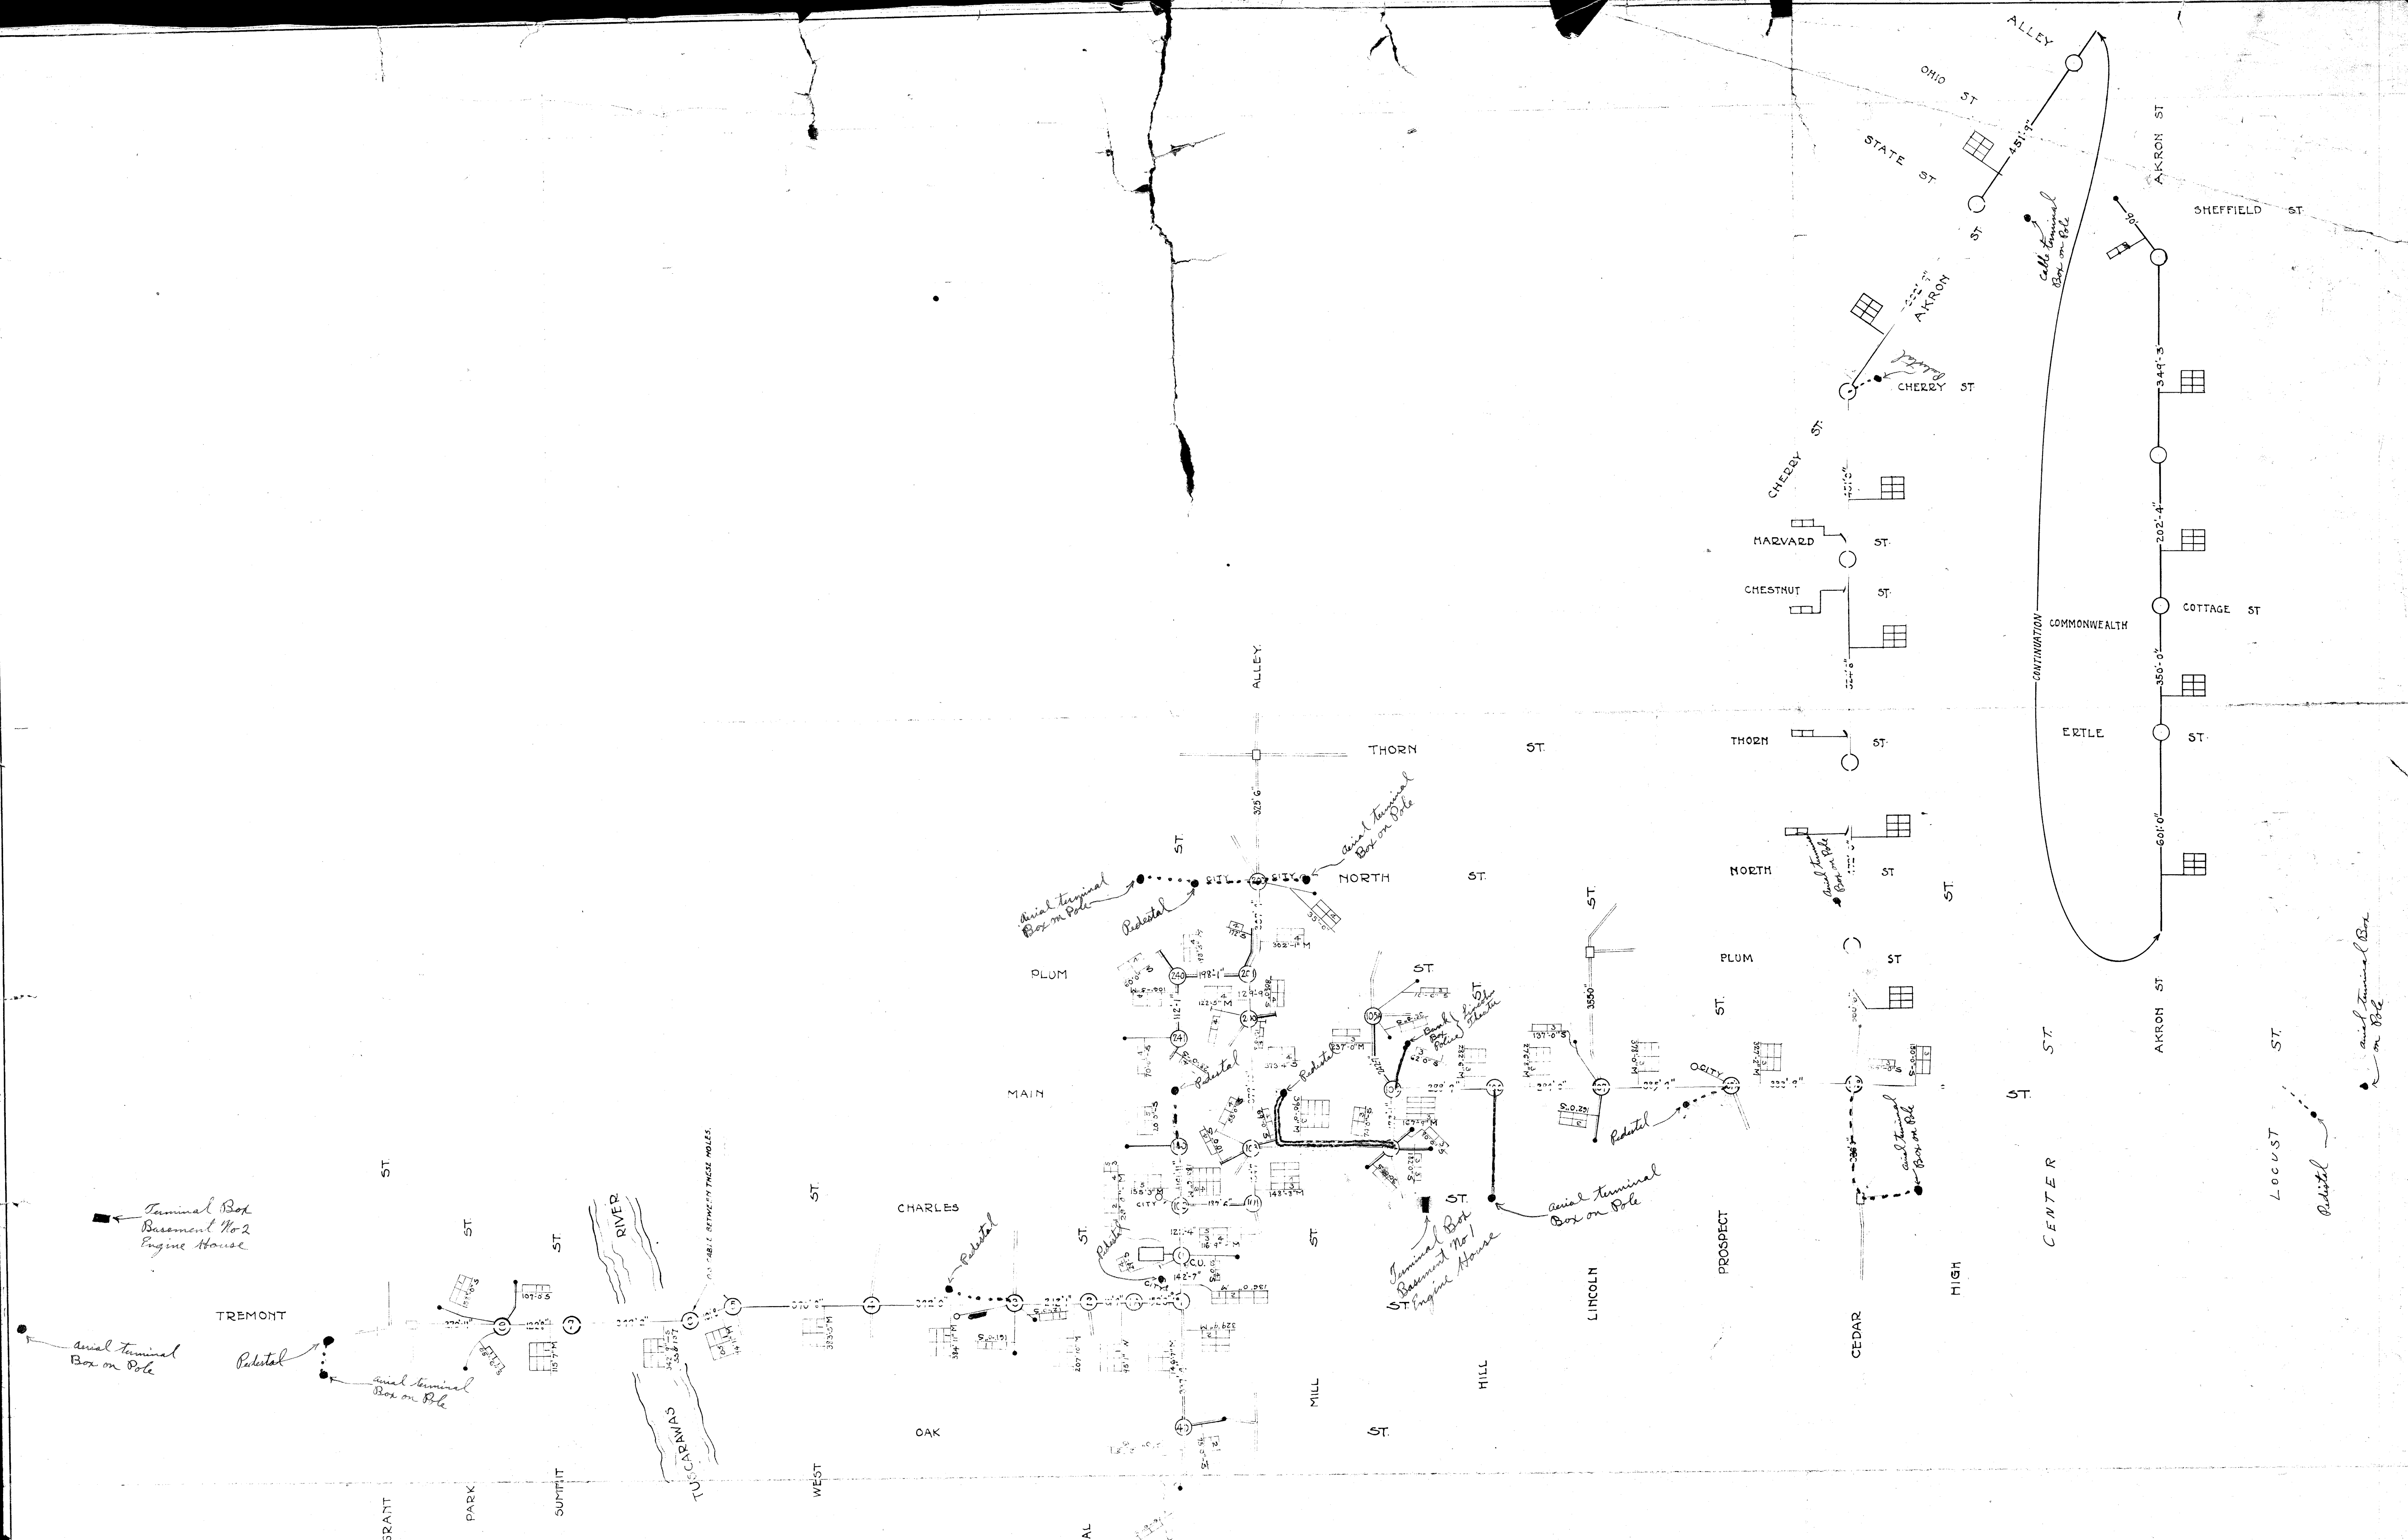

UNDERGROUND POLICE AND FIRE ALARM CABLE IN PLACE

— CODE —

20-CONDUCTOR

10-CONDUCTOR

--- 6-CONDUCTOR

--- 2-CONDUCTOR

Ivan A. Pitt
City Electrician

NOTE: - ALL MANHOLES SHOWN BY CIRCLE ○
ARE JOINT EXCEPT WHERE INDICATED OTHERWISE

MASSILLON, OHIO.
M.H. & CONDUIT RECORD.
SCALE: 1"=200' FEB. 18, 1916.

— CODE —

○ 325' C.T.O.C. OF M.H.

— CU CONDUIT & M.H.

DUCT FORMATION LOOKING AWAY FROM OFFICE

DUCT LENGTH - MULT. TILE

JOINT CONDUIT OSTCO & C.U.T.CO

C.U.T.CO LATERAL

OSTCO CONDUIT & LATERAL

Corrected to 1-13-22

M-187