

S.E. 1/4 SECT. 6 PERRY TWP.

RIVER

CORPORATION LINE

TUSCARAWAS

CITY OF MASSILLON

O. L. 1 6 3

OHIO WATER SERVICE CO.
PUMP HOUSE

EXIST. GATE VALVES TO REMAIN
EXIST. 12" PIPE

NEW 16" PIPE

STATE STANDARD #1 MH
STA. 655+08.62

16" TO 12" REDUCER

16" TO 12" REDUCER

EXIST. GATE VALVE TO REMAIN


NISH AVE.

W. N. ST.
KRACKER



OHIO WATER SERVICE CO.
MASSILLON, OHIO
16" WATER LINE CROSSING @ STARK
U. S. 21-12.39 STA 655+08.62
Scale 1"=50' Feb. 1957

NOTE:

NONE OF PROPOSED WORK WILL BE DONE UNTIL THE HIGHWAY FILL SHALL HAVE BEEN COMPACTED & COMPLETED, THEN A TRENCH SHALL BE DUG FOR PLACEMENT, FOLLOWED BY PROPER FILL & COMPACTION.

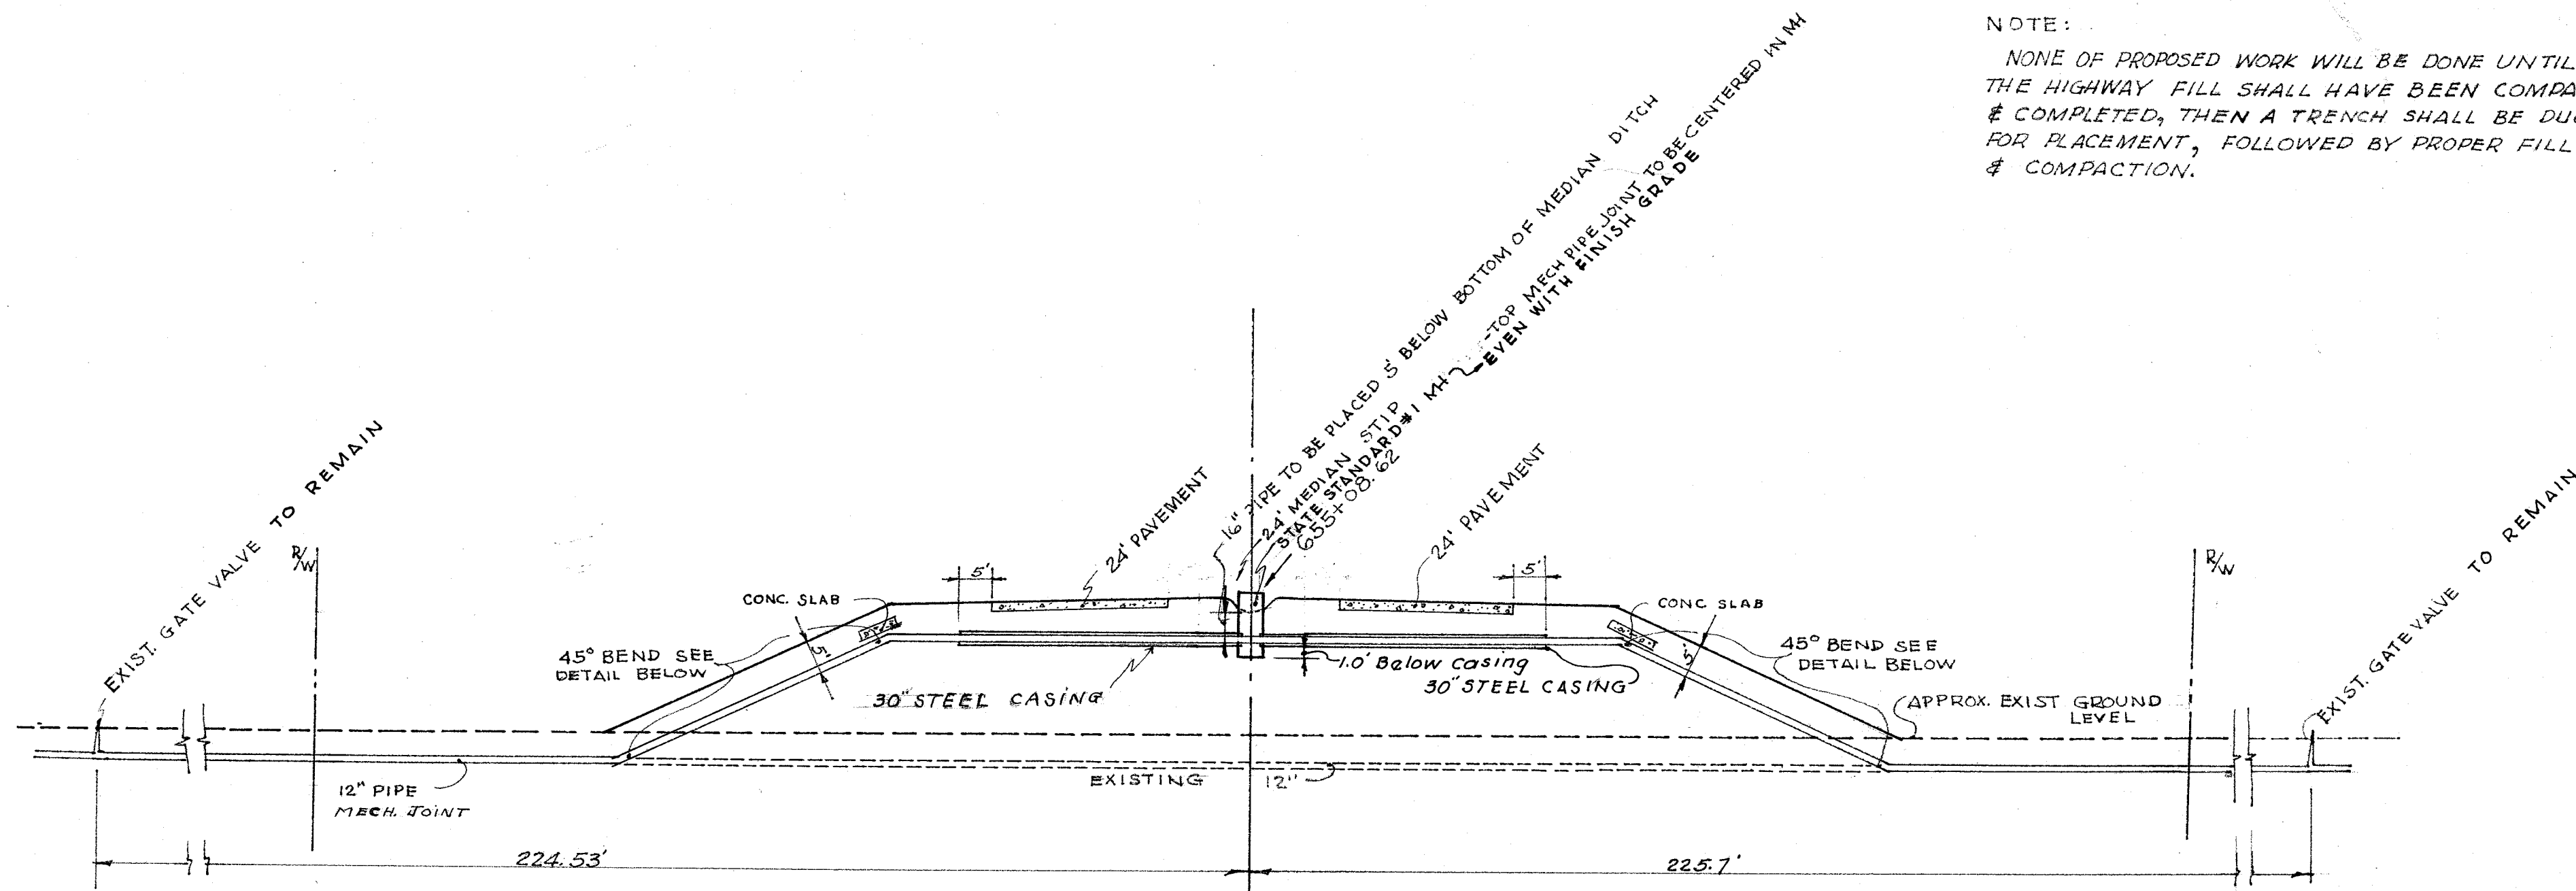

X-SECTION
WATER LINE CROSSING UNDER HIGHWAY

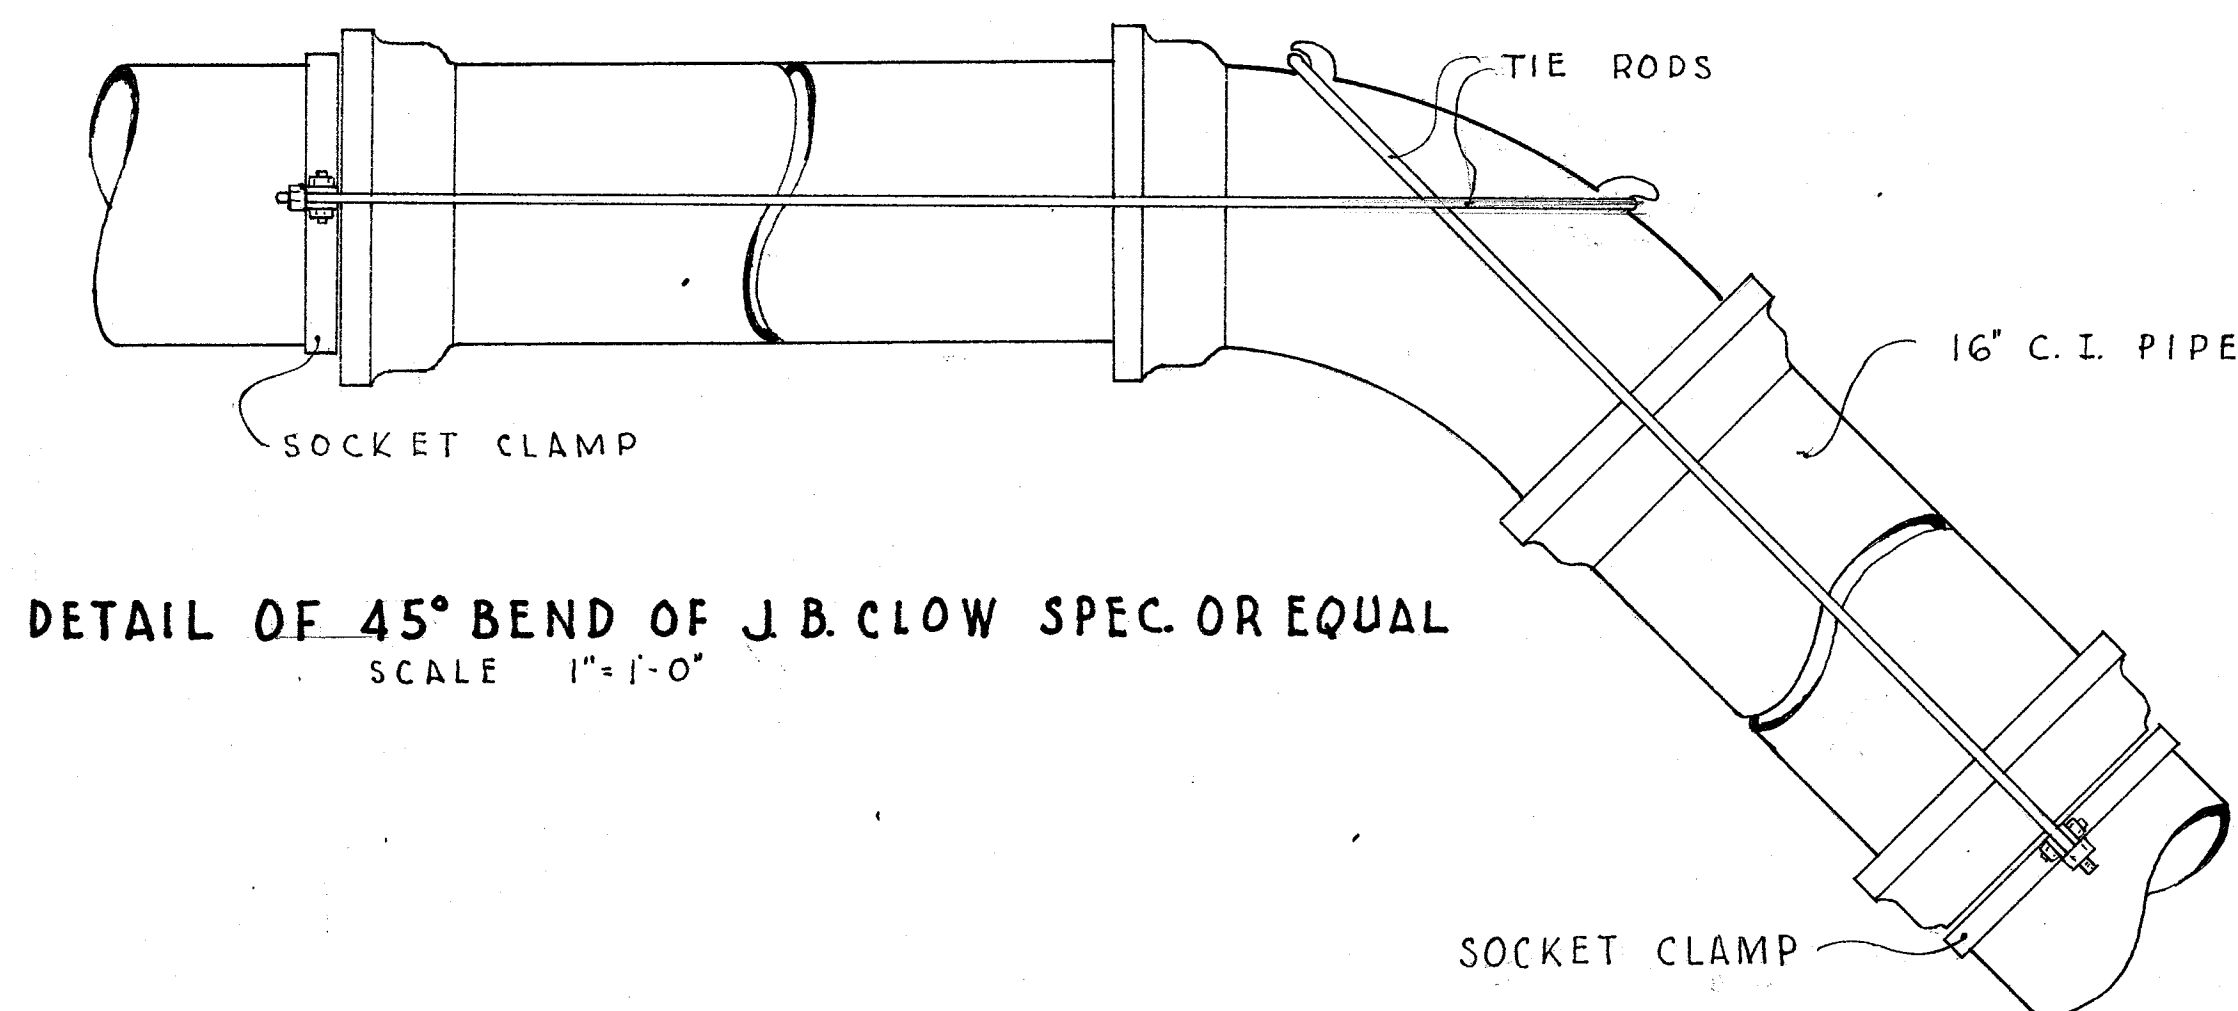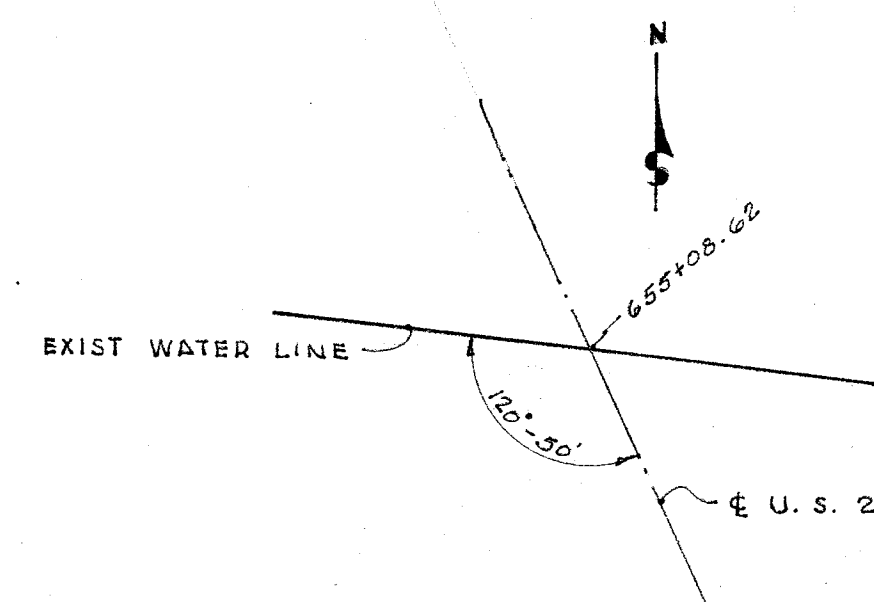

DETAIL OF 45° BEND OF J.B. CLOW SPEC. OR EQUAL
SCALE 1"=1'-0"

OHIO WATER SERVICE CO.
MASSILLON, OHIO
16" WATER LINE CROSSING @ STARK
U.S. 21-12.39 STA 655+08.62
SO. OF & 120°-50' WEST