

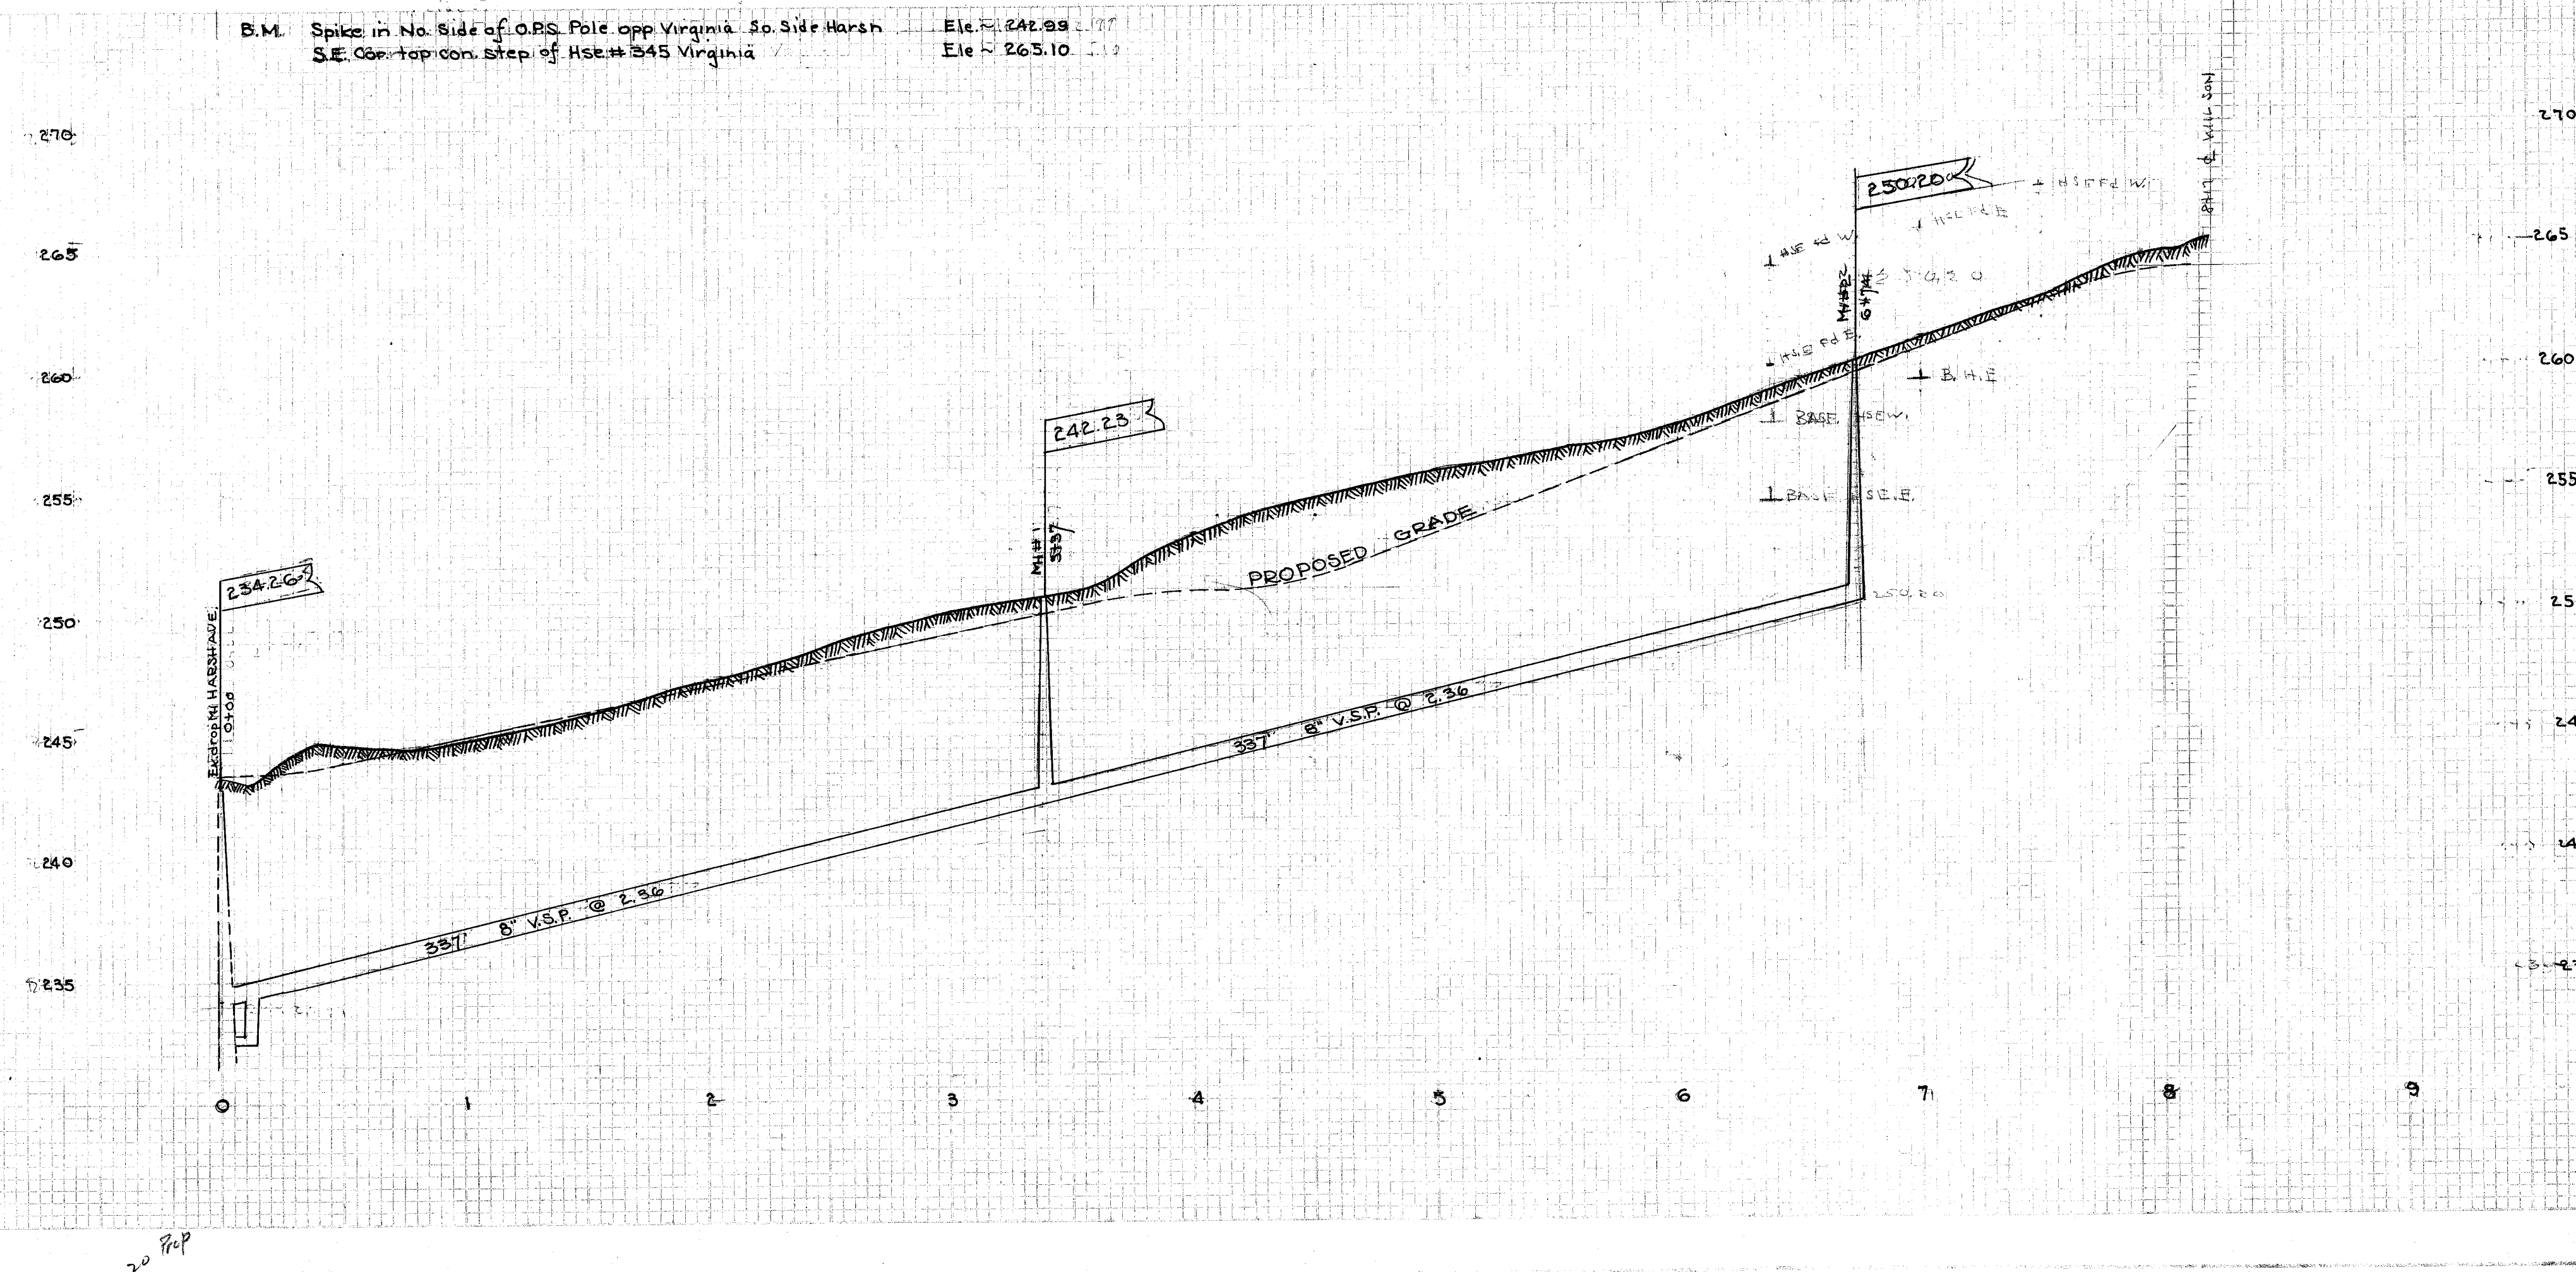


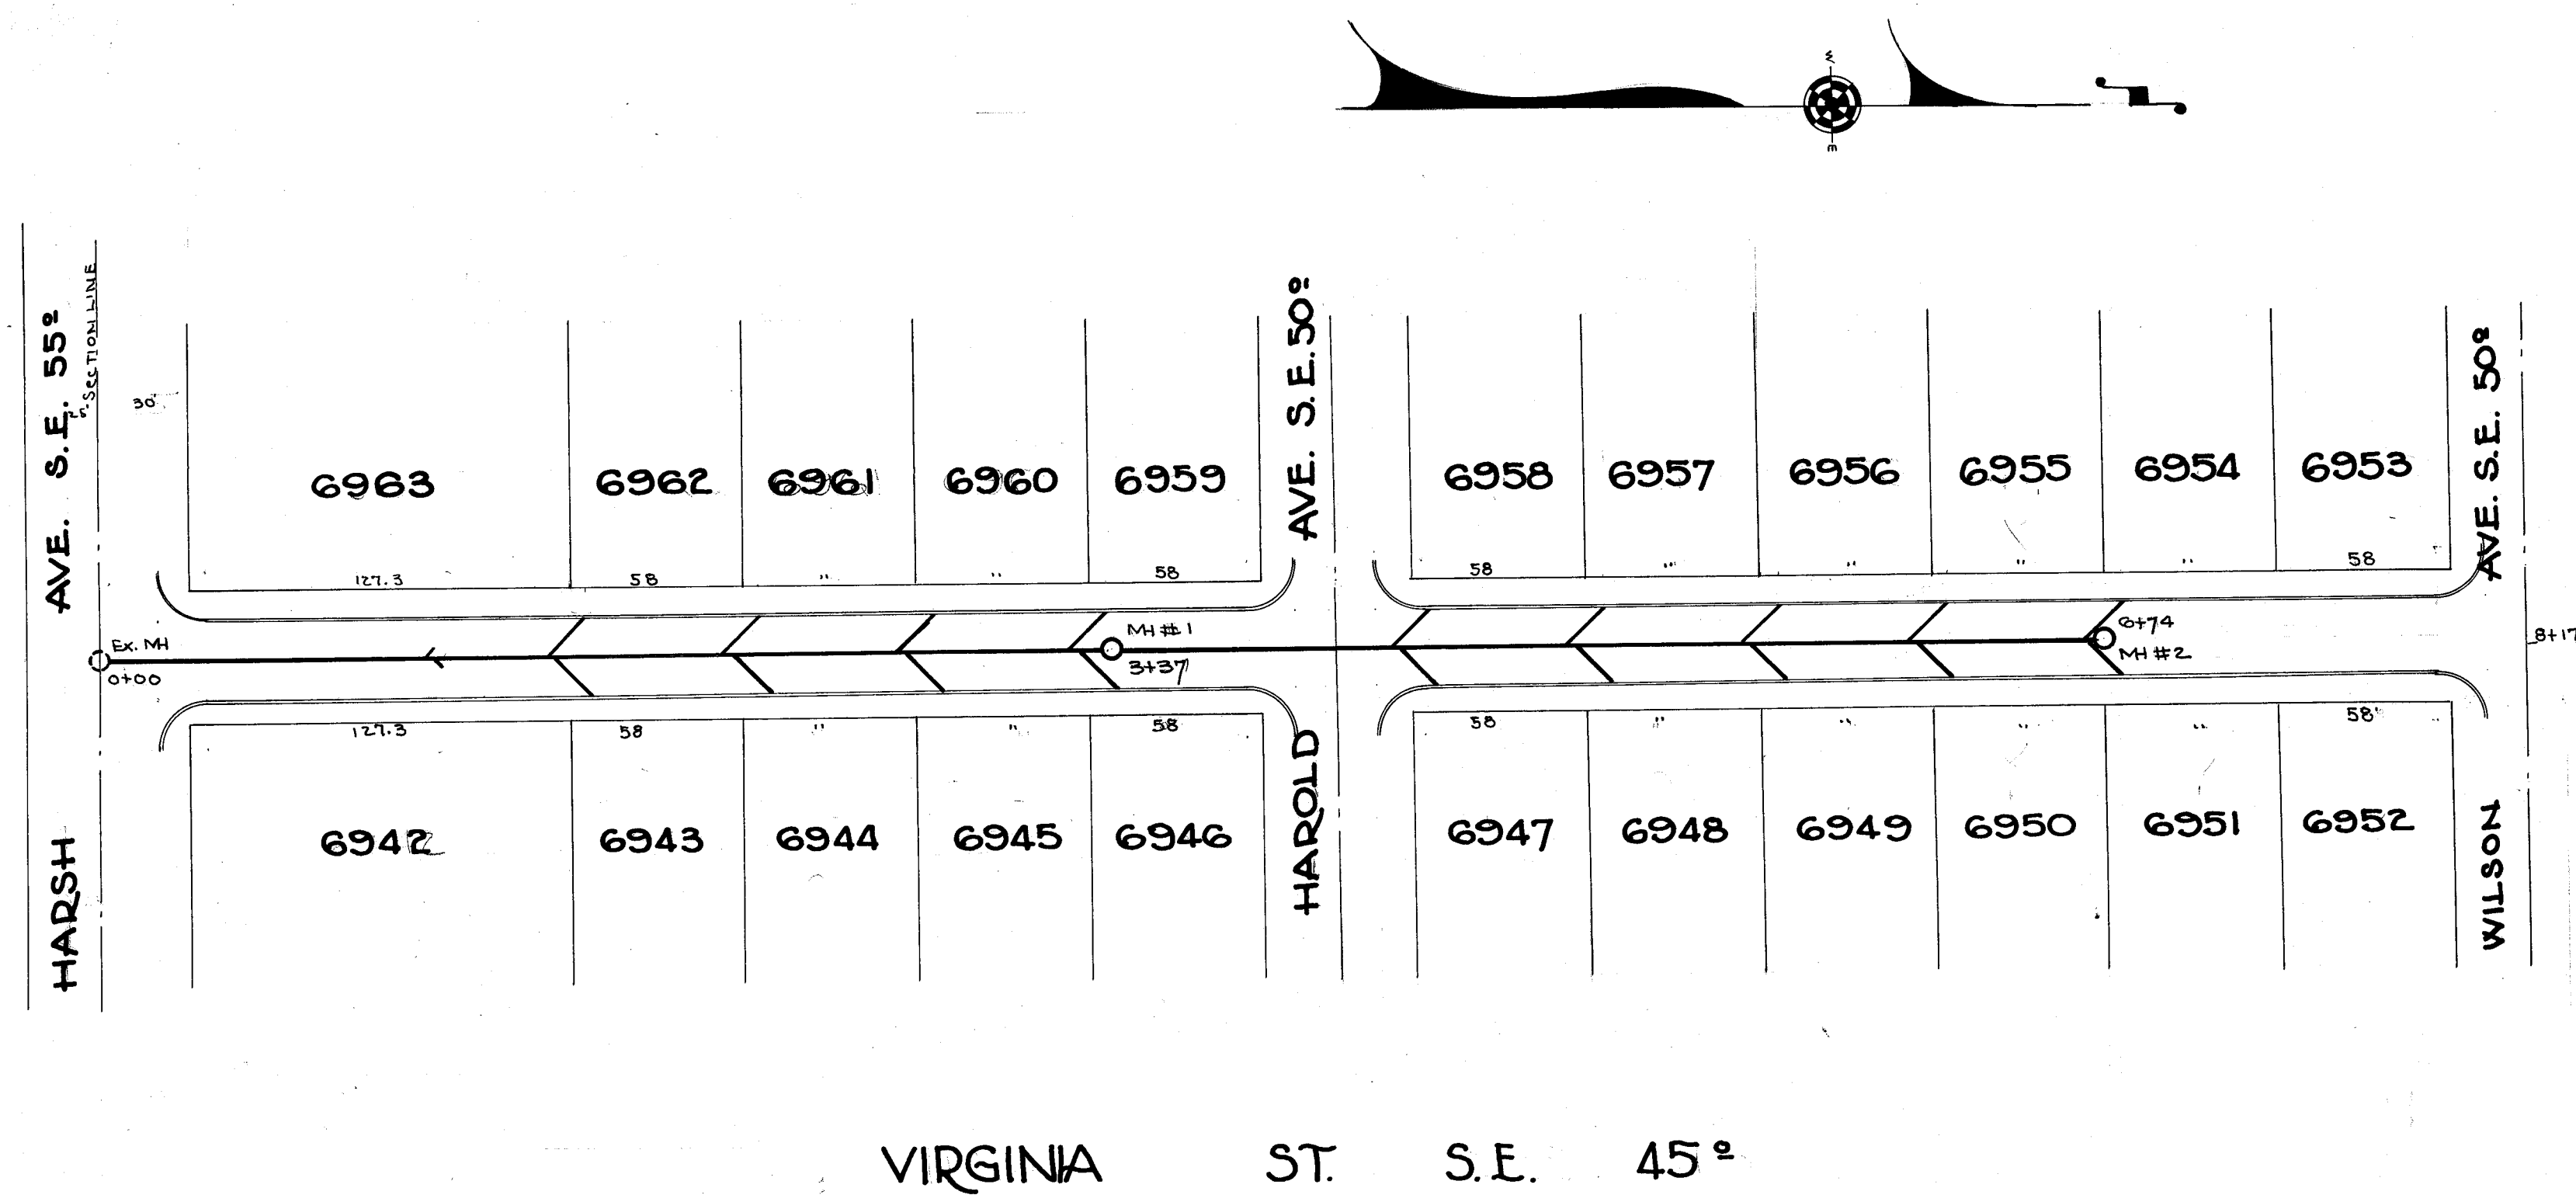

- Note:
1. All pipe to be class I; joints to be slipseal or equal.
 2. Manholes to be plastered on outside with $\frac{1}{2}$ " 1:2 mortar.
 3. Manholes to be constructed according to Massillon Standard practice.
 4. Trenches to be kept backfilled a maximum distance of 50' back of machine.
 5. Laterals (6") to be constructed to curb line.
 6. Trenches to be puddled where ordered by the Engineer.
 7. Contractor to be responsible for all damage to private property.
 8. All unused dirt to be removed from street by contractor.
 9. All work on streets & private land to be neatly returned as near as possible to its original condition under the inspectors supervision. Final acceptance by the city will be held up until this item is complied with.
 10. Top 12" of main & lateral ditches to be filled with Bank Run Gravel suitable to the Engineer (cost to be included in price per foot of 8" main or 6" laterals).

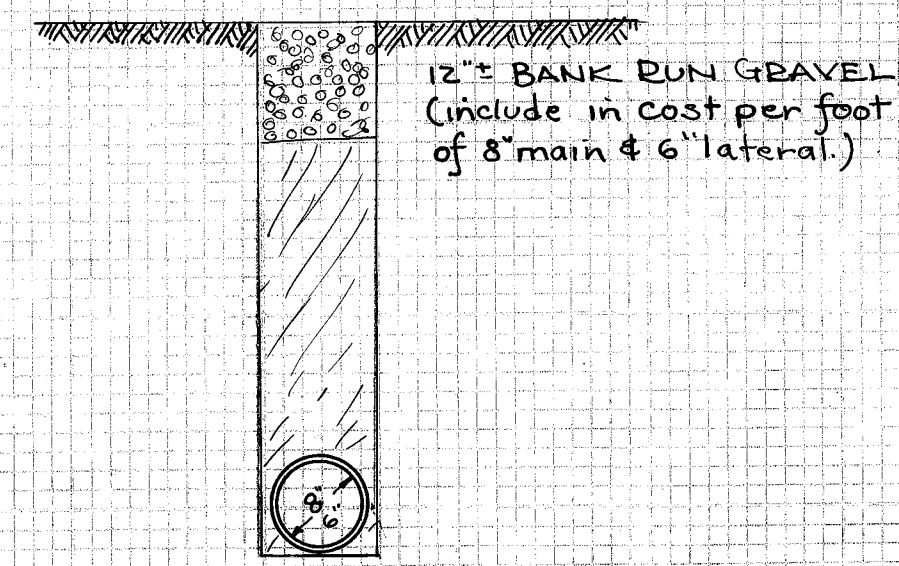

TYPICAL SECTION DITCH

CITY OF MASSILLON, OHIO			
VIRGINIA ST. S.E. 45°			
SANITARY SEWER			
HARSH AVE. S.E. TO WILSON AVE. S.E.			
Approved <i>W. Wagoner</i>	DEPT. OF PUBLIC SERVICE ENGINEERING DIVISION		
DR. BY: R. WAGONER	JUNE 23-1950	SCALE: 1"=50' HORIZ. 1"=5' VERT.	FILE NO. SE. 447
CK. BY:			ACC. NO. 1746