



NOTE:

- 1- All pipe to be class I: Joints to be slipseal or equal.
- 2- MH's to be plastered on outside with $\frac{1}{2}$ - 1:2 mortar.
- 3- MH's to be constructed according to Massillon Standard Practice.
- 4- Trenches to be kept backfilled a maximum distance of 50'.
- 5- Trenches to be puddled where ordered by the Engineer.
- 6- Maintenance of traffic to be held at a maximum at all times.
- 7- All unused dirt to be removed from the street by contractor.
- 8- Top 12" of Main & Lateral ditches to be filled with Bank Run Gravel suitable to the Engineer (Cost to be included in price per foot of 8" Main or 6" laterals)

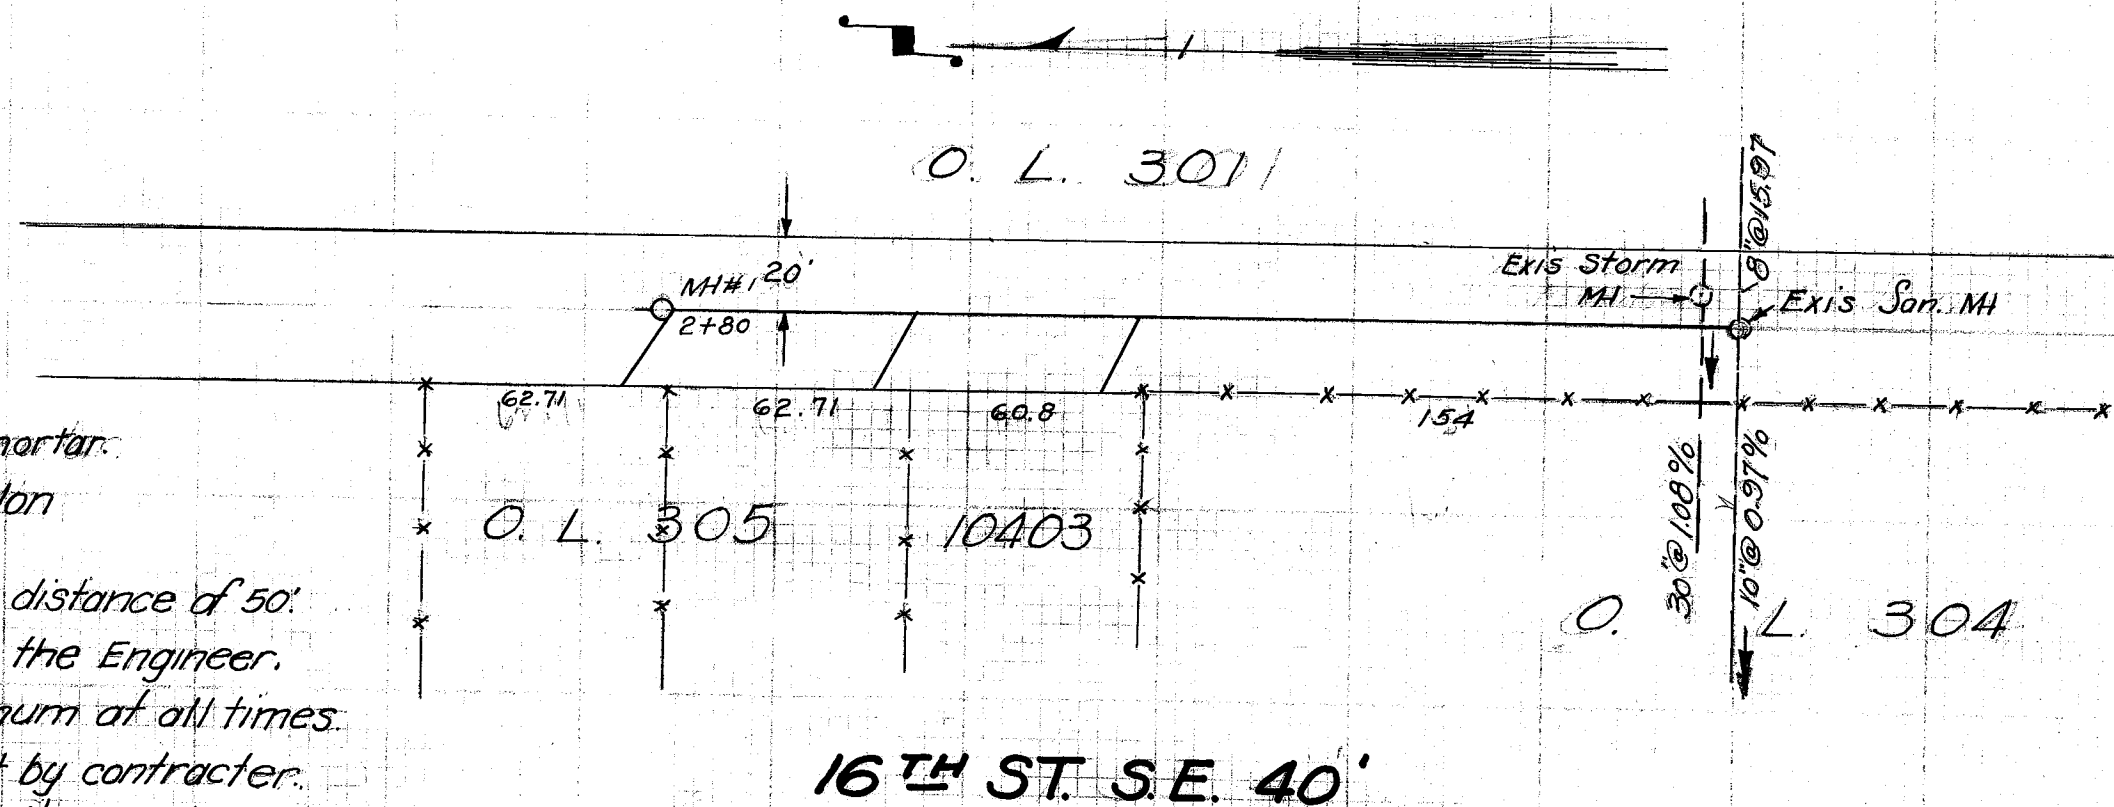

16TH ST. S.E. 40'

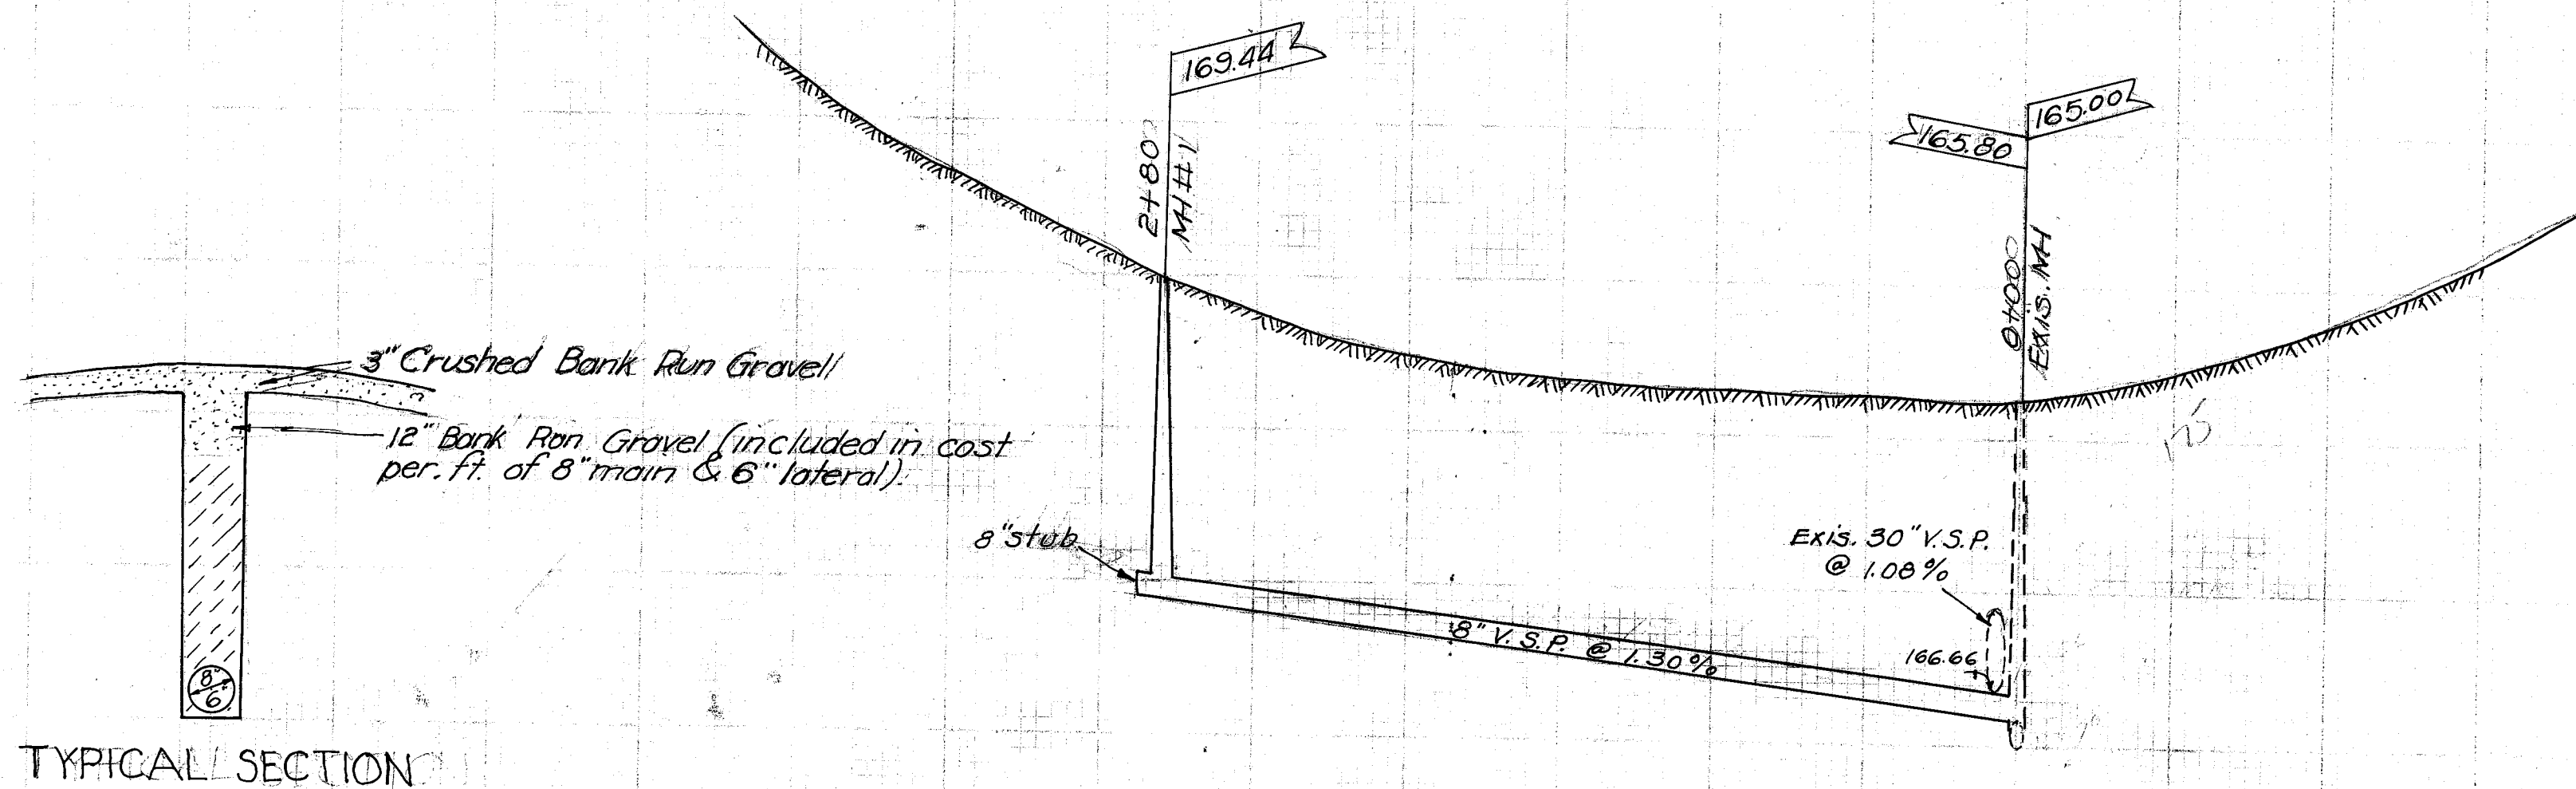

CITY OF MASSILLON, OHIO			
16 TH ST. S.E.			
SANITARY SEWER			
From existing MH, 280' North			
Approved	DEPT. OF PUBLIC SERVICE		
CITY ENGINEER	ENGINEERING DIVISION		
Dr. By R.W. HMP	Dec. 13, 1952	Scale 1"=50' Hor. N.B.	P.
ck By		1"=5' Ver.	
S.E. 451	ACC. NO 1816		