






NO.	DATE
BY	
REVISION	
NO.	DATE
BY	
REVISION	

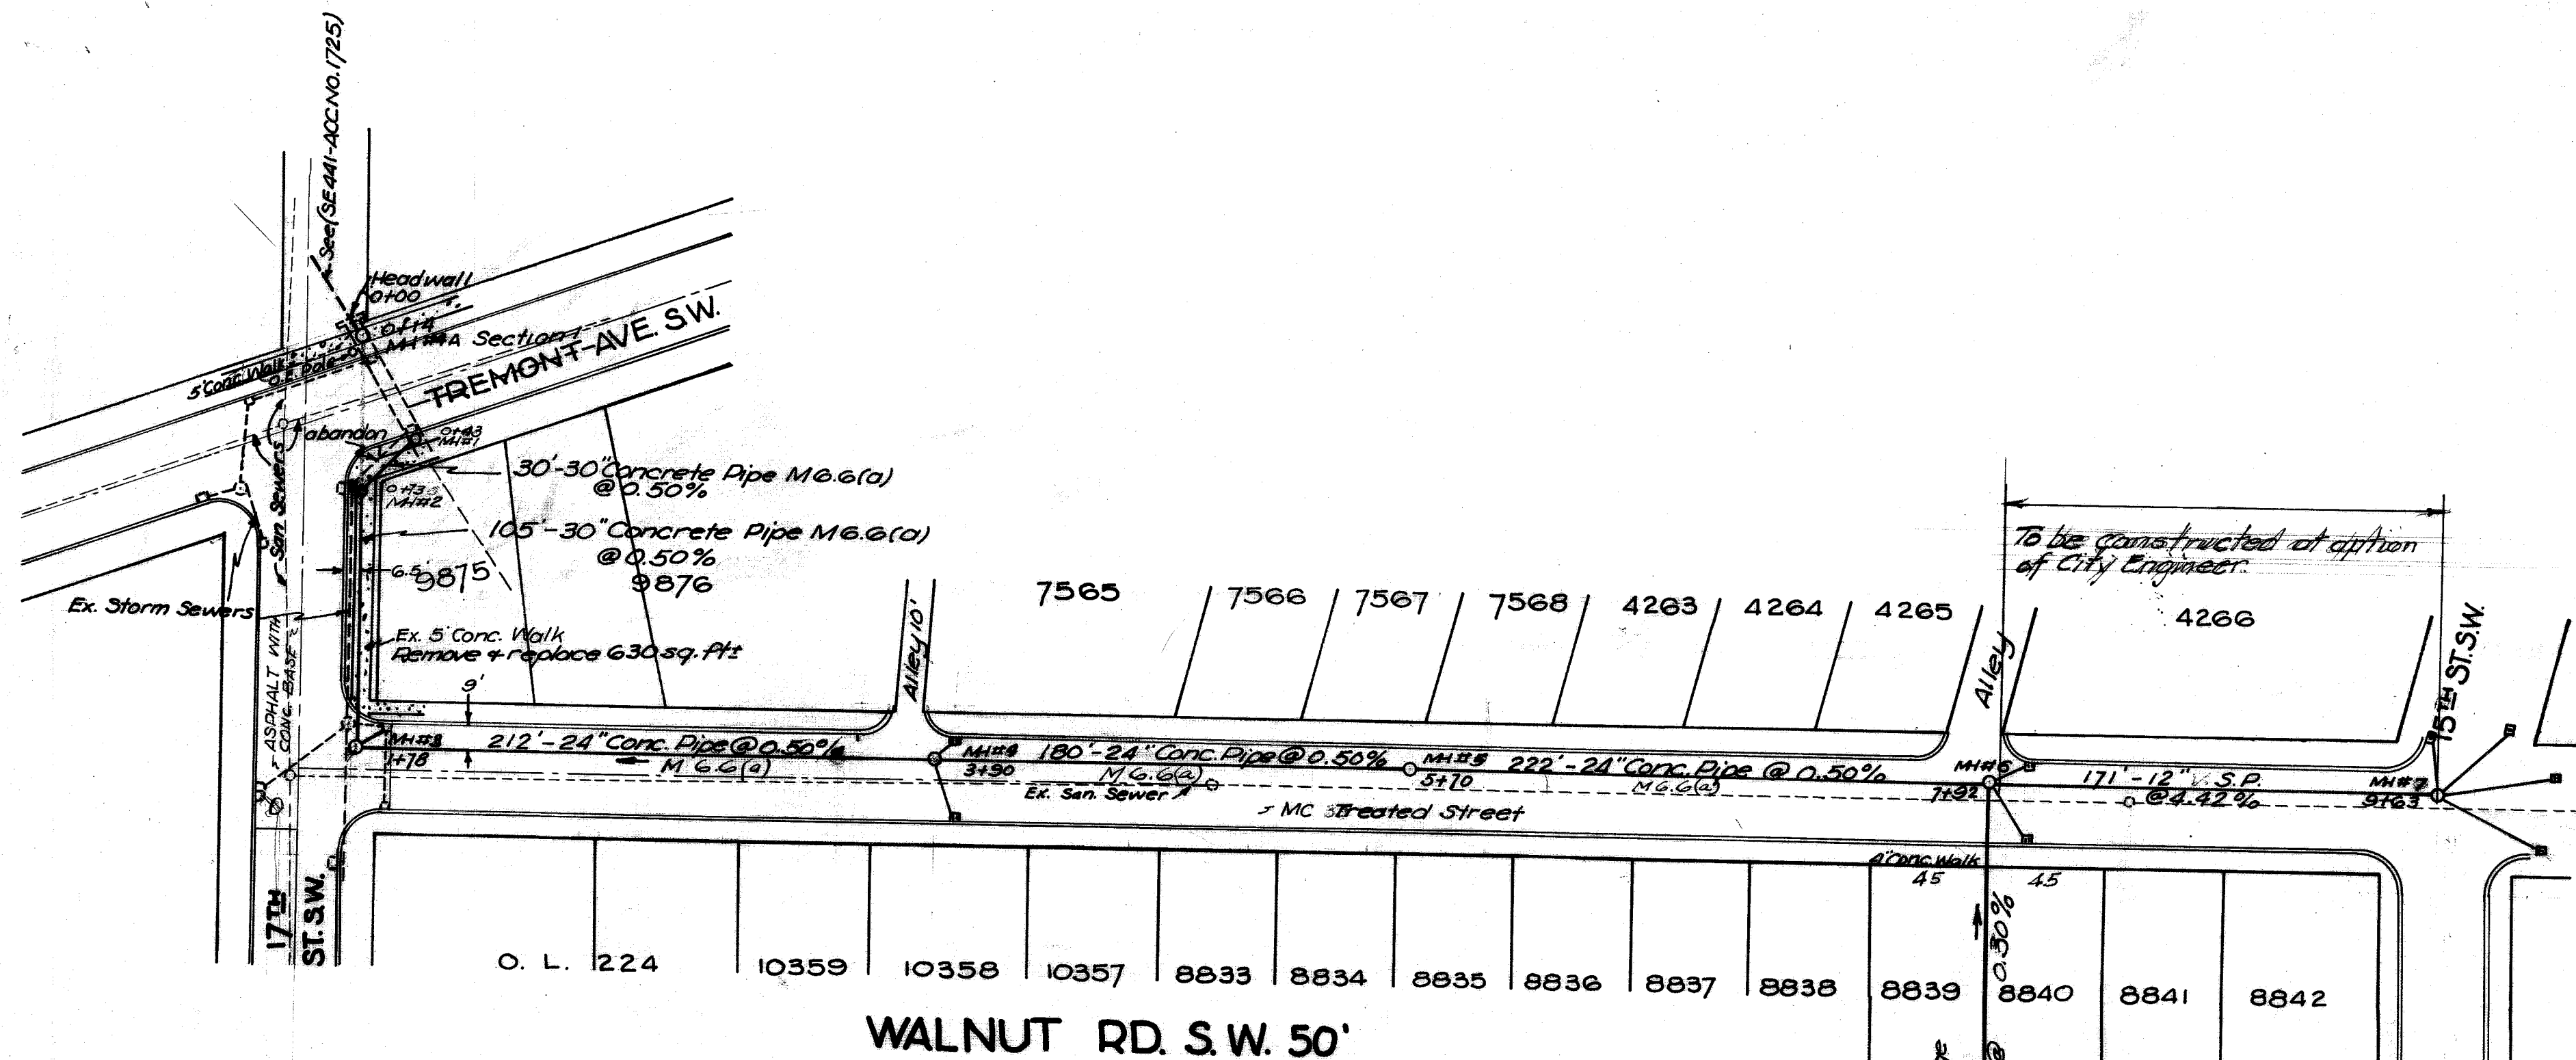

Sanitary Sewer laterals (6") extend to curb line on all lots and must be repaired by contractor if broken.

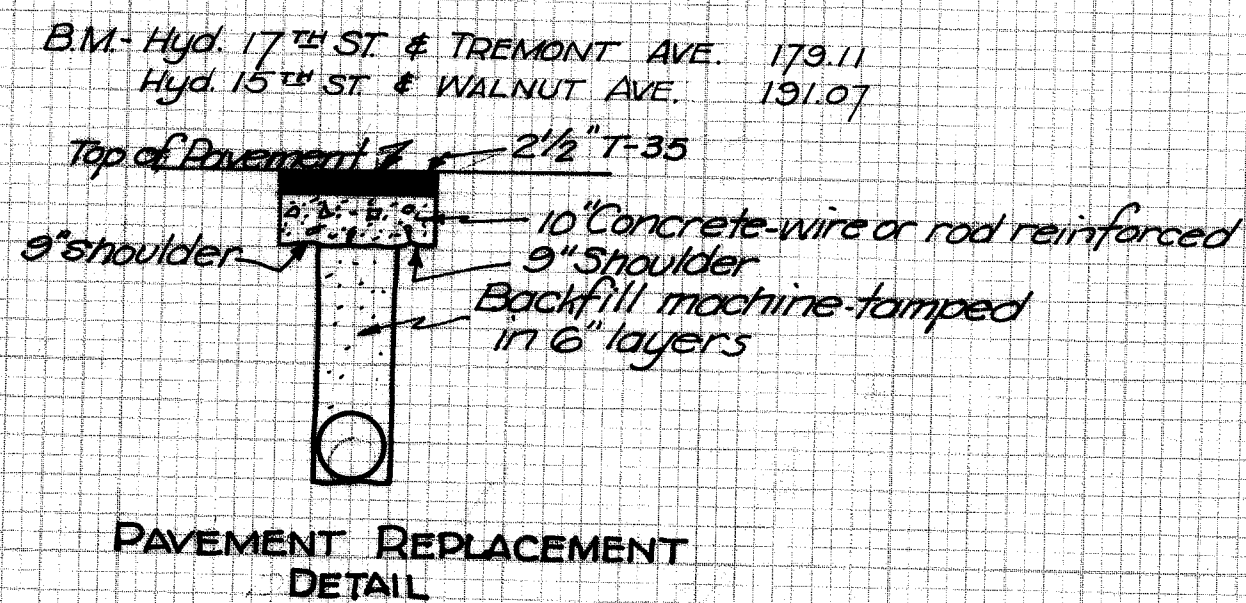

SECTION TWO

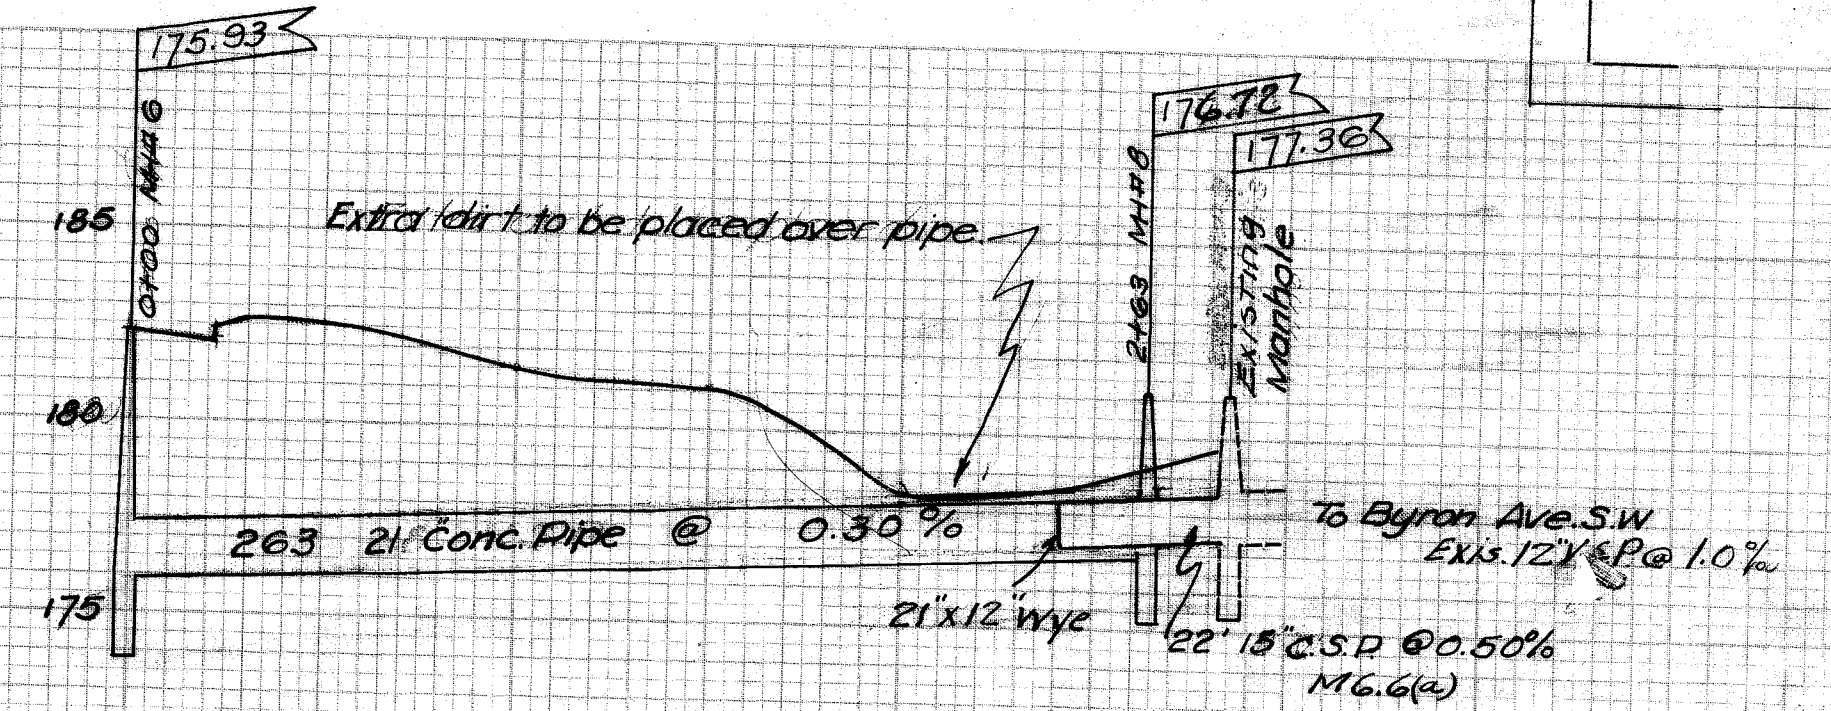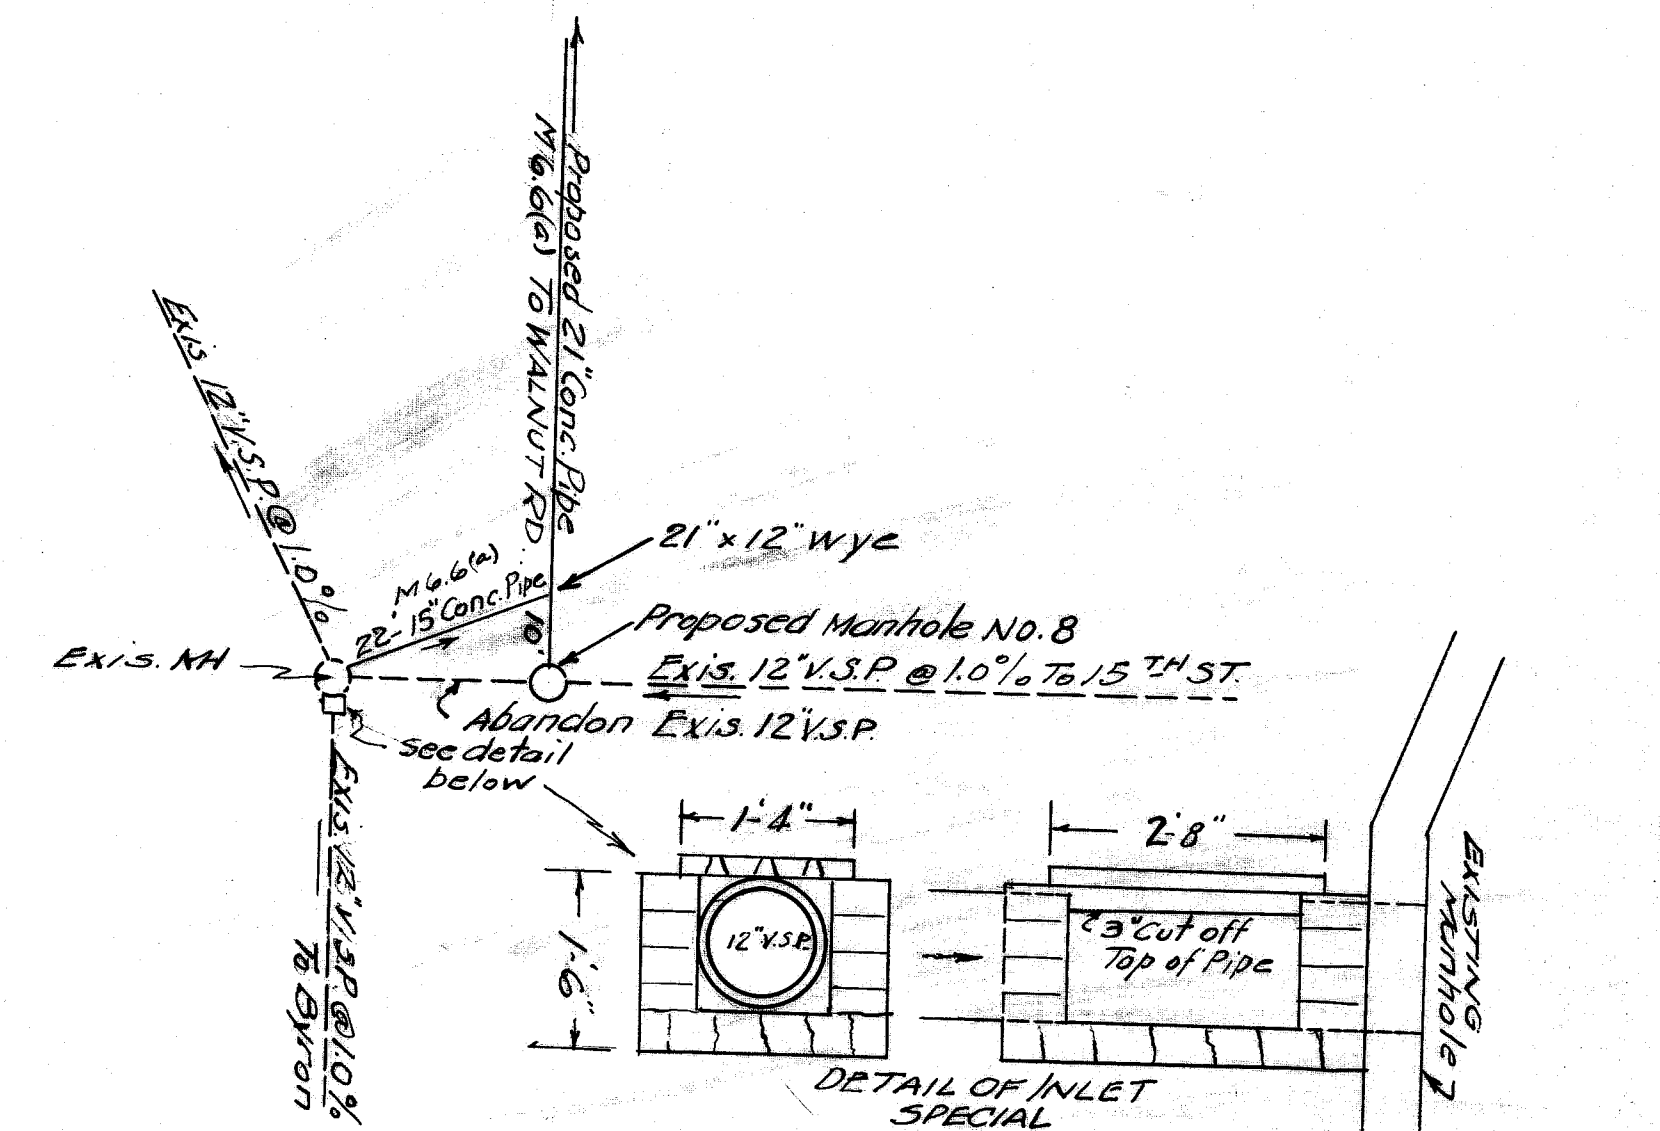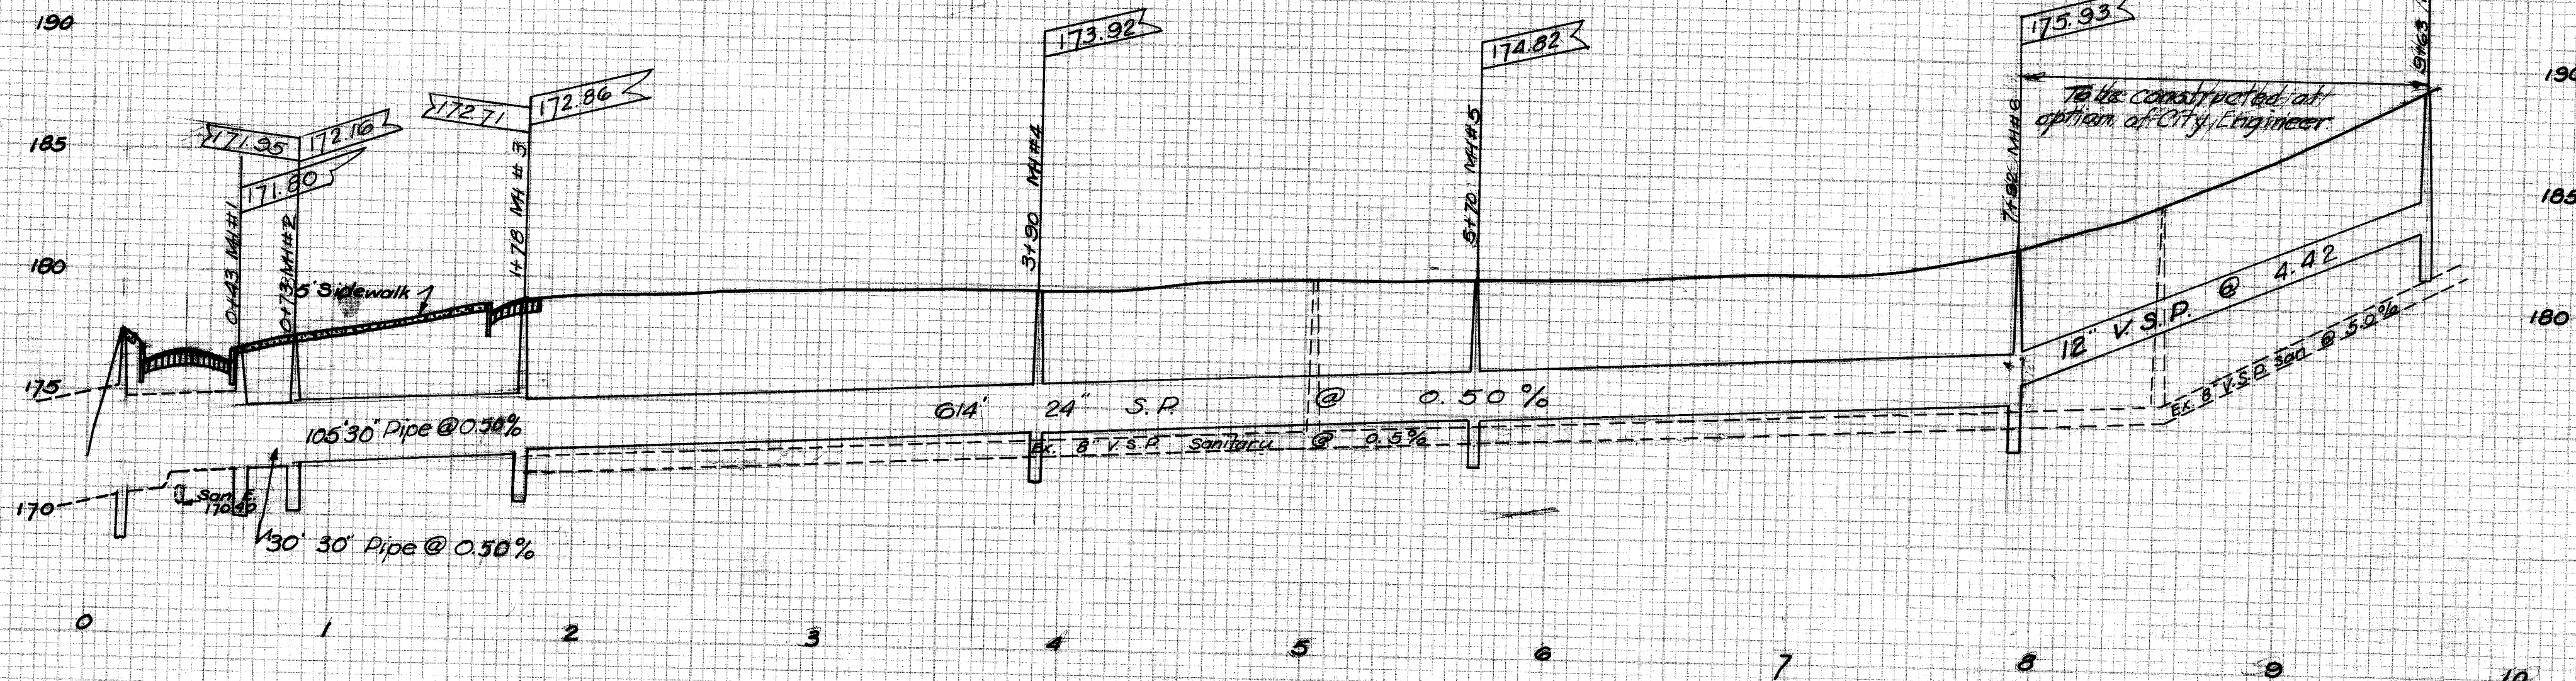

- NOTE:
- 1- All pipe to be Class I and meet state specifications as noted.
 - 2- Manhole castings to be Massillon Standard furnished by contractor, cost to be included in price per vertical foot of manhole.
 - 3- Catch Basin castings to be Massillon Standard Type B (32" x 32") furnished by contractor. Cost to be included in cost per basin.
 - 4- Manholes may be constructed with brick or concrete manhole block.
 - 5- Trench to be kept backfilled a maximum distance of 50' back of machine.
 - 6- Top 18" of all trenches to be filled with gravel. (cost to be included in bid per foot of main.)
 - 7- Trenches to be puddled to the satisfaction of the inspector and must be maintained by the contractor for a period of one year or until oiled by City.
 - 8- Clean-up of project to meet approval of Inspector before final acceptance by City.
 - 9- Joints to be 1:2 mortar or approved asphaltic. Joints to be used with mortar on bell and spigot type.

CITY OF MASSILLON, OHIO	
WALNUT RD. S.W. 50'	
STORM SEWER	
17 TH ST. - 15 TH ST. S.W.	
Approved: <i>N.M. Row</i>	CITY ENGINEER
Dr. by <i>R. W. Rogers</i>	DEPT. OF PUBLIC SERVICE - ENGINEERING DIVISION
Ch. by <i>H. W. Dyer</i>	JUNE 1954
Scale: 1" = 50' Hor. 1" = 5' Ver.	FILE NO. S.E. 458 ACC. NO. 1866