



ORIGINAL	SURVEYED	BY	DATE
SURVEY	PLOTTED		
NOTE BOOK	TEMPLATE		
AREAS	AREAS		
NO.	AREAS CHECKED		

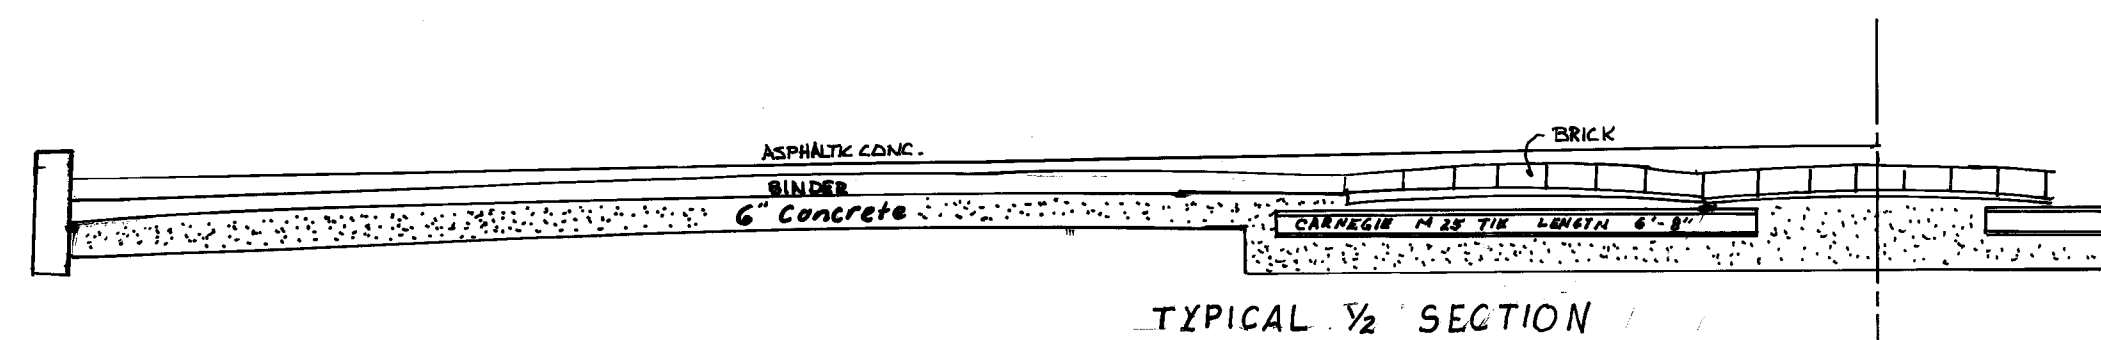

- ### GENERAL NOTES
- * All construction to be City of Massillon specifications and standards, and the latest edition of the State of Ohio, Department of Transportation, Construction and Material Specifications.
 - * A preconstruction meeting shall be held with the contractor, subcontractors, City Engineer, Safety & Service Director, and the E.E.O. Director.
 - * The E.E.O. Director shall receive the required weekly and monthly reports on this project.
 - * When conflicts arise over the interpretation of notes and details in the drawings, the drawings take preference over general provisions and specifications that appear in the contracts.
 - * The contractor is responsible for having all the utilities marked by their respected companies.
 - * Concrete castings are to be placed as directed by the Inspector.
 - * Manholes and catch basins are to be plastered on outside with 1/2"- 1:2 mortar.
 - * All ditches are to be compacted as directed in the latest edition of the State of Ohio, Department of Transportation, Construction and Material Specifications, so as not to settle.
 - * Trenches are to be backfilled no less than 50 feet from the trenching machine.
 - * All work on street and private land is to be neatly returned as near as possible to its original condition under the inspectors supervision. Final acceptance by the City will be held up until this item is complied with.
 - * The Contractor is to be responsible for any damage on property outside the Right of Way.
 - * The traffic is to be maintained as to minimize the confusion. The traffic detail sheet shows only the minimal acceptable traffic control devices.
 - * The contractor is responsible for the placement of all traffic control devices as to insure the safety of the workers and the general public.
 - * The cut in the existing pavement shall be extended 24" around the entire perimeter to subbase level to provide a shoulder on which the concrete slab base shall rest. This base shall be of 1:2:4, 6 bag mix. Portland cement concrete using high early strength cement and it must be cured at least forty-eight hours. The pad must be reinforced with No. 6 wire mesh. 1.5" of 402 shall be placed followed by a lift of 404 with a thickness of 1.5". All edges of the patch must be sealed with a roller and 705 Hot Applied Crack and Joint Sealer.

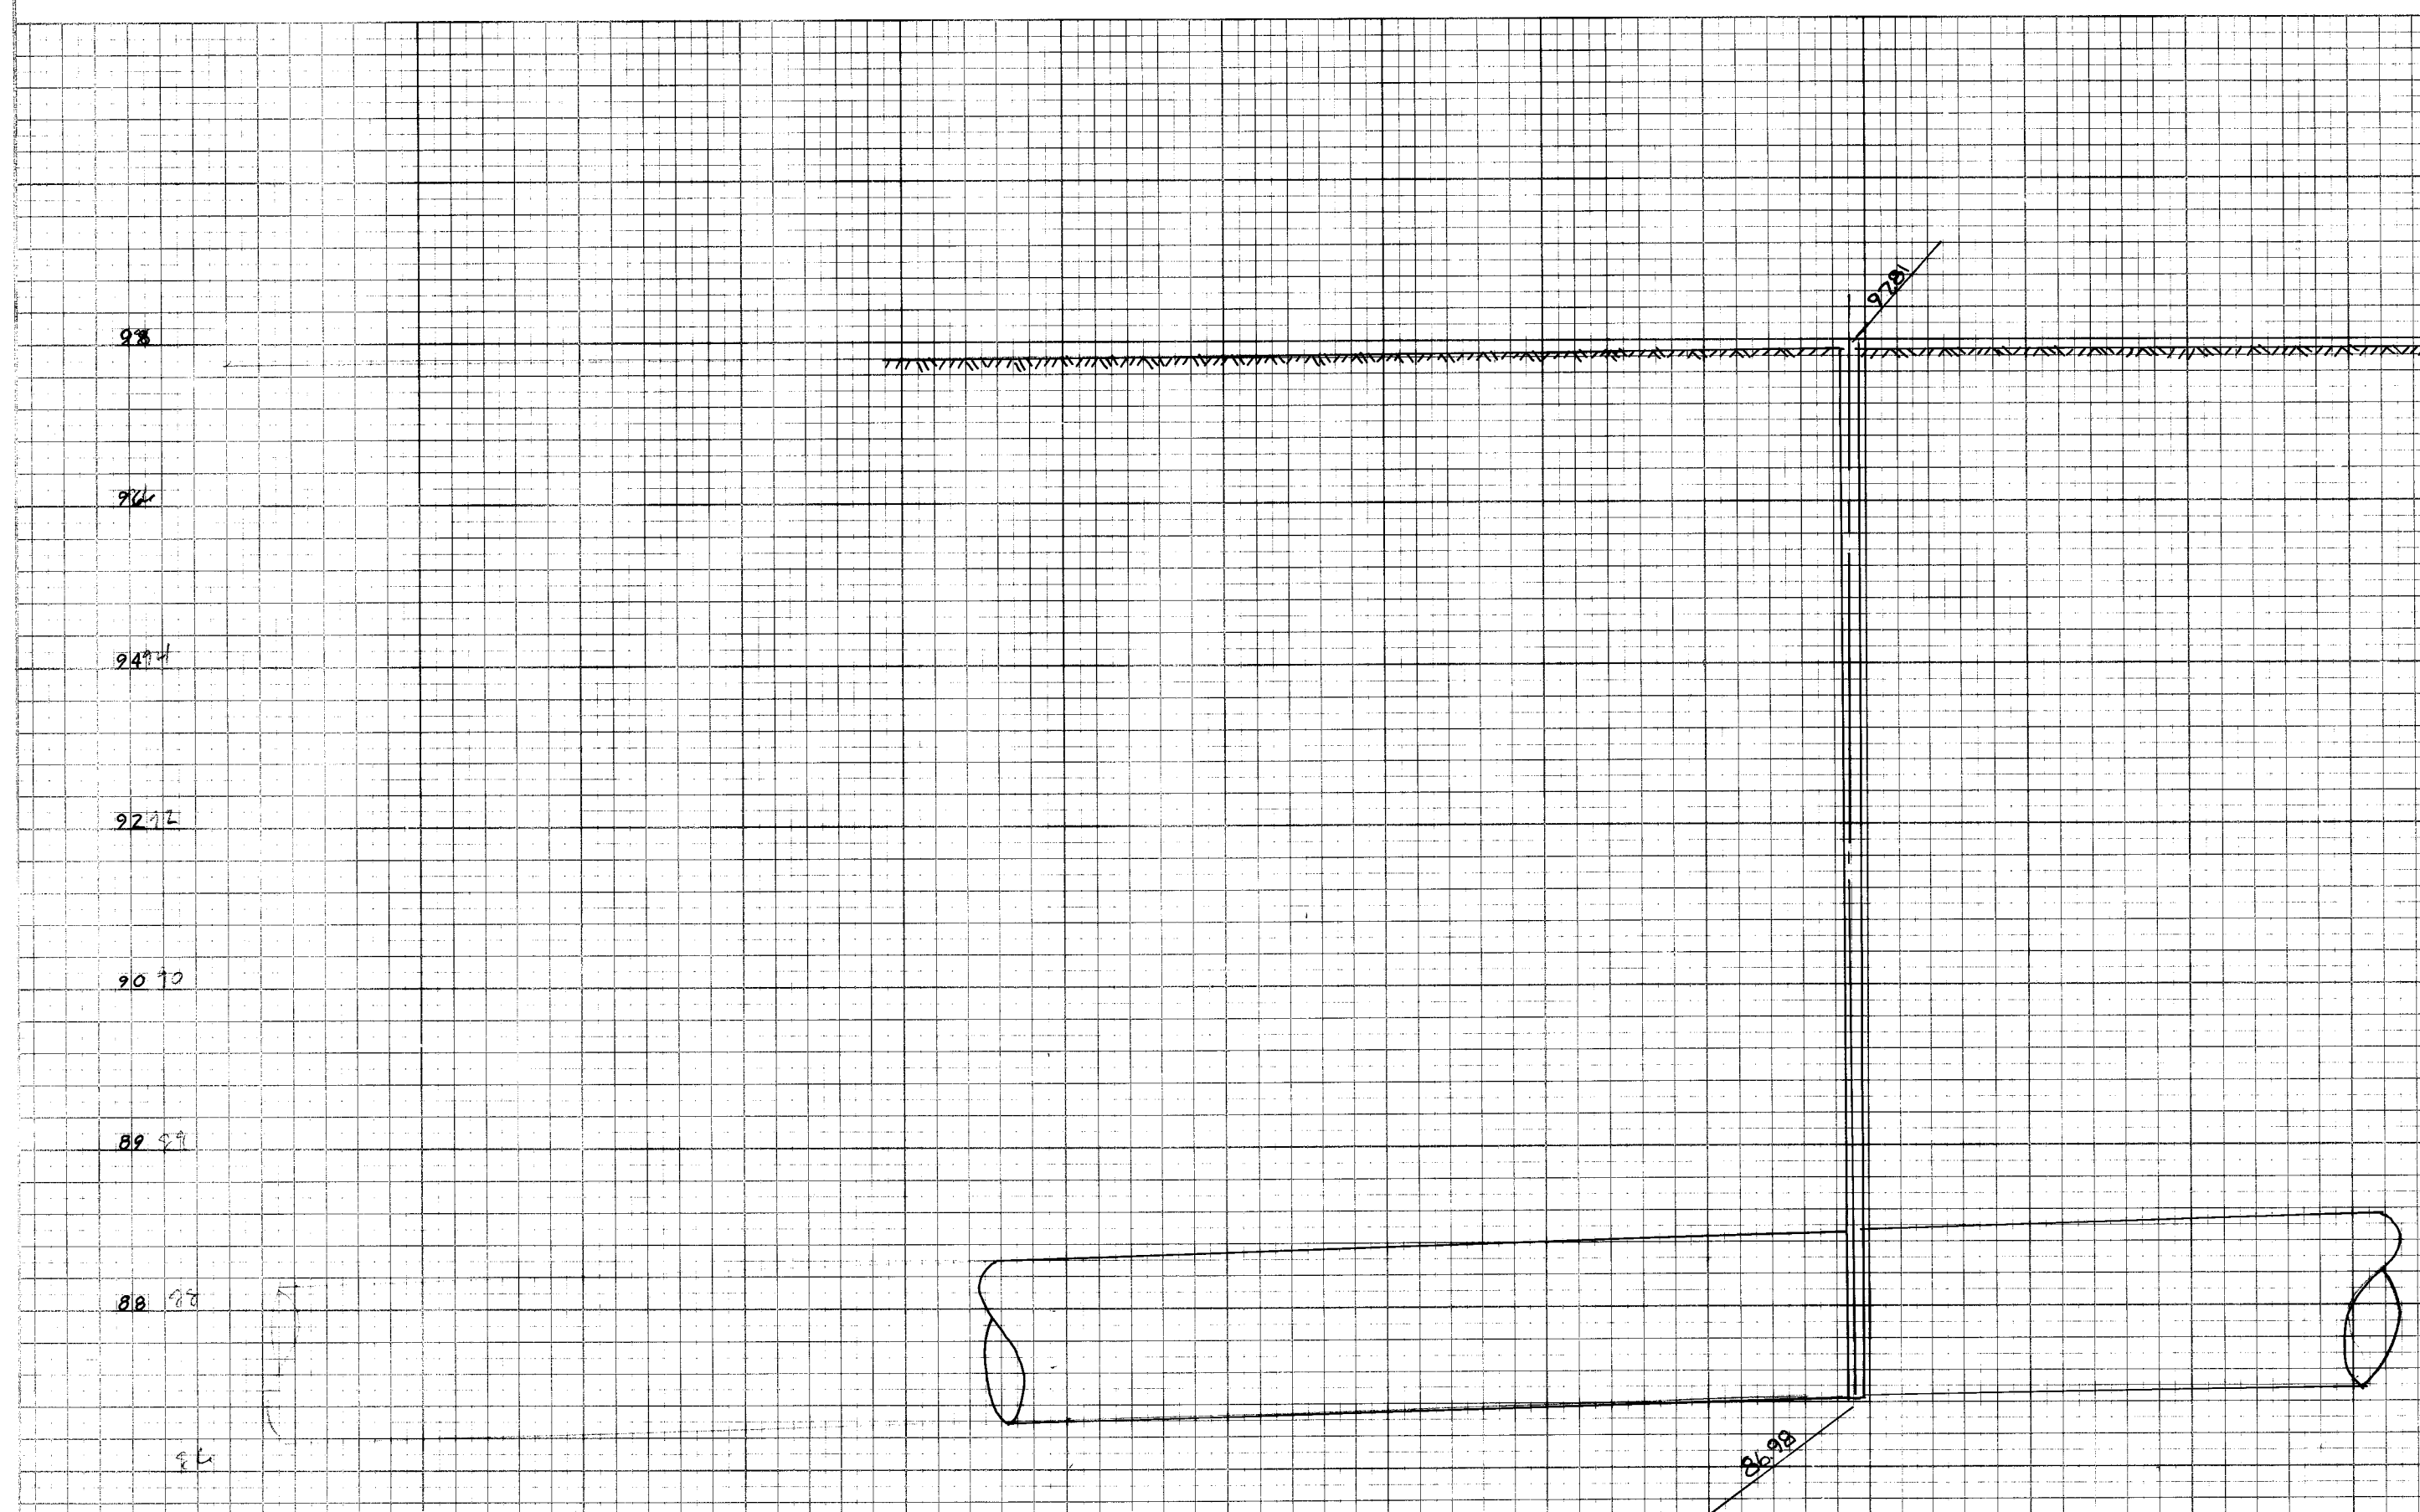

CITY OF MASSILLON, OHIO	
LINCOLN WAY & ERIE ST.	
SANITARY SEWER REHAB	
CITY ENGINEER	
R. WAGONER	
DRAWN BY:	SCALE 1" = 20'
S. HAMIT	DATE 4-6-94
FILE NO.	SE - 618 ACC. NO. 3224

