

Project Information

Surveyor Name	Matthew W. Adams	Certificate Number	00000000
Owner		Customer	City of Massillon
Drainage Area		PO Number	
Pipe Segment		Date	11/6/2019 14:30
Reference		City	Massillon
Street	Jamestown		
Comments			

Manhole

Upstream MH	Pump Siphon #31	Rim to Invert (U)	
Grade to Invert (U)		Rim to Grade (U)	
Downstream MH	Pump Pipe Inlet #31	Rim to Invert (D)	
Grade to Invert (D)		Rim to Grade (D)	
Sewer Use	Stormwater Pipe	Direction of Survey	Upstream

Pipe

Height (Diameter)	(30)	Width	
Shape	Circular	Material	Ductile Iron Pipe
Lining Method	None	Pipe Joint Length	
Total Length		Length Surveyed	52.9
Year Laid		Year Renewed	

Misc

Flow Control		Media Label	DVD
Purpose		Sewer Category	
Pre-Cleaning	No Pre-Cleaning	Date Cleaned	
Weather		Location Code	
Additional Info		Location Details	

Custom

Number of Taps	0	Number of Roots	0
Num Cracks / Fractures	0	Number of Broken / Holes / Collapse	0
Number of Deposits	0	Custom6	
Custom7		Struct Grade	
OM Grade		Overall Grade	

Pacp 6

Reverse Setup ID		Sheet (Group) Number	
Imperial Units (US)	True	Pressure Value	
Work Order		Project	
		Completed	No

Project:

Date: 11/6/2019 2:30:00 PM

Street: Jamestown

Length Surveyed: 52.9

Pacp Quick Overall Rating: 4135

Height (Diameter): (30)

Street: Jamestown

Pipe Segment Reference:

Upstream MH: Pump Siphon #31

Downstream MH: Pump Pipe Inlet #31

Direction of Survey: Upstream

Material: Ductile Iron Pipe

Distance	Fault Observation	Picture
0.0	Special Chamber Remarks: Jamestown Pump Siphon #3	
0.0	Water Level	
0.0	Surface Other Position: 12 To 12 Joint Remarks: coating peeling back	
4.7	Surface Corrosion Metal Pipe Position: 5 To 7 Joint	
31.9	Surface Corrosion Metal Pipe Position: 4 To 8 Joint	

Distance	Fault Observation	Picture
34.7	General Observation Remarks: unable to proceed past this point due to lack of access on inlet end of pipe, camera stuck at change of grade	
41.1	Miscellaneous General Observation Remarks: resuming inspection at previous stopping point	
41.3	Surface Damage Corrosion Position: 12 To 12 Joint Remarks: heaviest corrosion is from 4-8 O'clock	
42.6	Surface Damage Corrosion Position: 5 To 7 Remarks: heavy corrosion	
48.5	Joint Separated Large	
48.5	Surface Damage Corrosion Position: 12 To 12 Joint	

Distance	Fault Observation	Picture
52.9	Access Point Other Remarks: Pump Pipe #31 Inlet	 MH Pump Pip 11/14/2019 TO MH Pump Pip 16:40 Access Point Other Pump Pipe #31 Inlet 52.8 FT

Created with the  report generator

Project:

Date: 11/6/2019 2:30:00 PM

Street: Jamestown

Length Surveyed: 52.9

Pacp Quick Overall Rating: 4135

Height (Diameter): (30)

Street: Jamestown

Pipe Segment Reference:


Upstream MH: Pump Siphon #31

Downstream MH: Pump Pipe Inlet #31

Direction of Survey: Upstream

Material: Ductile Iron Pipe

Severity
Light
Moderate
Average
Heavy
Severe

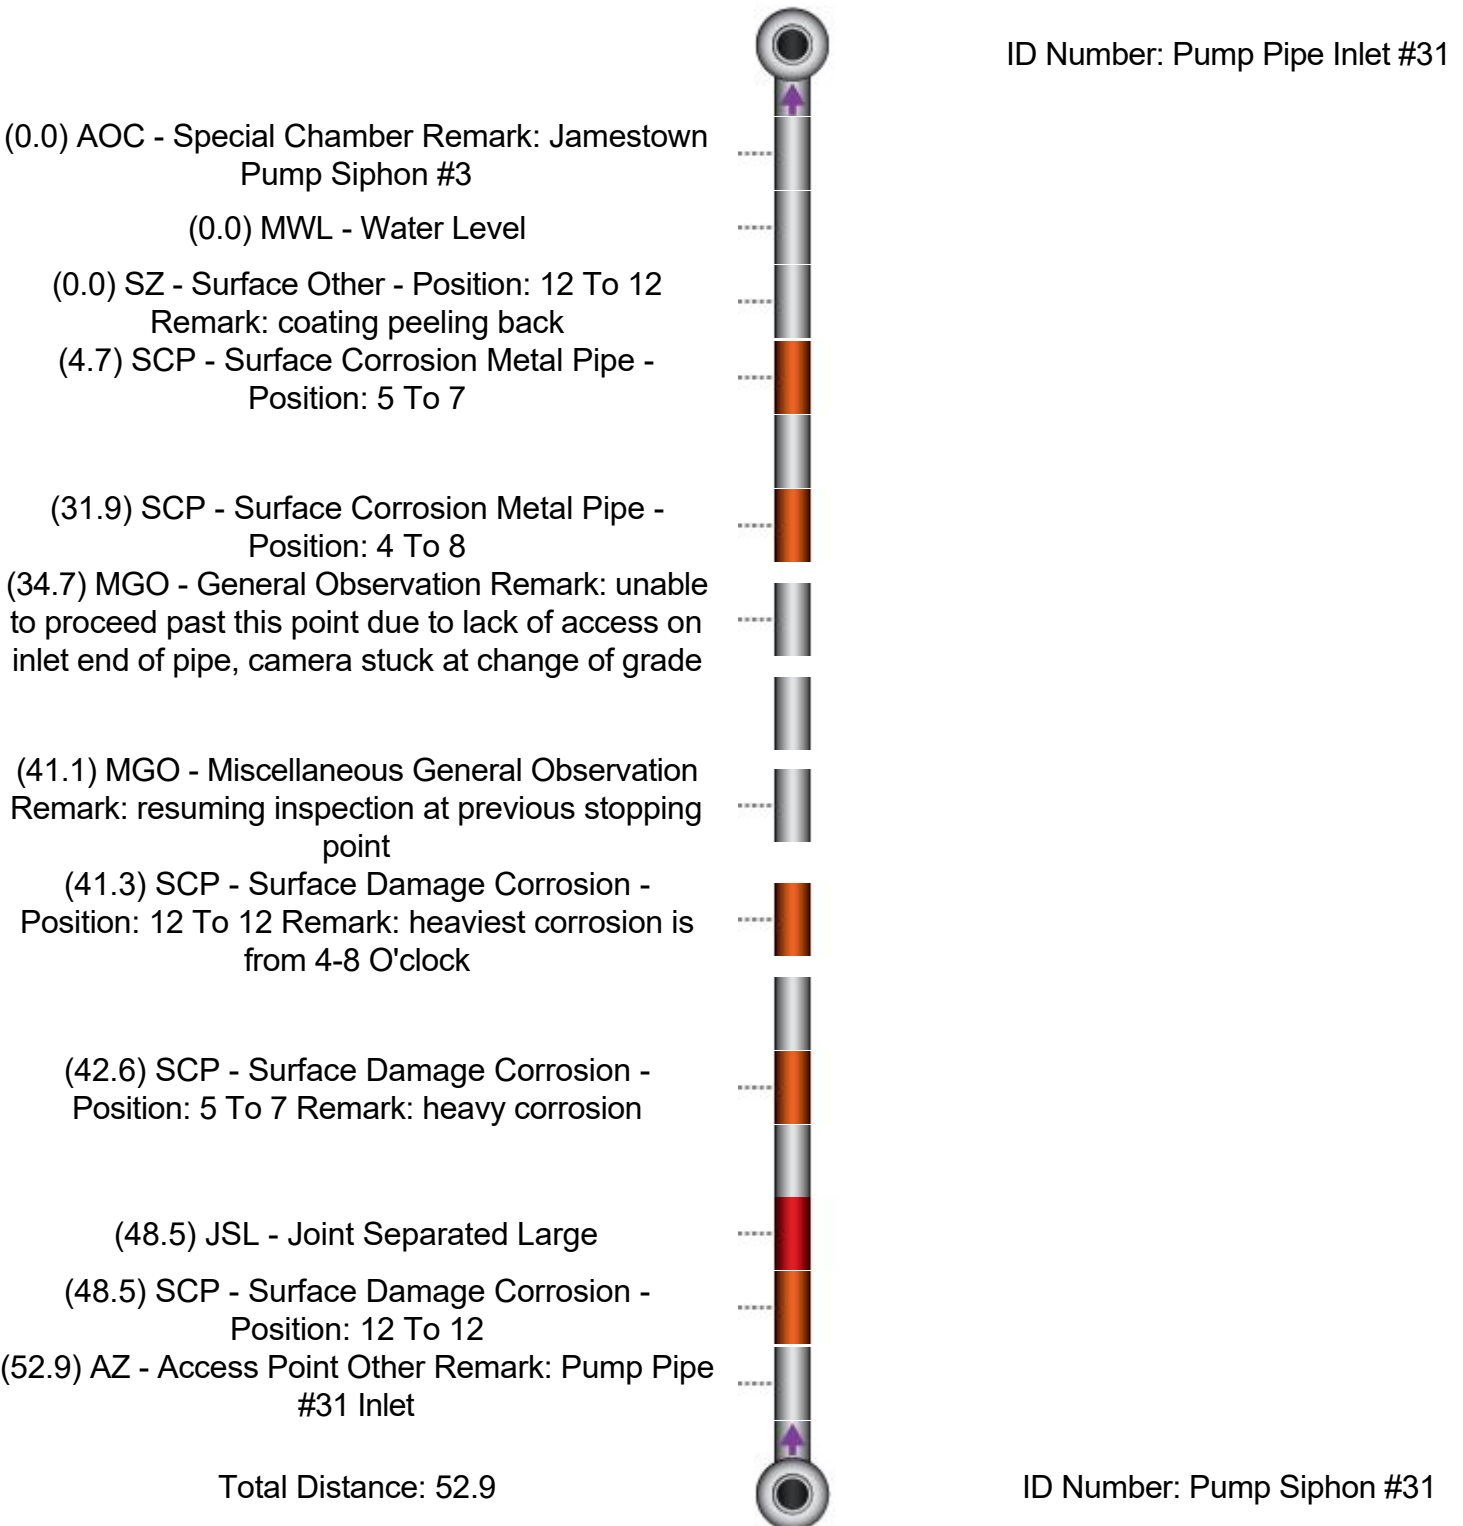

Videos Created for Session

_Pump Siphon 3-Pump Pipe Inlet 3_1162019-1431_U_14538.mp4 Size: 305 MB

Your browser does not support the video tag.

_Pump Siphon 31-Pump Pipe Inlet 31_12192019-1406_U_32760.mp4 Size: 175 MB

Your browser does not support the video tag.

Created with the  report generator