

DEVILLE 21 LINCOLN WAY

IMPROVEMENT PLANS

CITY OF MASSILLON
COUNTY OF STARK
STATE OF OHIO

SANITARY, STORM SEWERS, WATER & PAVING


JUNE, 2015

DESIGN ENGINEER:

GBC DESIGN, INC.
565 White Pond Drive Akron, OH 44320
Phone 330-896-0228 Fax 330-896-5782

DEVELOPER:

21 LINCOLN WAY PROJECT LLC
SUITE 301
3951 CONVENIENCE CIRCLE N.W.
CANTON, OH 44718
PHONE: 330-493-9131
REP.: PATRICK SIRPILLA

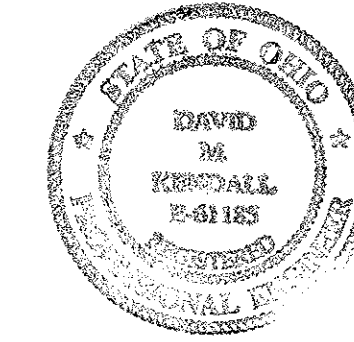

SUBMITTED BY: D.M. Kendall
D. MICHAEL KENDALL Reg. Engineer No. 61185

DATE: 8-26-2015


ENGINEERING APPROVALS

APPROVED BY THE MASSILLON CITY ENGINEER THIS 3RD DAY OF DECEMBER, 2015.

K.A.T.
KEITH A. DYLEWSKI, P.E., P.S.
CITY ENGINEER

ONLY APPROVED SIGNED PLANS BY THE CITY
ENGINEER ARE TO BE USED FOR CONSTRUCTION

LEGEND			
MONUMENTS			
●	5/8" CAPPED REBAR TO BE SET, (GBC DESIGN, INC.)		
○	IRON PIN FOUND (TYPE & SIZE AS INDICATED)		
■	MONUMENT ASSEMBLY TO BE SET		
□	MONUMENT FOUND		
★	1" REBAR TO BE SET		
☆	1" REBAR FOUND		
■	DRILL HOLE SET		
■	DRILL HOLE FOUND		
▲	P.K. NAIL SET		
▲	P.K. NAIL FOUND		
ABBREVIATIONS			
EX.	EXISTING	TELE.	TELEPHONE
PROP.	PROPOSED	CBL.	CABLE
FND.	FOUND	BLDG.	BUILDING
MEAS.	MEASURED	F.F.	FINISHED FLOOR
REC.	RECORD	CONC.	CONCRETE
STM.	STORM	ASPH.	ASPHALT
SAN.	SANITARY	M.H.	MANHOLE
W.M.	WATER MAIN	C.B.	CATCH BASIN
F.W.	FIRE WATER	H.W.	HEADWALL
D.W.	DOMESTIC WATER	INV.	INVERT
DOM.	DOMESTIC WATER	WIN.	WINDOW
F.D.C.	FIRE DEPT. CONN.	R.D.	ROOF DRAIN
ELEC.	ELECTRIC	C.O.	CLEAN OUT
O.H.W.	OVERHEAD WIRE		
P/L	PROPERTY LINE	R/W	RIGHT OF WAY
C.L.	CENTER LINE	EASE.	EASEMENT
STA.	STATION	LT.	LEFT
RT.	RIGHT	SHT.	SHEET
No.	NUMBER	T/W	TOP OF WALL
B/W	BOTTOM OF WALL		
SYMBOLS			
○	PROPOSED FIRE HYDRANT	●	PROPOSED MANHOLE
○	EXISTING FIRE HYDRANT	○	EXISTING MANHOLE
■	FIRE DEPARTMENT CONNECTION	■	PROPOSED CATCH BASIN
■	PROPOSED VALVE	□	EXISTING CATCH BASIN
■	EXISTING VALVE	■	PROPOSED CURB INLET
○	PROPOSED LIGHT POLE	□	EXISTING CURB INLET
○	EXISTING LIGHT POLE	▲	PROPOSED SIGN
○	PROPOSED POWER POLE	○	EXISTING SIGN
○	EXISTING POWER POLE		
LINETYPES			
---	PROPOSED CABLE LINE	---	PROPOSED SANITARY SEWER
---	EXISTING CABLE LINE	---	PROPOSED SANITARY LATERAL
---	PROPOSED ELECTRIC LINE	---	PROPOSED FORCE MAIN
---	EXISTING ELECTRIC LINE	---	EXISTING SANITARY SEWER
---	PROPOSED TELEPHONE LINE	---	EXISTING SANITARY LATERAL
---	EXISTING TELEPHONE LINE	---	EXISTING FORCE MAIN
---	PROPOSED GAS LINE	---	PROPOSED STORM SEWER
---	EXISTING GAS LINE	---	PROPOSED ROOF DRAIN
---	PROPOSED WATER MAIN	---	EXISTING STORM SEWER
---	PROPOSED WATER SERVICE	---	EXISTING ROOF DRAIN
---	PROPOSED DOMESTIC SVC.	---	PROPOSED FENCE
---	PROPOSED FIRE WATER SVC.	---	EXISTING FENCE
---	EXISTING WATER MAIN		
---	EXISTING WATER SERVICE		

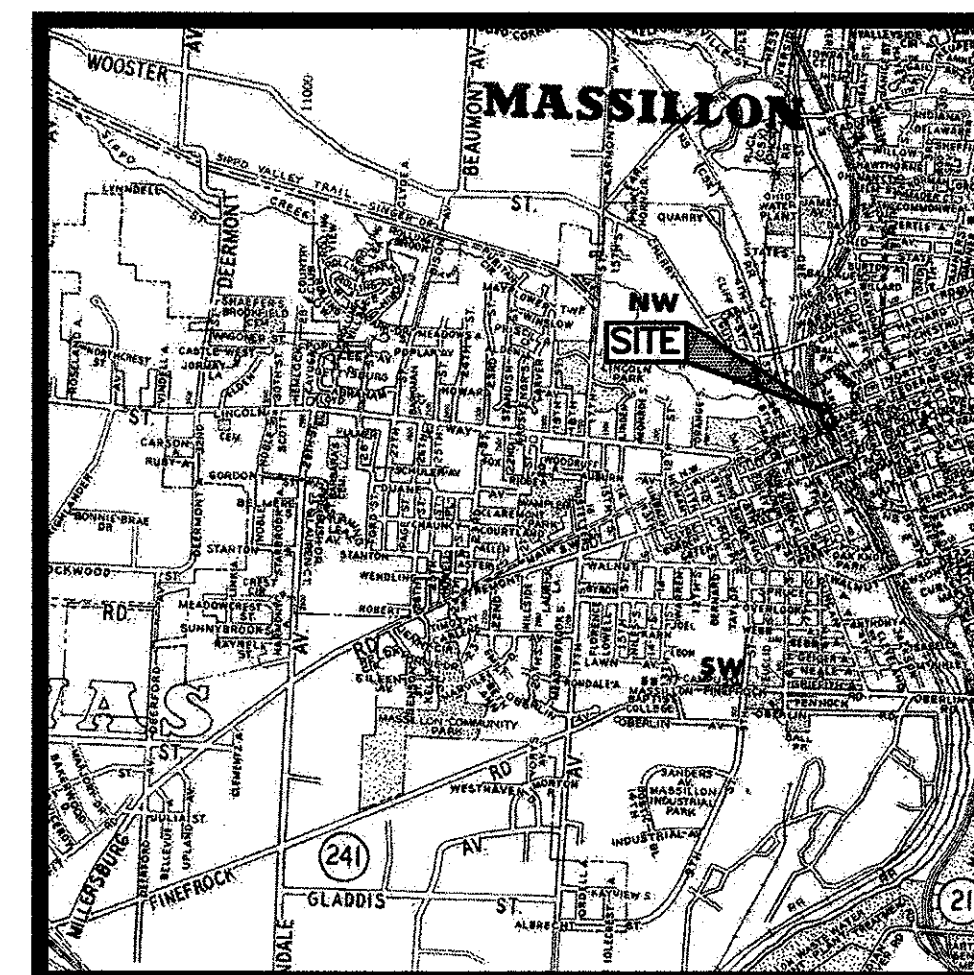

LOCATION MAP

SCALE: 1" = 3000'



Know what's below.
Call before you dig.

TITLE
TITLE SHEET
GENERAL NOTES
DEMOLITION PLAN
SITE PLAN
UTILITY PLAN
GRADING PLAN
SITE DETAILS
SWPPP
SWPPP DETAILS

INDEX

SHEET No.
SD1.00
SD1.01
SD2.00
SD3.00
SD4.00
SD5.00
SD6.00 - SD6.02
SD7.00 & SD7.01
SD7.02 - SD7.03

REVISIONS

GBC DESIGN, INC.
565 White Pond Dr.
Akron, OH 44320
Phone 330-896-0228

21 LINCOLN WAY PROJECT LLC
SUITE 301
3951 CONVENIENCE CIRCLE N.W.
CANTON, OH 44718

DEVILLE 21 LINCOLN WAY
OUT LOT 1122
MASSILLON, OHIO
TITLE SHEET



DRAWN BY:
T.G.W.

DATE:
6/26/2015

PROJECT NO.
47190

DRAWING NO.

SD1.00

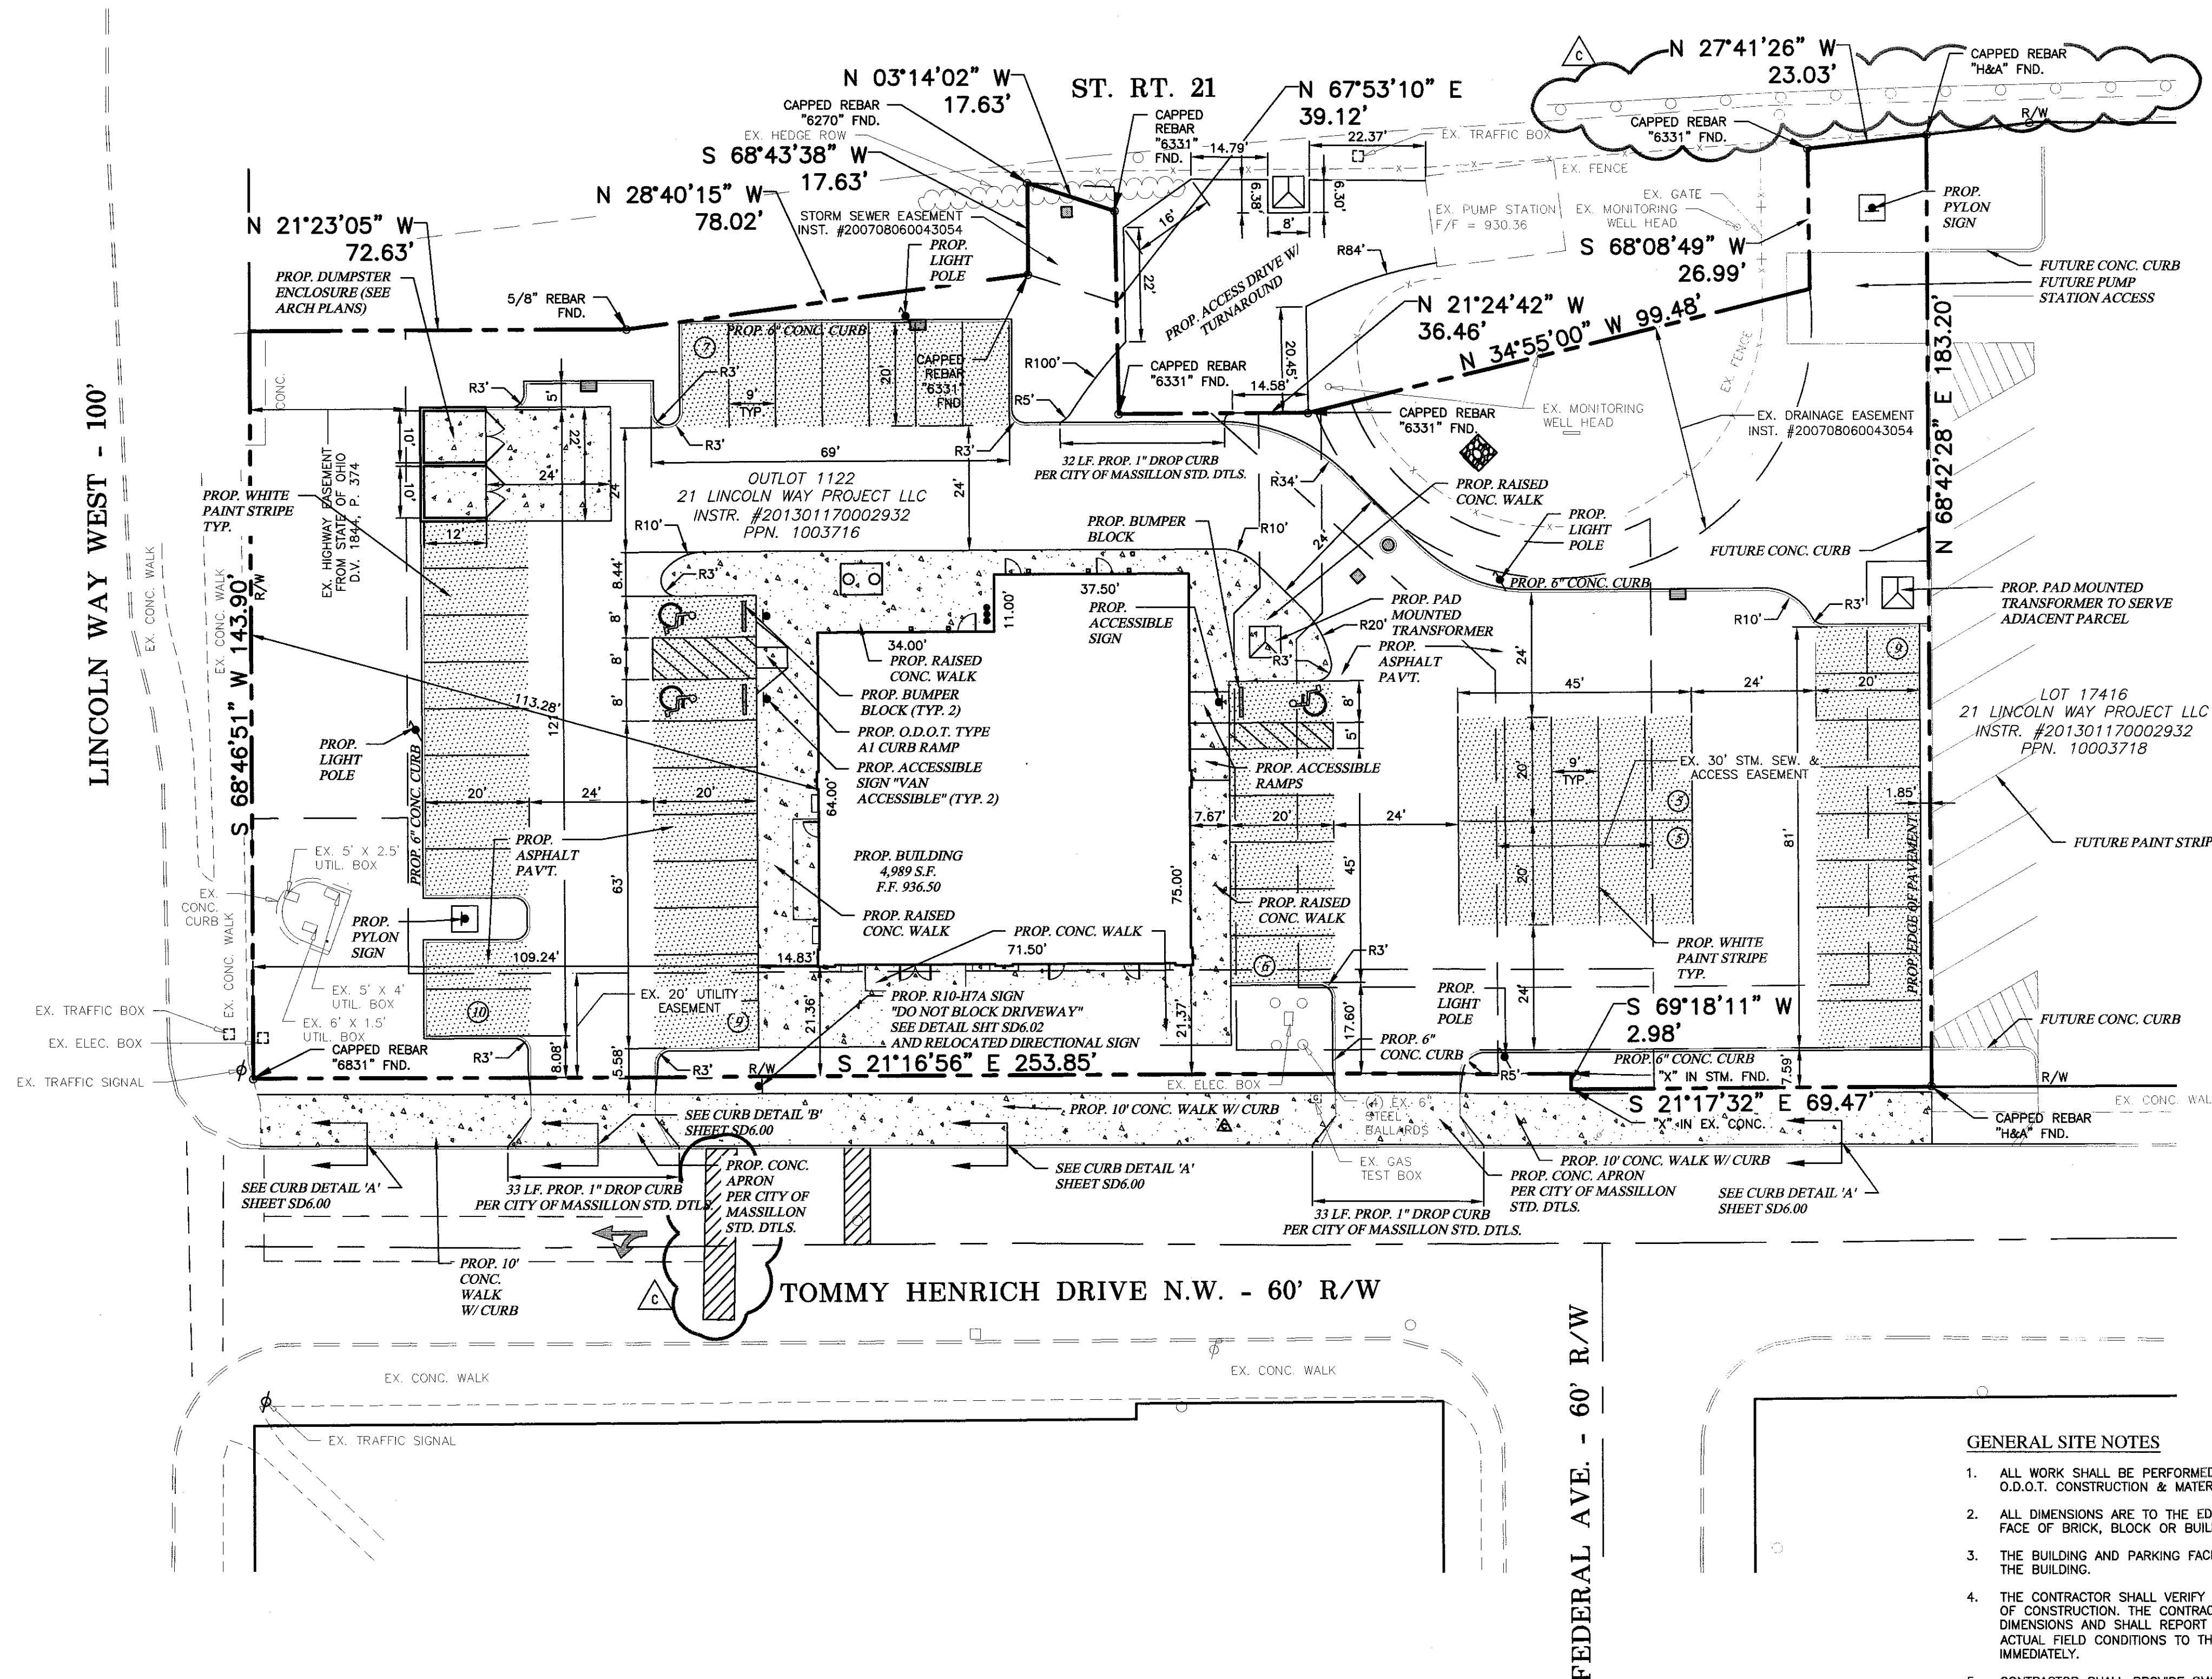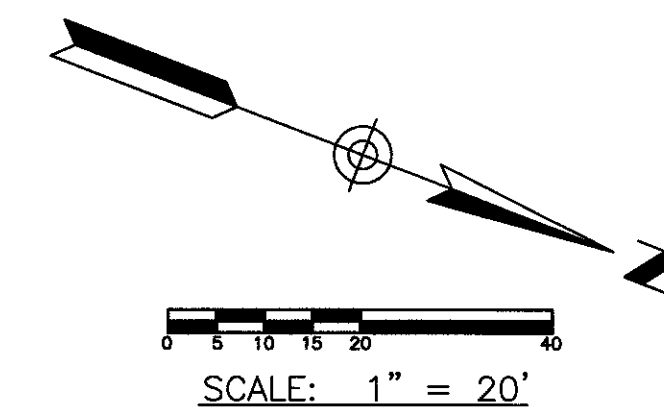

SITE DATA

ZONING: B2 CENTRAL BUSINESS

SITE AREA = 1.0846 AC.

PARKING REQUIRED

- PLANNED COMMERCIAL OR SHOPPING CENTER:
 - 1 SPACE PER 200 S.F. OF GROSS FLOOR AREA
 - 2813/200=15 SPACES
- ESTABLISHMENT FOR SALE AND CONSUMPTION ON THE PREMISES, OF BEVERAGES, FOOD OR REFRESHMENTS-RESTAURANT:
 - 1 SPACE PER 150 S.F. OF GROSS FLOOR AREA
 - 2176/150=15 SPACES

PARKING PROVIDED

REGULAR PARKING SPACES = 48
 ACCESSIBLE PARKING SPACES = 3
 TOTAL PARKING SPACES = 51

LEGEND

	PROP. MEDIUM DUTY ASPHALT
	PROP. HEAVY DUTY ASPHALT

TOTAL IMPERVIOUS AREA = 0.7494 AC.

GENERAL SITE NOTES

- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITION OF THE O.D.O.T. CONSTRUCTION & MATERIAL SPECIFICATIONS.
- ALL DIMENSIONS ARE TO THE EDGE OF PAVEMENT, FACE OF CURBS, OR OUTSIDE FACE OF BRICK, BLOCK OR BUILDING FASCIA UNLESS OTHERWISE INDICATED.
- THE BUILDING AND PARKING FACILITIES ARE PARALLEL WITH OR PERPENDICULAR TO THE BUILDING.
- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS IN THE FIELD PRIOR TO THE START OF CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FIELD DIMENSIONS AND SHALL REPORT ANY DISCREPANCIES BETWEEN THE PLANS AND ACTUAL FIELD CONDITIONS TO THE OWNER OR OWNER'S REPRESENTATIVE IMMEDIATELY.
- CONTRACTOR SHALL PROVIDE SMOOTH TRANSITIONS FROM PROPOSED FEATURES TO EXISTING FEATURES AS NECESSARY.
- ALL DISTURBED AREAS SHALL BE SEEDED OR SODDED AFTER FINISH GRADING IS COMPLETED UNLESS OTHERWISE NOTED. ALL NEW SEEDED OR SODDED AREAS SHALL HAVE A TOPSOIL LAYER OF 4" MINIMUM. CONTRACTOR SHALL SUPPLY AND PLACE STRAW MULCH WHEREVER GRASS SEED HAS BEEN PLACED.
- CONTRACTOR SHALL REPAIR, RESURFACE, RECONSTRUCT OR REFURBISH ANY AREAS DAMAGED DURING CONSTRUCTION BY THE CONTRACTOR, HIS SUBCONTRACTORS OR SUPPLIERS AT NO ADDITIONAL COST TO THE OWNER.
- ALL PAINT STRIPING SHALL BE 4" TRAFFIC PAINT IN ACCORDANCE WITH O.D.O.T. ITEM 641 AND SHALL BE WHITE.
- CONTRACTOR MUST MAINTAIN DAILY AND OVERNIGHT EMERGENCY ACCESS TO THE PUMP STATION BUILDING DURING THE CONSTRUCTION PROJECT.

GBC DESIGN, INC.
 565 White Pond Dr.
 Akron, OH 44320
 Phone 330-596-0228 Fax 330-596-5782

21 LINCOLN WAY PROJECT LLC
 SUITE 301
 3951 CONVENIENCE CIRCLE N.W.
 CANTON, OH 44718



DEVILLE 21 LINCOLN WAY
 OUT LOT 1122
 MASSILLON, OHIO
 SITE PLAN












DRAWN BY:
 T.G.W.


DATE:
 6/26/2015

PROJECT NO.
 47190


DRAWING NO.
 SD3.00

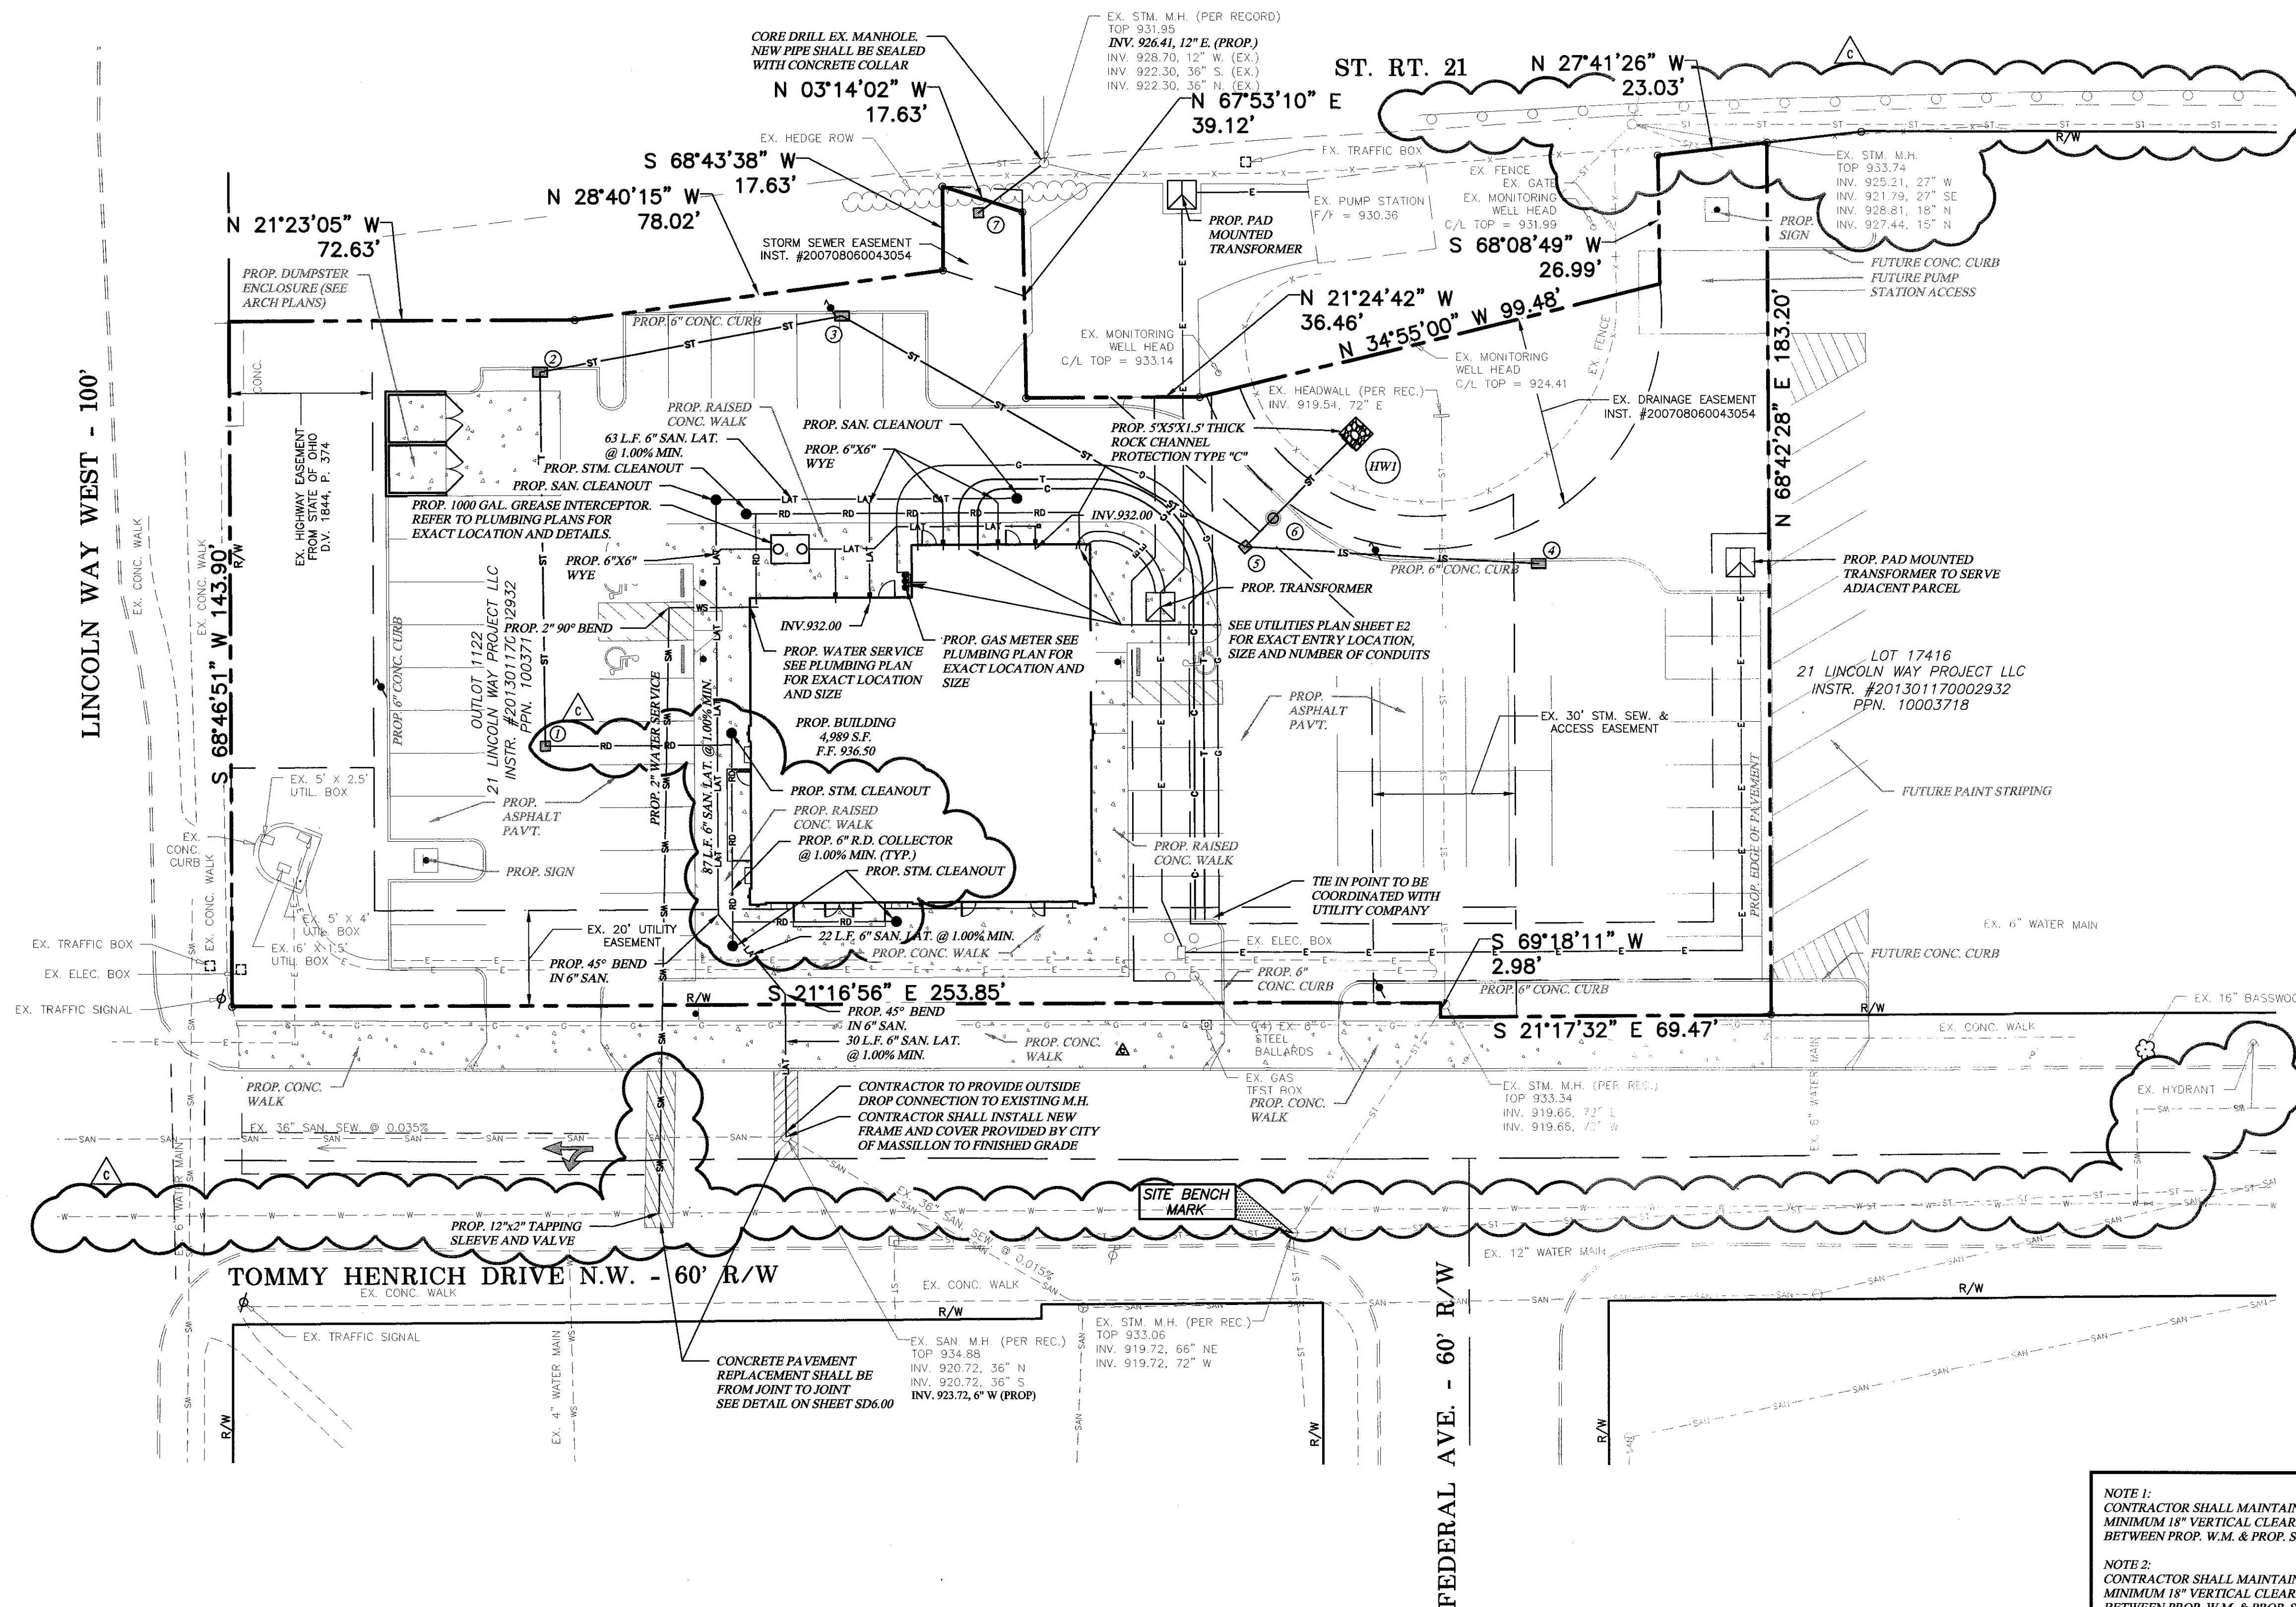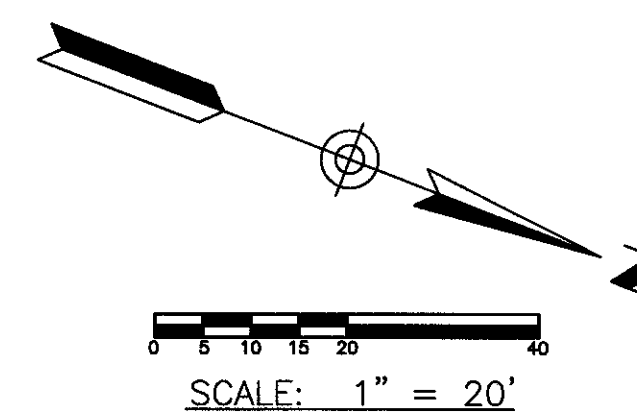

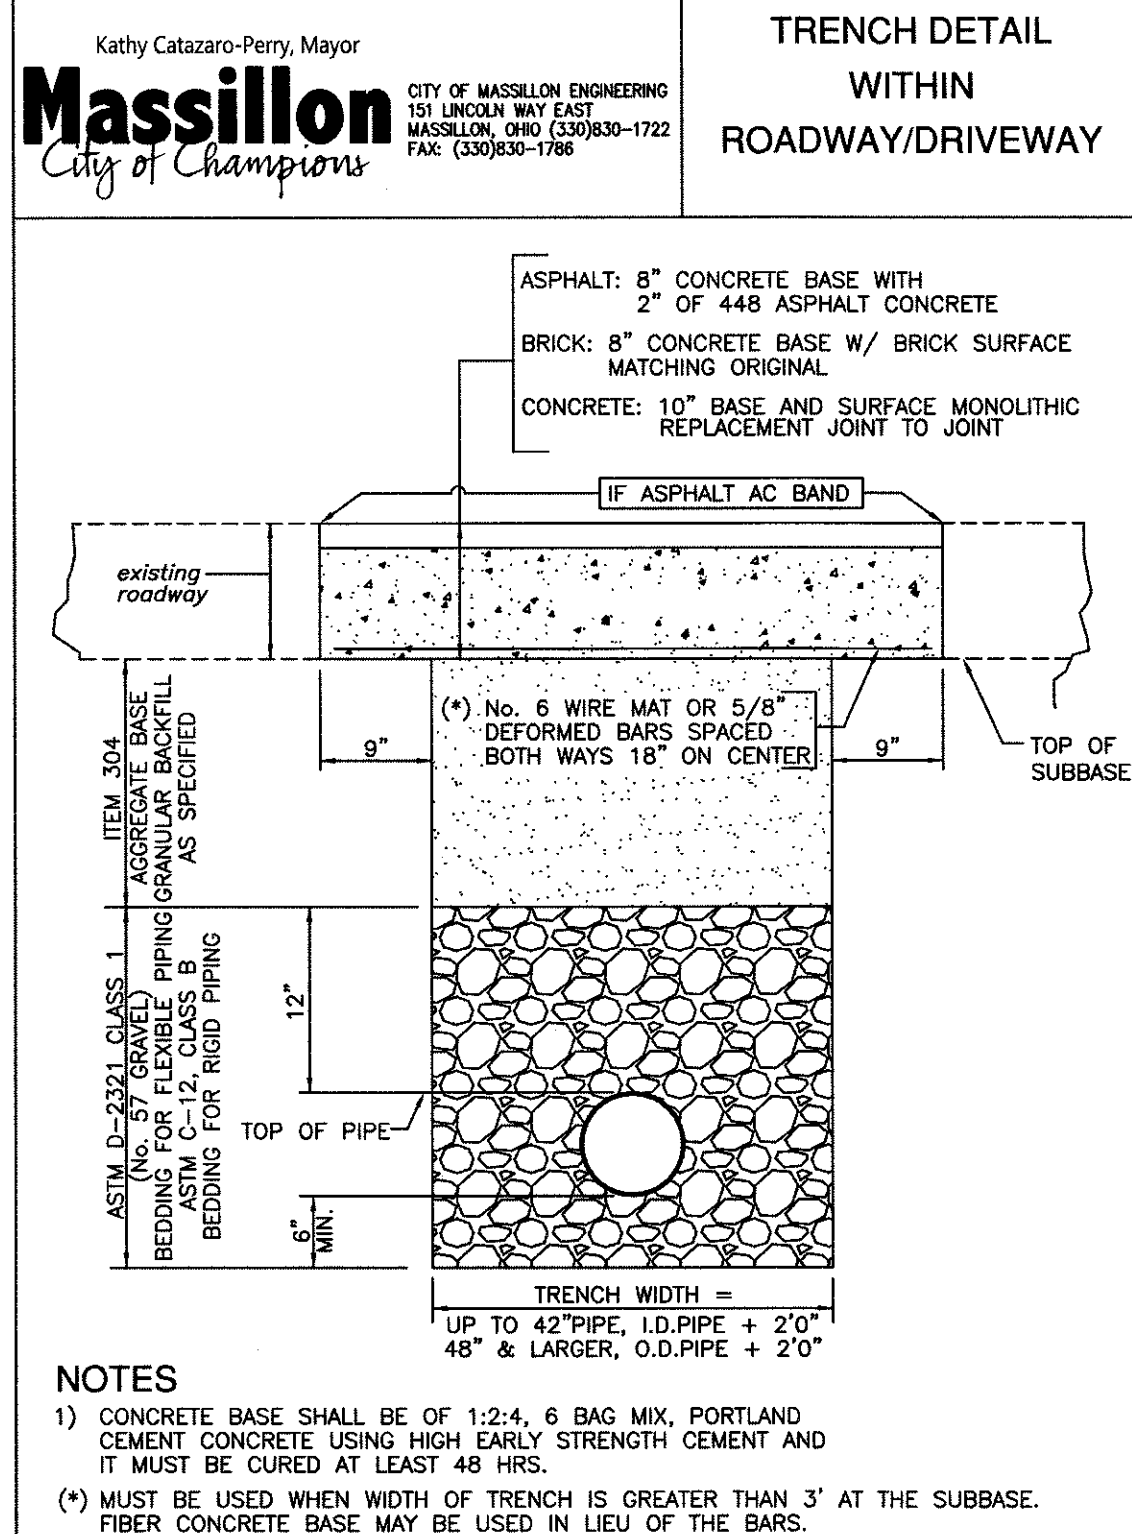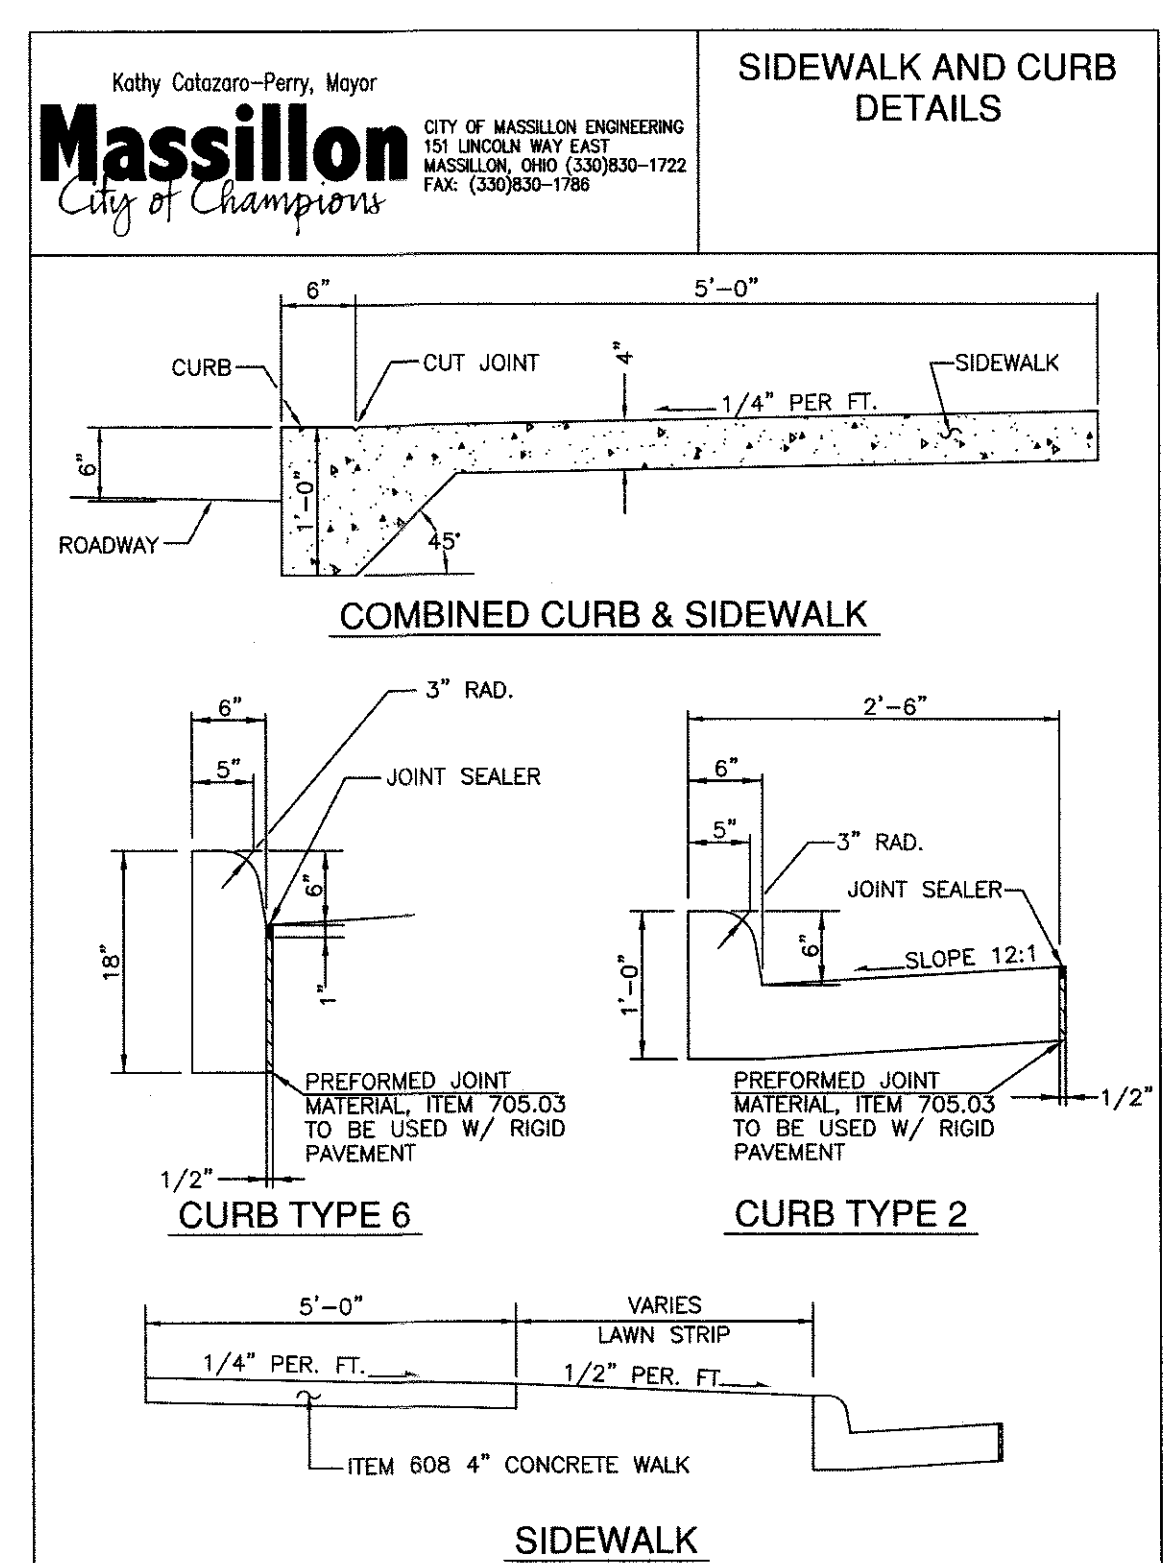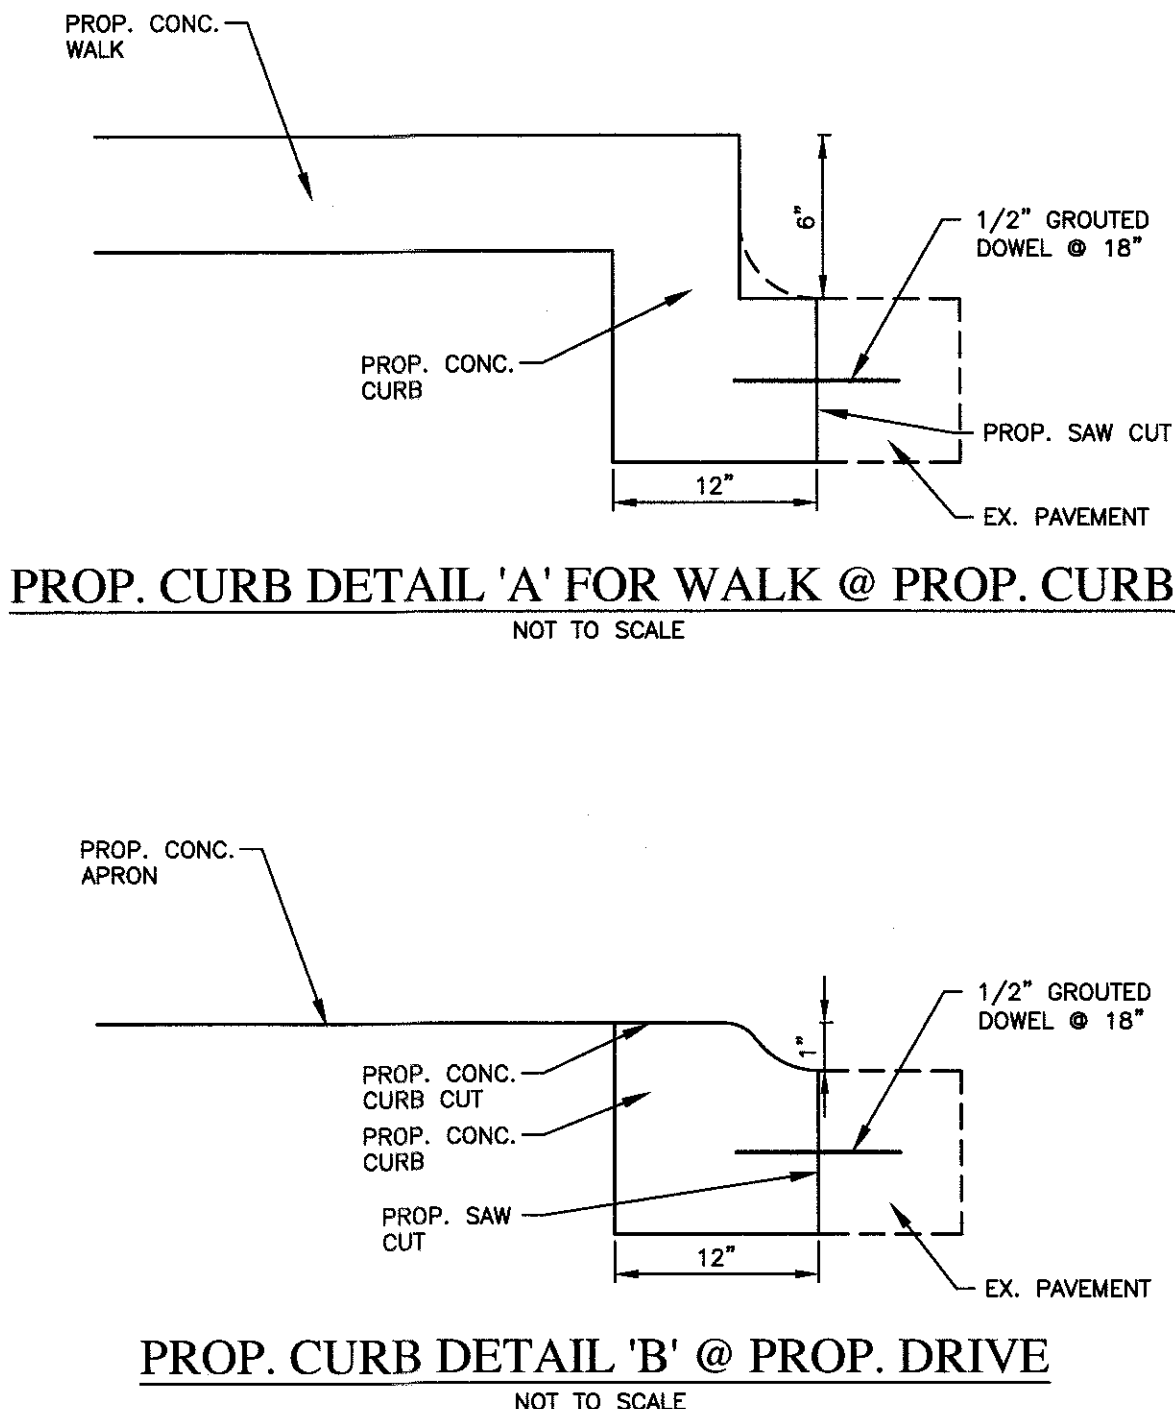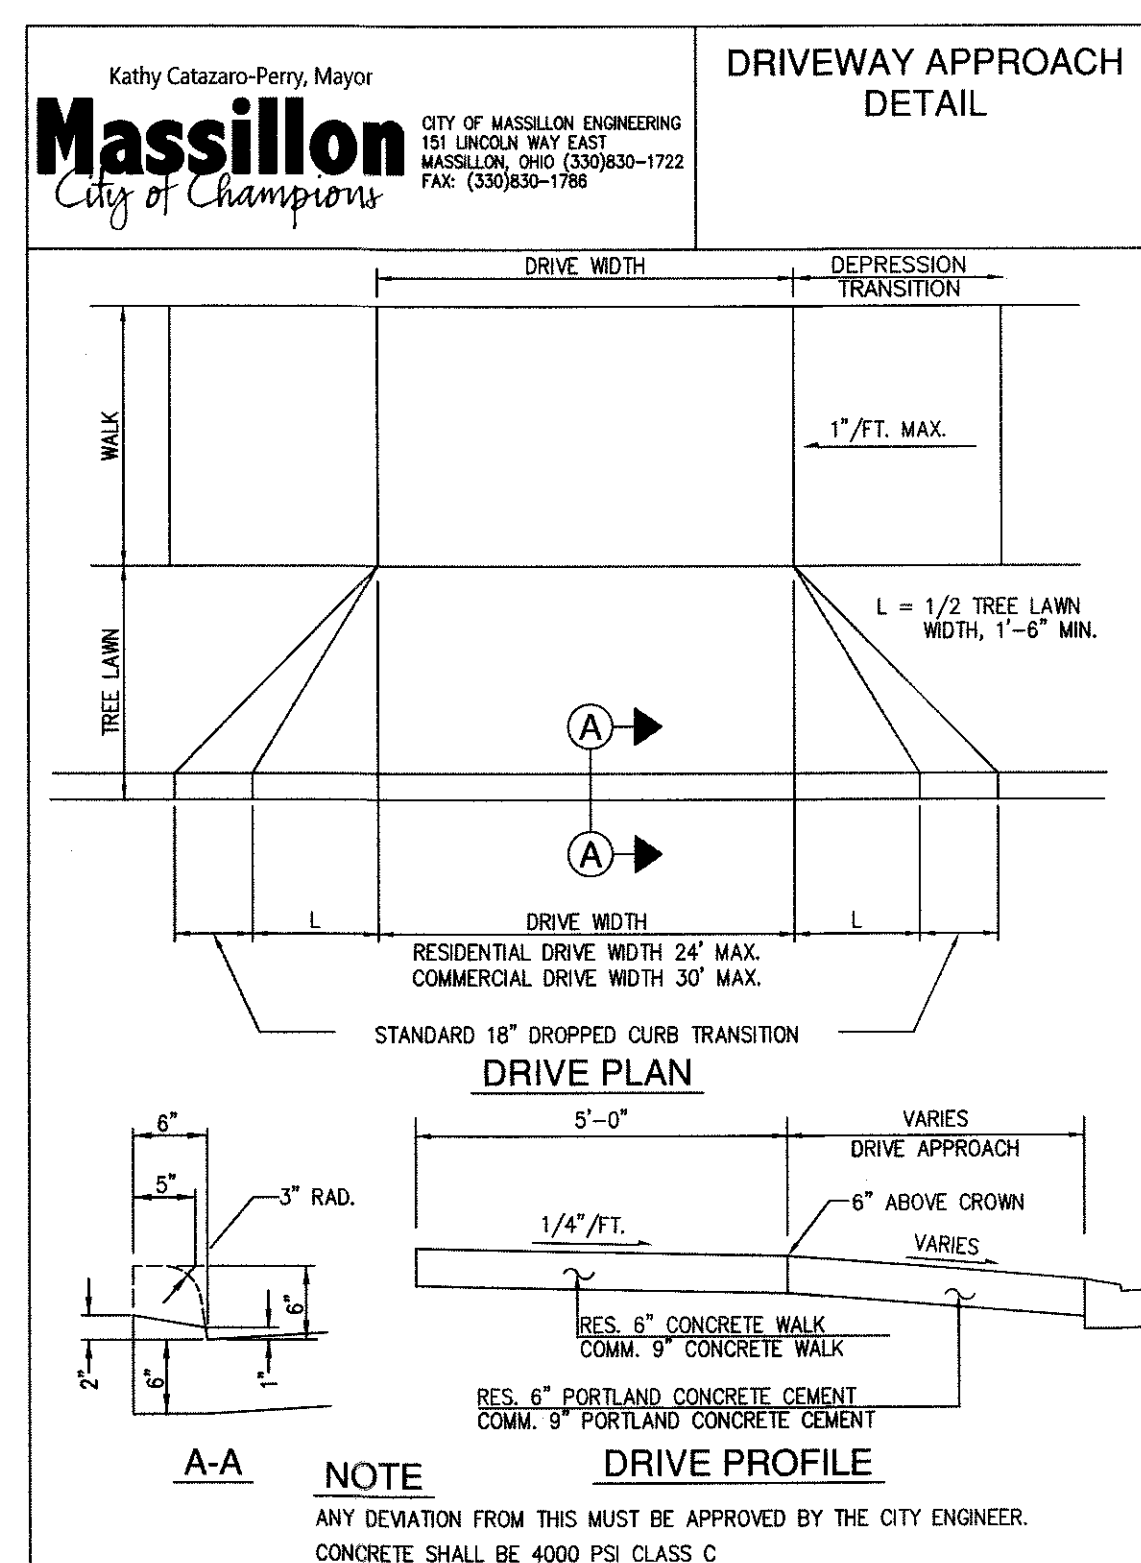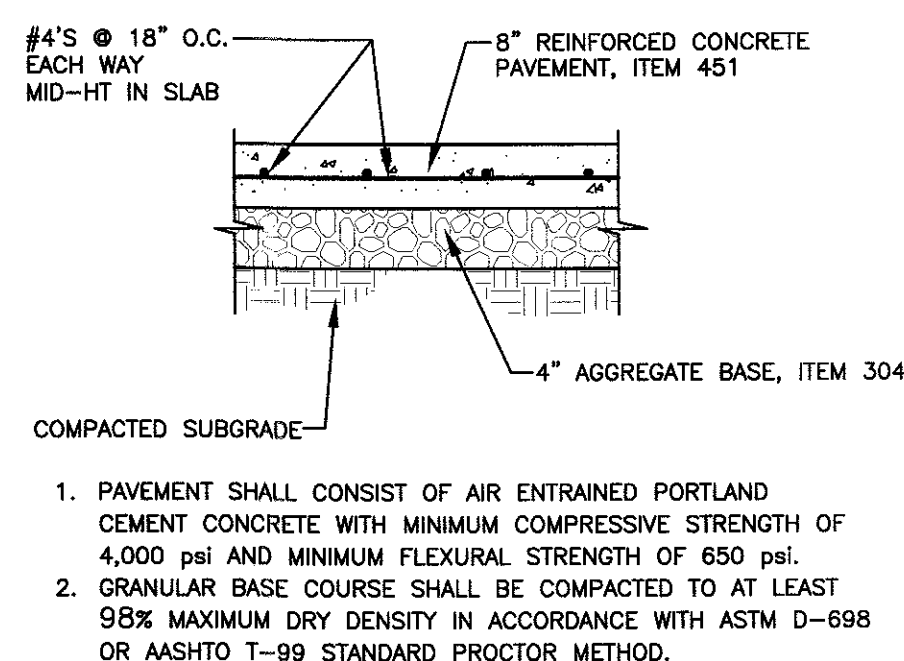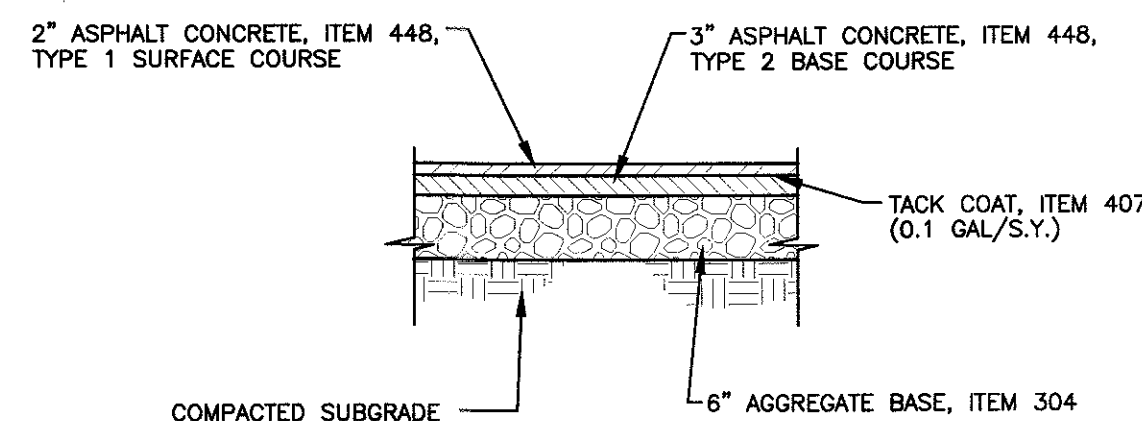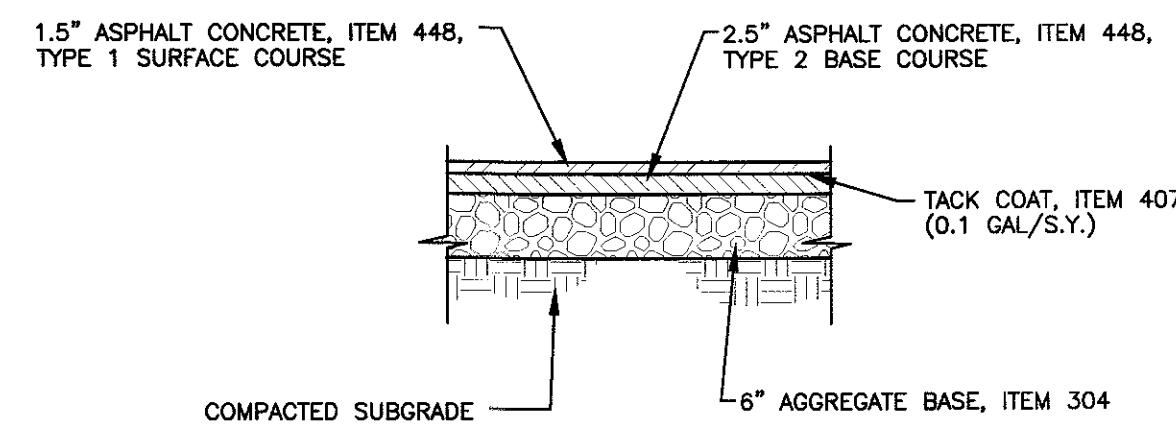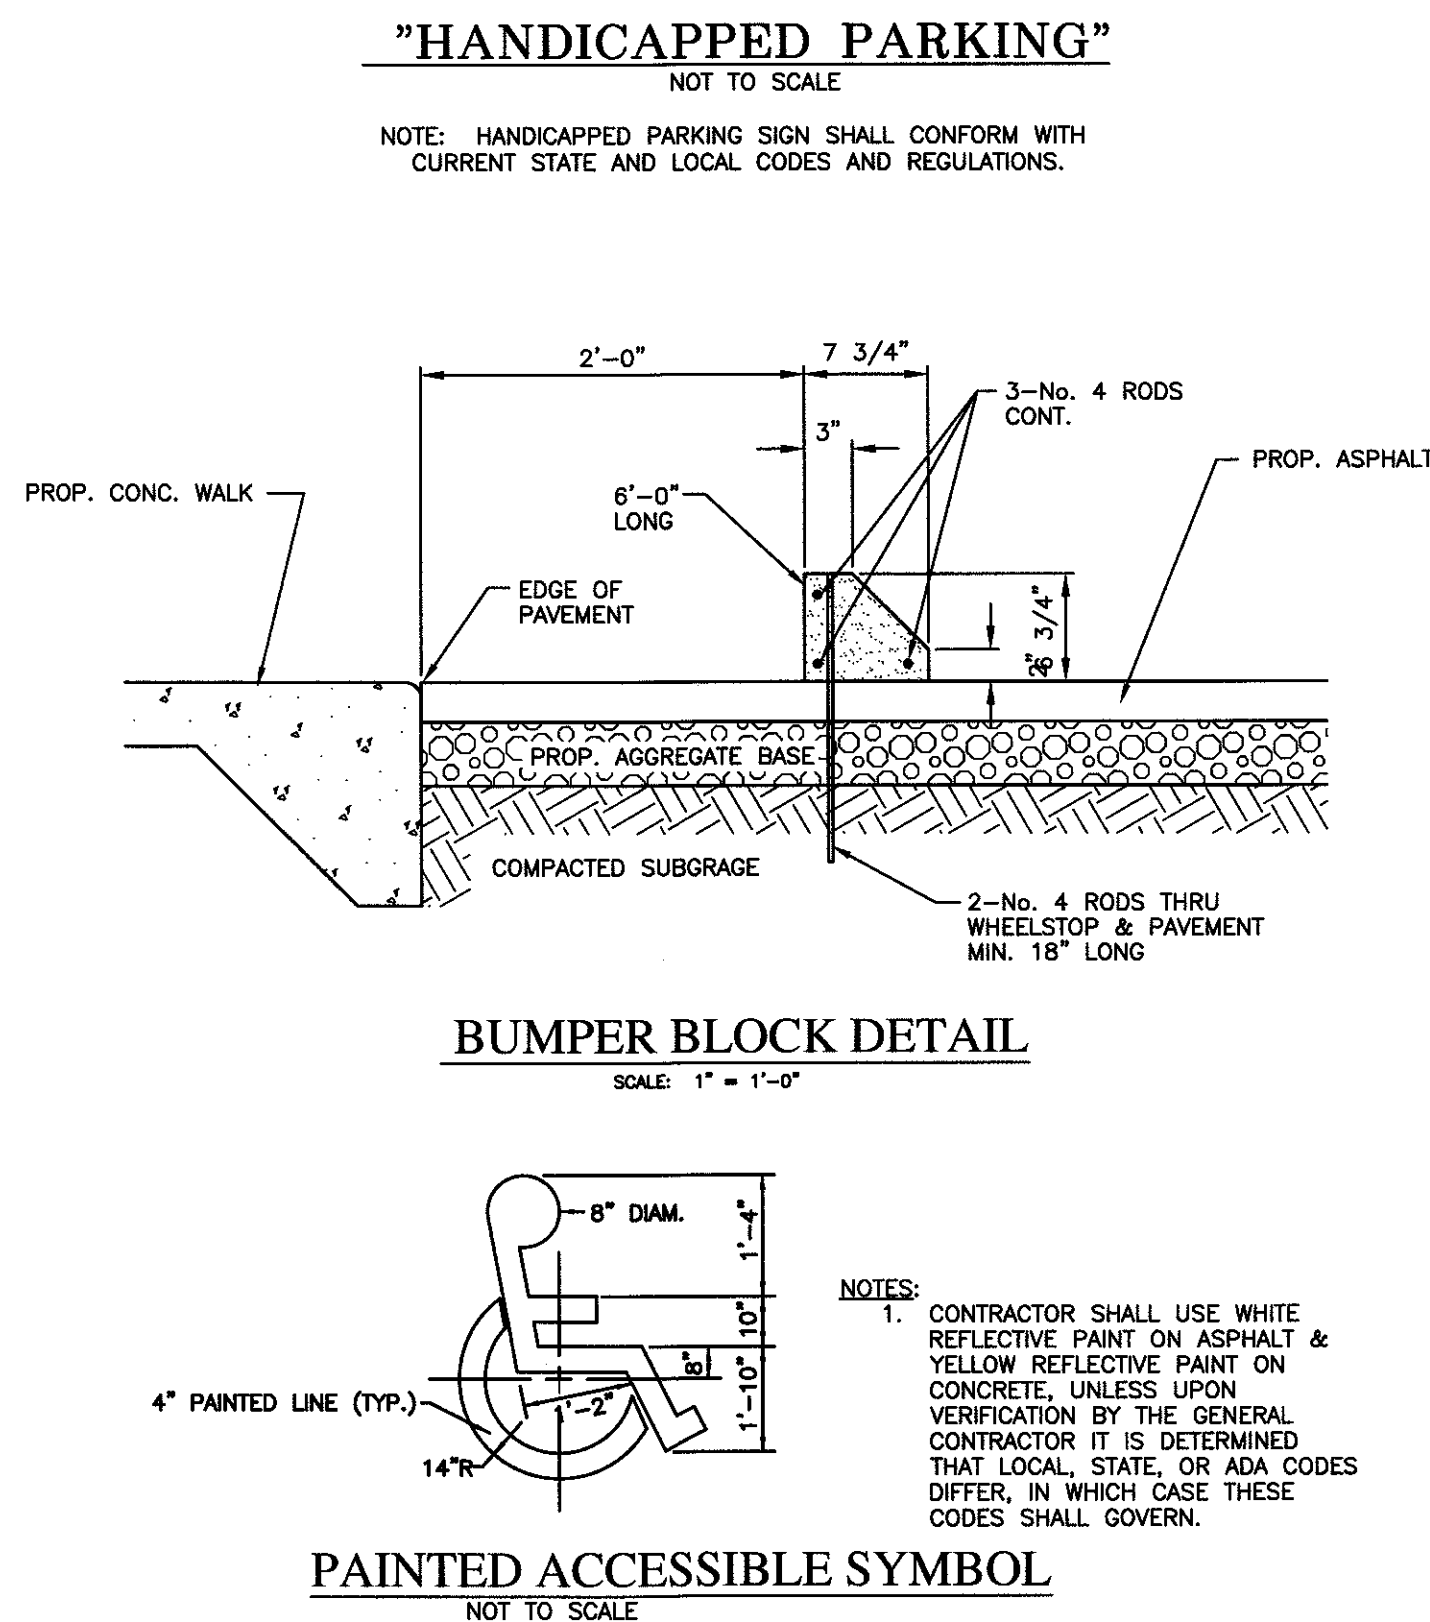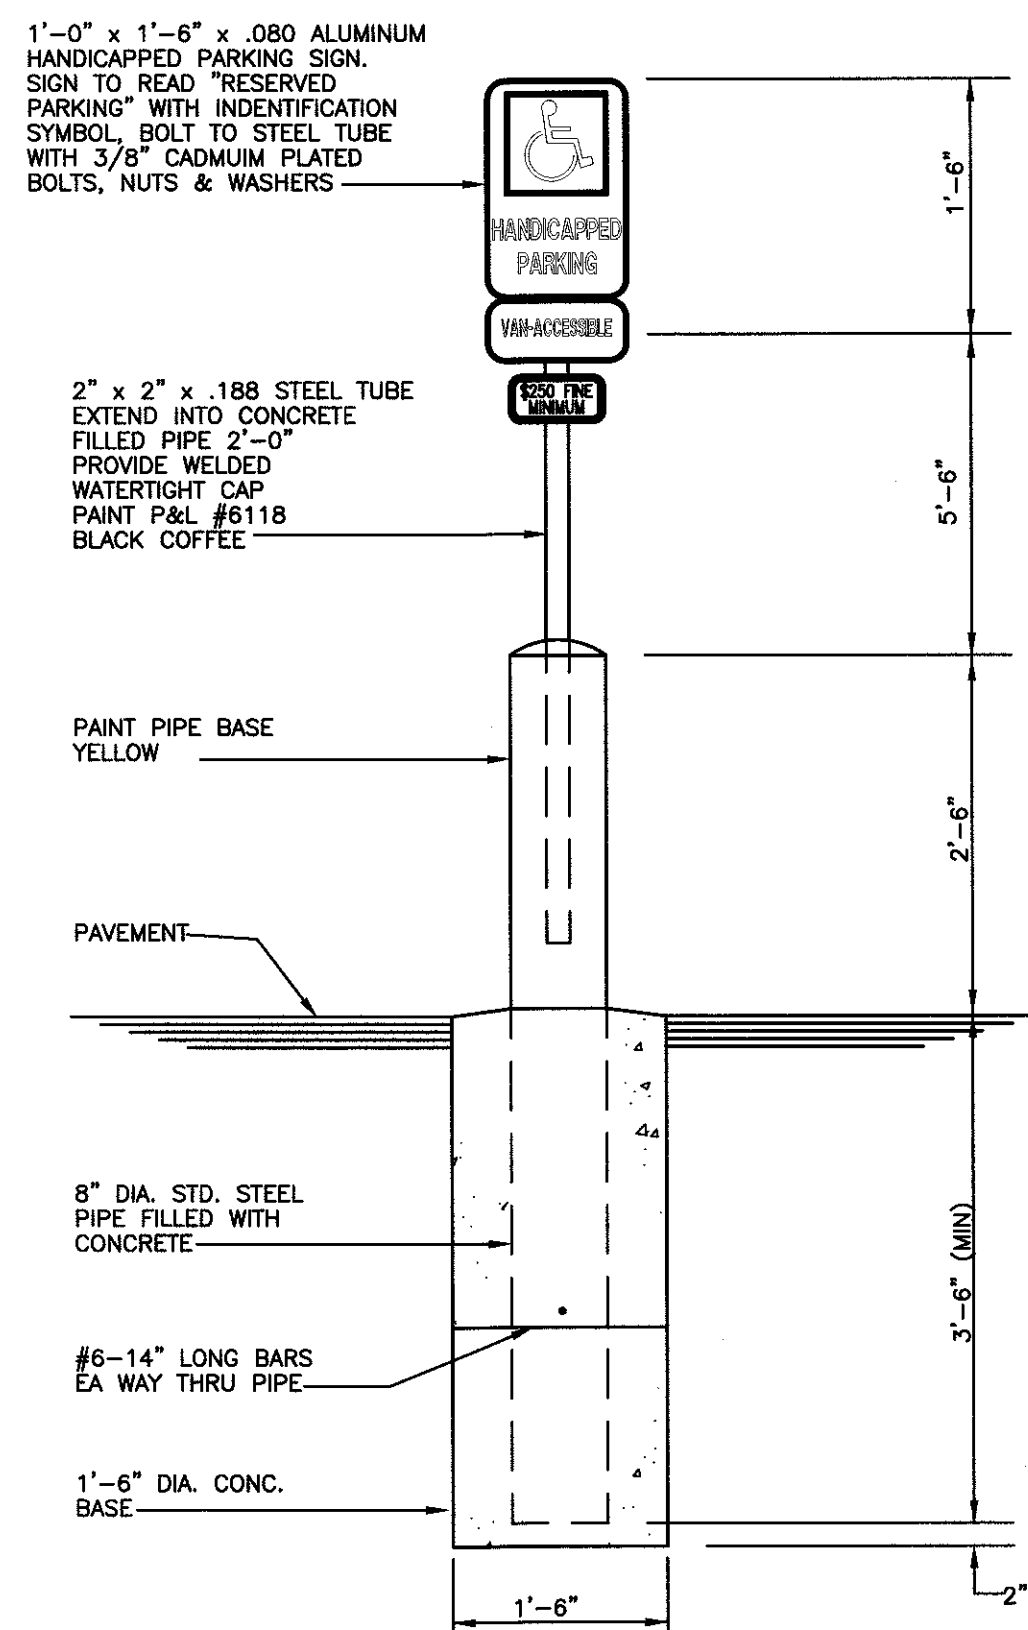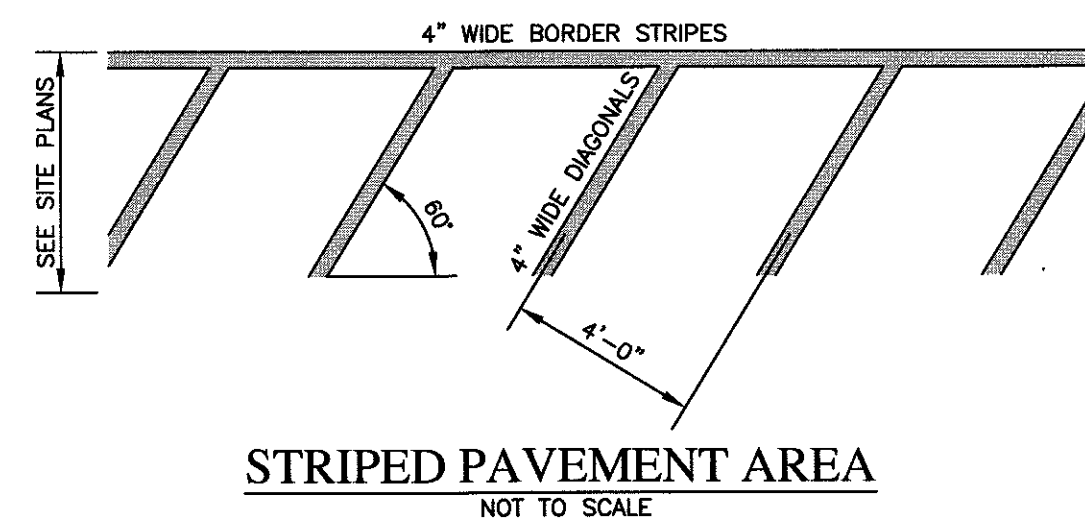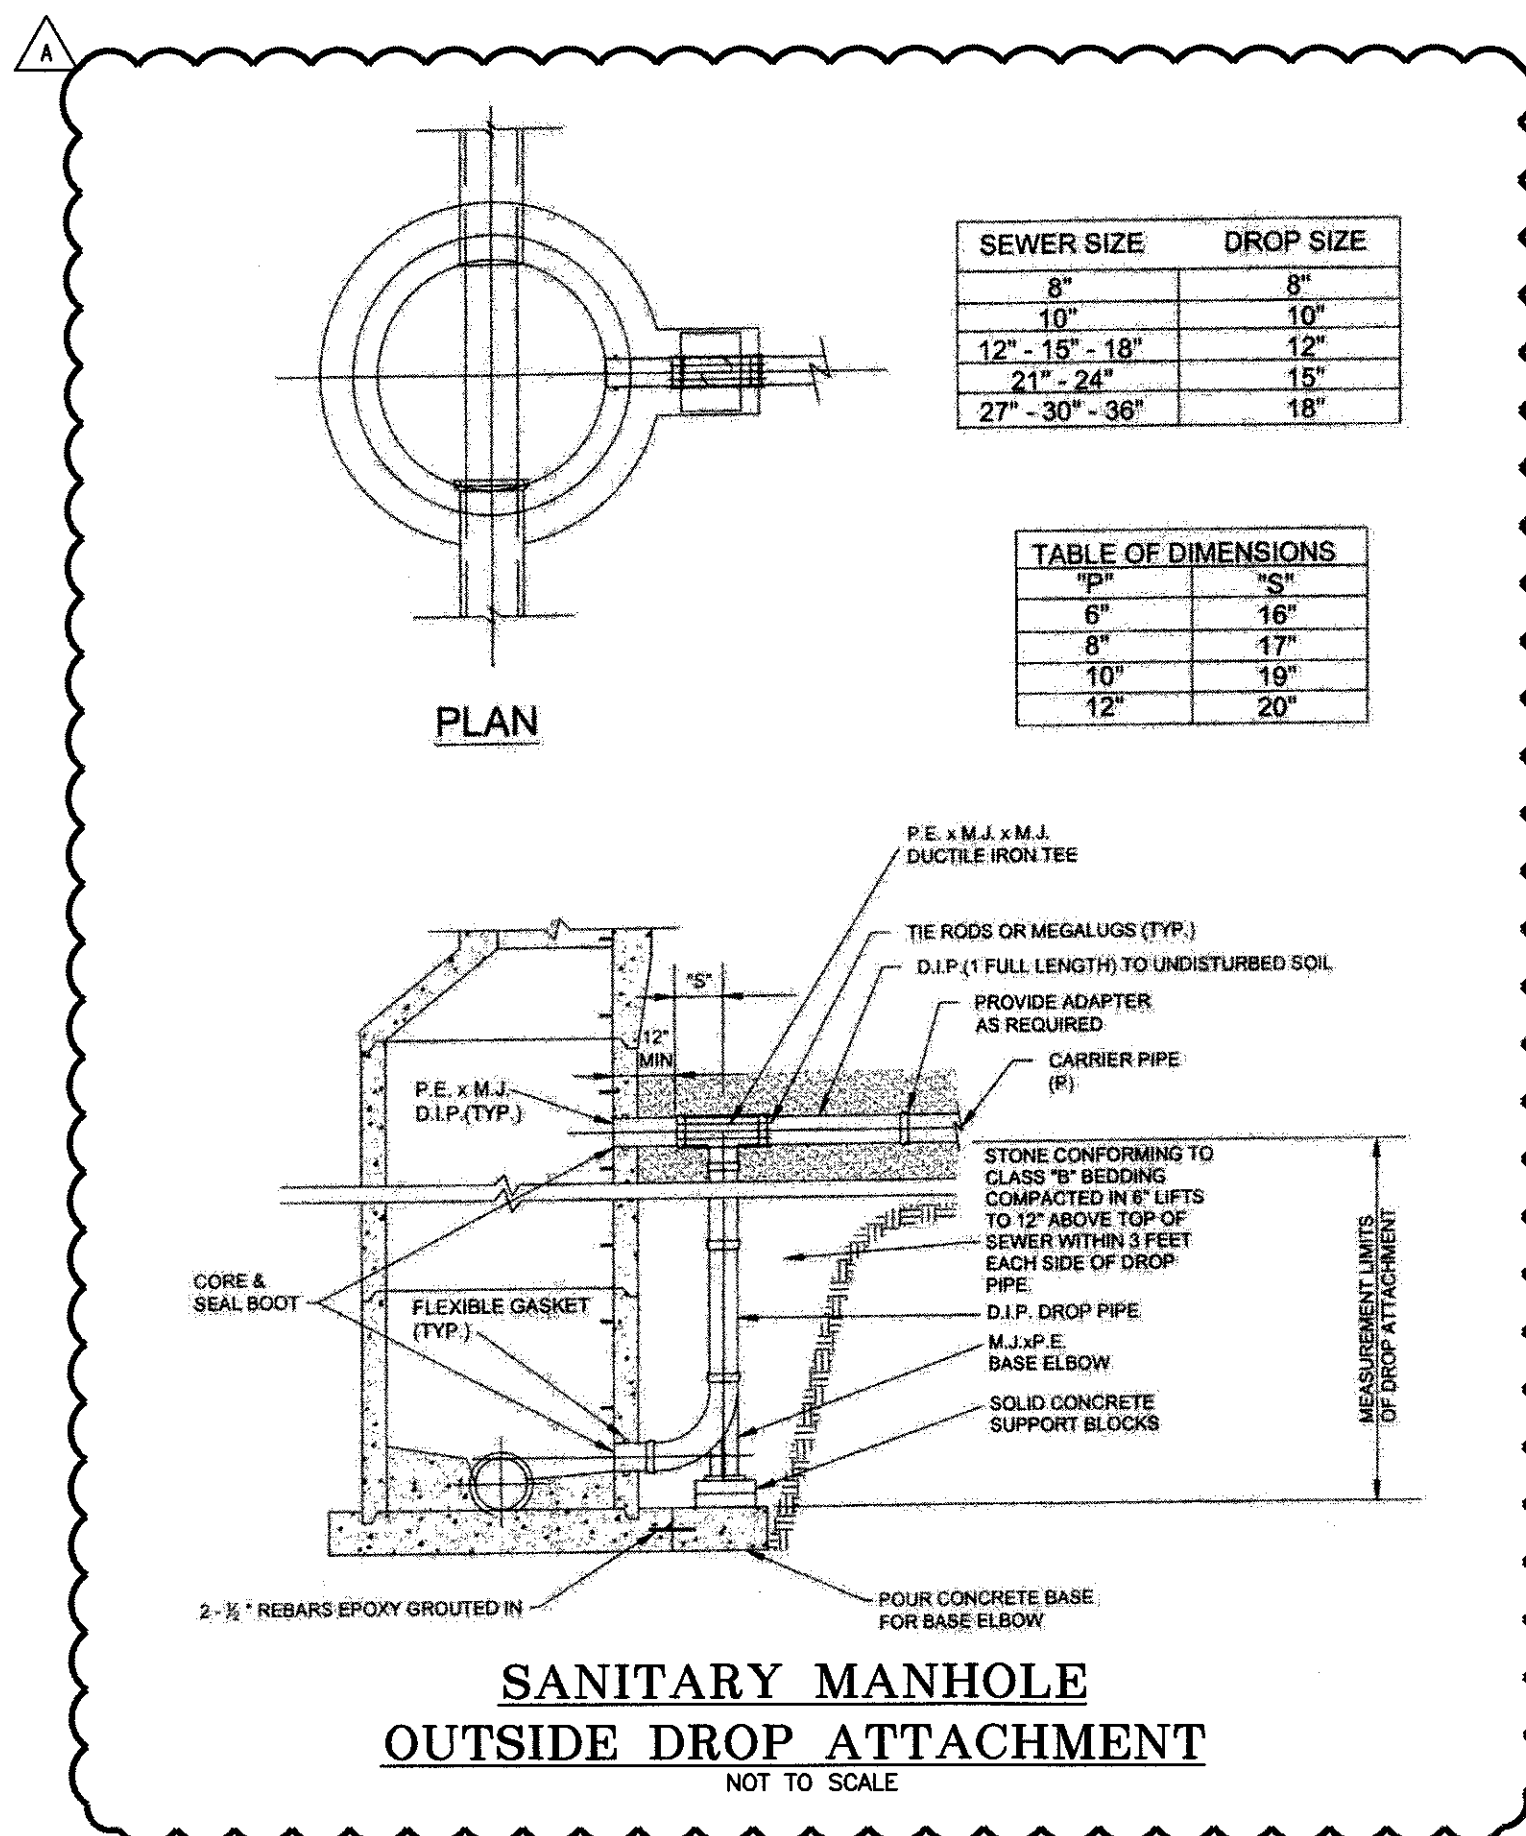


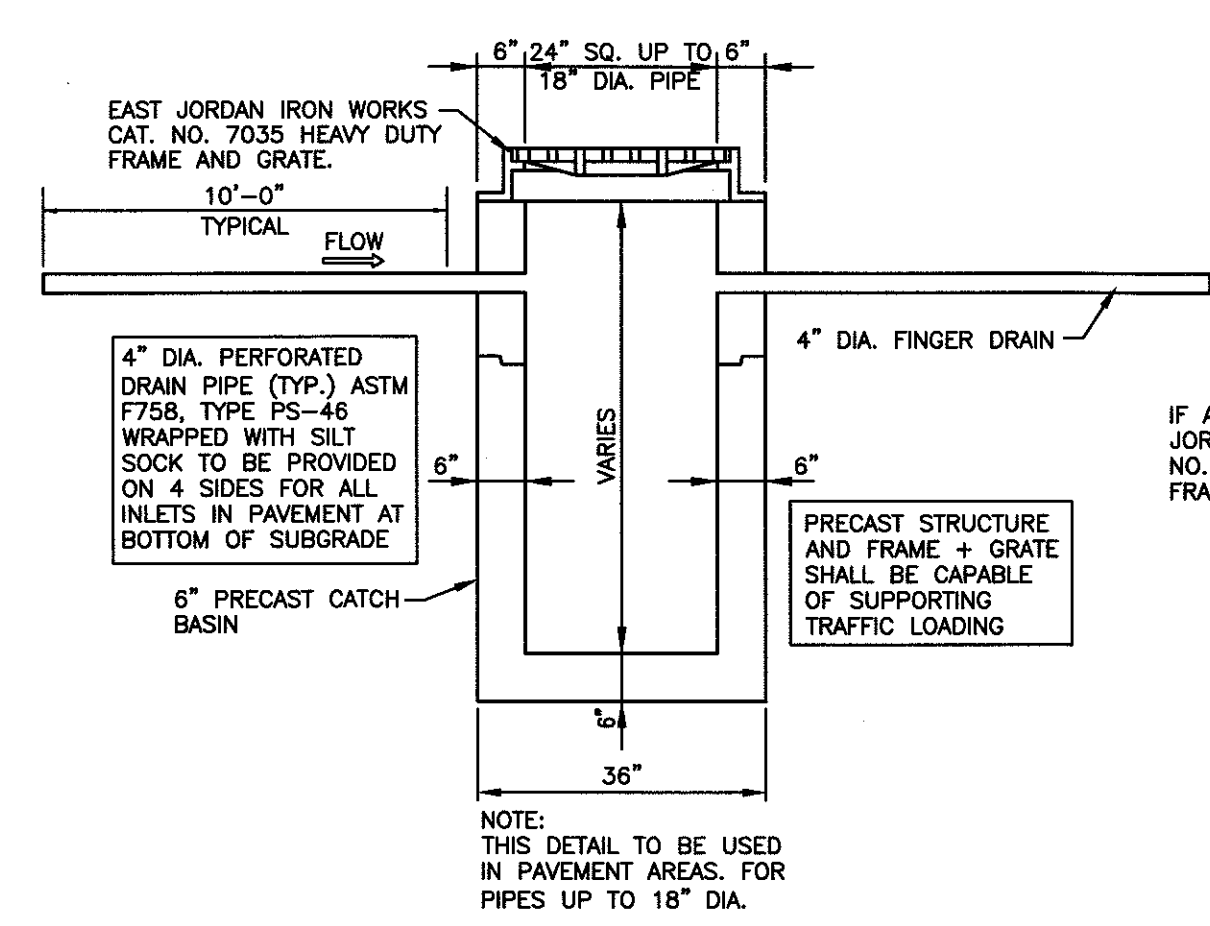


CURB INLET DETAIL
NOT TO SCALE

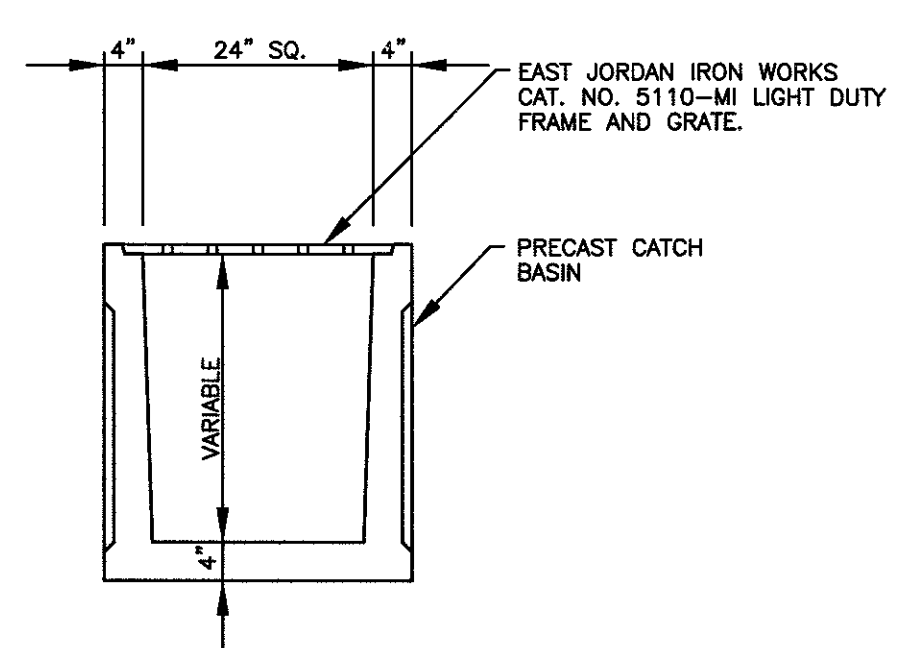


YARD INLET DETAIL
NO SCALE
NOTE: TO BE USED IN LAWN AREAS

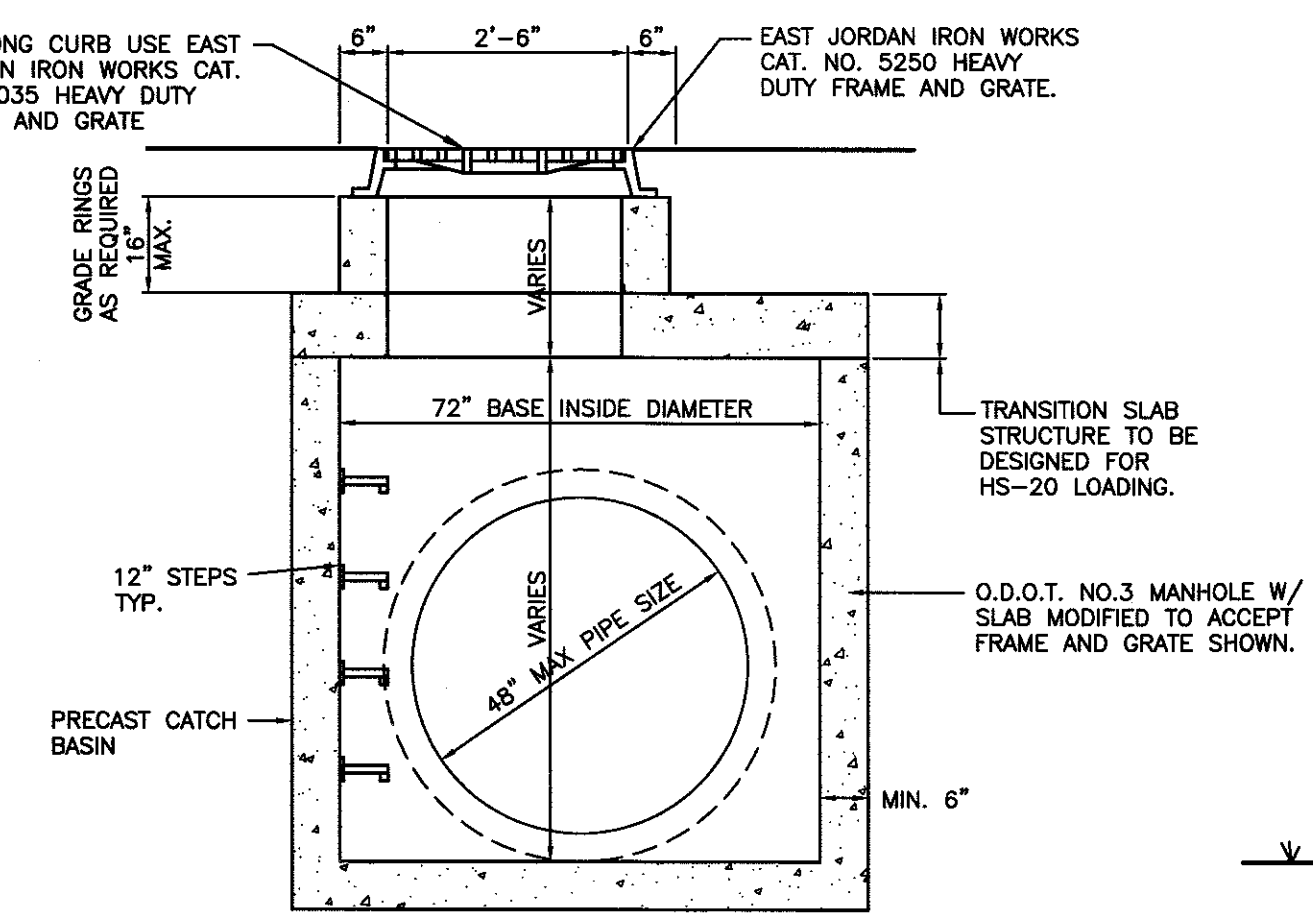


MODIFIED O.D.O.T. NO. 3 MANHOLE GRATE INLET
NOT TO SCALE

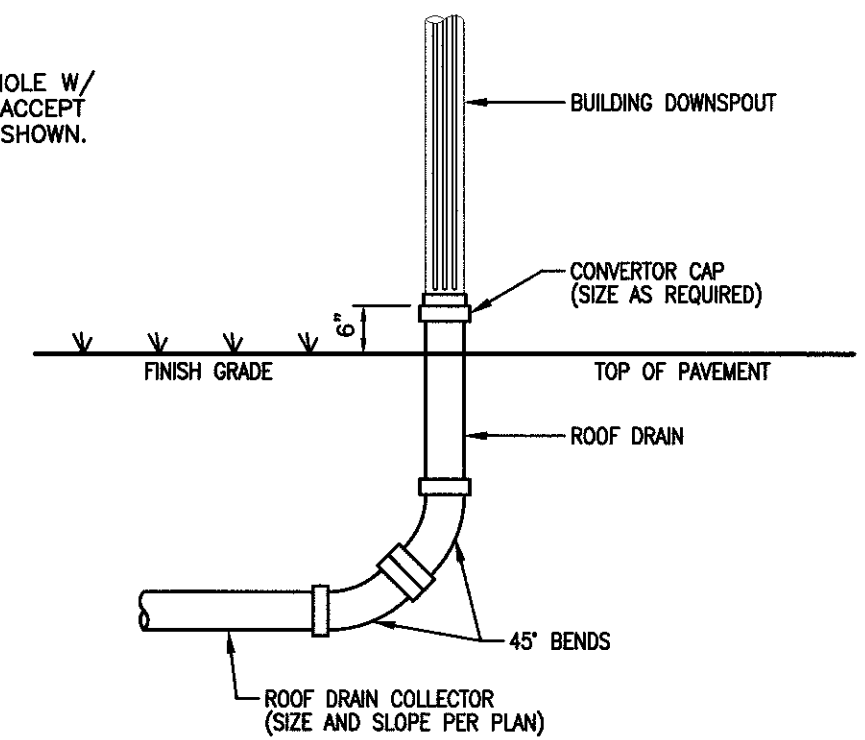

ROOF DRAIN / DOWNSPOUT CONNECTION
NOT TO SCALE

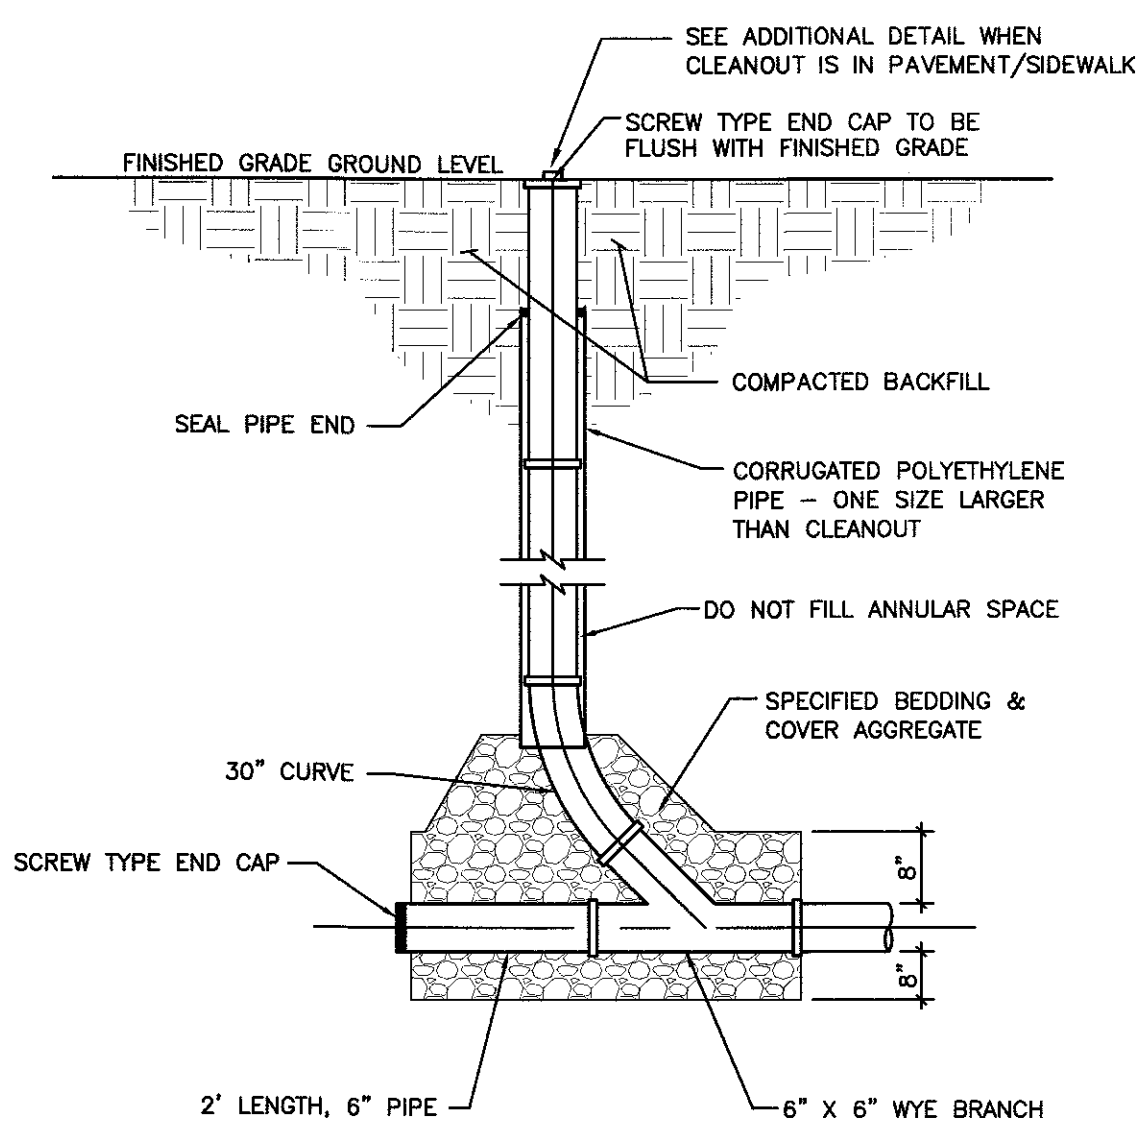

SEWER CLEANOUT DETAIL
NOT TO SCALE

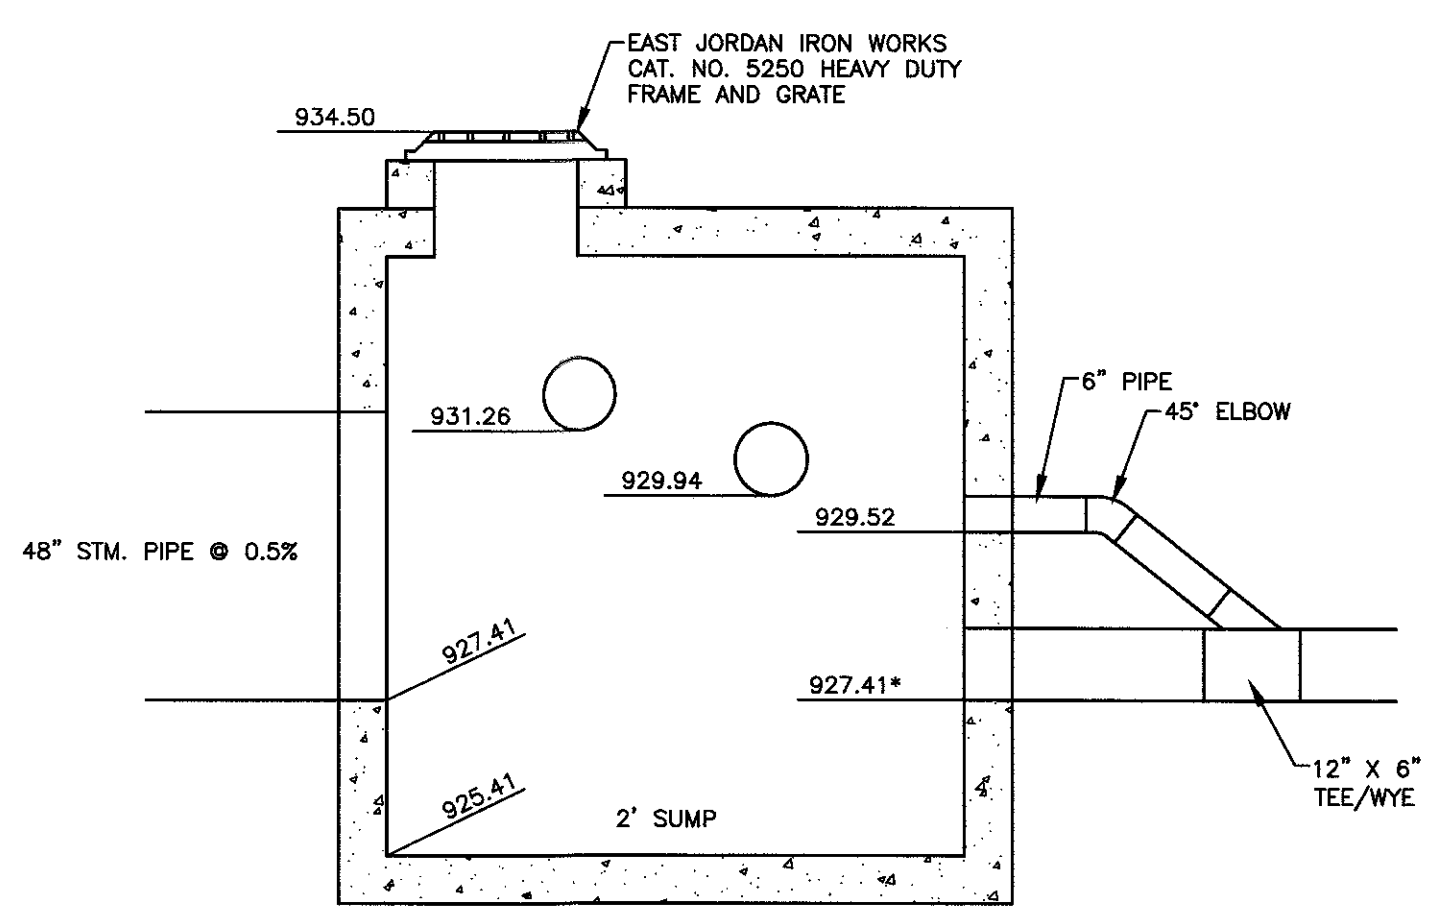


MODIFIED O.D.O.T. M.H. NO. 3
INLET & 5 DETAIL
NOT TO SCALE


AQUA-SWIRL™ PCS SPECIFICATION NOTES
03-19-13

- MANUFACTURER SHALL BE RESPONSIBLE FOR COMPLETE ASSEMBLY OF SWIRL CONCENTRATOR.
- POLYMER COATED STEEL (PCS) SWIRL CONCENTRATOR SHALL BE FABRICATED FROM POLYMER PRE-COATED STEEL SHEET FOR CORRUGATED STEEL PIPE, AND SHALL COMPLY WITH ASTM A 780 AND ASTM A 742.
- STUB OUTS AND INTERNAL COMPONENTS SHALL BE SUPPLIED BY MANUFACTURER AND MIG WELDED USING ACCEPTED WELDING PRACTICES.
- MANUFACTURER SHALL SUPPLY DIRECT ACCESS TO SWIRL CONCENTRATOR VIA 30-INCH ID RISER(S). RISER SHOULD NOT BE FIELD CUT BY CONTRACTOR. RISER SHOULD MAINTAIN ITS FINISH CUT LENGTH AS SUPPLIED BY MANUFACTURER TO MATCH FINAL GRADE PER APPROVED SITE ELEVATIONS (AS INDICATED ON APPROVED SHOP DRAWING). IF NECESSARY TO EXTEND RISER, CONTRACTOR SHOULD USE ADJUSTING RINGS TO BRING TOP OF STRUCTURE TO GRADE.
- CONTRACTOR SHALL SUPPLY PIPE COUPLINGS TO AND FROM SWIRL CONCENTRATOR, WHICH SHALL BE MAR-MAC, FERNCO, OR MISSION STYLE FLEXIBLE BOOT WITH STAINLESS STEEL TENSION BANDS AND SHEAR GUARD. MAR-MAC COUPLINGS SHOULD BE USED FOR CONNECTIONS TO CORRUGATED PLASTIC PIPE AND ARE RECOMMENDED FOR USE WITH LARGER DIAMETER PIPE (E.G. 24" ID AND LARGER). A CONCRETE CRADLE IS RECOMMENDED BENEATH MAR-MAC'S TO PREVENT JOINT MOVEMENT.
- CONTRACTOR SHALL PREPARE EXCAVATION AND OFF-LOAD SWIRL CONCENTRATOR. CONTRACTOR IS RESPONSIBLE FOR BEDDING AND BACKFILL AROUND SWIRL CONCENTRATOR AS DETAILED ON SITE PLAN. (SEE NOTES 11 AND 12)
- MANUFACTURER SHALL SUPPLY STANDARD MANHOLE FRAME(S) AND COVER(S). (TRAFFIC RATED H20)
- WHERE TRAFFIC LOADING (H-20) IS REQUIRED OR ANTICIPATED, A 4-FOOT DIAMETER, 14-INCH THICK REINFORCED CONCRETE PAD MUST BE PLACED OVER THE SWIRL CONCENTRATOR TO SUPPORT AND LEVEL THE MANHOLE FRAME. THE TOP OF RISER PIPE MUST BE WRAPPED WITH COMPRESSIBLE EXPANSION JOINT MATERIAL TO A MINIMUM 1-INCH THICKNESS TO ALLOW TRANSFER OF WHEEL LOADS FROM MANHOLE COVER TO CONCRETE SLAB. MANHOLE COVER SHALL BEAR ON CONCRETE SLAB AND NOT ON RISER PIPE. THE CONCRETE SLAB SHALL HAVE A MINIMUM STRENGTH OF 3,000 PSI AND BE REINFORCED WITH #4 REINFORCING STEEL (PER DRAWING). MINIMUM COVER OVER REINFORCING STEEL SHALL BE 1-INCH. TOP OF MANHOLE COVER AND CONCRETE SLAB SHALL BE LEVEL WITH FINISH GRADE.
- UNLESS OTHER TRAFFIC BARRIERS ARE PRESENT, BOLLARDS SHALL BE PLACED AROUND ACCESS RISERS IN NON-TRAFFIC AREAS TO PREVENT INADVERTENT LOADING BY MAINTENANCE VEHICLES. SAMPLE OF TYPICAL BOLLARD INSTALLATION DETAIL AND RECOMMENDED LOCATIONS OF BOLLARDS AROUND THE SWIRL CONCENTRATOR CAN BE PROVIDED UPON REQUEST.
- WHERE HIGH GROUNDWATER ELEVATIONS ARE PRESENT OR ANTICIPATED, CONTRACTOR SHALL SUPPLY CONCRETE ANTI-FLOATATION PAD UNDERNEATH AND FLOATED OVER THE OCTAGONAL BASE PLATE OF THE SWIRL (SEE ANTI-FLOATATION BASE DETAIL) TO PREVENT BUOYANCY AND BASE PLATE DEFLECTION (DETAILS, IF NECESSARY, AVAILABLE UPON REQUEST).
- EXCAVATION AND BEDDING - THE TRENCH AND TRENCH BOTTOM SHALL BE CONSTRUCTED IN ACCORDANCE WITH ASTM A 798 SECTION 5, TRENCH EXCAVATION, SECTION 6, FOUNDATION, AND SECTION 7, BEDDING. THE PCS SWIRL CONCENTRATOR SHALL BE INSTALLED ON A STABLE BASE CONSISTING OF AT LEAST 6-INCHES OF FINE, READILY COMPACTED SOIL OR GRANULAR FILL MATERIAL, AND COMPACTED TO 95% PROCTOR DENSITY. BEDDING SHALL NOT CONTAIN STONES RETAINED ON A 3-INCH RING, FROZEN LUMPS, HIGHLY PLASTIC CLAY, ORGANIC MATERIAL, CORROSIVE MATERIAL, OR OTHER DELETERIOUS FOREIGN MATERIALS. ALL REQUIRED SAFETY PRECAUTIONS FOR SWIRL CONCENTRATOR INSTALLATION ARE THE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE PER OSHA APPROVED METHODS.
- BACKFILL REQUIREMENTS - BACKFILL MATERIALS SHALL BE FINE, READILY COMPACTED SOIL OR GRANULAR FILL MATERIAL, AND COMPACTED TO 90% PROCTOR DENSITY. PROCESSED GRANULAR MATERIALS WITH EXCELLENT STRUCTURAL CHARACTERISTICS ARE PREFERRED. COARSE GRAINED SOILS OF USCS GROUPS GW, GP, GM, GC, SW, AND SP AS DESCRIBED IN ASTM D 2487 ARE GENERALLY ACCEPTABLE MATERIALS WHEN COMPACTED TO 90% PROCTOR DENSITY. BACKFILL SHALL NOT CONTAIN STONES RETAINED ON A 3-INCH RING, FROZEN LUMPS, HIGHLY PLASTIC CLAY, ORGANIC MATERIAL, CORROSIVE MATERIAL, OR OTHER DELETERIOUS FOREIGN MATERIALS. BACKFILLING SHALL CONFORM TO ASTM A 798, SECTION 10, STRUCTURAL BACKFILL PLACEMENT. BACKFILL SHALL BE PLACED IN 6 TO 12 INCH LAYERS OR "LIFTS" AND COMPACTED BEFORE ADDING THE NEXT LIFT. BACKFILL SHALL EXTEND AT LEAST 18 INCHES OUTWARD FROM SWIRL CONCENTRATOR AND FOR THE FULL HEIGHT OF THE SWIRL CONCENTRATOR (INCLUDING RISER(S)) EXTENDING LATERALLY TO UNDISTURBED SOILS.

D" DIAM.	L" LENGTH	QUANTITIES IN TWO HEADWALLS			
		A BARS	B BARS	STEEL REINF.	PLAIN
OF PIPE	WALL	NO.	NO.	NO.	C.Y.
12"	4'-0"	8	4'-0"	8	1.3
15"	5'-0"	8	4'-3"	8	1.7
18"	6'-0"	8	4'-6"	8	2.0
21"	7'-0"	8	4'-9"	8	2.4
24"	8'-0"	8	5'-0"	8	2.8
27"	9'-0"	8	5'-3"	8	3.2
30"	10'-0"	8	5'-6"	8	3.6
33"	11'-0"	8	5'-9"	8	4.0
36"	12'-0"	8	6'-0"	8	4.4

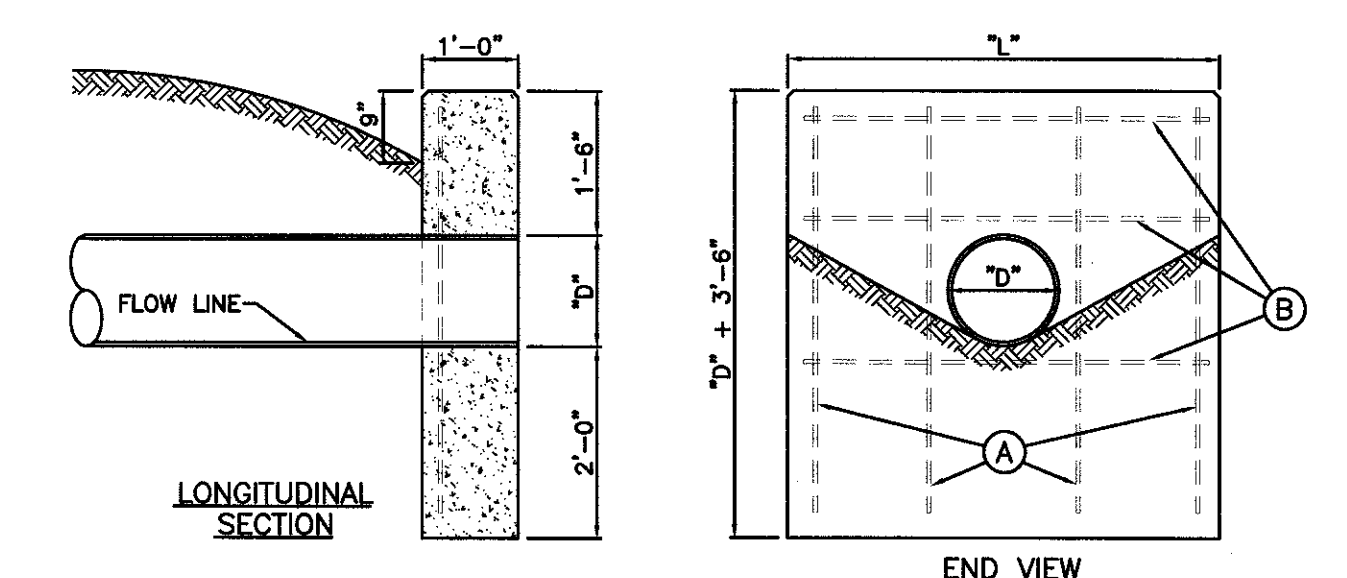


REINFORCED CONCRETE HEADWALL
STANDARD HEADWALL DETAILS
NOT TO SCALE

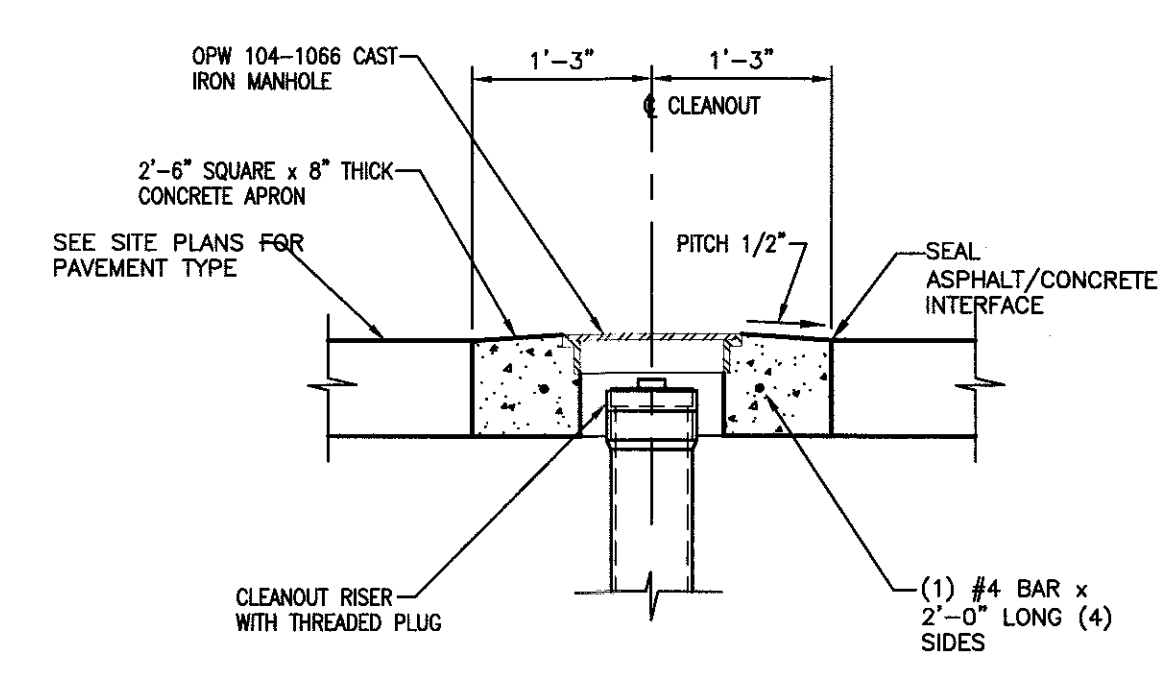



SEWER CLEANOUT DETAIL IN PAVEMENT
NOT TO SCALE

Aqua-Swirl Polymer Coated Steel (PCS)
Stormwater Treatment System

Unless other traffic barriers are present, bollards shall be placed around access riser(s) in non-traffic areas to prevent inadvertent loading by maintenance vehicles.



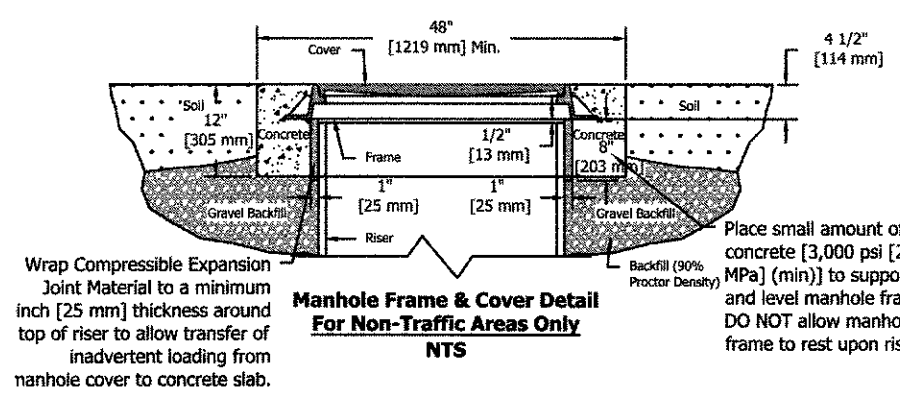


If traffic loading (H-20) is required or anticipated, a 4-foot (1.22 m) diameter, 14-inch (356 mm) thick reinforced concrete pad must be placed over the Stormwater Treatment System Riser to support and level the manhole frame, as shown. The top of riser pipe must be wrapped with compressible expansion joint material to a minimum 1-inch (25 mm) thickness to allow transfer of wheel loads from manhole cover to concrete slab. Manhole cover shall bear on concrete slab and not on riser pipe. The concrete slab shall have a minimum strength of 3,000 psi (20 MPa) and be reinforced with #4 (13 mm) reinforcing steel as shown. Minimum cover over reinforcing steel shall be 1-inch (25 mm). Top of manhole cover and concrete slab shall be level with finish grade.

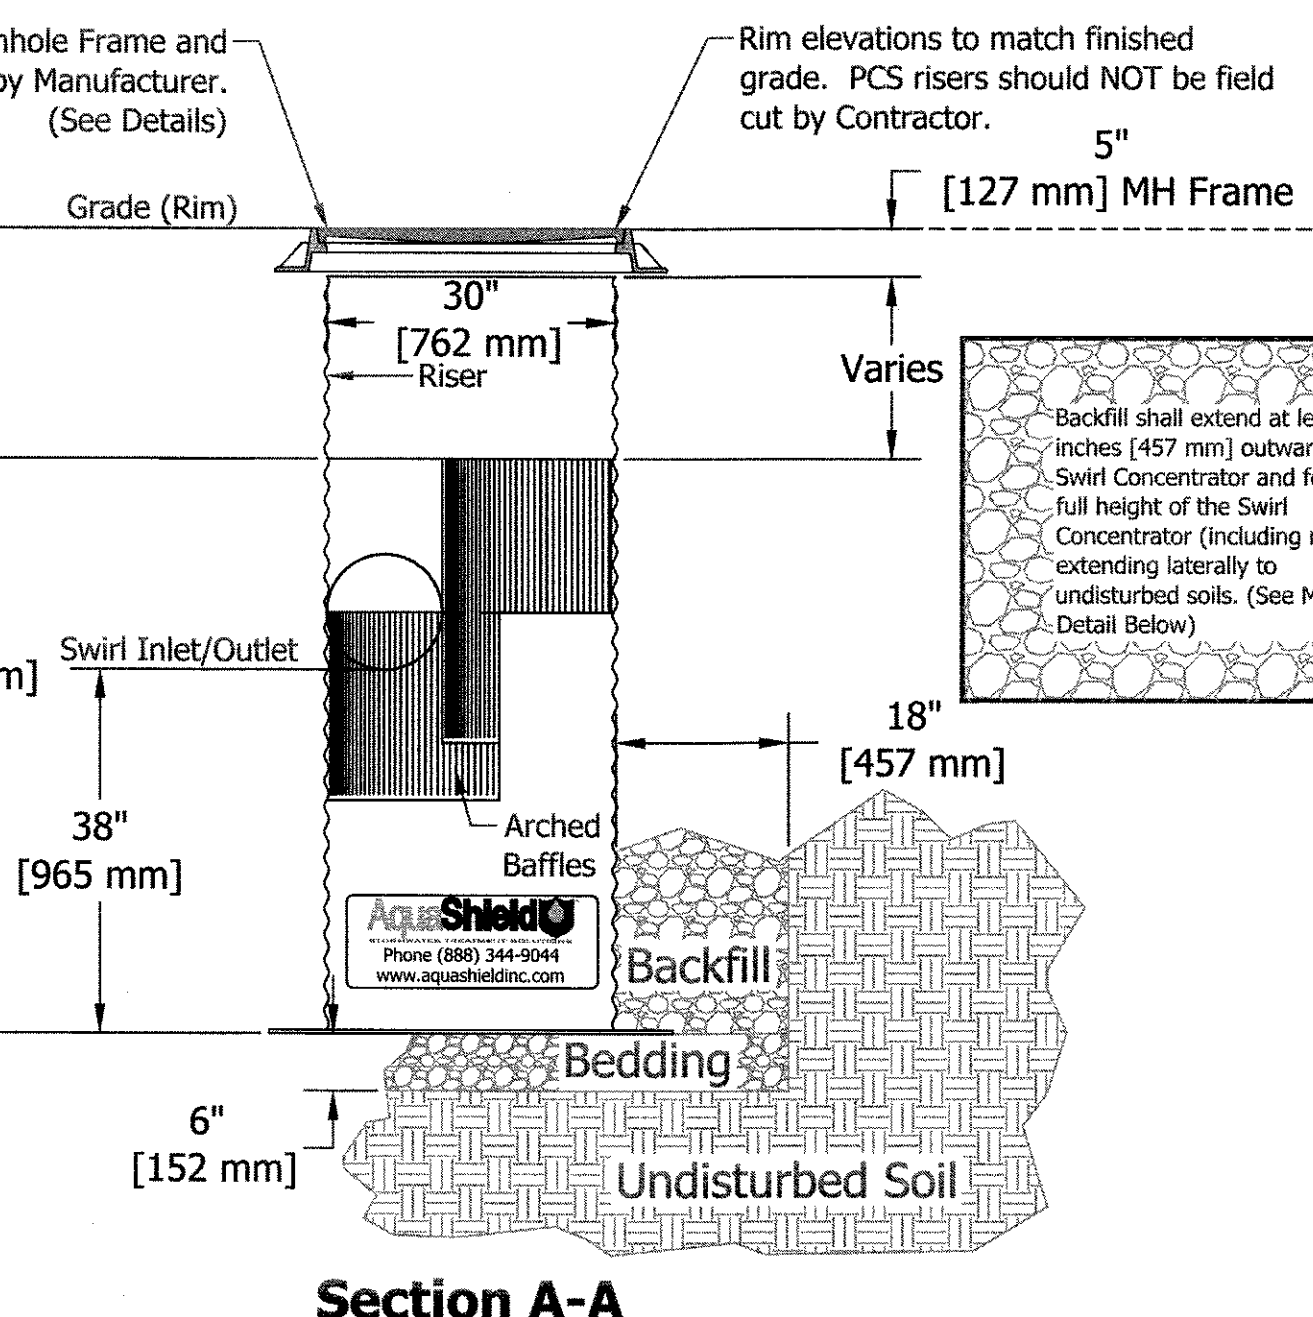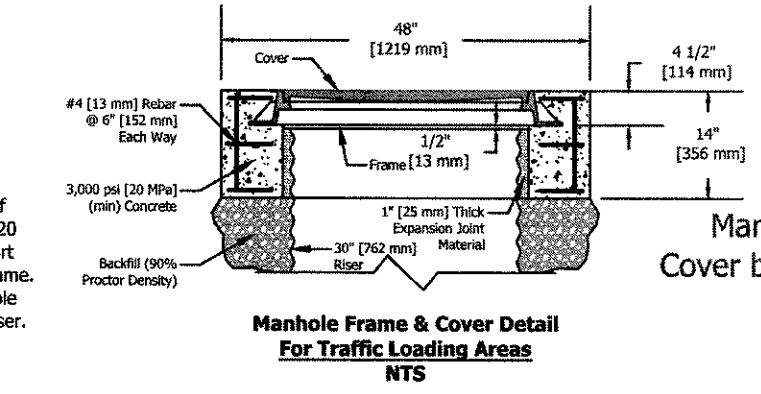



Section A-A

Aqua-Swirl Concentrator Model AS-2 CFD PCS Standard Detail

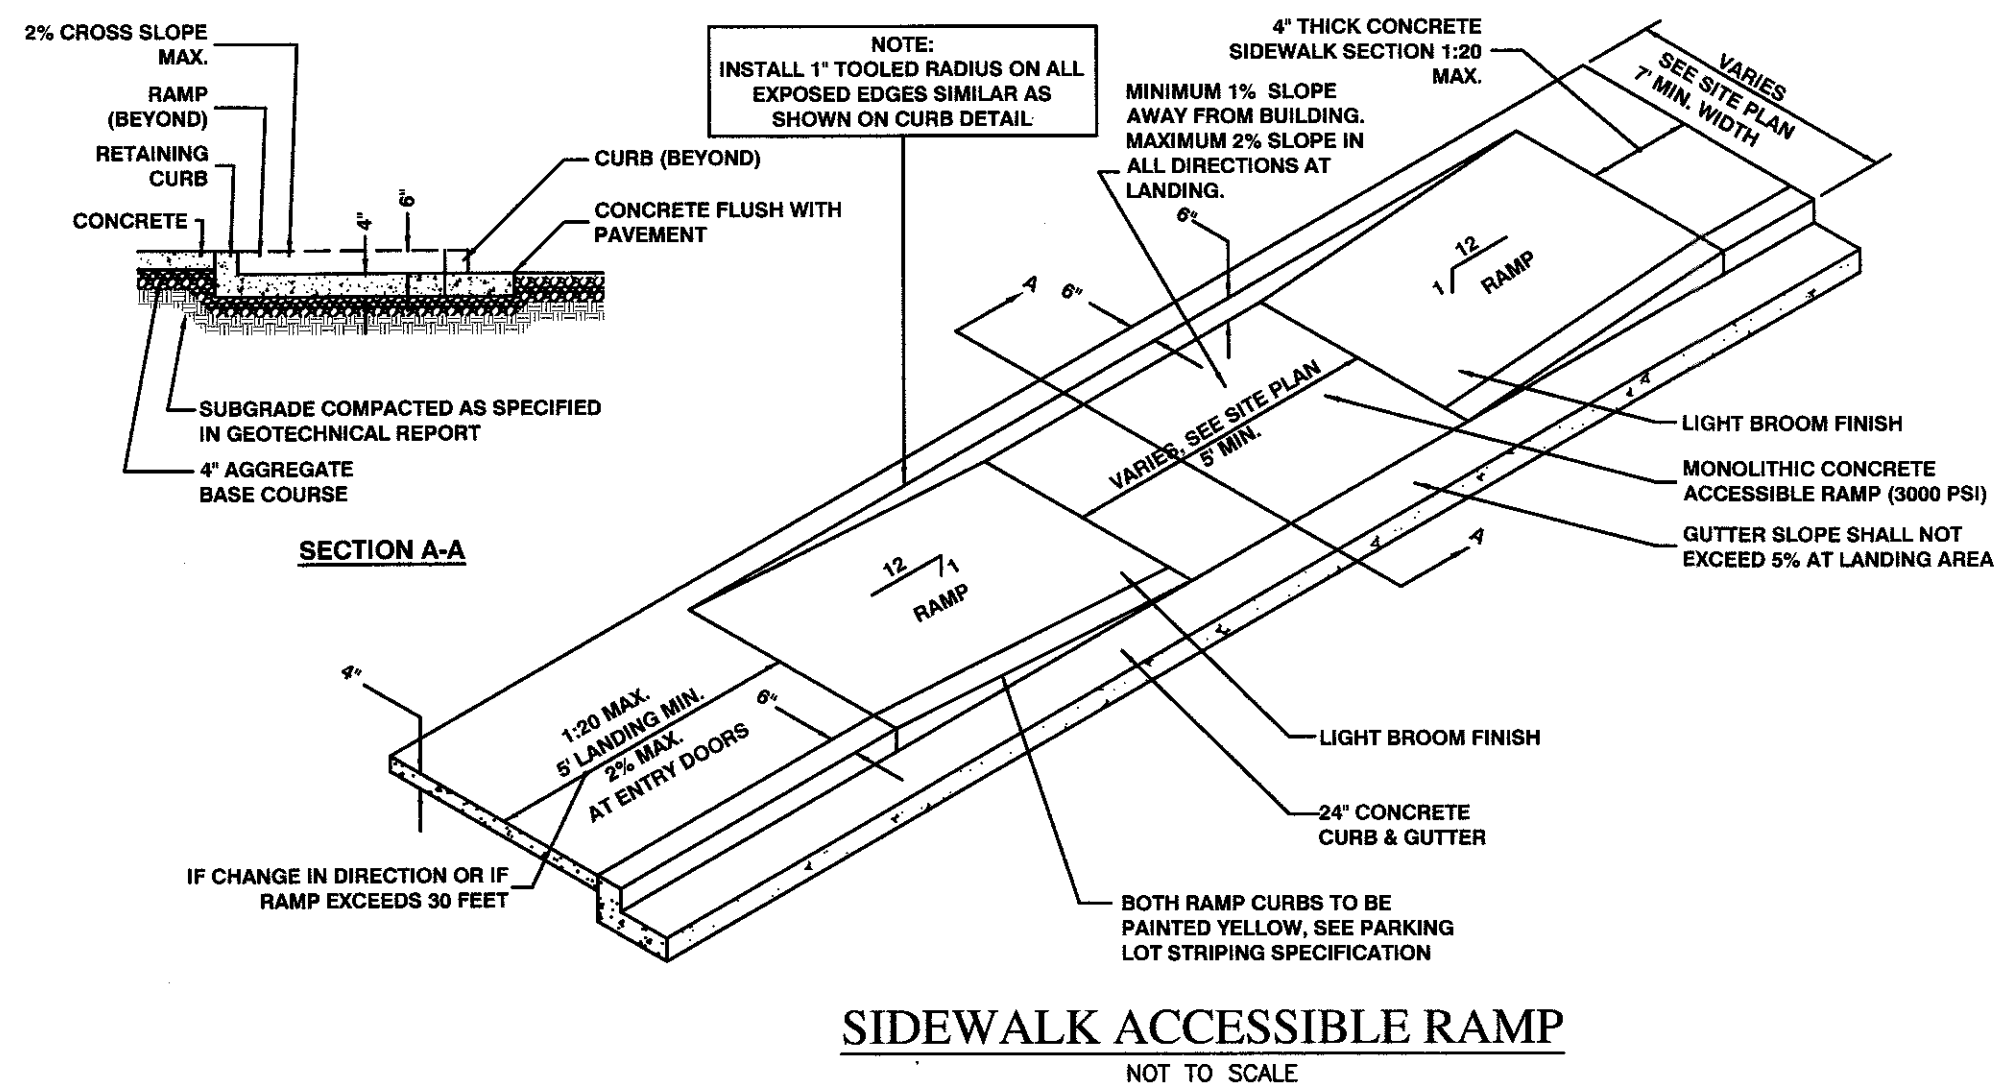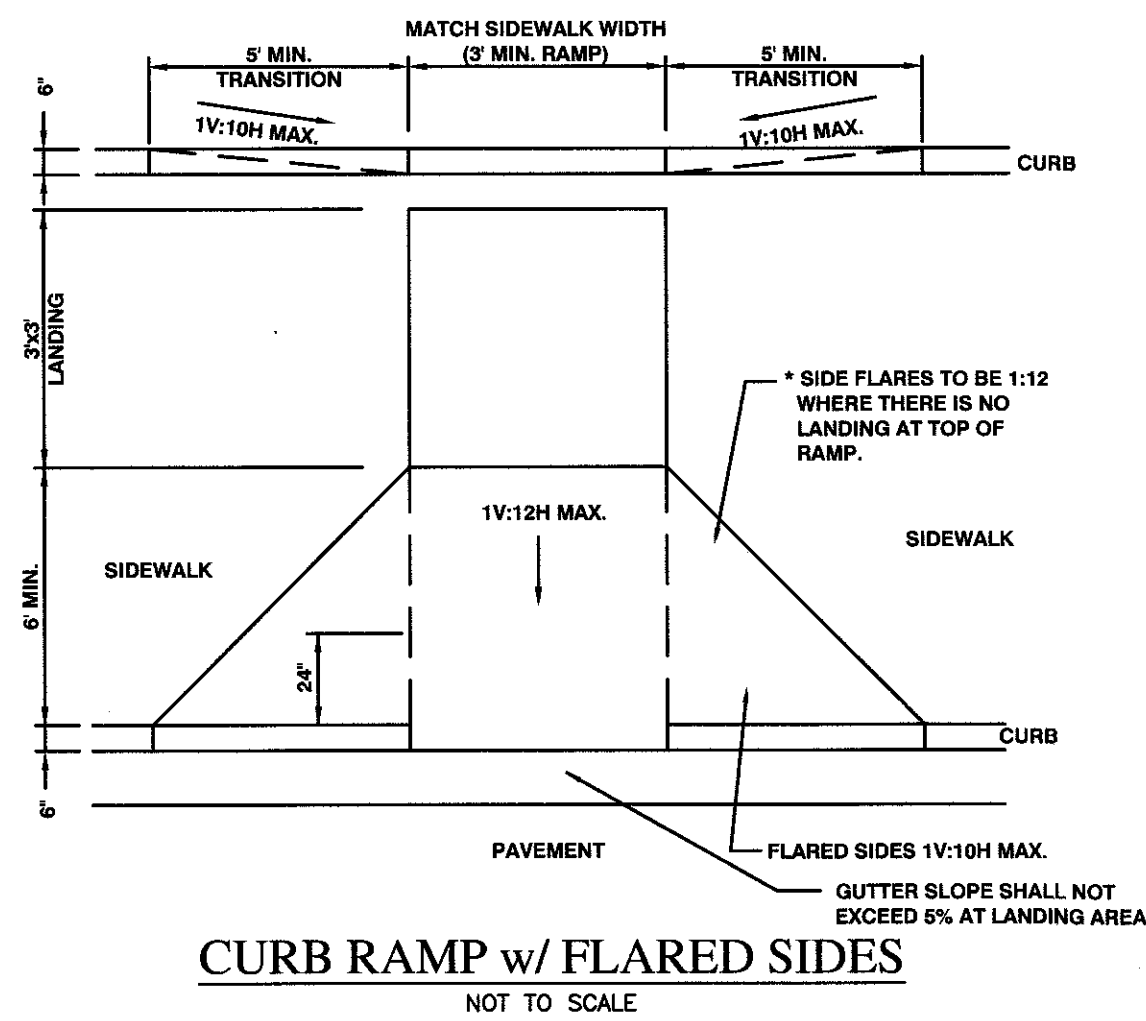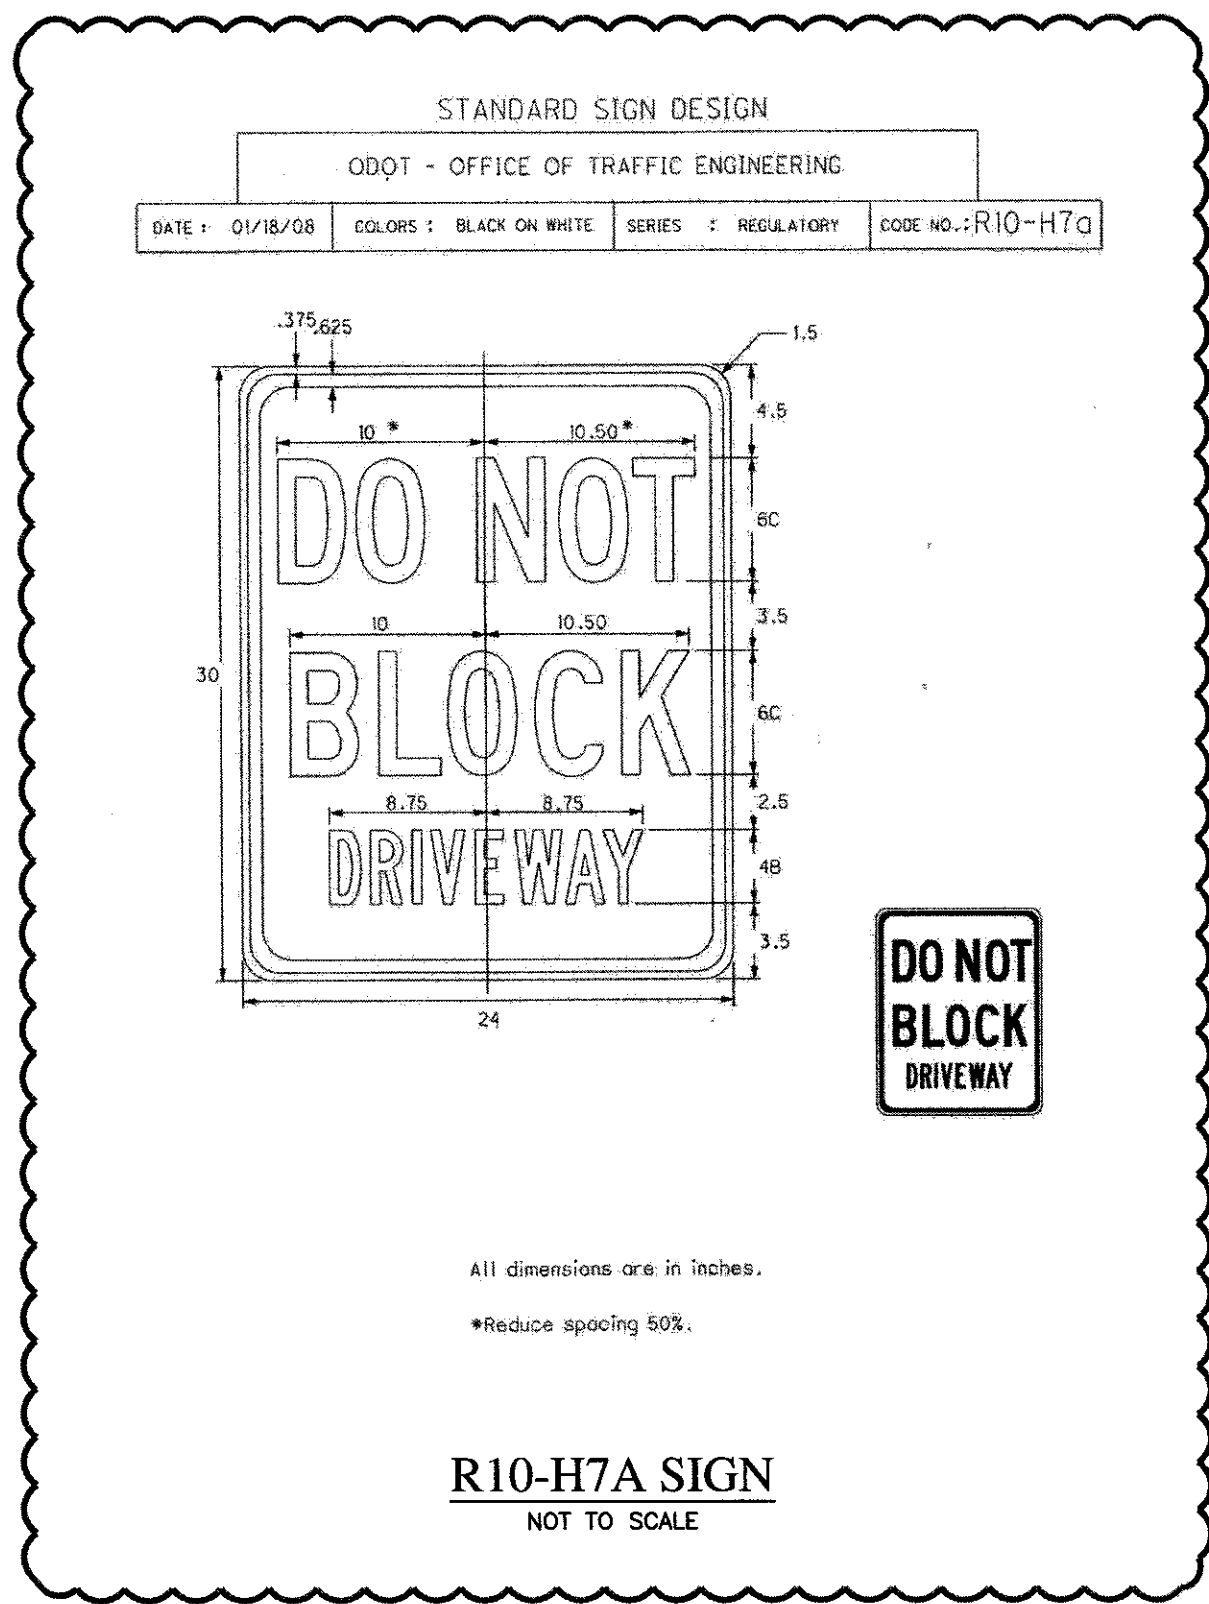

DETECTABLE WARNING NOTES

- A. DETECTABLE WARNINGS SHALL BE ARMOR-TILE "CAST IN PLACE DETECTABLE WARNING SYSTEMS". COLOR SHALL BE BRICK RED. TILES ARE AVAILABLE IN VARIOUS SIZES. CONTRACTOR SHALL USE THE LONGEST STANDARD LENGTH AVAILABLE TO LIMIT THE NUMBER OF TILES NECESSARY. TILES SHALL BE INSTALLED PER THE MANUFACTURER'S INSTRUCTIONS. REFER TO WEB SITE OR CONTACT MANUFACTURER FOR INSTALLATION INSTRUCTIONS AND SPECIFICATIONS:
- ARMOR-TILE
<http://www.armor-tile.com/truncateddome/cast-in-place.htm>
 ENGINEERED PLASTICS, INC.
 300 INTERNATIONAL DRIVE SUITE 100
 WILLIAMSVILLE, NY 14221
 1-800-682-2525
- B. SUBSTITUTIONS ARE NOT PERMITTED.
- C. NOT TO BE INSTALLED IN THE ROW

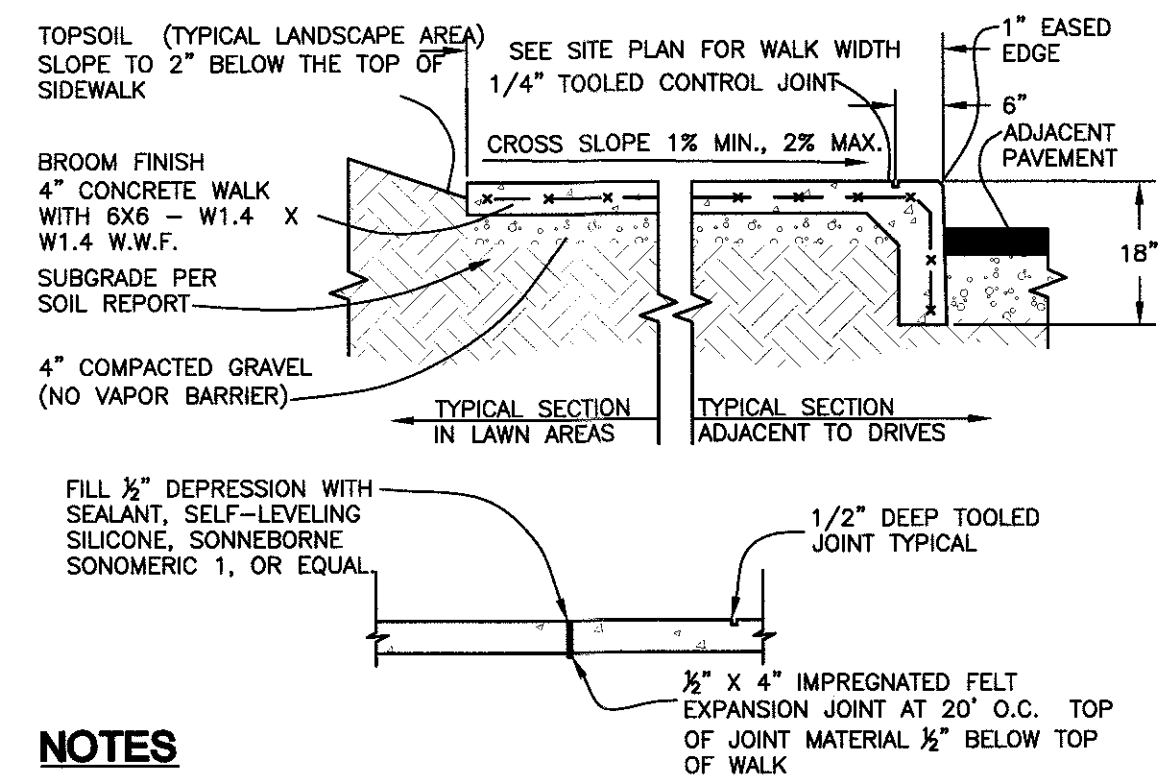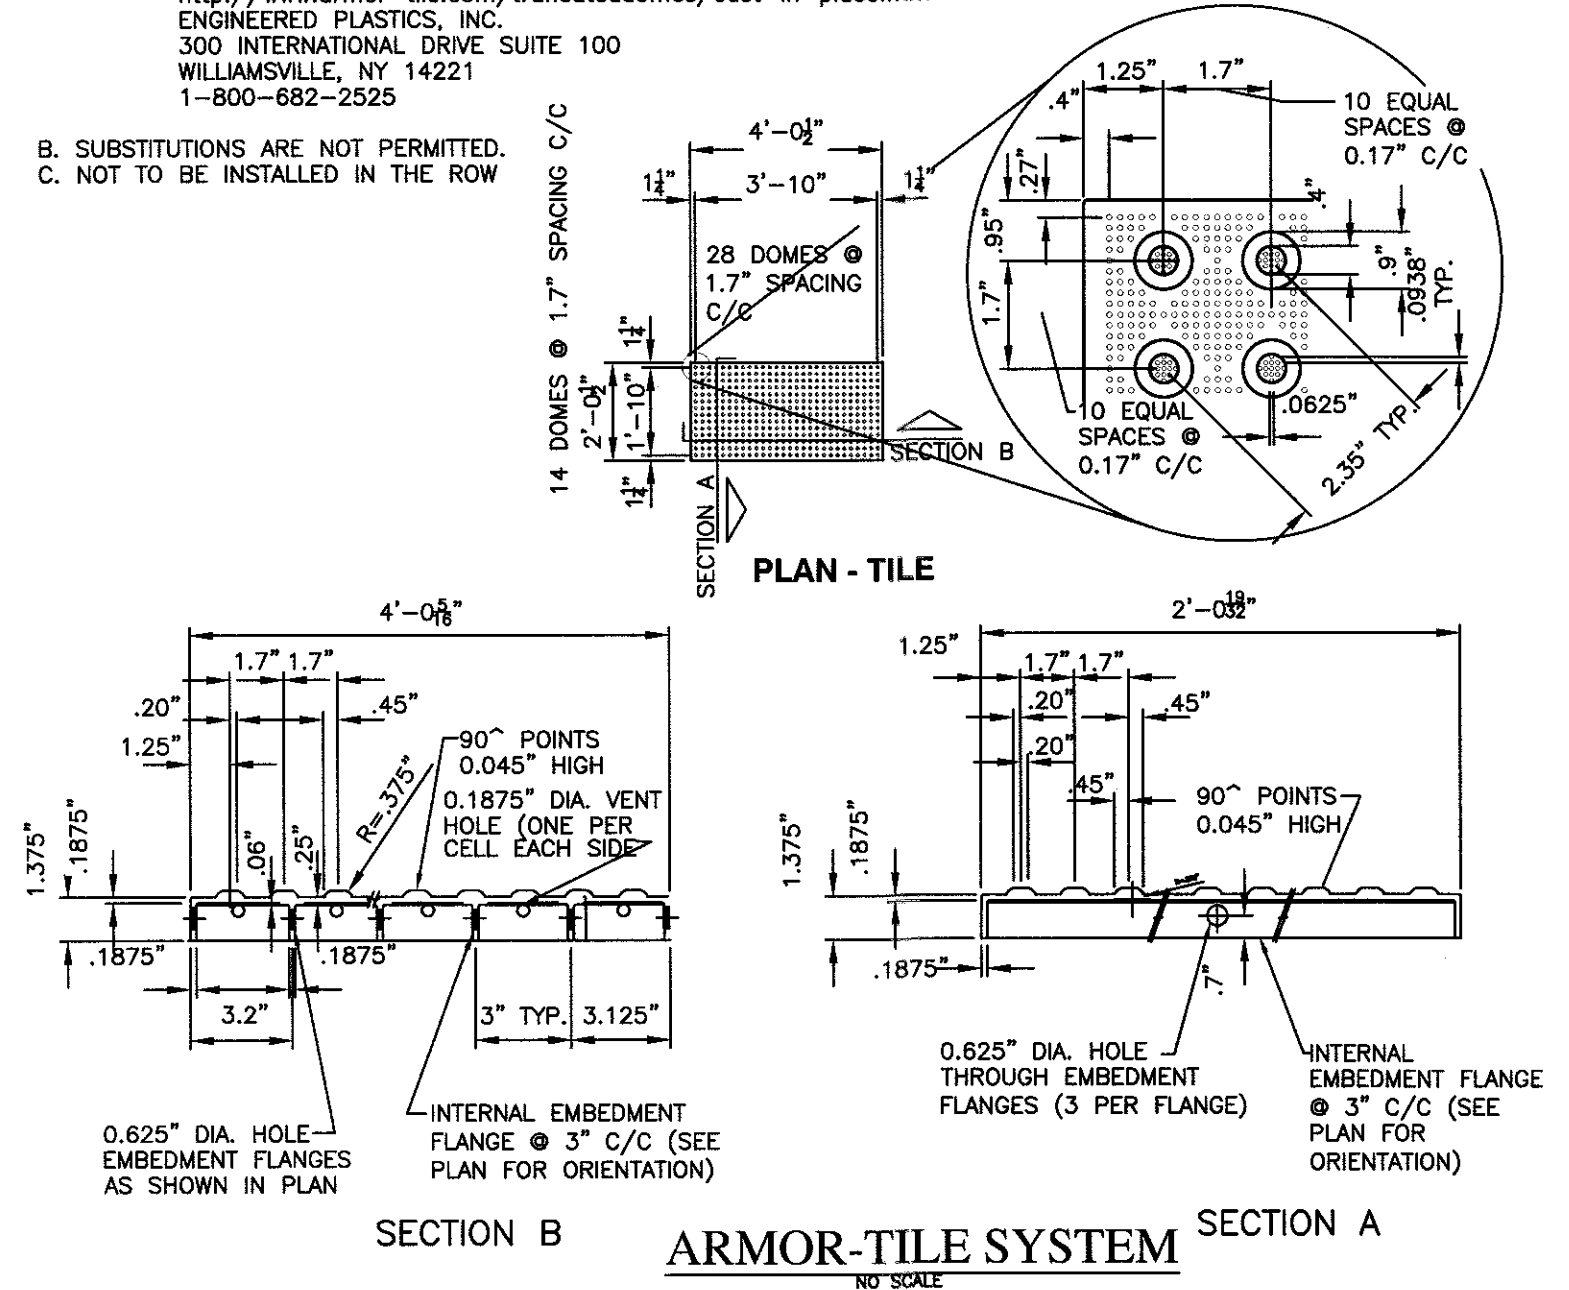


NOTES



- A. $\frac{1}{4}$ " TOOLED CONTROL JOINTS AT 4' TO 7' O.C.
- B. PLACE PRE-FORMED $\frac{1}{2}$ " EXPANSION JOINT 30' O.C. ALONG ENTIRE LENGTH
- C. $\frac{1}{2}$ " PRE-FORMED EXPANSION JOINT SHALL BE INSTALLED AT ALL INTERSECTIONS OF BUILDING, WALKS, AND ANY OTHER FIXED STRUCTURE.
- D. CONCRETE SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 4000 PSI
- E. ALL EDGES TO BE "PICTURE FRAMED" TOOLED FINISH.

NOTES:

1. JOINTS AT 5'-0" O.C. TOOLED $\frac{1}{4}$ " WIDE, 1" DEEP OR MAX. $\frac{1}{2}$ " DEEP WHICHEVER IS GREATER. EXPANSION JOINTS AT 20' MAX. & ALL P.C.s, UNLESS APPROVED OR INDICATED OTHERWISE ON PLAN VIEW JOINT PATTERN.

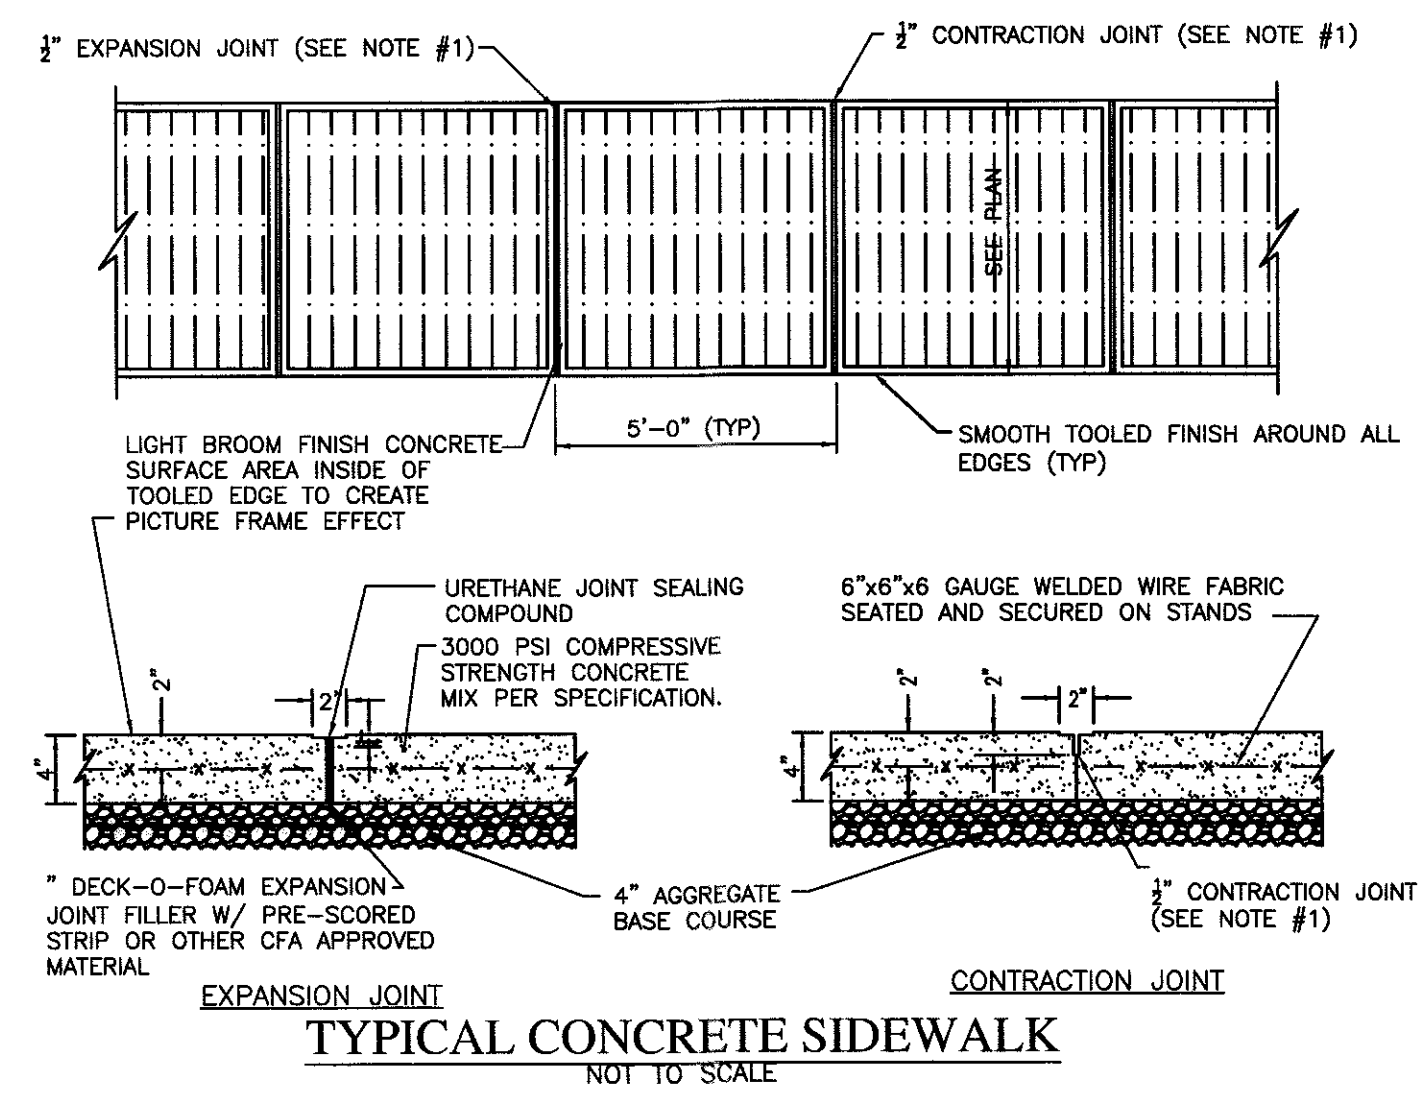

REVISIONS
 A 10/09/2015
 B 10/19/2015
 C 11/06/2015

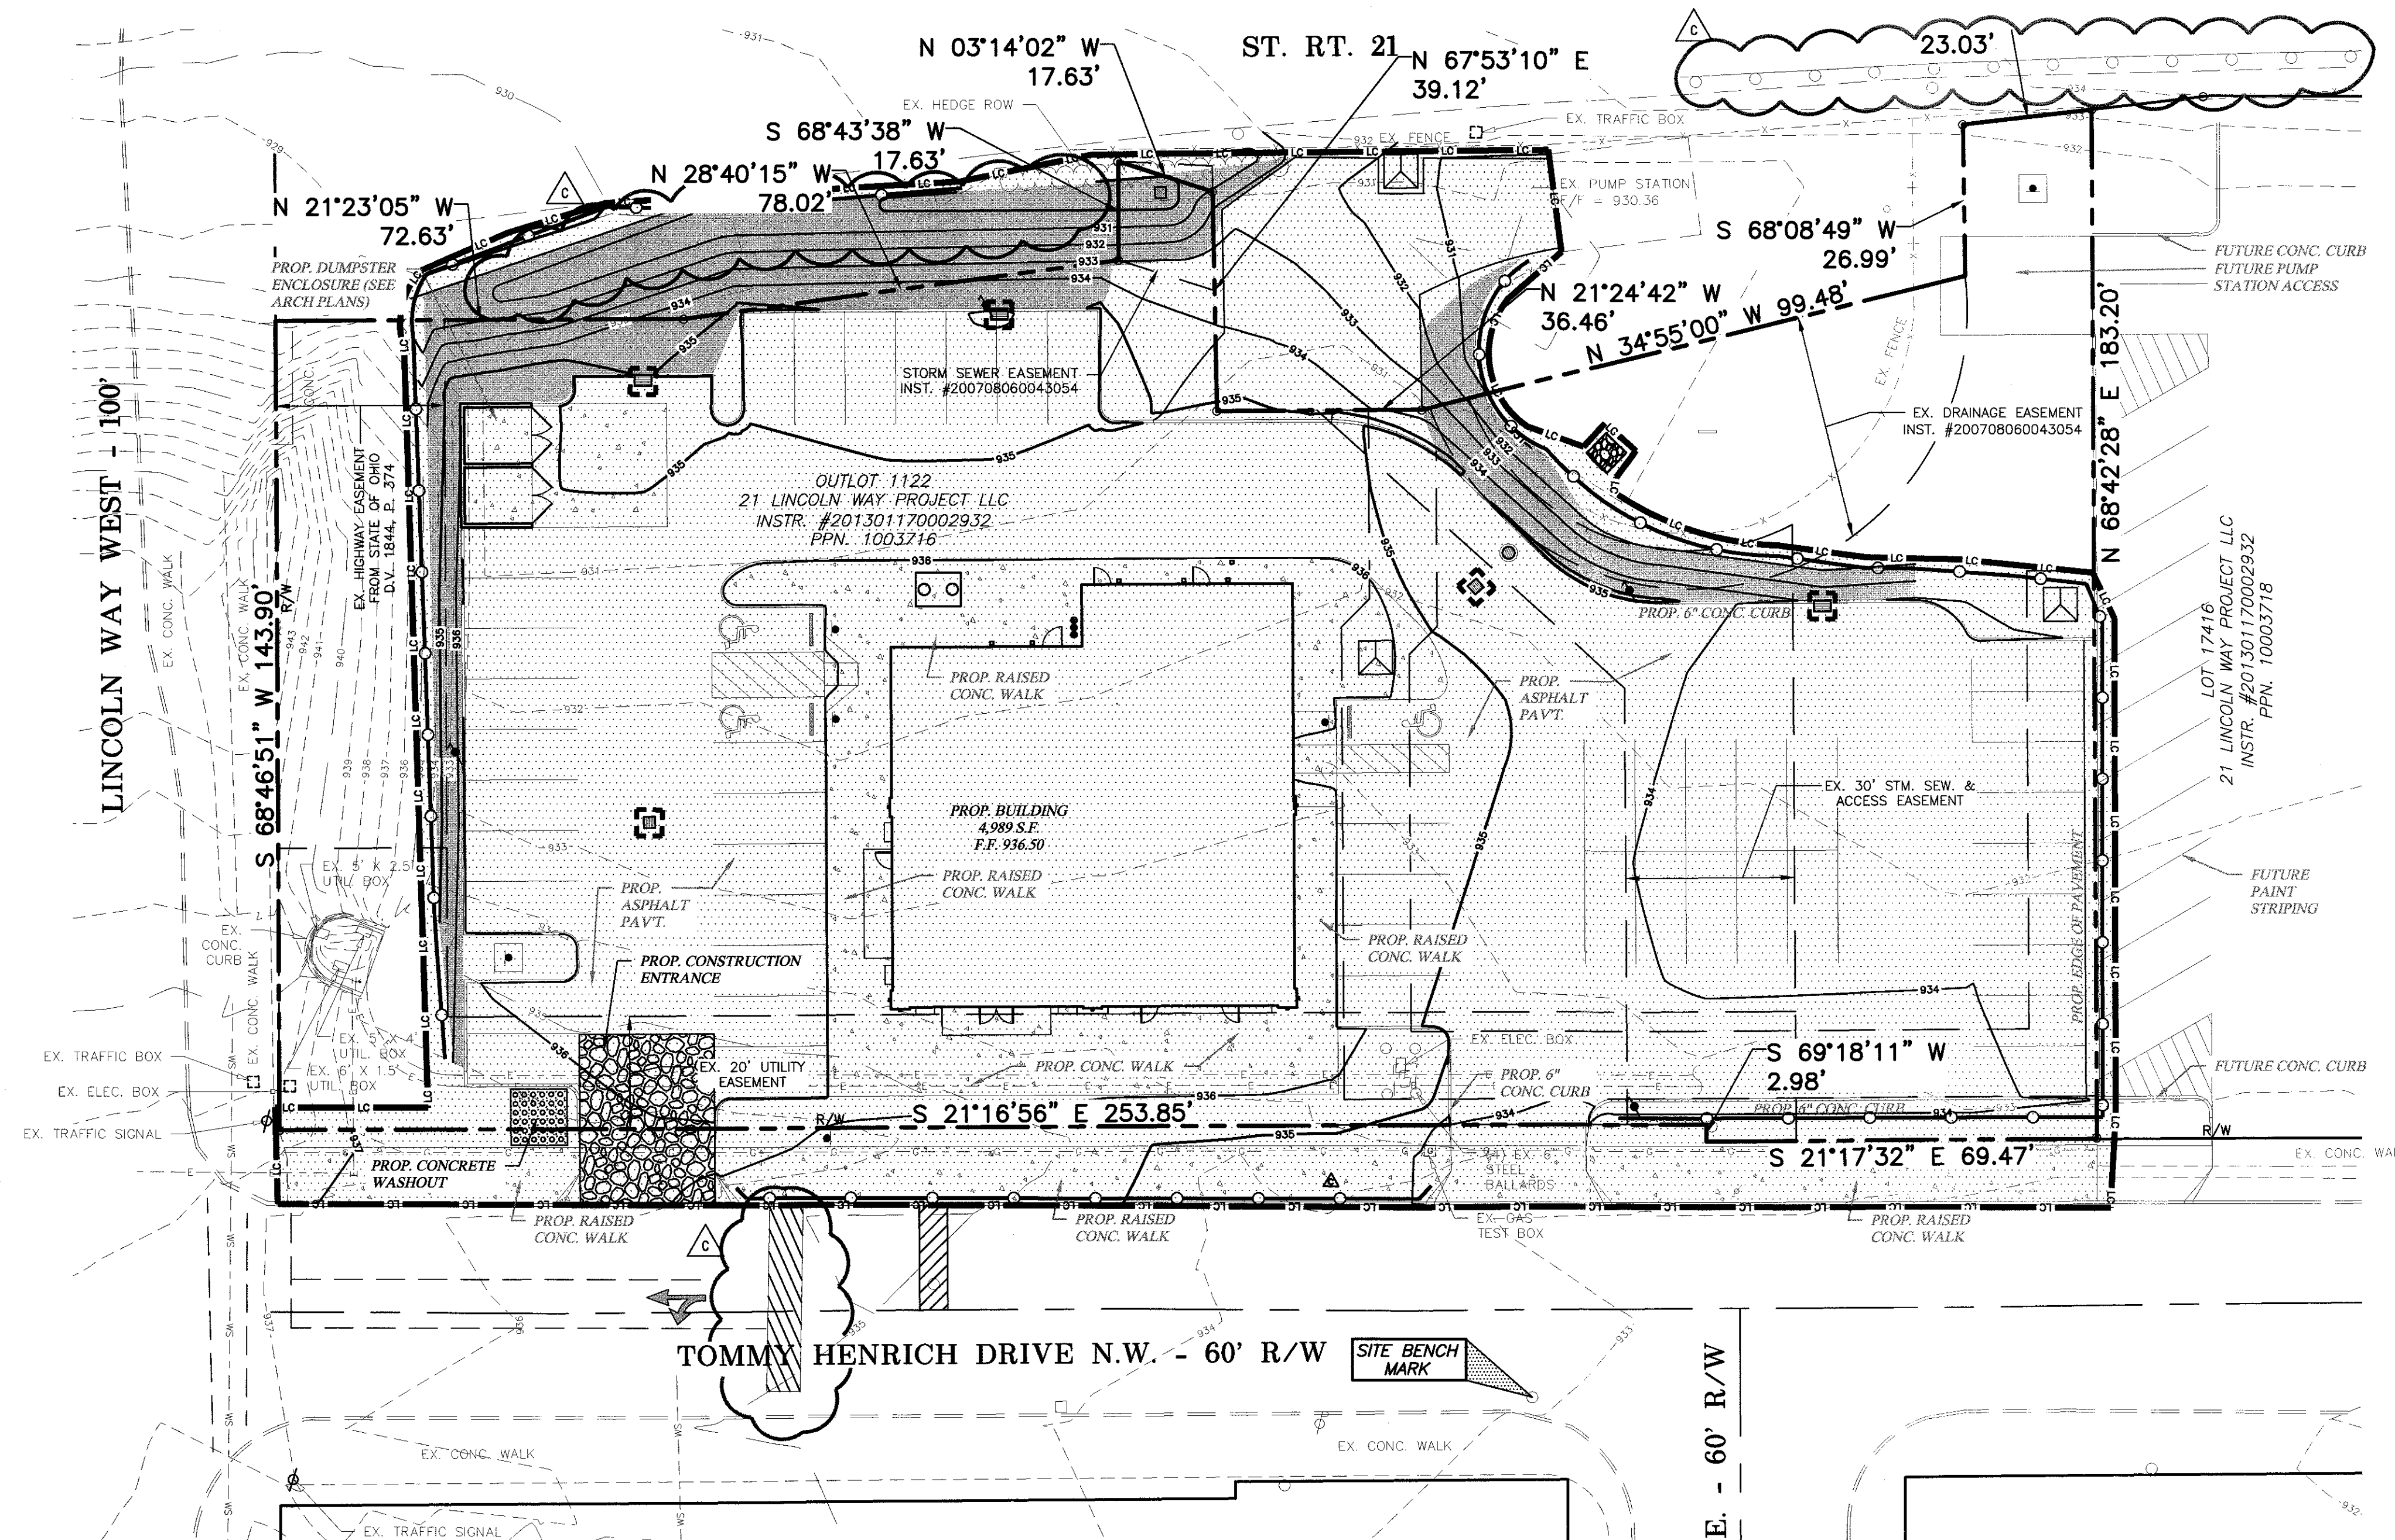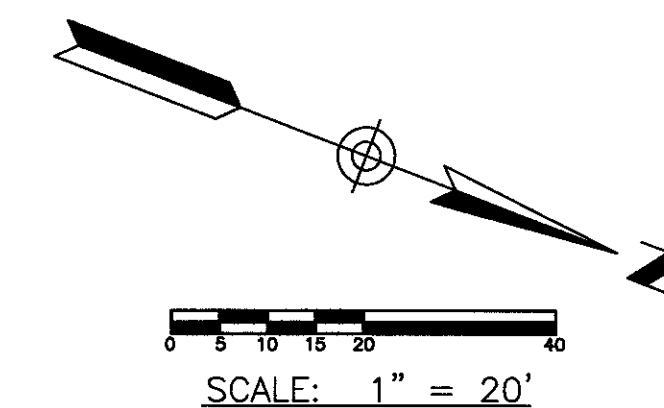

SYMBOL	ITEM REFERENCE
[Pattern]	AREA OF CLEARING, GRUBBING
[Pattern]	TEMPORARY CONSTRUCTION ENTRANCE
[Pattern]	CEMENT TRUCK WASHOUT
[Pattern]	OUTLET PROTECTION
[Pattern]	EXCELSIOR MATTING, O.D.O.T. ITEM 712.11 TYPE "C" ON ALL SWALES, SLOPES UP TO 3:1 AND THE POND BANKS UNLESS OTHERWISE NOTED.
[Symbol]	INLET PROTECTION
[Line]	CONSTRUCTION LIMITS
[Line]	SILT FENCE

SITE BENCH MARK 1
TOP OF STORM MANHOLE FOUND IN ROAD
ELEVATION = 933.06

GRADING, STABILIZATION, & SWP3 AMENDMENT ACTIVITIES

	DATE(S)
GRADING	
SITE STABILIZATION	
SWP3 AMENDMENTS	

CONSTRUCTION SITE & SWP3 RESPONSIBLE PARTY
 21 LINCOLN WAY PROJECT LLC
 SUITE 301
 3951 CONVENIENCE CIRCLE N.W.
 CANTON, OH 44718
 REP: PATRICK SIRPILLA

SWP3 PREPARED 6/26/15

ESTIMATED CONSTRUCTION
 START DATE 08/03/15
 ESTIMATED CONSTRUCTION
 COMPLETION DATE 11/02/16

*THE CONTRACTOR SHALL PREVENT AND/OR REDUCE AND CONTROL SOIL EROSION RESULTING FROM THE PROPOSED IMPROVEMENTS. THE USE OF SILT FENCING, JUTE MATTING, TEMPORARY SEEDING, SILT CHECKS, INLET PROTECTION AROUND ALL CATCH BASINS, STABILIZED CONSTRUCTION ENTRANCE(S), ETC. WILL BE REQUIRED. SEDIMENT CONTROL STRUCTURES/DEVICES SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE MANUAL RAINWATER AND LAND DEVELOPMENT - OHIO'S STANDARDS FOR STORM WATER MANAGEMENT, LAND DEVELOPMENT AND URBAN PROTECTION. SEDIMENT CONTROL DEVICES MUST BE INSTALLED PRIOR TO BEGINNING ANY CONSTRUCTION ACTIVITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONTINUED INSPECTION AND MAINTENANCE OF ALL SEDIMENT CONTROL DEVICES. THE CONTRACTOR SHALL FOLLOW THE REQUIREMENTS SET FORTH ON THE APPROVED STORM WATER POLLUTION PREVENTION PLAN IF APPLICABLE, OR AS DETAILED ON THE CONSTRUCTION PLANS, AS SPECIFIED BY THE CITY OF MASSILLON.

PLAN CERTIFICATION

I, THE UNDERSIGNED, CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHED DOCUMENTS WERE PREPARED UNDER MY DIRECTION AND SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHERED AND EVALUATED THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGED THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

OWNER

DATE 8/7/15

GBC DESIGN, INC.
 565 White Pond Dr.
 Akron, OH 44320
 Phone 330-586-0228 Fax 330-586-5762

21 LINCOLN WAY PROJECT LLC
 SUITE 301
 3951 CONVENIENCE CIRCLE N.W.
 CANTON, OH 44718

DEVILLE 21 LINCOLN WAY
 OUT LOT 1122
 MASSILLON, OHIO
 SWPPP



DRAWN BY:
 T.G.W.

DATE:
 6/26/2015

PROJECT NO.
 47190

DRAWING NO.

SD7.00

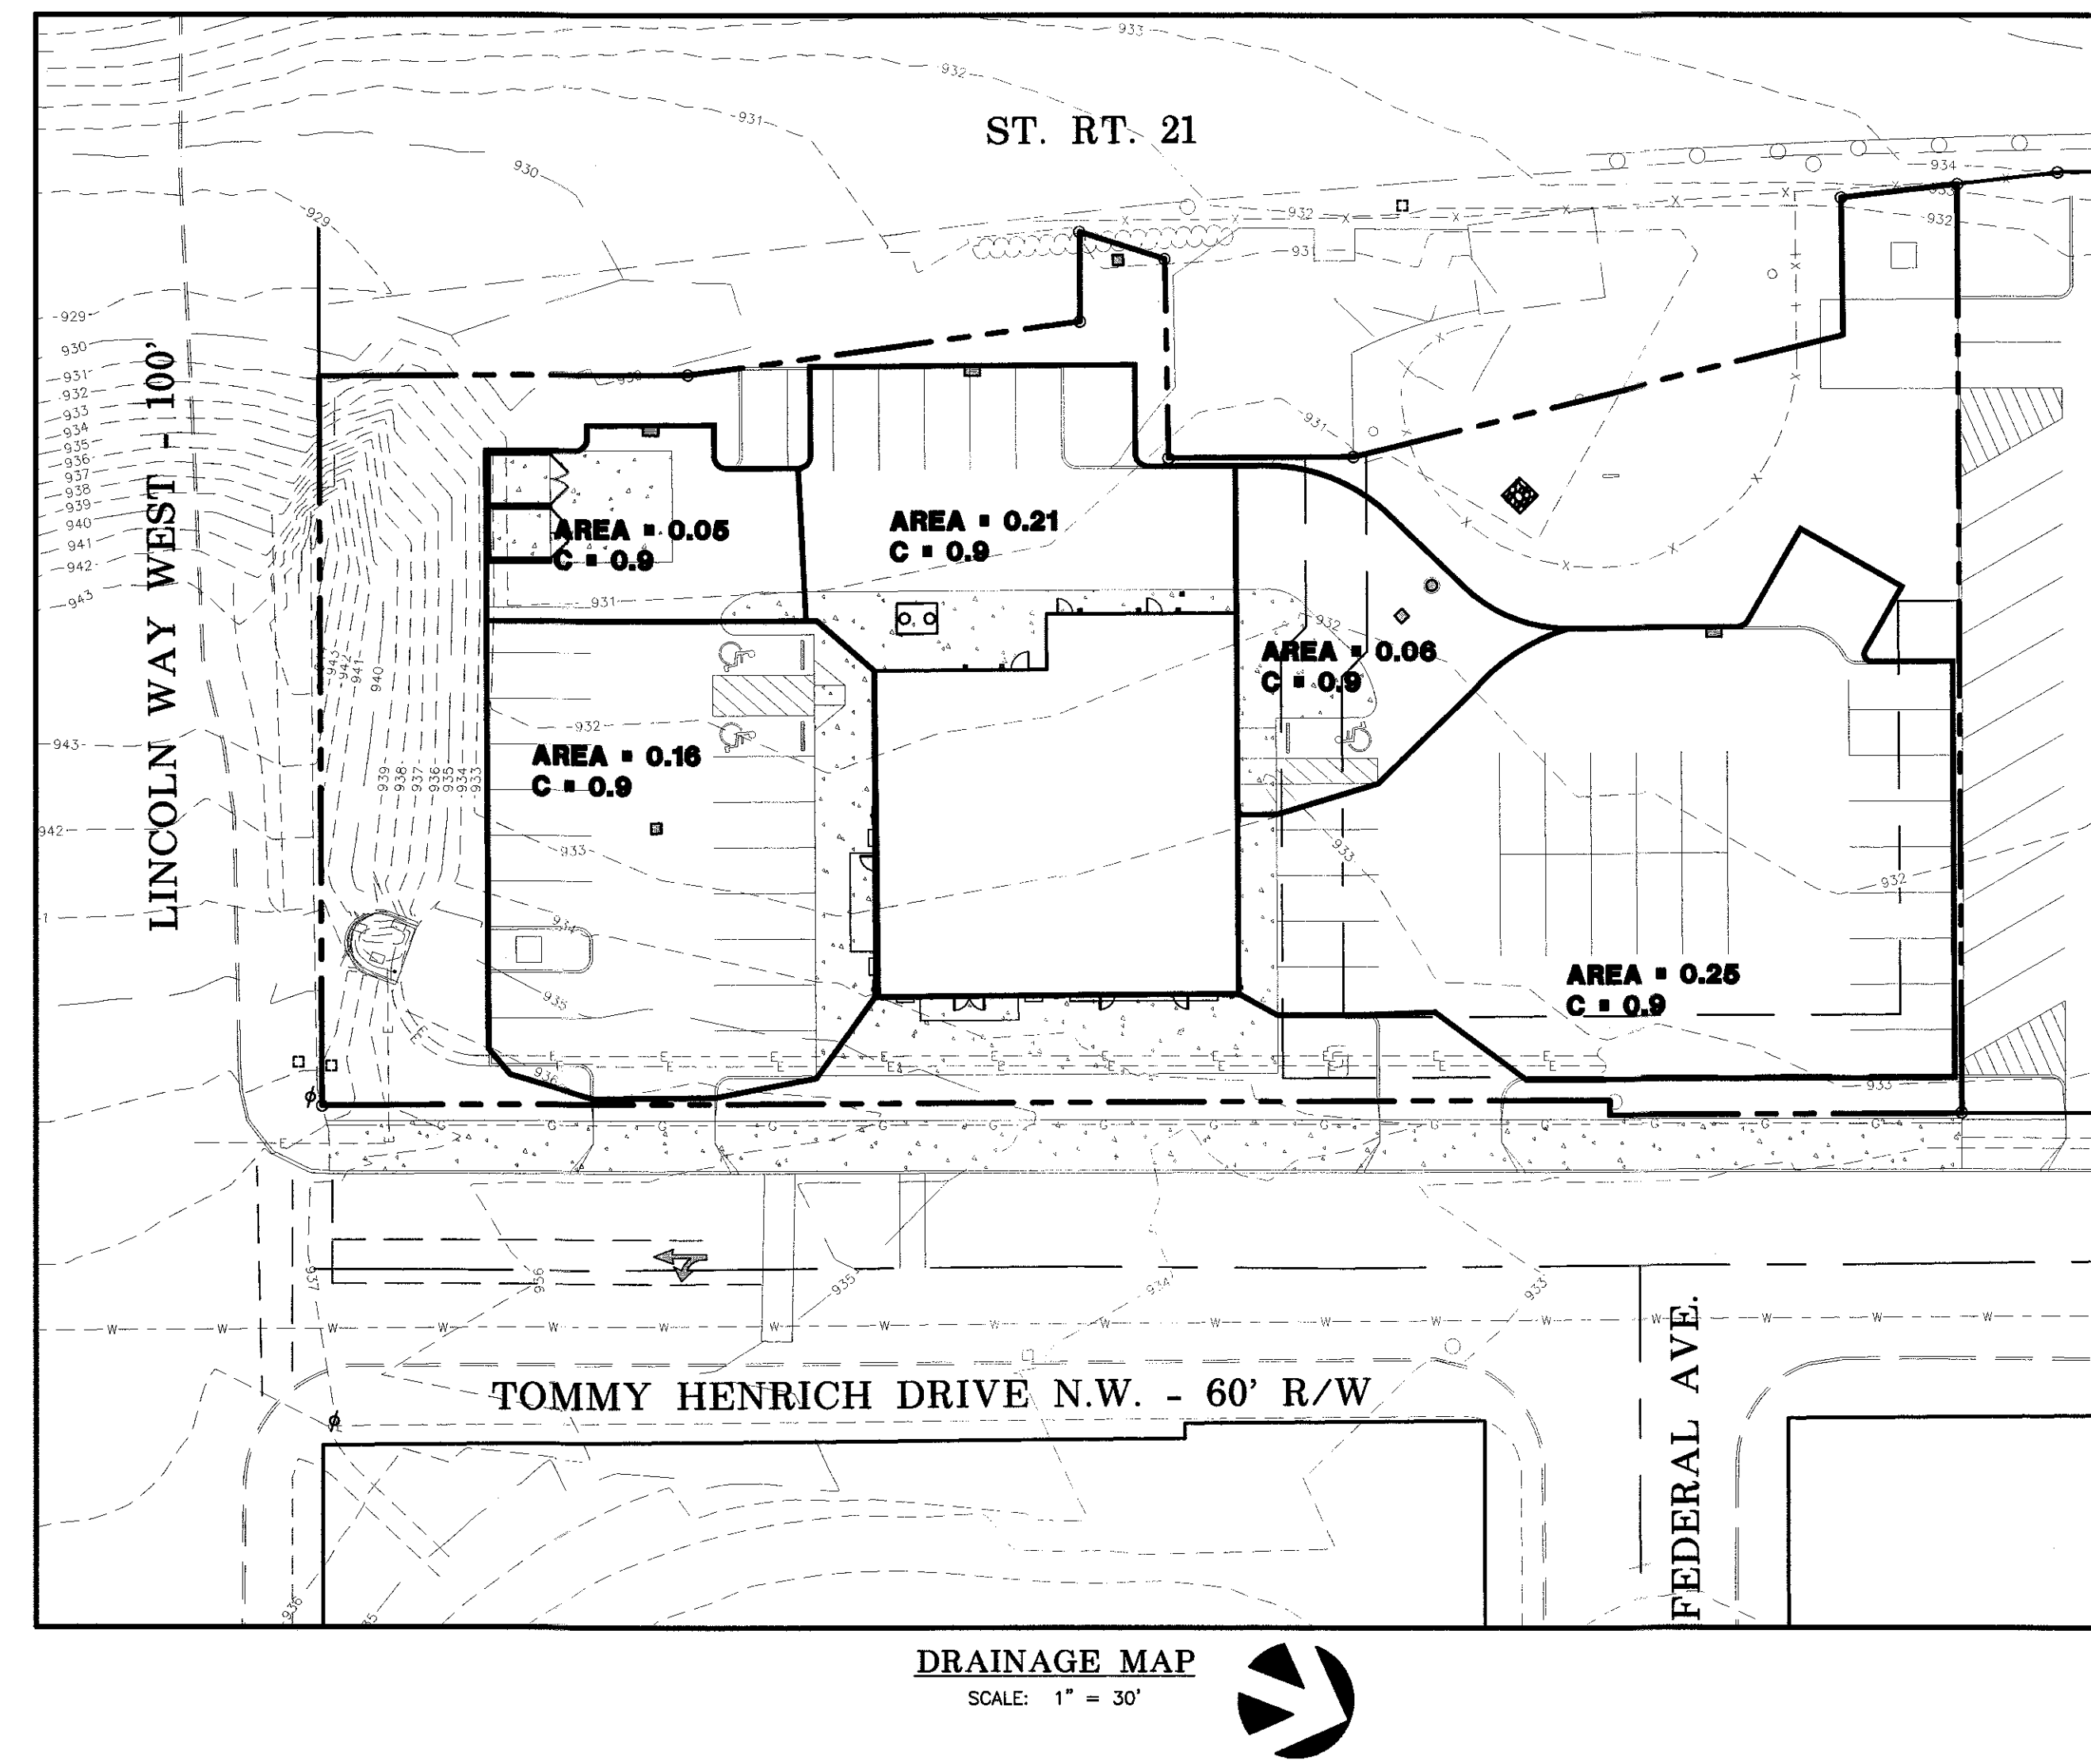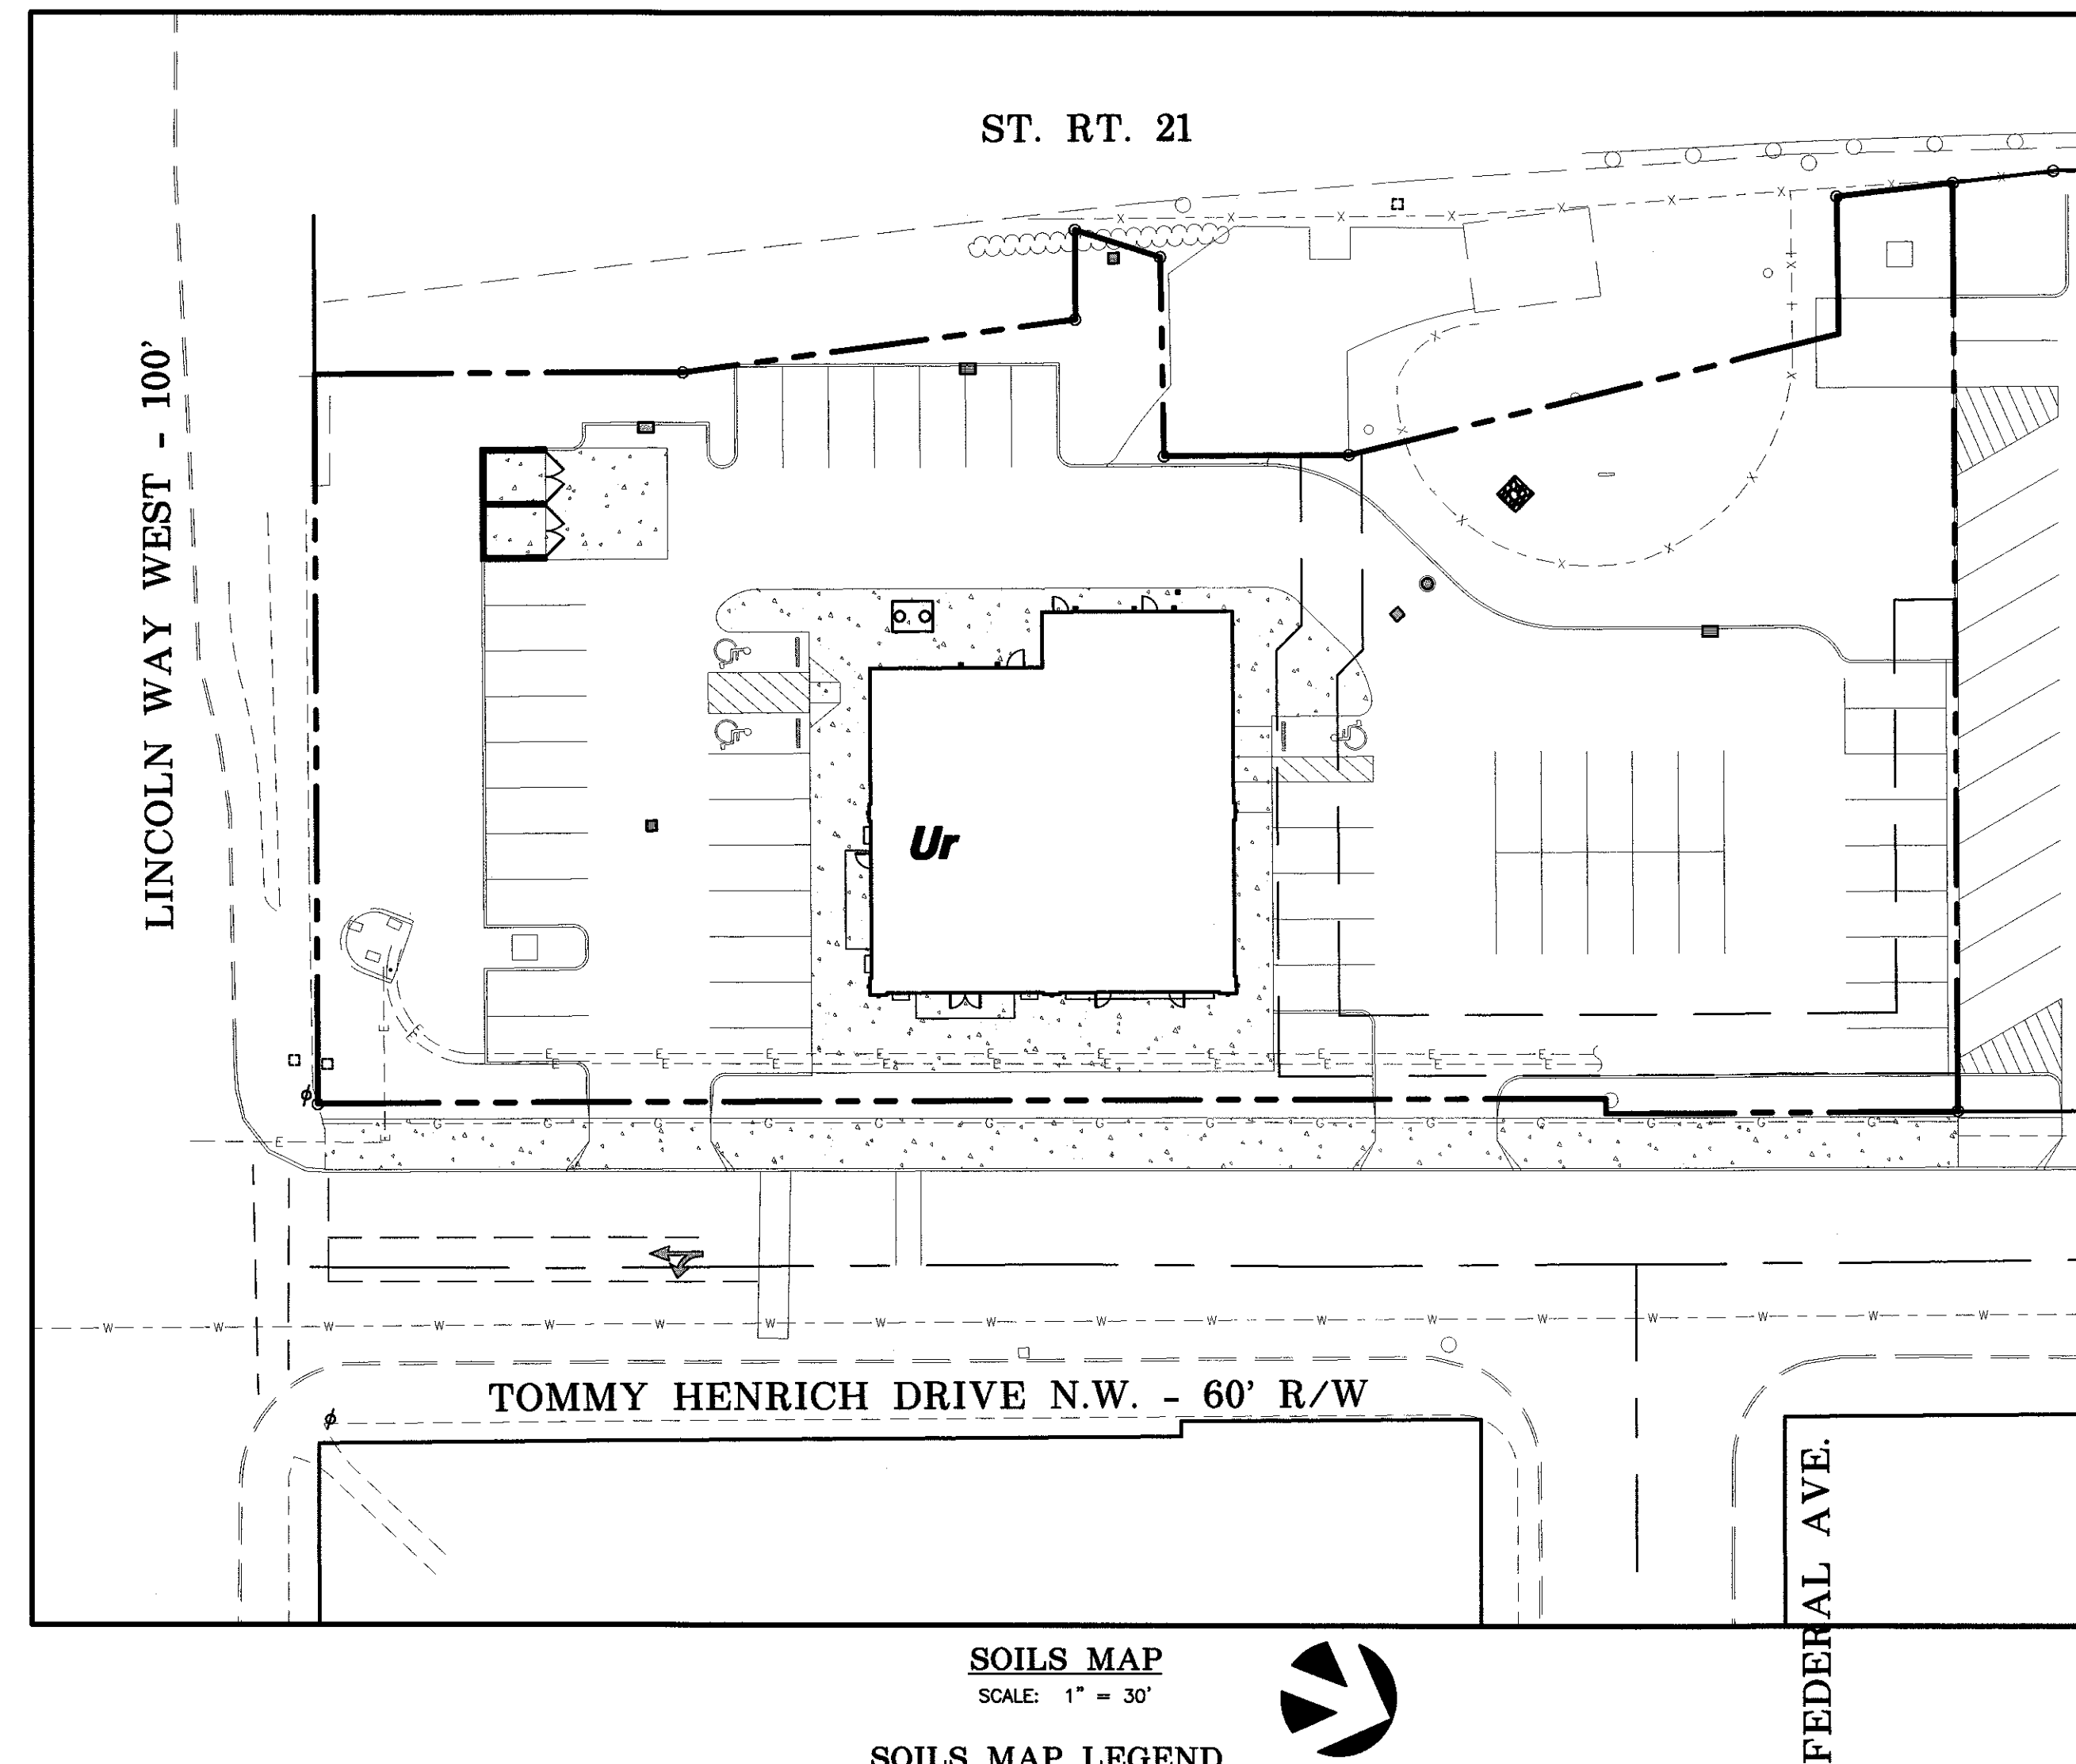

INSPECTIONS SHALL BE MADE ONCE EVERY SEVEN (7) CALENDAR DAYS AND WITHIN 24 HOURS AFTER ANY STORM EVENT GREATER THAN ONE-HALF INCH OF RAIN PER 24 HOUR PERIOD.

[illegible]

PART III G. SWP3 REQUIREMENTS

1. a. COMMERCIAL BUILDING AND SITE UTILITIES
b. TOTAL SITE AREA = 1.0846 AC. - DISTURBED AREA = 1.08 AC.
c. PRE-CONSTRUCTION RUNOFF COEFFICIENT - C=0.45; POST-CONSTRUCTION RUNOFF COEFFICIENT (WEIGHTED) C=0.90.
d. IMPERVIOUS AREA = 0.78 AC., PERCENT IMPERVIOUS = 72%.
e. SOIL TYPES
• Ur URBAN LAND
f. PRIOR LAND USE - VACANT.
g. CONSTRUCTION SEQUENCE - SEE IMPROVEMENT PLANS
h. TUSCARAWAS RIVER
i. NOT SUBDIVIDED (MEASURES IDENTIFIED ON PLANS)
j. NOT APPLICABLE
k. PERMIT REQUIREMENTS ATTACHED. (FIELD COPY)
l. IDENTIFIED ON SHEET SD7.00 & SD7.01
m. IDENTIFIED ON SHEET SD7.00 & SD7.01
n.
(i) LIMITS OF CONSTRUCTION IDENTIFIED ON THE PLANS (LC).
(ii) SOIL TYPES IDENTIFIED ON THE PLANS
(iii) DRAINAGE WATER SHEDS IDENTIFIED ON THE PLANS.
(iv) DELINEATED WETLANDS & STREAMS HAVE BEEN SHOWN ON THE PLANS.
(v) EXISTING & PLANNED LOCATIONS OF BUILDINGS, ROADS, PARKING FACILITIES AND UTILITIES ARE IDENTIFIED ON THE PLANS.
(vi) EROSION AND SEDIMENT CONTROL PRACTICES ARE IDENTIFIED ON THE PLANS.
(vii) SEDIMENT & STORM WATER MANAGEMENT DATA IS IDENTIFIED ON THE PLANS.
(viii) PERMANENT MANAGEMENT PRACTICES ARE IDENTIFIED ON THE PLANS.
(ix) CEMENT TRUCK WASHOUT, DUMPSTER & VEHICLE FUELING AREA ARE IDENTIFIED ON THE PLANS.
(x) CONSTRUCTION ENTRANCE IS IDENTIFIED ON THE PLANS.
(xi) NOT APPLICABLE
2. A. NOT APPLICABLE.
B. TEMPORARY SEEDING AND PERMANENT SEEDING MEASURES ARE IDENTIFIED ON THE PLANS.
(i) TABLE 1 & TABLE 2 HAVE BEEN IDENTIFIED ON THE PLANS.
(ii) CHANNELS TO BE STABILIZED w/ MATTING & SEEDING & MULCHING.
C. SHEET FLOW RUNOFF HAS BEEN CONTROLLED BY MEANS OF SILT FENCE AND DIRECTED TOWARDS UNDISTURBED SOILS. POINT DISCHARGES HAVE BEEN CONTAINED WITHIN STORM SEWERS.
D. SEDIMENT CONTROL HAS BEEN MANAGED BY MEANS OF SILT FENCE, TEMPORARY DIVERSION CHANNELS, AND SEDIMENT BASIN.
(i) NOTED THROUGHOUT THE PLANS.
(ii) TEMPORARY SEDIMENT BASIN WILL BE UTILIZED TO CONTROL SEDIMENT DURING GRADING OF SITE.
(iii) SILT FENCE & DIVERSIONS IS IDENTIFIED ON THE PLANS.
(iv) INLET PROTECTION IS IDENTIFIED ON THE PLANS.
(v) NOT APPLICABLE.
(vi) NOTED ON THE IMPROVEMENT PLANS.
E. POST-CONSTRUCTION MAINTENANCE AND INSPECTION IS IDENTIFIED ON THE PLANS.
F. SMALL CONSTRUCTION ACTIVITIES - POST CONSTRUCTION W.Q. IS PROVIDED BY AN AQUASWIRL AS-2 HYDRODYNAMIC SEPARATOR. THIS BMP IS SUITABLE FOR A SMALL SITE AS STATED IN OHIO EPA STORM WATER POST CONSTRUCTION QUESTION AND ANSWERS ITEM #14.
G. SURFACE WATER PROTECTION - NOT APPLICABLE
H. OTHER CONTROLS
(i) CEMENT TRUCK WASHOUT AREA IS IDENTIFIED ON THE PLANS.
(ii) DUST CONTROL MEASURES AND VEHICLE TRACKING ARE IDENTIFIED ON THE PLANS.
(iii) ADDITIONAL NOTES ARE IDENTIFIED ON THE PLANS.
(iv) NOTED ON THE PLANS.
(v) NOTED ON THE PLANS.
I. NOTED THROUGHOUT THE PLANS.
J. INSPECTION FREQUENCY AND INSPECTION CHECKLIST IS NOTED ON THE PLANS.
(i) NOTED ON THE PLANS.
(ii) NOTED ON THE PLANS.
(iii) STATEMENT NOTED.
3. APPROVED STATE OR LOCAL PLANS STATEMENT NOTED.
4. EXCEPTIONS STATEMENT NOTED.

ADDITIONAL CONSTRUCTION SITE POLLUTION CONTROLS

1. CONSTRUCTION PERSONNEL, INCLUDING SUBCONTRACTORS WHO MAY USE OR HANDLE HAZARDOUS OR TOXIC MATERIALS, SHALL BE MADE AWARE OF THE FOLLOWING GENERAL GUIDELINES REGARDING DISPOSAL AND HANDING OF HAZARDOUS AND CONSTRUCTION WASTES:
• PREVENT SPILLS
• USE PRODUCTS UP
• FOLLOW LABEL DIRECTIONS FOR DISPOSAL
• REMOVE LIDS FROM EMPTY DRUMS AND CANS WHEN DISPOSING IN TRASH.
• RECYCLE WASTES WHENEVER POSSIBLE.
• DON'T POUR INTO WATERWAYS, STORM DRAINS OR ONTO THE GROUND
• DON'T POUR DOWN THE SINK, FLOOR DRAIN OR SEPTIC TANKS
• DON'T BURY CHEMICALS OR CONTAINERS
• DON'T BURN CHEMICALS OR CONTAINERS
• DON'T MIX CHEMICALS TOGETHER
2. CONTAINERS SHALL BE PROVIDED FOR THE PROPER COLLECTION OF ALL WASTE MATERIAL INCLUDING CONSTRUCTION DEBRIS, TRASH, PETROLEUM PRODUCTS AND ANY HAZARDOUS MATERIALS USED ON-SITE. CONTAINERS SHALL BE COVERED AND NOT LEAKING. ALL WASTE MATERIAL SHALL BE DISPOSED OF AT FACILITIES APPROVED FOR THAT MATERIAL. CONSTRUCTION DEMOLITION AND DEBRIS (CD&D) WASTE MUST BE DISPOSED OF AT AN OHIO EPA APPROVED CD&D LANDFILL.
3. NO CONSTRUCTION RELATED WASTE MATERIALS ARE TO BE BURIED ON-SITE. BY EXCEPTION, CLEAN FILL (BRICKS, HARDENED CONCRETE, SOIL) MAY BE UTILIZED IN A WAY WHICH DOES NOT ENCRoACH UPON NATURAL WETLANDS, STREAMS OR FLOODPLAINS OR RESULT IN THE CONTAMINATION OF WATERS OF THE STATE.
4. HANDLING CONSTRUCTION CHEMICALS. MIXING, PUMPING, TRANSFERRING OR OTHER HANDLING OF CONSTRUCTION CHEMICALS SUCH AS FERTILIZER, LIME, ASPHALT, CONCRETE DRYING COMPOUNDS, AND ALL OTHER POTENTIALLY HAZARDOUS MATERIALS SHALL BE PERFORMED IN AN AREA AWAY FROM ANY WATERCOURSE, DITCH OR STORM DRAIN.
5. EQUIPMENT FUELING AND MAINTENANCE, OIL CHANGING, ETC., SHALL BE PERFORMED AWAY FROM WATERCOURSES, DITCHES OR STORM DRAINS, IN AN AREA DESIGNATED FOR THAT PURPOSE. THE DESIGNATED AREA SHALL BE EQUIPPED FOR RECYCLING OIL AND CATCHING SPILLS. SECONDARY CONTAINMENT SHALL BE PROVIDED FOR ALL FUEL OIL STORAGE TANKS. THESE AREAS MUST BE INSPECTED EVERY SEVEN DAYS AND WITHIN 24 HRS. OF A 0.5 INCH OR GREATER RAIN EVENT TO ENSURE THERE ARE NO EXPOSED MATERIALS WHICH WOULD CONTAMINATE STORM WATER. SITE OPERATORS MUST BE AWARE THAT SPILL PREVENTION CONTROL AND COUNTERMEASURES (SPCC) REQUIREMENTS MAY APPLY. AN SPCC PLAN IS REQUIRED FOR SITES WITH ONE SINGLE ABOVE GROUND TANK OF 660 GALLONS OR MORE, ACCUMULATIVE ABOVE GROUND STORAGE OF 1330 GALLONS OR MORE, OR 42,000 GALLONS OF UNDERGROUND STORAGE. CONTAMINATED SOILS MUST BE DISPOSED OF IN ACCORDANCE WITH ITEM 8.
6. CONCRETE WASH WATER SHALL NOT BE ALLOWED TO FLOW TO STREAMS, DITCHES, STORM DRAINS, OR ANY OTHER WATER COURSE. CONCRETE WASH WATER HAS NO POTENTIAL FOR DISCHARGE SHALL-BE CONSTRUCTED IF NEEDED TO CONTAIN CONCRETE WASH WATER. FIELD TILE OR OTHER SUBSURFACE DRAINAGE STRUCTURES WITHIN 10 FT. OF THE PUMP SHALL BE CUT AND PLUGGED. FOR LARGE CONSTRUCTION PROJECTS, TRUCK CHUTES MAY BE RINSED AWAY FROM ANY WATER CONVEYANCES.
7. SPILL REPORTING REQUIREMENTS: SPILLS ON PAVEMENT SHALL BE ABSORBED WITH SAWDUST OR KITTY LITTER AND DISPOSED OF AS SOLID WASTE AT A LICENSED SANITARY LANDFILL. HAZARDOUS OR INDUSTRIAL WASTES, SUCH AS MOST SOLVENTS, GASOLINE, OIL-BASED PAINTS, AND CEMENT CURING COMPOUNDS REQUIRE SPECIAL HANDLING. SPILLS SHALL BE REPORTED TO OHIO EPA (1-800-282-2282). SPILLS OF 25 GALLONS OR MORE OF PETROLEUM PRODUCTS SHALL BE REPORTED TO OHIO EPA, THE LOCAL FIRE DEPARTMENT, AND THE LOCAL EMERGENCY PLANNING COMMITTEE WITHIN 30 MIN. OF THE DISCOVERY OF THE RELEASE. ALL SPILLS WHICH CONTACT WATERS OF THE STATE MUST BE REPORTED TO OHIO EPA.
8. CONTAMINATED SOILS, IF SUBSTANCES SUCH AS OIL, DIESEL FUEL, HYDRAULIC FLUID, ANTIFREEZE, ETC. ARE SPILLED, LEAKED, OR RELEASED ONTO THE SOIL, THE SOIL SHOULD BE DUG UP AND DISPOSED OF AT LICENSED SANITARY LANDFILL OR OTHER APPROVED PETROLEUM CONTAMINATED SOIL REMEDIATION FACILITY. (NOT A CONSTRUCTION/DEMOLITION DEBRIS LANDFILL). NOTE THAT STORM WATER RUN OFF ASSOCIATED WITH CONTAMINATED SOILS ARE NOT BE AUTHORIZED UNDER OHIO EPA'S GENERAL STORM WATER PERMIT ASSOCIATED WITH CONSTRUCTION ACTIVITIES.
9. OPEN BURNING. NO MATERIALS CONTAINING RUBBER, GREASE, ASPHALT, OR PETROLEUM PRODUCTS, SUCH AS TIRES, AUTO PARTS, PLASTICS OR PLASTIC COATED WIRE MAY BE BURNED (OAC 3745-19). OPEN BURNING IS NOT ALLOWED IN RESTRICTED AREAS, WHICH ARE DEFINED AS: 1) WITHIN CORPORATION LIMITS; 2) WITHIN 1000 FEET OUTSIDE A MUNICIPAL CORPORATION HAVING A POPULATION OF 1000 TO 10,000; AND 3) A ZONE OUTSIDE OF A CORPORATION OF 10, 000 OR MORE, OUTSIDE OF RESTRICTED AREAS, NO OPEN BURNING IS ALLOWED WITHIN A 1000 FEET OF AN INHABITED BUILDING ON ANOTHER PROPERTY. OPEN BURNING IS PERMISSIBLE IN A RESTRICTED AREA FOR: HEATING TAR, WELDING, SMUDGE POTS AND SIMILAR OCCUPATIONAL NEEDS, AND HEATING FOR WARMTH OR OUTDOOR BARBEQUES. OUTSIDE OF RESTRICTED AREAS, OPEN BURNING IS PERMISSIBLE - FOR LANDSCAPE OR LAND-CLEARING WASTES (PLANT MATERIAL, WITH PRIOR WRITTEN PERMISSION FROM OHIO EPA), AND AGRICULTURAL WASTES, EXCLUDING BUILDINGS.
10. DUST CONTROL OR DUST SUPPRESSANTS SHALL BE USED TO PREVENT NUISANCE CONDITIONS, IN ACCORDANCE WITH THE SPECIFICATIONS AND IN A MANNER, WHICH PREVENT A DISCHARGE TO WATERS OF THE STATE. SUFFICIENT DISTANCE MUST BE PROVIDED BETWEEN APPLICATIONS AND NEARBY BRIDGES, CATCH BASINS, AND OTHER WATERWAYS. APPLICATION (EXCLUDING WATER) MAY NOT OCCUR WHEN RAIN IS IMMINENT AS NOTED IN THE SHORT TERM FORECAST. USED OIL MAY NOT BE APPLIED FOR DUST CONTROL.
11. OTHER AIR PERMITTING REQUIREMENTS: CERTAIN ACTIVITIES ASSOCIATED WITH CONSTRUCTION WILL REQUIRE AIR PERMITS INCLUDING BUT NOT LIMITED TO: MOBILE CONCRETE BATCH PLANTS, MOBILE ASPHALT PLANTS, CONCRETE CRUSHERS, LARGE GENERATORS, ETC. THESE ACTIVITIES WILL REQUIRE SPECIFIC OHIO EPA AIR PERMITS FOR INSTALLATION AND OPERATION. THE CONTRACTOR SHALL SEEK AUTHORIZATION FROM THE CORRESPONDING DISTRICT OF OHIO EPA. FOR DEMOLITION OF ALL COMMERCIAL SITES, A NOTIFICATION FOR RESTORATION AND DEMOLITION MUST BE SUBMITTED TO OHIO EPA TO DETERMINE IF ASBESTOS CORRECTIVE ACTIONS ARE REQUIRED.
12. PROCESS WASTE WATER/LEACHATE MANAGEMENT. OHIO EPA'S CONSTRUCTION GENERAL PERMIT ONLY ALLOWS THE DISCHARGE OF STORM WATER AND DOES NOT ALLOW OTHER WASTE STREAMS/DISCHARGES SUCH AS VEHICLE AND/OR EQUIPMENT WASHING, ON-SITE SEPTIC LEACHATE CONCRETE WASH OUTS, WHICH ARE CONSIDERED PROCESS WASTEWATERS. ALL PROCESS WASTEWATERS MUST BE COLLECTED AND PROPERLY DISPOSED AT AN APPROVED DISPOSAL FACILITY. IN THE EVENT, LEACHATE OR SEPTAGE IS DISCHARGED; IT MUST BE ISOLATED FOR COLLECTION AND PROPER DISPOSAL, AND CORRECTIVE ACTIONS TAKEN TO ELIMINATE THE SOURCE OF WASTE WATER.
13. A PERMIT TO INSTALL (PTI) IS REQUIRED PRIOR TO THE CONSTRUCTION OF ALL CENTRALIZED SANITARY SYSTEMS, INCLUDING SEWER EXTENSIONS, AND SEWERAGE SYSTEMS (EXCEPT THOSE SERVING ONE, TWO, AND THREE FAMILY DWELLINGS) AND POTABLE WATER LINES. PLANS MUST BE SUBMITTED AND APPROVED BY OHIO EPA. ISSUANCE OF AN OHIO EPA CONSTRUCTION GENERAL STORM WATER PERMIT DOES NOT AUTHORIZE THE INSTALLATION OF ANY SEWERAGE SYSTEM WHERE OHIO EPA HAS NOT APPROVED A PTI.

TABLE 1: PERMANENT STABILIZATION

AREA REQUIRING PERMANENT STABILIZATION	TIME FRAME TO APPLY EROSION CONTROLS
ANY AREAS THAT WILL LIE DORMANT FOR ONE YEAR OR MORE	WITHIN SEVEN DAYS OF THE MOST RECENT DISTURBANCE
AN AREAS WITHIN 50 FEET OF A STREAM AND AT FINAL GRADE	WITHIN TWO DAYS OF REACHING FINAL GRADE
ANY OTHER AREAS AT FINAL GRADE	WITHIN SEVEN DAYS OF REACHING FINAL GRADE

TABLE 2: TEMPORARY STABILIZATION

AREA REQUIRING TEMPORARY STABILIZATION	TIME FRAME TO APPLY EROSION CONTROLS
ANY DISTURBED AREAS WITHIN 50 FEET OF A STREAM AND NOT AT FINAL GRADE	WITHIN TWO DAYS OF THE MOST RECENT DISTURBANCE IF THE AREA WILL REMAIN IDLE FOR MORE THAN 14 DAYS
FOR ALL CONSTRUCTION ACTIVITIES, ANY DISTURBED AREAS THAT WILL BE DORMANT FOR MORE THAN 14 DAYS BUT LESS THAN ONE YEAR AND NOT WITHIN 50 FEET OF A STREAM	WITHIN SEVEN DAYS OF THE MOST RECENT DISTURBANCE WITHIN THE AREA
DISTURBED AREAS THAT WILL BE IDLE OVER WINTER	FOR RESIDENTIAL SUBDIVISIONS, DISTURBED AREAS MUST BE STABILIZED AT LEAST SEVEN DAYS PRIOR TO TRANSFER OF PERMIT COVERAGE FOR THE INDIVIDUAL LOTS(S).
	PRIOR TO THE ONSET OF WINTER WEATHER

WHERE VEGETATIVE STABILIZATION TECHNIQUES MAY CAUSE STRUCTURAL INSTABILITY OR ARE OTHERWISE UNOBTAINABLE, ALTERNATIVE STABILIZATION TECHNIQUES MUST BE EMPLOYED.

CONSTRUCTION SEQUENCE

(ALL ITEMS ARE TO BE THE RESPONSIBILITY OF THE GENERAL SITE CONTRACTOR)

SITE PREPARATION

- NOTE: PROVIDE SAFE AND SECURE PEDESTRIAN AND VEHICULAR TRAFFIC CIRCULATION THROUGHOUT THE ENTIRETY OF THE CONSTRUCTION SEQUENCE WITHIN THE DEFINED CONSTRUCTION BOUNDARIES TO BE ACCESSED BY CONSTRUCTION PERSONNEL ONLY. ALL EROSION CONTROLS ARE TO BE THOROUGHLY INSPECTED BY THE CONTRACTOR UPON THE COMPLETION OF EACH WORK DAY AND MAINTAINED THROUGHOUT THE REQUIRED LIFE OF THE CONTROL, AS SPECIFIED BY THE APPROVED EROSION AND SEDIMENTATION CONTROL PLANS AND NARRATIVE. THE CONTRACTOR MUST REVIEW THE APPROVED EROSION AND SEDIMENTATION CONTROL PLANS AND NARRATIVE. THE CONTRACTOR MUST REVIEW THE APPROVED NPDES PERMIT AND SIGN THE PERMIT TO ACCEPT RESPONSIBILITIES AS THE CO-PERMITTEE.

INITIAL PHASE (WITHIN 7 DAYS OF START OF GRUBBING)

1. PRIOR TO BEGINNING ANY CONSTRUCTION, THE CONTRACTOR SHALL CONTACT STARK SOIL AND WATER CONSERVATION DISTRICT TO SCHEDULE A PRE-CONSTRUCTION MEETING AT 330-830-7700.
2. INSTALL A TEMPORARY CONSTRUCTION ENTRANCE AND CEMENT TRUCK WASHOUT AREA FOR ACCESS TO CONSTRUCTION AREAS OF SITE.
3. SETUP CONSTRUCTION TRAILER ON SITE AND ESTABLISH TEMPORARY POWER AND TELEPHONE SERVICE.
4. ALL TEMPORARY UTILITY SERVICES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
5. STAKEOUT LIMITS OF DISTURBANCE.
6. INSTALL REQUIRED SILT FENCE PRIOR TO GRADING.
7. BEGIN SITE CLEARING.
8. REMOVE TOPSOIL FROM AREAS OF BUILDING AND PAVEMENT.
9. BEGIN EARTHWORK OPERATIONS.
10. IN THE EVENT OF RAIN, ALLOW STANDING WATER TO SETTLE PRIOR TO PUMPING. UTILIZE THE PUMPING SYSTEMS TO PUMP POLLUTED WATER PER E.P.A. REQUIREMENTS. ALLOW ONLY CLEAN WATER TO BE DISCHARGED TO THE EXISTING DRAINAGE SYSTEM. REMOVE SILT FROM BASINS AS NECESSARY PRIOR TO CONTINUING EARTHWORK. MATERIAL SHOULD BE MECHANICALLY SPREAD AND DRIED PRIOR TO INCORPORATION INTO THE EARTHWORK PROCEDURES. ADEQUACY OF THE DRIED MATERIAL IS TO BE DETERMINED BY A GEOTECHNICAL ENGINEER. THE CONTRACTOR SHALL BE RESPONSIBLE AND ENSURE THAT PROPER MECHANISMS ARE IN PLACE TO CONTROL WASTE MATERIALS. CONSTRUCTION WASTES INCLUDES, BUT ARE NOT LIMITED TO, EXCESS SOIL MATERIALS, BUILDING MATERIALS, CONCRETE WASH WATER, SANITARY WASTES, ETC., THAT COULD ADVERSELY IMPACT WATER QUALITY. MEASURES SHALL BE PLANNED AND IMPLEMENTED FOR HOUSEKEEPING, MATERIALS MANAGEMENT, AND LITTER CONTROL. WHEREVER POSSIBLE, RECYCLING OF EXCESS MATERIALS IS PREFERRED, RATHER THAN DISPOSAL.
11. THE DEVELOPER IS RESPONSIBLE TO MAINTAIN INLET PROTECTION ON CATCH BASINS UNTIL THE PROJECT IS BUILT OUT.

INTERIM PHASE GENERAL CONSTRUCTION

1. MAINTAIN TEMPORARY CONTROLS UNTIL REMOVAL IS WARRANTED DUE TO PROGRESSION OF WORK.
2. BEGIN EARTHMOVING OPERATIONS. CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE COUNTY CONSERVATION DISTRICT OF LOCATION AND EROSION AND SEDIMENTATION CONTROL MEASURES IMPLEMENTED AT BORROW OR SPOIL. SITE OF IMPORT/EXPORT MATERIAL. THE CONTRACTOR IS TO COORDINATE WITH OWNER THE PLACEMENT OF SUCH MEASURES.
3. STORM SEWER, SANITARY SEWER, WATER LINE AND UTILITY LINE CONSTRUCTION MAY BEGIN IMMEDIATELY FOLLOWING ESTABLISHMENT OF GRADE AND WITH THE PERMISSION OF THE OWNER.
4. STABILIZE ALL UTILITY TRENCHES AT THE END OF EACH WORKDAY BY MEANS OF GRAVEL BACKFILL TO SURFACE, REPAVING OR MULCHING.
5. REPLACE TOPSOIL, FINE GRADE AND SEED AS REQUIRED.
6. STABILIZE ALL DISTURBED AREAS WITH PERMANENT SEED AND MULCHING OR CROWNVECH SEEDING IMMEDIATELY UPON REACHING FINAL GRADE.
7. INSTALL PAVEMENT SUBBASE.
8. BEGIN BITUMINOUS PAVING, REMOVING TEMPORARY CONSTRUCTION ENTRANCE ONLY WHEN NECESSARY.
9. RESEED AND REDRESS ANY AREAS THAT MAY REQUIRE ATTENTION IMMEDIATELY. NOTE THAT LAWN AREAS WILL NOT BE DEEMED STABLE UNTIL A UNIFORM 80% COVERAGE IS ACHIEVED.
10. ALL EROSION MEASURES SHALL REMAIN IN PLACE UNTIL THE SITE IS STABILIZED. ALL AREAS OF VEGETATIVE RESTORATION SHALL BE PREPARED IMMEDIATELY AFTER SEEDING. SHALL BE CONSIDERED TO BE IN PLACE AND FUNCTIONAL WHEN THE REQUIRED UNIFORM RATE OF COVERAGE (70%) IS OBTAINED.

FINAL PHASE POST-PAVING BASIN CONVERSION

1. IF, FOR ANY REASON, THE PROJECT IS SUSPENDED, THE CONTRACTOR SHALL INSURE THAT ALL INSTALLED EROSION MEASURES ARE FUNCTIONING AND PROPERLY MAINTAINED DURING THIS PERIOD, AND THAT ALL BARED SOILS ARE SEEDDED AND MULCHED WITH TEMPORARY SEED MIXTURE.
2. THE FOLLOWING ITEMS MUST BE COMPLETED BY THE CONTRACTOR, IN ORDER, ONCE THE SITE HAS BEEN DEEMED STABLE:

- A. REMOVE SEDIMENT CONTROL DEVICES.
B. REMOVE TEMPORARY CONSTRUCTION ENTRANCE PRIOR TO COMPLETION OF PAVING.
C. SITE CLEAN UP.
D. RESEED ANY AREAS THAT REQUIRE ADDITIONAL SEED
E. FILTER FENCES ARE TO BE CLEANED, REMOVED, BACKFILLED AND SEEDDED WITH PERMANENT SEEDING.
F. VERIFY POSITIVE CONVEYANCE FLOW IN ALL DRAINAGE STRUCTURES.

INSPECTION SCHEDULE		
PRACTICE ITEM	FREQUENCY	NOTES
GENERAL INSPECTION	EVERY 6 MONTHS	
SWALES	MONTHLY	
VEGETATION	MONTHLY	FOR THE FIRST 2 GROWING SEASONS, THEN 2 TIMES A YEAR.
SILT FENCE	MONTHLY	FOR THE FIRST GROWING SEASON

REGULAR INSPECTION AND MAINTENANCE WILL BE PROVIDED FOR ALL EROSION AND SEDIMENT CONTROL PRACTICES. PERMANENT RECORDS OF MAINTENANCE AND INSPECTIONS MUST BE KEPT THROUGHOUT THE CONSTRUCTION PERIOD. INSPECTIONS MUST BE MADE A MINIMUM OF ONCE EVERY 7 DAYS AND IMMEDIATELY AFTER STORM EVENTS GREATER THAN 0.5 INCHES OF RAIN IN A 24 HOUR PERIOD. PROVIDED WILL BE NAME OF INSPECTOR, MAJOR OBSERVATIONS, DATED OF INSPECTION AND CORRECTIVE MEASURES TAKEN. RECORDS SHALL L BE SUBMITTED TO THE STARK COUNTY SOIL & WATER CONSERVATION DISTRICT OFFICE AND THE CITY OF MASSILLON ENGINEERING DEPARTMENT FOR REVIEW BY 1st of EACH YEAR.

ALL CONTROL PRACTICES THAT REQUIRE REPAIR SHALL BE REPAIRED WITHIN 3 DAYS OF THE INSPECTION.

TEMPORARY SEEDING

TEMPORARY SEEDING SPECIES SELECTION			
SEEDING DATES	SPECIES	LB/1000 FT ²	PER ACRE
MARCH 1 TO AUGUST 15	OATS	3	4 BUSHEL 40 LB.
	TALL FESCUE	2	40 LB. 40 LB.
AUGUST 16 TO NOVEMBER 1	PERENNIAL RYEGRASS	2	40 LB. 40 LB.
	TALL FESCUE	1	40 LB. 40 LB.
NOVEMBER 1 TO SPRING SEEDING	RYE	3	2 BUSHEL 40 LB.
	TALL FESCUE	1	40 LB. 40 LB.
	PERENNIAL RYEGRASS	1	40 LB. 40 LB.
	WHEAT	3	2 BUSHEL 40 LB.
	TALL FESCUE	1	40 LB. 40 LB.
	PERENNIAL RYEGRASS	1	40 LB. 40 LB.
	TALL FESCUE	2	40 LB. 40 LB.

- NOTE: OTHER APPROVED SEED SPECIES MAY BE SUBSTITUTED.
1. STRUCTURAL EROSION AND SEDIMENT CONTROL PRACTICES SUCH AS DIVERSIONS AND SEDIMENT TRAPS SHALL BE INSTALLED AND STABILIZED WITH TEMPORARY SEEDING PRIOR TO GRADING THE REST OF THE CONSTRUCTION-SITE.
2. TEMPORARY SEED SHALL BE APPLIED BETWEEN CONSTRUCTION OPERATIONS ON SOIL THAT WILL NOT BE GRADED OR REWORKED FOR 14 DAYS OR MORE. THESE IDLE AREAS SHOULD BE SEEDDED AS SOON AS POSSIBLE AFTER GRADING OR SHALL BE SEEDDED WITHIN 7 DAYS. SEVERAL APPLICATIONS OF TEMPORARY SEEDING ARE NECESSARY ON TYPICAL CONSTRUCTION PROJECTS.
3. THE SEEDBED SHALL BE PULVERIZED AND LOOSE TO ENSURE THE SUCCESS OF ESTABLISHING VEGETATION. HOWEVER, TEMPORARY SEEDING SHALL NOT BE POSTPONED IF IDEAL SEEDBED PREPARATION IS NOT POSSIBLE.
4. SOIL AMENDMENTS--APPLICATIONS OF TEMPORARY VEGETATION SHALL ESTABLISHED ADEQUATE STANDS OF VEGETATION WHICH MAY REQUIRE THE USE OF SOIL AMENDMENTS. SOIL TESTS SHOULD BE TAKEN ON THE SITE TO PREDICT THE NEED FOR LIME AND FERTILIZER.
5. SEEDING METHOD--SEED SHALL BE APPLIED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, CULTPACKER SEEDER, OR HYDROSEEDER, WHEN FEASIBLE, SEED THAT HAS BEEN BROADCAST SHALL BE COVERED BY RAKING OR DRAGGING AND THEN LIGHTLY TAMPED INTO PLACE USING A ROLLER OR CULTPACKER. IF HYDROSEEDING IS USED, THE SEED AND FERTILIZER WILL BE MIXED ON-SITE AND THE SEEDING SHALL BE DONE IMMEDIATELY AND WITHOUT INTERRUPTION.
MULCHING TEMPORARY SEEDING
1. APPLICATIONS OF TEMPORARY SEEDING SHALL INCLUDE MULCH WHICH SHALL BE APPLIED DURING OR IMMEDIATELY AFTER SEEDING. SEEDINGS MADE DURING OPTIMUM SEEDING DATES AND WITH FAVORABLE SOIL CONDITIONS AND ON VERY FLAT AREAS MAY NOT NEED MULCH TO ACHIEVE ADEQUATE STABILIZATION.
2. MATERIALS:
STRAW--IF STRAW IS USED, IT SHALL BE UNROTTED SMALL--GRAIN APPLIED AT 2 TONS/AC. OR 90 LB. / 1,000 SQ. FT. (TWO TO THREE BALES). THE MULCH SHALL BE SPREAD UNIFORMLY BY HAND OR MECHANICALLY SO THE SOIL SURFACE IS COVERED. FOR UNIFORM DISTRIBUTION OF HAND-SPREAD MULCH, DIVIDE AREA INTO APPROXIMATELY 1,000 SQ. FT. SECTIONS AND SPREAD TWO 45 LB. BALES OF STRAW IN EACH SECTION.
HYDROSEEDERS--IF WOOD CELLULOSE FIBER IS USED, IT SHALL BE USED AT 2,000 LB. / AC. OR 48 LB. /1,000 SQ. FT.
OTHER--OTHER ACCEPTABLE MULCHES INCLUDE MULCH MATTINGS APPLIED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS OR WOOD CHIPS APPLIED AT 6 TONS / AC.
3. STRAW MULCH SHALL BE ANCHORED IMMEDIATELY TO MINIMIZE LOSS BY WIND OR WATER.
ANCHORING METHODS:
MECHANICAL--A DISK, CRIMPER OR SIMILAR TYPE TOOL SHALL BE SET STRAIGHT TO PUNCH OR ANCHOR THE MULCH MATERIAL INTO THE SOIL. STRAW MECHANICALLY ANCHORED SHALL NOT BE FINELY CHOPPED BUT, GENERALLY BE LEFT LONGER THAN 6 IN.
MULCH NETTINGS--NETTINGS SHALL BE USED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS. NETTING MAY BE NECESSARY TO HOLD MULCH IN PLACE IN AREAS OF CONCENTRATED RUNOFF AND ON CRITICAL SLOPES.
ASPHALT EMULSION--ASPHALT SHALL BE APPLIED AS RECOMMENDED BY THE MANUFACTURER OR AT THE RATE OF 160 GAL. / AC.
SYNTHETIC BINDERS--SYNTHETIC BINDERS SUCH AS ACRYLIC DLR (AGRI-TAC), DCA-70, PETROSEI, TERRA-TACK OR EQUAL MAY BE USED AT RATES RECOMMENDED BY THE MANUFACTURER.
WOOD-CELLULOSE FIBRE--WOOD-CELLULOSE FIBER BINDER SHALL BE APPLIED AT A NET DRY WEIGHT OF 750 LB. /AC. THE WOOD-CELLULOSE FIBER SHALL BE MIXED WITH WATER AND THE MIXTURE SHALL CONTAIN A MAXIMUM OF 50 LB. / 100 GAL.

POST-CONSTRUCTION BMP RATIONALE

POST CONSTRUCTION W.Q. IS PROVIDED BY AN AQUASWIRL AS-2 HYDRODYNAMIC SEPARATOR. THIS BMP IS SUITABLE FOR A SMALL SITE AS STATED IN OHIO EPA STORM WATER POST CONSTRUCTION QUESTIONS AND ANSWERS ITEM #14.

ADDITIONAL SWP3 CONSIDERATIONS

- NO OPEN BURNING
DUST CONTROL SHALL BE ACHIEVED BY USE OF WATERING TRUCKS. USE OF OIL IS STRICTLY PROHIBITED. INLET PROTECTION MUST BE IMPLEMENTED PRIOR TO DUST CONTROL MEASURES.
IN THE EVENT OF A PETROLEUM SPILL (>25 GALLONS) OR THE PRESENCE OF OIL SHEEN, THE CONTRACTOR SHALL CONTACT THE OHIO E.P.A. AT 800-282-9378, THE LOCAL FIRE DEPARTMENT.
SMALL SPILLS (<25 GALLONS) SHALL BE CLEANED UP USING AN ABSORBING AGENT, THE ABSORBING AGENT REMOVED AND DISPOSED OF ACCORDING TO FEDERAL REGULATIONS.
ALL TRENCH DEWATERING MEASURES SHALL BE DISCHARGED INTO SETTLING BASINS PRIOR TO DISCHARGE FROM SITE. BMP'S THAT REQUIRE REPAIR SHALL BE REPAIRED WITHIN 3 DAYS OF INSPECTION. SETTLING PONDS MUST BE REPAIRED WITHIN 10 DAYS OF INSPECTION.
STREETS ADJACENT TO SITE SHALL BE CLEANED AT THE END OF EACH WORK DAY.

CONSTRUCTION ENTRANCE NOTE

MINIMIZE TRACKING OF SEDIMENTS BY VEHICLES BY UTILIZING THE CONSTRUCTION ENTRANCE AS THE ONLY ENTRANCE FOR VEHICLES. MAINTAIN THIS ENTRANCE WITH STONE AS NEEDED TO PREVENT DIRT AND MUD FROM TRACKING ONTO THE ROADWAY. REGULAR SWEEPING OF THE ROADWAY MAY BE NECESSARY TO ENSURE ROADWAY DOES NOT BUILD UP WITH SEDIMENTS.

PERMANENT SEEDING

SEED MIX	SEEDING RATE		NOTES
	LB/ACRE	LB/1000 FT. ²	
GENERAL USE			
CREeping RED FESCUE	20-40	1/2 - 1	FOR CLOSE MOWING & FOR WATERWAYS WITH <2.0 FT/SEC. VELOCITY
DOMESTIC RYEGRASS	10-20	1/4 - 1/2	
KENTUCKY RYEGRASS	20-40	1/2 - 1	
TALL FESCUE	40-50	1 - 1 1/4	
TURF-TYPE (DWARF) FESCUE	90	2 1/4	
STEEP BANKS OR CUT SLOPES			
TALL FESCUE	40-50	1 - 1 1/4	
CROWN VETCH	10-20	1/4 - 1/2	DO NOT SEED LATER THAN AUGUST.
TALL FESCUE	20-30	1/2 - 3/4	
FLAT PEA	20-25	1/2 - 3/4	DO NOT SEED LATER THAN AUGUST.
TALL FESCUE	20-30	1/2 - 3/4	
ROAD DITCHES AND SWALES			
TALL FESCUE	40-50	1 - 1 1/4	
TURF-TYPE (DWARF) FESCUE	90	2 1/4	
KENTUCKY BLUEGRASS	5	0.10	
LAWNS			
KENTUCKY BLUEGRASS	100-200	2	FOR SHADED AREAS
PERENNIAL RYEGRASS		2	
KENTUCKY BLUEGRASS	100-200	2	
CREeping RED FESCUE	20-30	1 1/2	

NOTE: OTHER APPROVED SEED SPECIES MAY BE SUBSTITUTED.

SITE PREPARATION

1. SUBSOIL, PLOW, OR OTHER IMPLEMENT SHALL BE USED TO REDUCE SOIL COMPACTION AND ALLOW MAXIMUM INFILTRATION. (MAXIMIZING INFILTRATION WILL HELP CONTROL BOTH RUNOFF RATE AND WATER QUALITY). SUBSOILING SHOULD BE DONE WIOUGH TO ALLOW THE SOIL MOISTURE TO ALLOW THE SOIL TO CRACK AND FRACTURE. SUBSOILING SHALL NOT BE LIMITED TO WHAT IS NECESSARY FOR ESTABLISHING VEGETATION.
2. THE SITE SHALL BE GRADED AS NEEDED TO PERMIT THE USE OF CONVENTIONAL EQUIPMENT FOR SEEDBED PREPARATION AND SEEDING.
3. TOPSOIL SHALL BE APPLIED WHERE NEEDED TO ESTABLISH VEGETATION LAND IS BEING DISTURBED TO CONSTRUCT A RESIDENTIAL SUBDIVISION ALONG WITH SITE UTILITIES.
SEEDBED PREPARATION
1. LIME-- AGRICULTURAL GROUND LIMESTONE SHALL BE APPLIED TO ACID SOIL AS RECOMMENDED BY A SOIL TEST. IN LIEU OF A SOIL TEST, LIME SHALL BE APPLIED AT THE RATE OF 100 POUNDS PER 1,222 SQ. FT. OR 2 TONS PER ACRE.
2. FERTILIZER-- FERTILIZER SHALL BE APPLIED AS RECOMMENDED BY A SOIL TEST. IN PLACE OF A SOIL TEST, FERTILIZER SHALL BE APPLIED AT A RATE OF 25 POUNDS PER 1,000 SQ. FT. OR 1,000 POUNDS PER ACRE OF A 10-10-10 OR 12-12-12 ANALYSES.
3. THE LIME AND FERTILIZER SHALL BE WORKED INTO THE SOIL WITH A DISK HARROW, SPRING-TOOTH HARROW, OR OTHER SUITABLE FIELD IMPLEMENT TO A DEPTH OF 3 INCHES. ON SLOPING LAND, THE SOIL SHALL BE WORKED ON THE CONTOUR.
SEEDING DATES AND SOIL CONDITIONS
SEEDING SHOULD BE DONE MARCH 1 TO MAY 31 OR AUGUST 1 TO SEPTEMBER 30. IF SEEDING OCCURS OUTSIDE OF THE ABOVE SPECIFIED DATES, ADDITIONAL MULCH AND IRRIGATION MAY BE REQUIRED TO ENSURE A MINIMUM OF 80% GERMINATION. TILLAGE FOR SEEDBED PREPARATION SHOULD BE DONE WHEN THE SOIL IS DRY ENOUGH TO CRUMBLE AND NOT FORM RIBBONS WHEN COMPRESSED BY HAND. FOR WINTER SEEDING, SEE BELOW FOR DORMANT SEEDING.

DORMANT SEEDINGS


1. SEEDINGS SHOULD NOT BE MADE FROM OCTOBER 1 THROUGH NOVEMBER 20. DURING THIS PERIOD, THE SEEDS ARE LIKELY TO GERMINATE BUT PROBABLY WILL NOT BE ABLE TO SURVIVE THE WINTER.
2. THE FOLLOWING METHODS MAY BE USED FOR "DORMANT SEEDING":
-FROM OCTOBER 1 TO FEBRUARY 20, PREPARE THE SEEDBED, ADD THE REQUIRED AMOUNTS OF LIME AND FERTILIZER, THEN MULCH AND ANCHOR. AFTER NOVEMBER 20, AND BEFORE MARCH 15, BROADCAST THE SELECTED SEED MIXTURE. INCREASE THE SEEDING RATES BY 50% FOR THIS TYPE OF SEEDING.
-FROM NOVEMBER 20 THROUGH MARCH 15, WHEN SOIL CONDITIONS PERMIT, PREPARE THE SEEDBED, LIME AND FERTILIZER, APPLY THE SELECTED SEED MIXTURE, MULCH AND ANCHOR. INCREASE THE SEEDING RATES BY 50% FOR THIS TYPE OF SEEDING.
-APPLY SEED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, CULTPACKER SEEDER, OR HYDRO-SEEDER (SLURRY MAY INCLUDE SEED AND FERTILIZER) ON A FIRM, MOIST SEEDBED.
-WHERE FEASIBLE, EXCEPT WHEN A CULTPACKER TYPE SEEDER IS USED, THE SEEDBED SHOULD BE FIRMED FOLLOWING SEEDING OPERATION WITH A CULTPACKER, ROLLER, OR LIGHT DRAG. ON SLOPING LAND, SEEDING OPERATIONS SHOULD BE ON THE CONTOUR WHERE FEASIBLE.

MULCHING

1. MULCH MATERIAL SHALL BE APPLIED IMMEDIATELY AFTER SEEDING. DORMANT SEEDING SHALL BE MULCHED. 100% OF THE GROUND SURFACE SHALL BE COVERED WITH AN APPROVED MATERIAL.
2. MATERIALS
-STRAW--IF STRAW IS USED IT SHALL BE UNROTTED SMALL--GRAIN STRAW APPLIED AT THE RATE OF 2 TONS PER ACRE OR 90 POUNDS (TWO TO THREE BALES) PER 1,000 SQ. FT. THE MULCH SHALL BE SPREAD UNIFORMLY BY HAND OR MECHANICALLY APPLIED SO THE SOIL SURFACE IS COVERED. FOR UNIFORM DISTRIBUTION OF HAND SPREAD MULCH, DIVIDE AREA INTO APPROXIMATELY 1,000 SQ. FT. SECTIONS AND SPREAD TWO 45-LB. BALES OF STRAW IN EACH SECTION.
-HYDROSEEDERS--IF WOOD CELLULOSE FIBER IS USED, IT SHALL BE APPLIED AT 2,000 LB./AC. OR 48 LB./1,000 SQ. FT.
-OTHER--OTHER ACCEPTABLE MULCHES INCLUDE ROLLED EROSION CONTROL MATTINGS OR BLANKETS APPLIED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS OR WOOD CHIPS APPLIED AT 6 TONS PER ACRE.
3. STRAW AND MULCH ANCHORING METHODS
STRAW MULCH SHALL BE ANCHORED IMMEDIATELY TO MINIMIZE LOSS BY WIND OR WATER.
-MECHANICAL--DISK, CRIMPER, OR SIMILAR TYPE TOOL SHALL BE SET STRAIGHT TO PUNCH OR ANCHOR THE MULCH MATERIAL INTO THE SOIL. STRAW MECHANICALLY ANCHORED SHALL NOT BE FINELY CHOPPED BUT, GENERALLY, BE LEFT LONGER THAN 6 INCHES.
-MULCH NETTING--NETTING SHALL BE USED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS. NETTING MAY BE NECESSARY TO HOLD MULCH IN PLACE IN AREAS OF CONCENTRATED RUNOFF AND ON CRITICAL SLOPES.
-ASPHALT EMULSION--ASPHALT SHALL BE APPLIED AS RECOMMENDED BY THE MANUFACTURER OR AT THE RATE OF 160 GALLONS PER ACRE.
-SYNTHETIC BINDERS--SYNTHETIC BINDERS SUCH AS ACRYLIC DLR (AGRI-TAC), DCA-70, PETROSEI, TERRA TACK OR EQUIVALENT MAY BE USED AT RATES SPECIFIED BY THE MANUFACTURER.
-WOOD-CELLULOSE FIBER--WOOD CELLULOSE FIBER SHALL BE APPLIED AT A NET DRY WEIGHT OF 750 POUNDS PER ACRE. THE WOOD CELLULOSE FIBER SHALL BE MIXED WITH WATER WITH THE MIXTURE CONTAINING A MAXIMUM OF 50 POUNDS CELLULOSE PER 100 GALLONS OF WATER.

IRRIGATION

PERMANENT SEEDING SHALL INCLUDE IRRIGATION TO ESTABLISH VEGETATION DURING DRY WEATHER OR ON ADVERSE SITE CONDITIONS, WHICH REQUIRE ADEQUATE MOISTURE FOR SEED GERMINATION AND PLANT GROWTH.
IRRIGATION RATE SHALL BE MONITORED TO PREVENT EROSION AND DAMAGE TO SEEDED AREAS FROM EXCESSIVE RUNOFF.

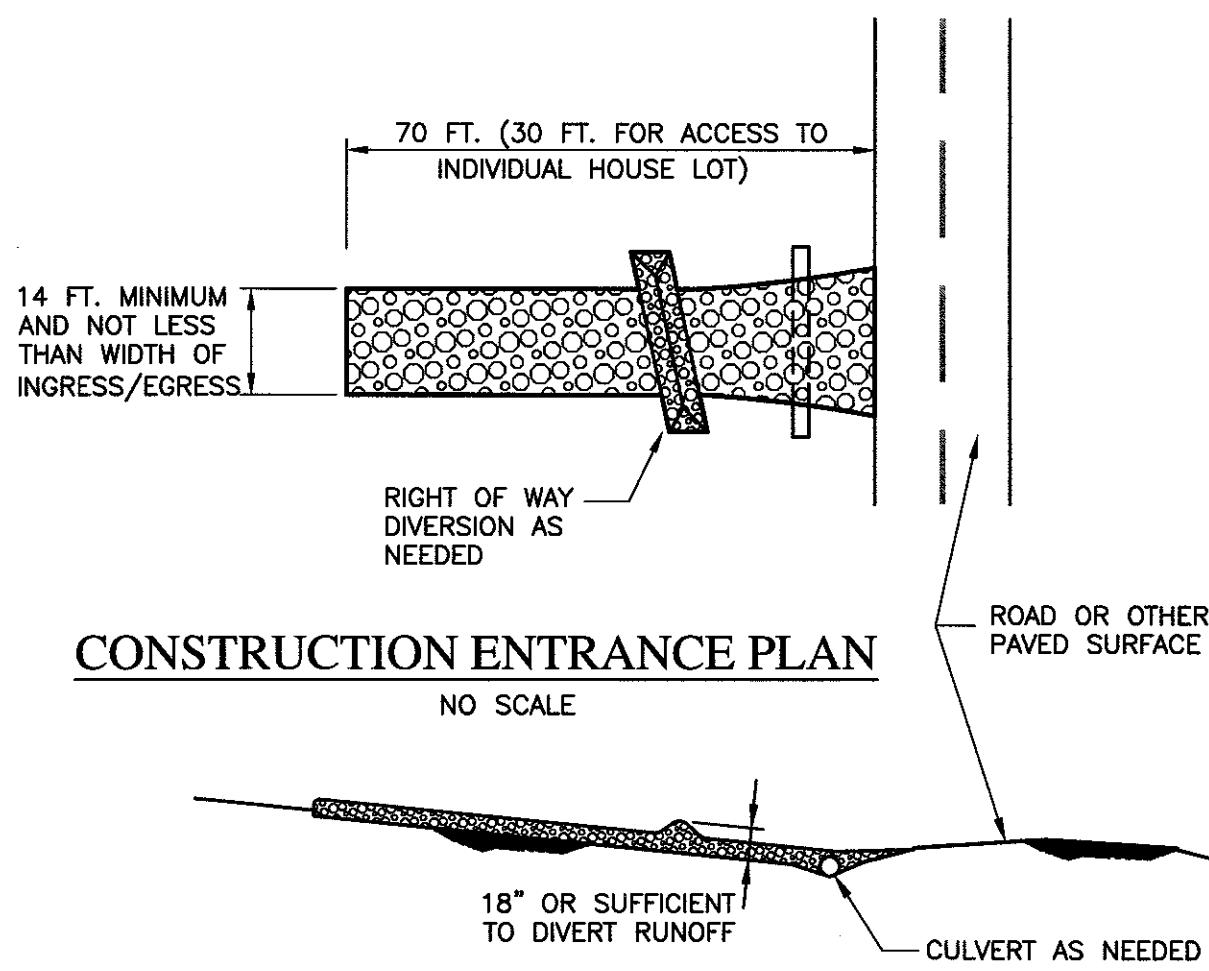


CONSTRUCTION ENTRANCE PLAN
NO SCALE

CONSTRUCTION ENTRANCE PROFILE
NO SCALE

- STONE SIZE--ODOT #2 (1.5 - 2.5 INCH) STONE SHALL BE USED, OR RECYCLED CONCRETE PAVEMENT.
- LENGTH--THE CONSTRUCTION ENTRANCE SHALL BE AS LONG AS REQUIRED TO STABILIZE HIGH TRAFFIC AREAS BUT NOT LESS THAN 70 FT. (EXCEPTION: APPLY 30 FT. MINIMUM TO SINGLE RESIDENCE LOT).
- THICKNESS--THE STONE LAYER SHALL BE AT LEAST 6-IN. THICK FOR LIGHT DUTY ENTRANCES OR AT LEAST 10-IN. FOR HEAVY DUTY USE.
- WIDTH--THE ENTRANCE SHALL BE AT LEAST 14-FT. WIDE, BUT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
- GEOTEXTILE--A GEOTEXTILE SHALL BE LAID OVER THE ENTIRE AREA PRIOR TO PLACING STONE. IT SHALL BE COMPOSED OF STRONG ROT-PROOF POLYMERIC FIBERS AND MEET THE FOLLOWING SPECIFICATIONS:
- TIMING--THE CONSTRUCTION ENTRANCE SHALL BE INSTALLED AS SOON AS IS PRACTICABLE BEFORE MAJOR GRADING ACTIVITIES.
- CULVERT--A PIPE OR CULVERT SHALL BE CONSTRUCTED UNDER THE ENTRANCE IF NEEDED TO PREVENT SURFACE WATER FLOWING ACROSS THE ENTRANCE OR TO PREVENT RUNOFF FROM BEING DIRECTED OUT ONTO PAVED SURFACES.
- WATER BAR--A WATER BAR SHALL BE CONSTRUCTED AS PART OF THE CONSTRUCTION ENTRANCE IF NEEDED TO PREVENT SURFACE RUNOFF FROM FLOWING THE LENGTH OF THE CONSTRUCTION ENTRANCE AND OUT ONTO PAVED SURFACES.
- MAINTENANCE--TOP DRESSING OF ADDITIONAL STONE SHALL BE APPLIED AS CONDITIONS DEMAND, MUD SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC ROADS, OR ANY SURFACE WHERE RUNOFF IS NOT CHECK BY SEDIMENT CONTROLS, SHALL BE REMOVED IMMEDIATELY. REMOVAL SHALL BE ACCOMPLISHED BY SCRAPING OR SWEEPING.
- CONSTRUCTION ENTRANCES SHALL NOT BE RELIED UPON TO REMOVE MUD FROM VEHICLES AND PREVENT OFF-SITE TRACKING. VEHICLES THAT ENTER AND LEAVE THE CONSTRUCTION--SITE SHALL BE RESTRICTED FROM MUDDY AREAS.
- REMOVAL--THE ENTRANCE SHALL REMAIN IN PLACE UNTIL THE DISTURBED AREA IS STABILIZED OR REPLACED WITH A PERMANENT ROADWAY OR ENTRANCE.

GEOTEXTILE SPEC. FOR CONSTRUCTION ENTRANCE	
MINIMUM TENSILE STRENGTH	200 LBS.
MINIMUM PUNCTURE STRENGTH	80 PSI
MINIMUM TEAR STRENGTH	50 LBS.
MINIMUM BURST STRENGTH	320 PSI
MINIMUM ELONGATION	20%
EQUIVALENT OPENING SIZE	EOS < 0.60 mm
PERMITTIVITY	1x10 ⁻³ CM/SEC

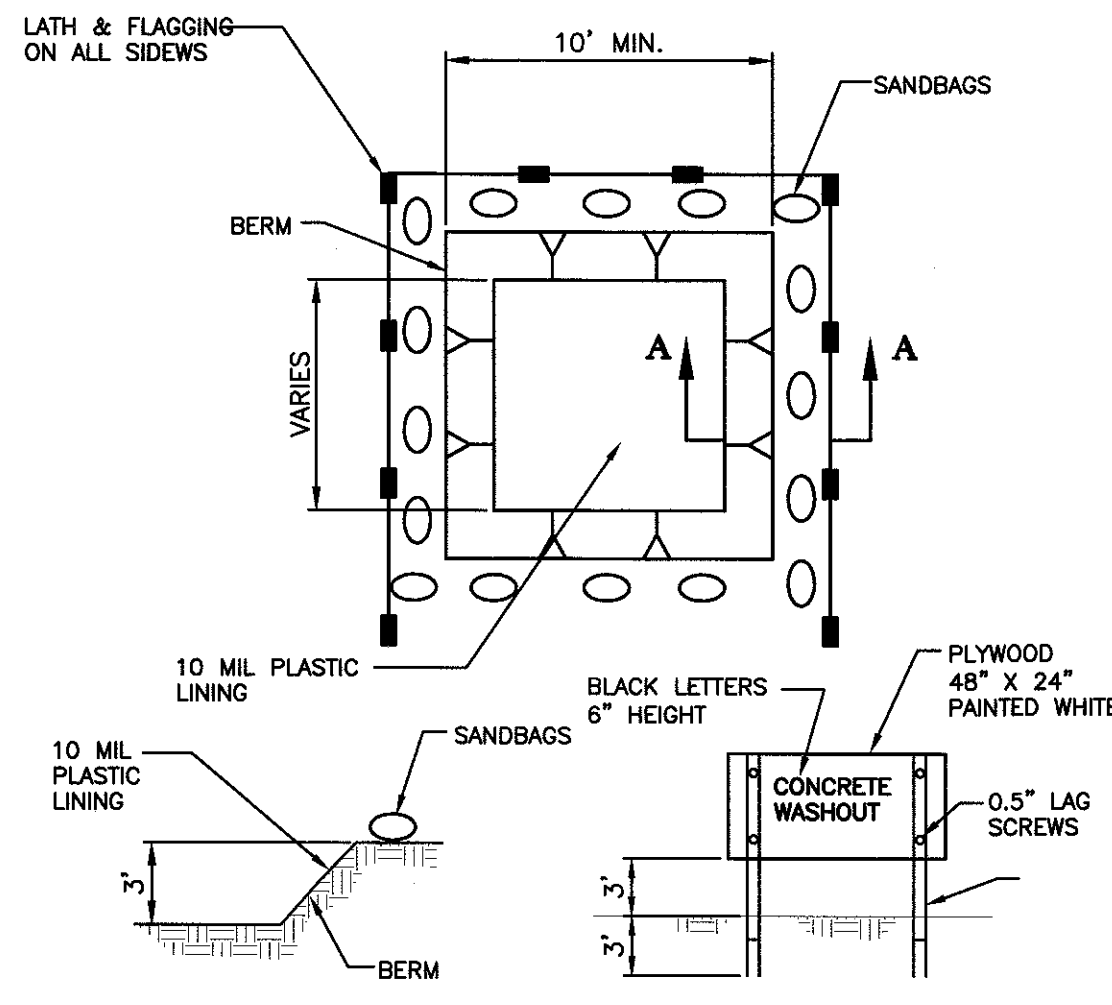


SECTION A-A
N.T.S.

CONCRETE WASHOUT
SIGN DETAIL
(OR EQUIVALENT)
N.T.S.

- TEMPORARY CONCRETE WASHOUT FACILITIES SHALL BE LOCATED A MINIMUM OF 50 FT FROM STORM DRAIN INLETS, OPEN DRAINAGE FACILITIES, AND WATERCOURSES. FACILITY SHALL BE LOCATED AWAY FROM CONSTRUCTION TRAFFIC OR ACCESS AREAS TO PREVENT DISTURBANCE OR TRACKING.
- TEMPORARY CONCRETE WASHOUT FACILITIES SHALL BE CONSTRUCTED AS SHOWN ON THE DETAIL WITH A MINIMUM LENGTH AND MINIMUM WIDTH OF 10'.
- LATH AND FLAGGING SHALL BE COMMERCIAL TYPE.
- PLASTIC LINING MATERIAL SHALL BE A MINIMUM OF 10 MIL POLYETHYLENE SHEETING AND SHALL BE FREE OF HOLES, TEARS, OR OTHER DEFECTS THAT COMPROMISE THE IMPERMEABILITY OF THE MATERIAL.
- A SIGN SHALL BE INSTALLED ADJACENT TO WASHOUT FACILITY TO INFORM CONCRETE EQUIPMENT OPERATORS TO UTILIZE THE PROPER FACILITIES.
- TEMPORARY CONCRETE WASHOUT FACILITIES SHALL HAVE A TEMPORARY PIT OR BERMED AREAS OF SUFFICIENT VOLUME TO COMPLETELY CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY WASHOUT PROCEDURES.
- WASHOUT OF CONCRETE TRUCKS SHALL BE PERFORMED IN DESIGNATED AREAS ONLY.
- ONLY CONCRETE FROM MIXER TRUCK CHUTES SHOULD BE WASHED INTO CONCRETE WASHOUT.
- CONCRETE WASHOUT FROM CONCRETE PUMPER BINS CAN BE WASHED INTO CONCRETE PUMPER TRUCKS AND DISCHARGED INTO DESIGNATED WASHOUT AREA OR PROPERLY DISPOSED OF OFF-SITE.
- CONCRETE WASTES SHALL BE ALLOWED TO HARDEN THEN BROKEN UP, REMOVED, AND PROPERLY DISPOSED OF IN ACCORDANCE WITH LOCAL REGULATION ON A REGULAR BASIS.
- WHEN TEMPORARY WASHOUT FACILITIES ARE NO LONGER REQUIRED FOR THE WORK, THE HARDENED CONCRETE SHALL BE REMOVED AND DISPOSED OF. MATERIALS USED TO CONSTRUCT THE WASHOUT FACILITIES SHALL BE REMOVED FROM THE SITE OF THE WORK AND DISPOSED OF.

TEMP. CONCRETE WASHOUT FACILITY
(BELOW GRADE)
N.T.S.

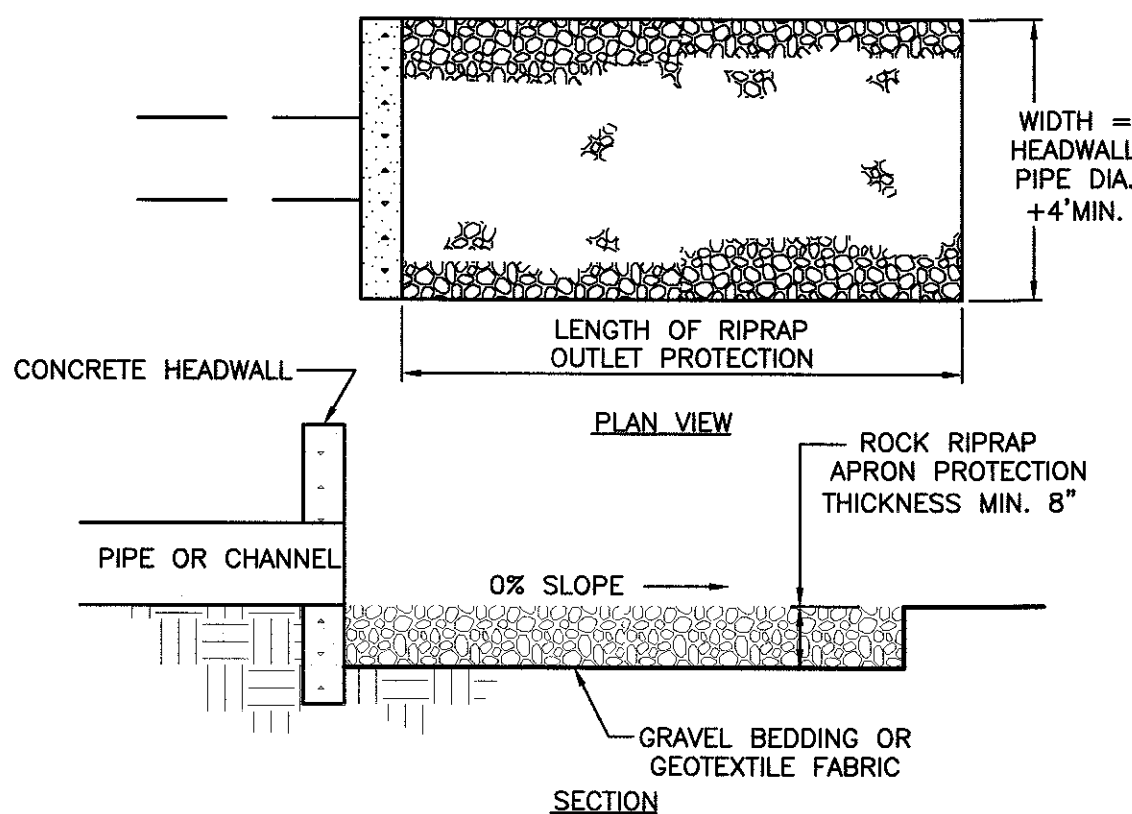

ROCK OUTLET PROTECTION
NOT TO SCALE

- SUBGRADE FOR THE FILTER OR BEDDING AND RIPRAP SHALL BE PREPARED TO THE REQUIRED LINES AND GRADES AS SHOWN ON THE PLAN. THE SUBGRADE SHALL BE CLEARED OF ALL TREES, STUMPS, ROOT, SOD, LOOSE ROCK OR OTHER MATERIAL.
- RIPRAP SHALL CONFORM TO THE GRADING LIMITS SHOWN ON THE PLAN.
- GEOTEXTILE SHALL BE SECURELY ANCHORED ACCORDING TO THE MANUFACTURERS' RECOMMENDATIONS.
- GEOTEXTILE SHALL BE LAID WITH THE LONG DIMENSION PARALLEL TO THE DIRECTION OF FLOW AND SHALL BE LAID LOOSELY BUT WITHOUT WRINKLES OR CREASES. WHERE JOINTS ARE NECESSARY, STRIPS SHALL BE PLACED TO PROVIDE A 12 IN. MINIMUM OVERLAP, WITH THE UPSTREAM STRIP OVERLAPPING THE DOWNSTREAM STRIP.
- GRAVEL BEDDING SHALL BE ODOT NO. 67's OR 57's UNLESS SHOWN DIFFERENTLY ON THE DRAWINGS.
- RIPRAP SHALL BE PLACED BY EQUIPMENT BUT SHALL BE PLACED IN A MANNER TO PREVENT SLIPPAGE OR DAMAGE TO THE GEOTEXTILE.
- RIPRAP SHALL BE PLACED BY A METHOD THAT DOES NOT CAUSE SEGREGATION OF SIZES. EXTENSIVE PUSHING WITH A DOZER CAUSES SEGREGATION AND SHALL BE AVOIDED BY DELIVERING RIPRAP NEAR ITS FINAL LOCATION WITHIN THE CHANNEL.
- CONSTRUCTION SHALL BE SEQUENCED SO THAT OUTLET PROTECTION IS PLACED AND FUNCTIONAL WHEN THE STORM DRAIN, CULVERT, OR OPEN CHANNEL ABOVE IT BECOMES OPERATIONAL.
- ALL DISTURBED AREAS SHALL BECOME VEGETATED AS SOON AS PRACTICAL.

- INLET PROTECTION SHALL BE CONSTRUCTED EITHER BEFORE UPSLOPE LAND DISTURBANCE BEGINS OR BEFORE THE STORM DRAIN BECOMES OPERATIONAL.
- THE EARTH AROUND THE INLET SHALL BE EXCAVATED COMPLETELY TO A DEPTH AT LEAST 18 INCHES.
- THE WOODEN FRAME SHALL BE CONSTRUCTED OF 2-BY-4-IN. CONSTRUCTION-GRADE LUMBER. THE 2-BY-4-IN. POSTS SHALL BE DRIVEN 1 FT. INTO THE GROUND AT FOUR CORNERS OF THE INLET AND THE TOP PORTION OF THE 2-BY-4-IN. FRAME ASSEMBLED USING THE OVERLAP JOINT SHOWN. THE TOP OF THE FRAME SHALL BE AT LEAST 6 INCHES BELOW ADJACENT ROADS, IF PONDED, WATER, WOULD POSE A SAFETY HAZARD TO TRAFFIC.
- WIRE MESH SHALL BE OF SUFFICIENT STRENGTH TO SUPPORT FABRIC WITH WATER FULLY IMPOUNDED AGAINST IT. IT SHALL BE STRETCHED TIGHTLY AROUND THE FRAME AND FASTENED SECURELY TO THE FRAME.

- SILT FENCE SHALL BE CONSTRUCTED BEFORE UPSLOPE LAND DISTURBANCE BEGINS.
- ALL SILT FENCE SHALL BE PLACED AS CLOSE TO THE CONTOUR AS POSSIBLE SO THAT WATER WILL NOT CONCENTRATE AT LOW POINTS IN THE FENCE AND SO THAT SMALL SWALES OR DEPRESSIONS WHICH MAY CARRY SMALL CONCENTRATED FLOWS TO THE SILT FENCE ARE DISSIPATED ALONG ITS LENGTH.
- TO PREVENT WATER PONDED BY THE SILT FENCE FROM FLOWING AROUND THE ENDS, EACH END SHALL BE CONSTRUCTED UPSLOPE SO THAT THE ENDS ARE AT A HIGHER ELEVATION.

- WHERE POSSIBLE, SILT FENCE SHALL BE PLACED ON THE FLATTEST AREA AVAILABLE.
- WHERE POSSIBLE, VEGETATION SHALL BE PRESERVED FOR 5 FT. (OR AS MUCH AS POSSIBLE) UPSLOPE FROM THE SILT FENCE. IF VEGETATION IS REMOVED, IT SHALL BE REESTABLISHED WITHIN 7 DAYS FROM THE INSTALLATION OF THE SILT FENCE.
- THE HEIGHT OF THE SILT FENCE SHALL BE A MIN. OF 16 IN. ABOVE THE ORIGINAL GROUND SURFACE.
- THE SILT FENCE SHALL BE PLACED IN A TRENCH CUT A MIN. OF 6 IN. DEEP. THE TRENCH SHALL BE CUT WITH A TRENCHER, CABLE LAYING MACHINE, OR OTHER SUITABLE DEVICE WHICH WILL ENSURE AN ADEQUATELY UNIFORM TRENCH DEPTH.

FABRIC PROPERTIES	VALUES	TEST METHOD
GRAB TENSILE STRENGTH	90 LB. MINIMUM	ASTM D 1682
MULLEN BURST STRENGTH	190 PSI MINIMUM	ASTM D 3786
SLURRY FLOW RATE	0.3 GAL./MIN./F ² MAXIMUM	ASTM D 3786
EQUIVALENT OPENING SIZE	40-80	US STD. SIEVE CW-02215
ULTRAVIOLET RADIATION STABILITY	90% MINIMUM	ASTM-G-26

SPECIFICATIONS FOR TEMPORARY ROLLED EROSION CONTROL PRODUCT

- CHANNEL/SLOPE SOIL PREPARATION GRADE AND COMPACT AREA OF INSTALLATION, PREPARING SEEDBED BY LOOSENING 2" 3" OF TOPSOIL ABOVE FINAL GRADE. INCORPORATE AMENDMENTS SUCH AS LIME AND FERTILIZER INTO SOIL. REMOVE ALL ROCKS, CLODS, VEGETATION OR OTHER DEBRIS SO THAT INSTALLED RECP WILL HAVE DIRECT CONTACT WITH THE SOIL SURFACE.
- CHANNEL/SLOPE SEEDING APPLY SEED TO SOIL SURFACE PRIOR TO INSTALLATION. ALL CHECK SLOTS, ANCHOR TRENCHES, AND OTHER DISTURBED AREAS MUST BE RESEED. REFER TO THE PERMANENT SEEDING SPECIFICATION FOR SEEDING RECOMMENDATIONS.

SLOPE INSTALLATION

- EXCAVATE TOP AND BOTTOM TRENCHES (12" X6"). INTERMITTENT EROSION CHECK SLOTS (6" X6") MAY BE REQUIRED BASED ON SLOPE LENGTH. EXCAVATE TOP ANCHOR TRENCH 2' X 3' OVER CREST OF THE SLOPE.
- IF INTERMITTENT EROSION CHECK SLOTS ARE REQUIRED, INSTALL RECP IN 6"X6" SLOT AT A MAXIMUM OF 30' CENTERS OR THE MID POINT OF THE SLOPE. RECP SHOULD BE STAPLED INTO TRENCH ON 12" CENTERS.
- INSTALL RECP IN TOP ANCHOR TRENCH, ANCHOR ON 12" SPACINGS, BACKFILL AND COMPACT SOIL.
- UNROLL RECP DOWN SLOPE WITH ADJACENT ROLLS OVERLAPPED A MINIMUM OF 3". ANCHOR THE SEAM EVERY 18". LAY THE RECP LOOSE TO MAINTAIN DIRECT SOIL CONTACT, DO NOT PULL TAUGHT.
- OVERLAP ROLL ENDS A MINIMUM OF 12" WITH UPSLOPE RECP ON TOP FOR A SHINGLE EFFECT. BEGIN ALL NEW ROLLS IN AN EROSION CHECK SLOT IF REQUIRED, DOUBLE ANCHOR ACROSS ROLL EVERY 12".
- INSTALL RECP IN BOTTOM ANCHOR TRENCH (12"X6"). ANCHOR EVERY 12". PLACE ALL OTHER STAPLES THROUGHOUT SLOPE AT 1 TO 2.5 PER SQUARE YARD DEPENDANT ON SLOPE. REFER TO MANUFACTURER'S ANCHOR GUIDE.

SILT FENCE


- GEOTEXTILE SHALL HAVE AN EQUIVALENT OPENING SIZE OF 20-40- SIEVE AND BE RESISTANT TO SUNLIGHT. IT SHALL BE STRETCHED TIGHTLY AROUND THE FRAME AND FASTENED SECURELY. IT SHALL EXTEND FROM TOP OF THE FRAME TO 18 INCHES BELOW THE INLET NOTCH ELEVATION. THE GEOTEXTILE SHALL OVERLAP ACROSS ON SIDE OF THE INLET SO THE ENDS OF THE CLOTH ARE NOT FASTENED TO THE SAME POST.
- BACKFILL SHALL BE PLACED AROUND THE INLET IN COMPACTED 6-IN. LAYERS UNTIL THE EARTH IS EVEN WITH NOTCH ELEVATION ON ENDS AND TOP ELEVATION ON SIDES.
- A COMPACTED EARTH DIKE OR A CHECK DAM SHALL BE CONSTRUCTED IN THE DITCH LINE BELOW THE INLET IF THE INLET IS NOT IN A DEPRESSION AND IF RUNOFF BYPASSING THE INLET WILL NOT FLOW TO A SETTLING POND. THE TOP OF EARTH DIKES SHALL BE AT LEAST 6 INCHES HIGHER THAN THE TOP OF THE FRAME.

- THE SILT FENCE SHALL BE PLACED WITH THE STAKES ON THE DOWN SLOPE SIDE OF THE GEOTEXTILE AND SO THAT 6 IN. OF CLOTH ARE BELOW THE GROUND SURFACE. EXCESS MATERIAL SHALL LAY ON THE BOTTOM OF THE 6 IN. DEEP TRENCH. THE TRENCH SHALL BE BACKFILLED AND COMPACTED.
- SEAMS BETWEEN SECTIONS OF SILT FENCE SHALL OVERLAP WITH THE END STAKES OF EACH SECTION WRAPPED TOGETHER BEFORE DRIVING INTO THE GROUND.


- MAINTENANCE--SILT FENCE SHALL ALLOW RUNOFF TO PASS ONLY AS DIFFUSE FLOW THROUGH THE GEOTEXTILE. IF RUNOFF OVERTOPS THE SILT FENCE, FLOWS UNDER OR AROUND THE ENDS, OR IN ANY OTHER WAY BECOMES A CONCENTRATED FLOW, ONE OF THE FOLLOWING SHALL BE PERFORMED, AS APPROPRIATE: 1) THE LAYOUT OF THE SILT FENCE SHALL BE CHANGED, 2) ACCUMULATED SEDIMENT SHALL BE REMOVED, OR 3) OTHER PRACTICES SHALL BE INSTALLED.

CRITERIA FOR SILT FENCE MATERIALS

- FENCE POSTS-- THE LENGTH SHALL BE A MINIMUM OF 32 IN. LONG. WOOD POSTS WILL BE 2-BY-2 IN. HARDWOOD OF SOUND QUALITY. THE MAXIMUM SPACING BETWEEN POSTS SHALL BE 10 FT.
- SILT FENCE FABRIC (SEE CHART BELOW):

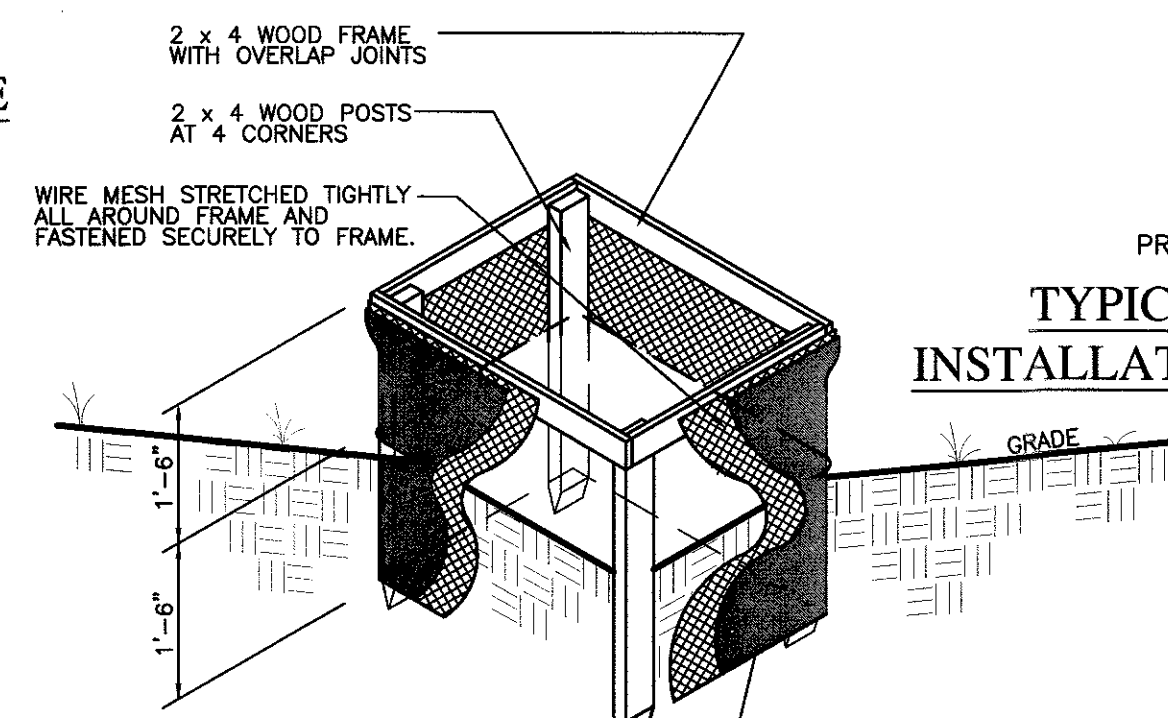


TYPICAL SILT FENCE
INSTALLATION AT ALL INLETS

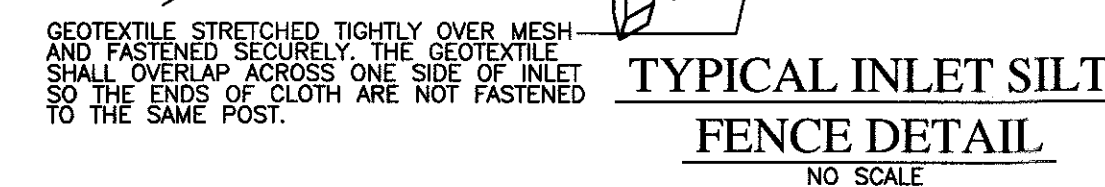


TYPICAL INLET SILT
FENCE DETAIL
NO SCALE

INLET PROTECTION NOTE


- THE TYPICAL INLET SILT FENCE DETAIL SHALL REMAIN IN PLACE UNTIL PAVEMENT IS ESTABLISHED.
- ONCE PAVEMENT HAS BEEN INSTALLED, THE INLETS WITHIN THE PAVING LIMITS MUST BE FITTED WITH THE "SILT-SACK" SEDIMENT CONTROL DEVICE AS MANUFACTURED BY ACF ENVIRONMENTAL CONTROL INC., OR APPROVED EQUAL.
- SILT SACK MUST REMAIN IN PLACE UNTIL THE SITE HAS BEEN SEED & STABILIZED.

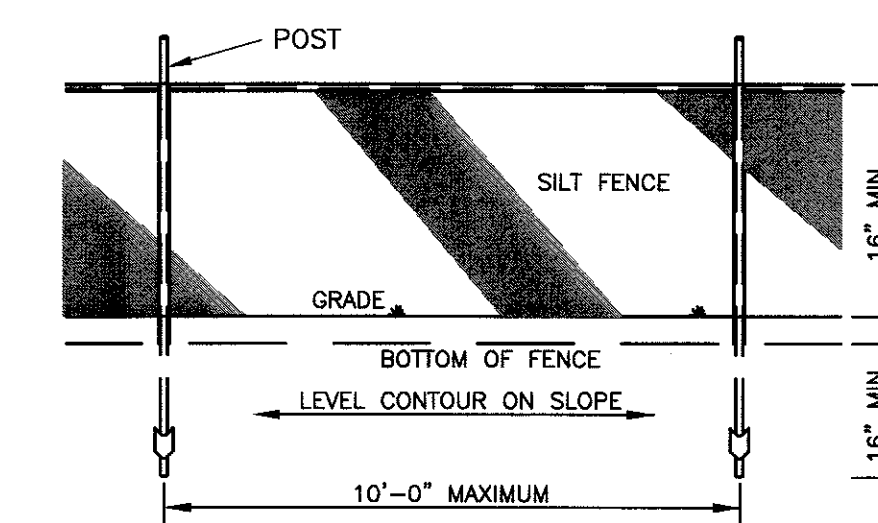

SILT FENCE DETAIL
NO SCALE

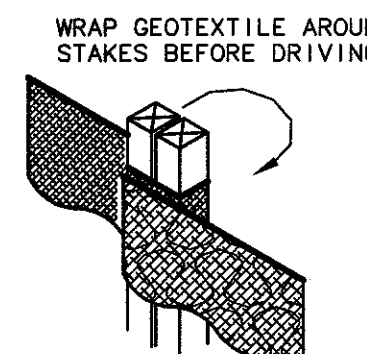

JOINING SECTIONS OF
SILT FENCE DETAIL
NO SCALE

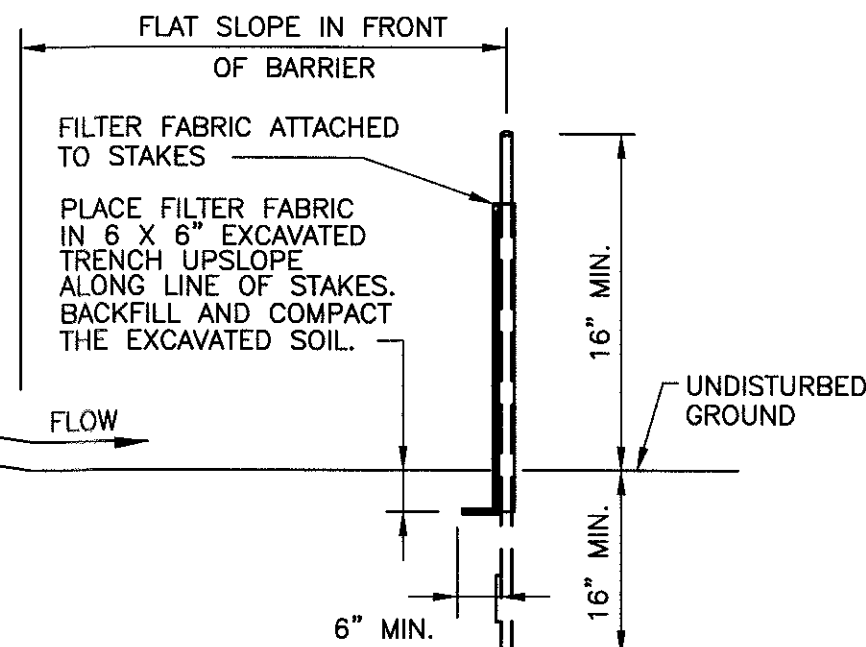


SILT FENCE SECTION
NO SCALE

SPECIFICATIONS FOR TEMPORARY ROLLED EROSION CONTROL PRODUCT (continued)

CHANNEL INSTALLATION

- EXCAVATE INITIAL ANCHOR TRENCH (12"X6") ACROSS THE LOWER END OF THE PROJECT AREA.
- EXCAVATE INTERMITTENT CHECK SLOTS (6"X6") ACROSS THE CHANNEL AT 30' INTERVALS ALONG THE CHANNEL.
- EXCAVATE LONGITUDINAL CHANNEL ANCHOR SLOTS (4"X4") ALONG BOTH SIDES OF THE CHANNEL TO BURY THE EDGES. WHENEVER POSSIBLE EXTEND THE RECP 2' 3" ABOVE THE CREST OF CHANNEL SIDE SLOPES.
- INSTALL RECP IN INITIAL ANCHOR TRENCH (DOWNSTREAM) ANCHOR EVERY 12", BACKFILL AND COMPACT SOIL.
- ROLL OUT RECP BEGINNING IN THE CENTER OF THE CHANNEL TOWARD THE INTERMITTENT CHECK SLOT. DO NOT PULL TAUGHT. UNROLL ADJACENT ROLLS UPSTREAM WITH A 3" MINIMUM OVERLAP (ANCHOR EVERY 18") AND UP EACH CHANNEL SIDE SLOPE.
- AT TOP OF CHANNEL SIDE SLOPES INSTALL RECP IN THE LONGITUDINAL ANCHOR SLOTS, ANCHOR EVERY 18".
- INSTALL RECP IN INTERMITTENT CHECK SLOTS LAY INTO TRENCH AND SECURE WITH ANCHORS EVERY 12", BACKFILL WITH SOIL AND COMPACT.
- OVERLAP ROLL ENDS A MINIMUM OF 12" WITH UPSLOPE RECP ON TOP FOR A SHINGLE EFFECT. BEGIN ALL NEW ROLLS IN AN INTERMITTENT CHECK SLOT, DOUBLE ANCHORED EVERY 12".
- INSTALL UPSLOPE END IN A TERMINAL ANCHOR TRENCH (12"X6"); ANCHOR EVERY 12", BACKFILL AND COMPACT.
- COMPLETE ANCHORING THROUGHOUT CHANNEL AT 2.5 PER SQUARE YARD USING SUITABLE GROUND ANCHORING DEVICES (U SHAPED WIRE STAPLES, METAL GEOTEXTILE PINS, PLASTIC STAKES, AND TRIANGULAR WOODEN STAKES). ANCHORS SHOULD BE OF SUFFICIENT LENGTH TO RESIST PULLOUT. LONGER ANCHORS MAY BE REQUIRED IN LOOSE SANDY OR GRAVELLY SOILS.

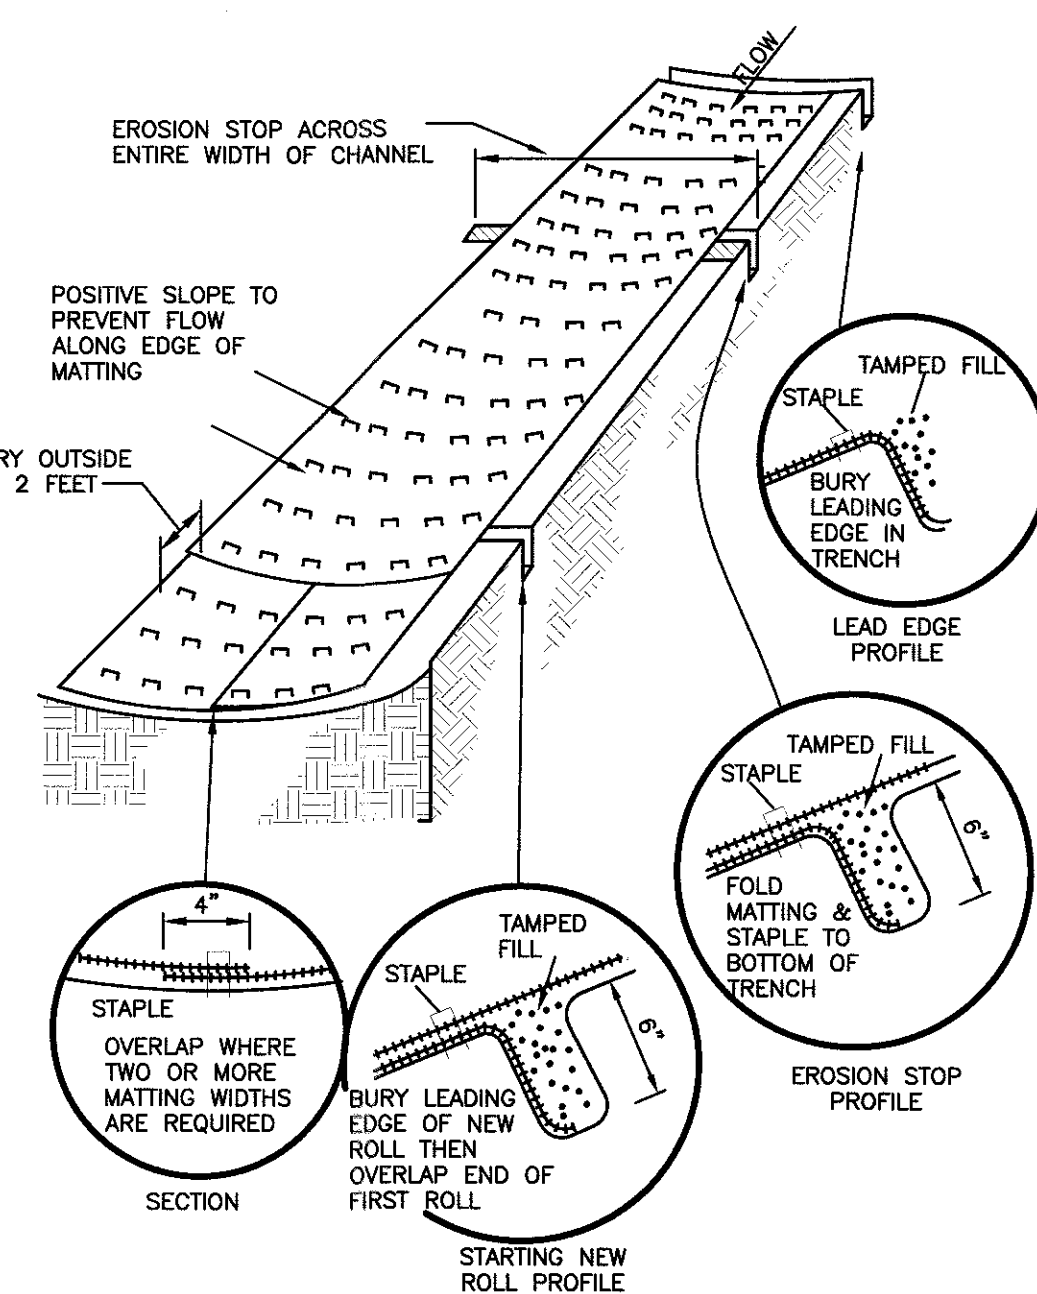

TEMPORARY ROLLED EROSION CONTROL PRODUCT
NOT TO SCALE

REVISIONS

GBC DESIGN, INC.
Akron, OH 44320
Phone 330-896-5782

21 LINCOLN WAY PROJECT LLC
SUITE 301
3951 CONVENIENCE CIRCLE N.W.
CANTON, OH 44718

DEVILLE 21 LINCOLN WAY
OUT LOT 1122
MASSILLON, OHIO
SWPPP DETAILS

DRAWN BY:
T.G.W.

DATE:
6/26/2015

PROJECT NO.
47190

DRAWING NO.

SD7.03