


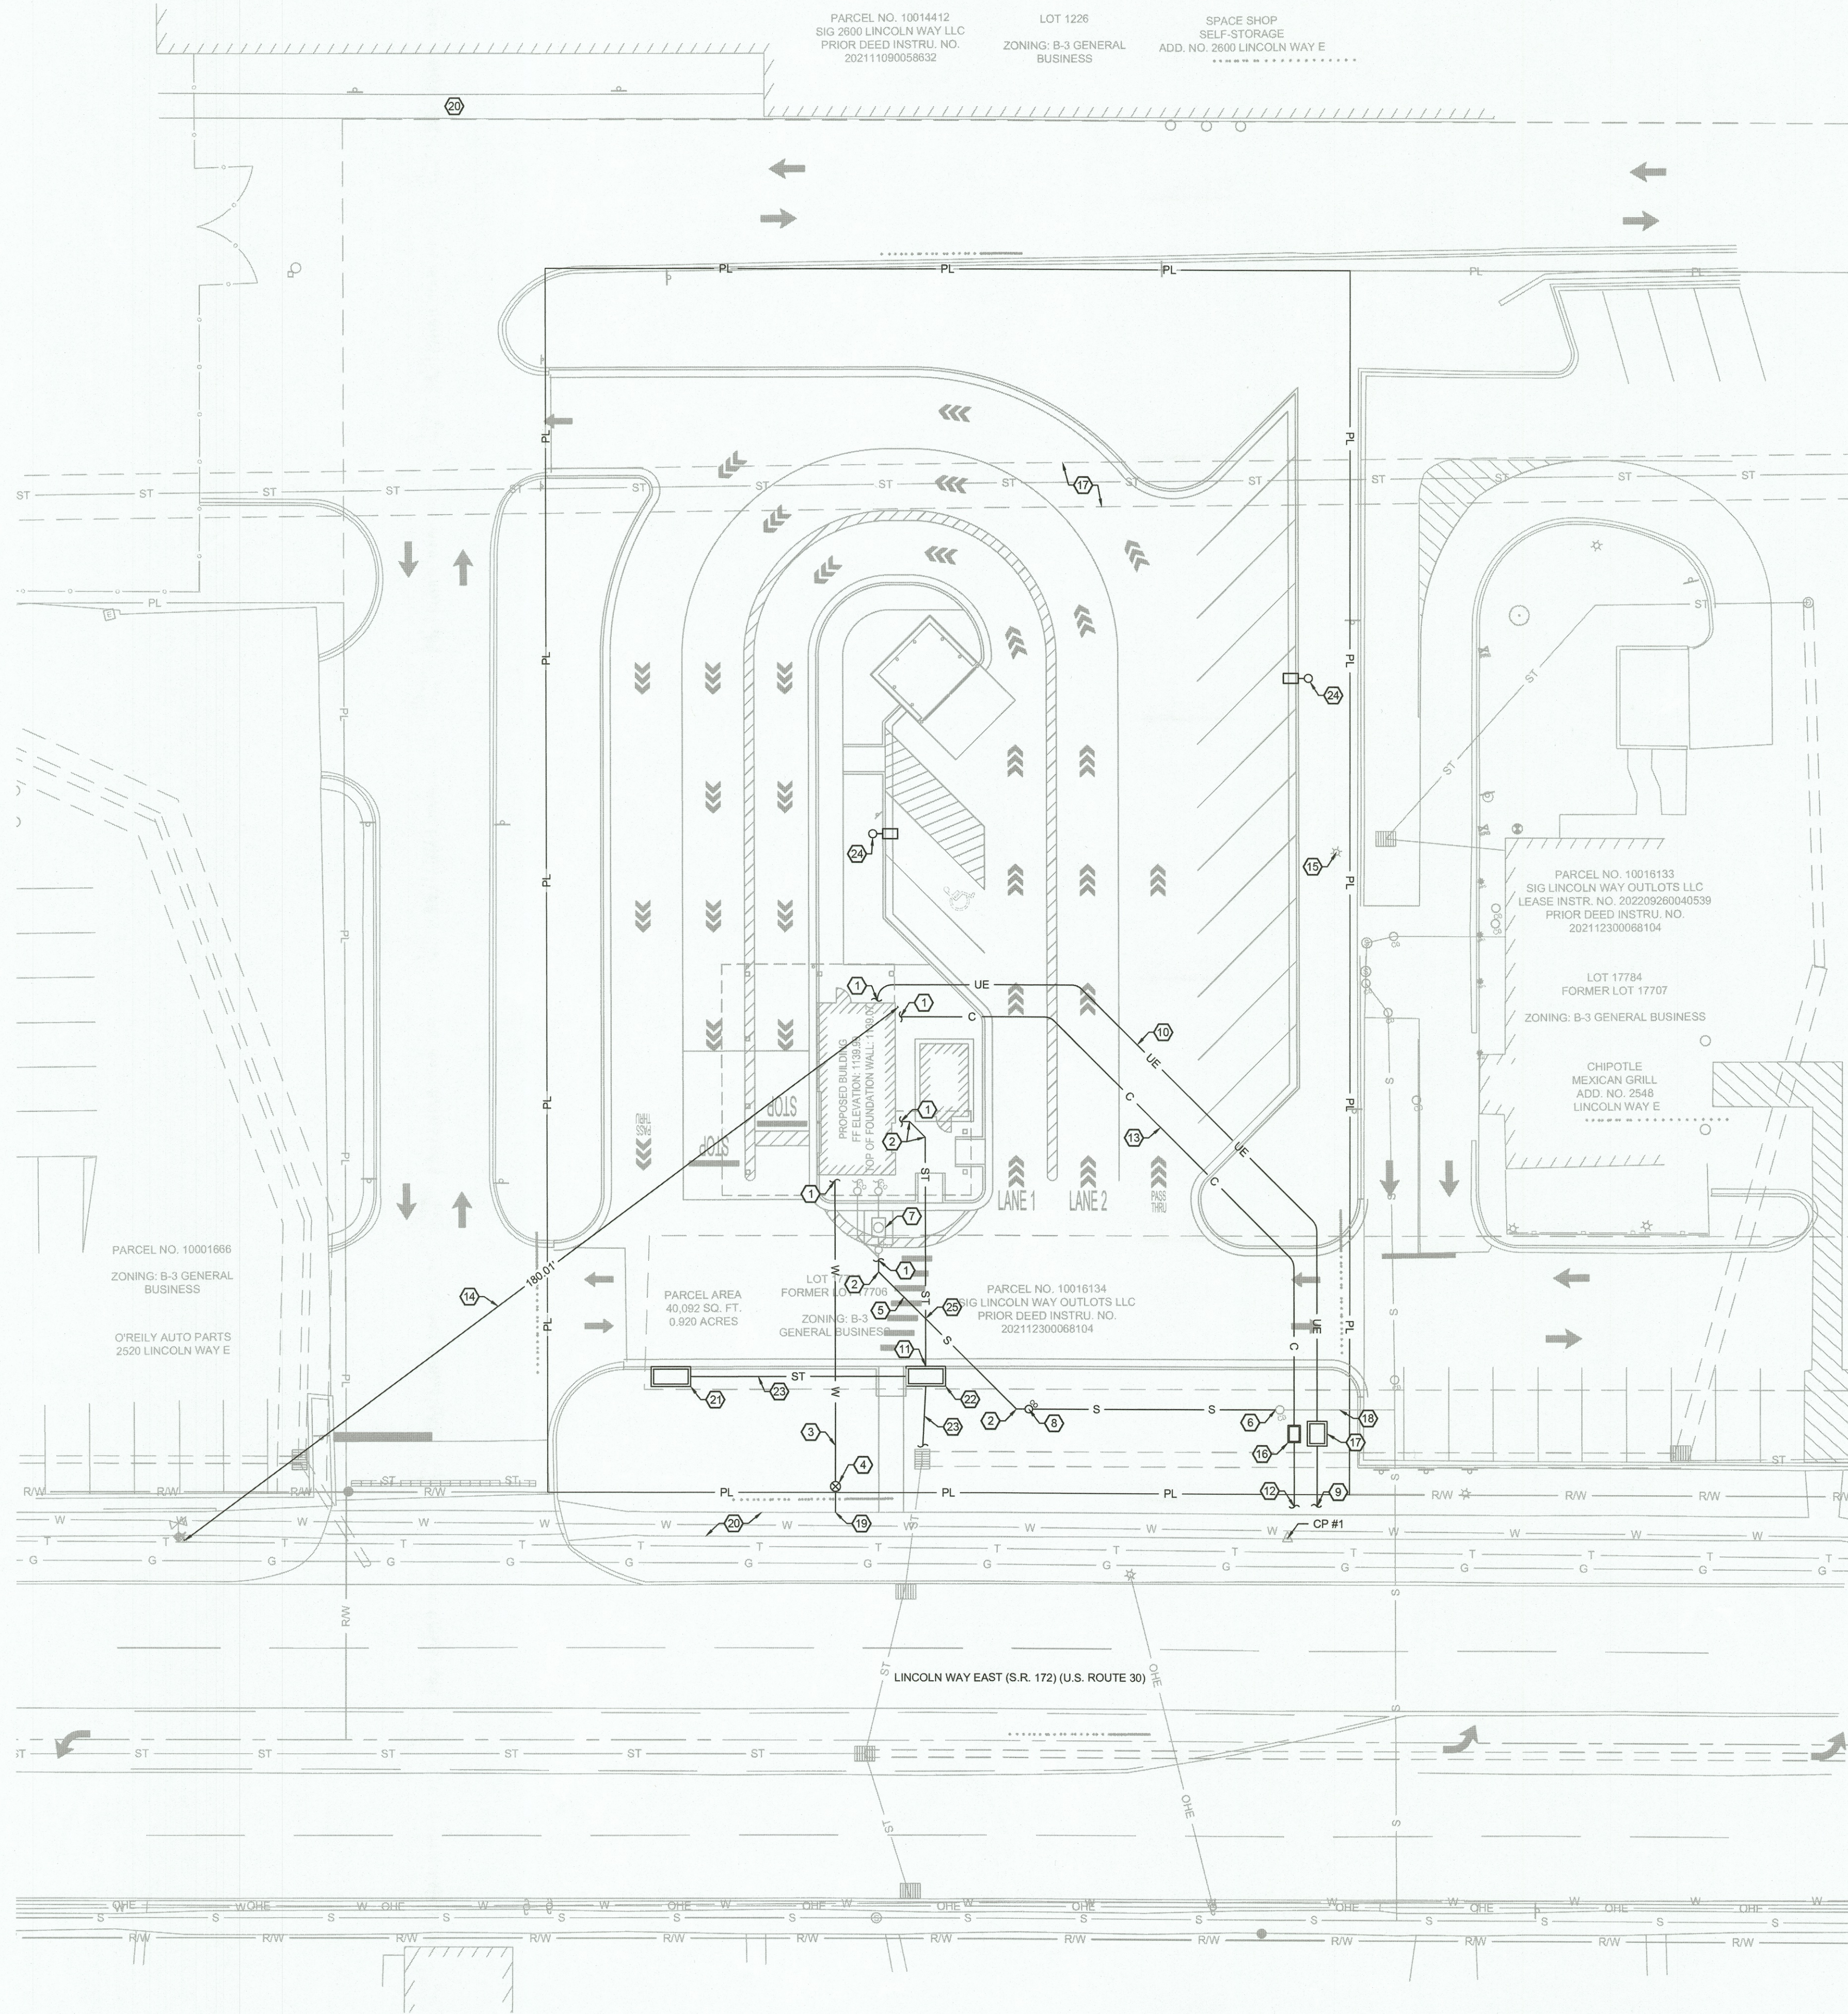

KEY NOTES:

- 1 SEE MEP PLANS FOR CONTINUATION.
- 2 FROM WATER METER TO BUILDING PER PIPE INSTALLATION DETAILS SHEET C7.2.
- 3 1" WATER METER TO BE INSTALLED BY WATER UTILITY PROVIDER. CONTRACTOR TO CONFIRM FINAL WATER METER LOCATION WITH THE WATER UTILITY PROVIDER PRIOR TO INSTALLATION OF WATER SERVICE LINE.
- 4 OF 1.00% PER PIPE INSTALLATION DETAILS SHEET C7.2.
- 5 CONTRACTOR TO CONNECT 6" SCH. 40 PVC SANITARY SEWER SERVICE LINE TO EXISTING SEWER LATERAL. CONTRACTOR TO VERIFY DEPTH AND LOCATION OF SEWER LINE TO ENSURE NO CONFLICT PRIOR TO CONSTRUCTION. COORDINATE CONNECTION WITH SEWER UTILITY PROVIDER.
- 6 125 GALLON SCHIER GB-75 GREASE INTERCEPTOR WITH H-20 RATED CAST IRON COVER, SEE MEP PLANS SHEET M3.1.
- 7 SEWER LATERAL CLEAN OUT PER DETAIL SHEET C7.2.
- 8 ROUTING OF PROPOSED ELECTRIC UTILITY AND POINT OF CONNECTION SHOWN IS APPROXIMATE. CONTRACTOR TO COORDINATE WITH ELECTRIC UTILITY PROVIDER TO DETERMINE FINAL LOCATION PRIOR TO INSTALLATION OF ELECTRIC SERVICE LINE.
- 9 BURIED ELECTRIC LINE, SEE MEP PLANS SHEET SU1.1.
- 10 TERMINATE DISCHARGE LINE TO CURB INLET.
- 11 ROUTING OF PROPOSED COMMUNICATION UTILITY AND POINT OF CONNECTION SHOWN IS APPROXIMATE. CONTRACTOR TO COORDINATE WITH COMMUNICATION UTILITY PROVIDER TO DETERMINE FINAL LOCATION PRIOR TO INSTALLATION OF COMMUNICATION SERVICE LINE.
- 12 (2) 2" COMMUNICATIONS CONDUITS WITH PULLWIRE.
- 13 DISTANCE TO NEAREST FIRE HYDRANT.
- 14 EXISTING LIGHT POLE, SEE MEP PLANS FOR SITE LIGHTING SHEET SU1.2.
- 15 PROPOSED COMMUNICATION PULL BOX LOCATION, IF REQUIRED. COORDINATE WITH COMMUNICATION UTILITY PROVIDER. SEE MEP PLANS SHEET SU1.1.
- 16 PROPOSED TRANSFORMER LOCATION, IF REQUIRED. COORDINATE WITH ELECTRIC UTILITY PROVIDER. SEE MEP PLANS SHEET SU1.1.
- 17 APPROXIMATE LOCATION OF EXISTING SANITARY SEWER.
- 18 CONNECTION OF WATER SERVICE TO MAIN BY WATER UTILITY PROVIDER.
- 19 EXISTING SIDEWALK.
- 20 PROPOSED CURB INLET, RIM: 1136.15, FLOW OUT: 1128.40.
- 21 PROPOSED CURB INLET, RIM: 1138.15, FLOW IN: 1127.51 FLOW OUT: 1127.46.
- 22 INSTALL NEW LIGHT POLE, SEE MEP PLANS SHEET SU1.1.
- 23 UTILITY CROSSING, CONTRACTOR TO COORDINATE DEPTH IN FIELD.

EXISTING UTILITY PROVIDER CONTACT INFORMATION:

1. WATER AQUA OHIO
870 3RD ST NW
MASSILLON, OH 44647
(877) 987-2782
2. ELECTRIC OHIO EDISON - FIRST ENERGY
470 EAST HIGHLAND ROAD
MACEDONIA, OH 44056
(330) 342-1220
3. SEWER CITY OF MASSILLON
151 LINCOLN WAY EAST
MASSILLON, OH 44646
(330) 830-1700
4. GAS DOMINION ENERGY OHIO
4725 SOUTHWAY ST SW
CANTON, OH 44708
(800) 362-7557
5. TELCOM AT&T
13630 LORAIN AVE. 2ND FLOOR
CLEVELAND, OH 44111
(216) 476-6142



ENGINEER OF RECORD:
NAME: SHAWN W. BARRY
LICENSE NO.: OH #E-88665

PROJECT NUMBER:
7B/MH

REVISION:

7 BREW COFFEE
MASSILLON, OH
2600 LINCOLN WAY E
MASSILLON, OHIO 44646

C4.1
UTILITY PLAN

DATE: MARCH 09, 2023

