
3 1 2

1

2

6 7 8 9 4 5

3 4 5 6 7 8

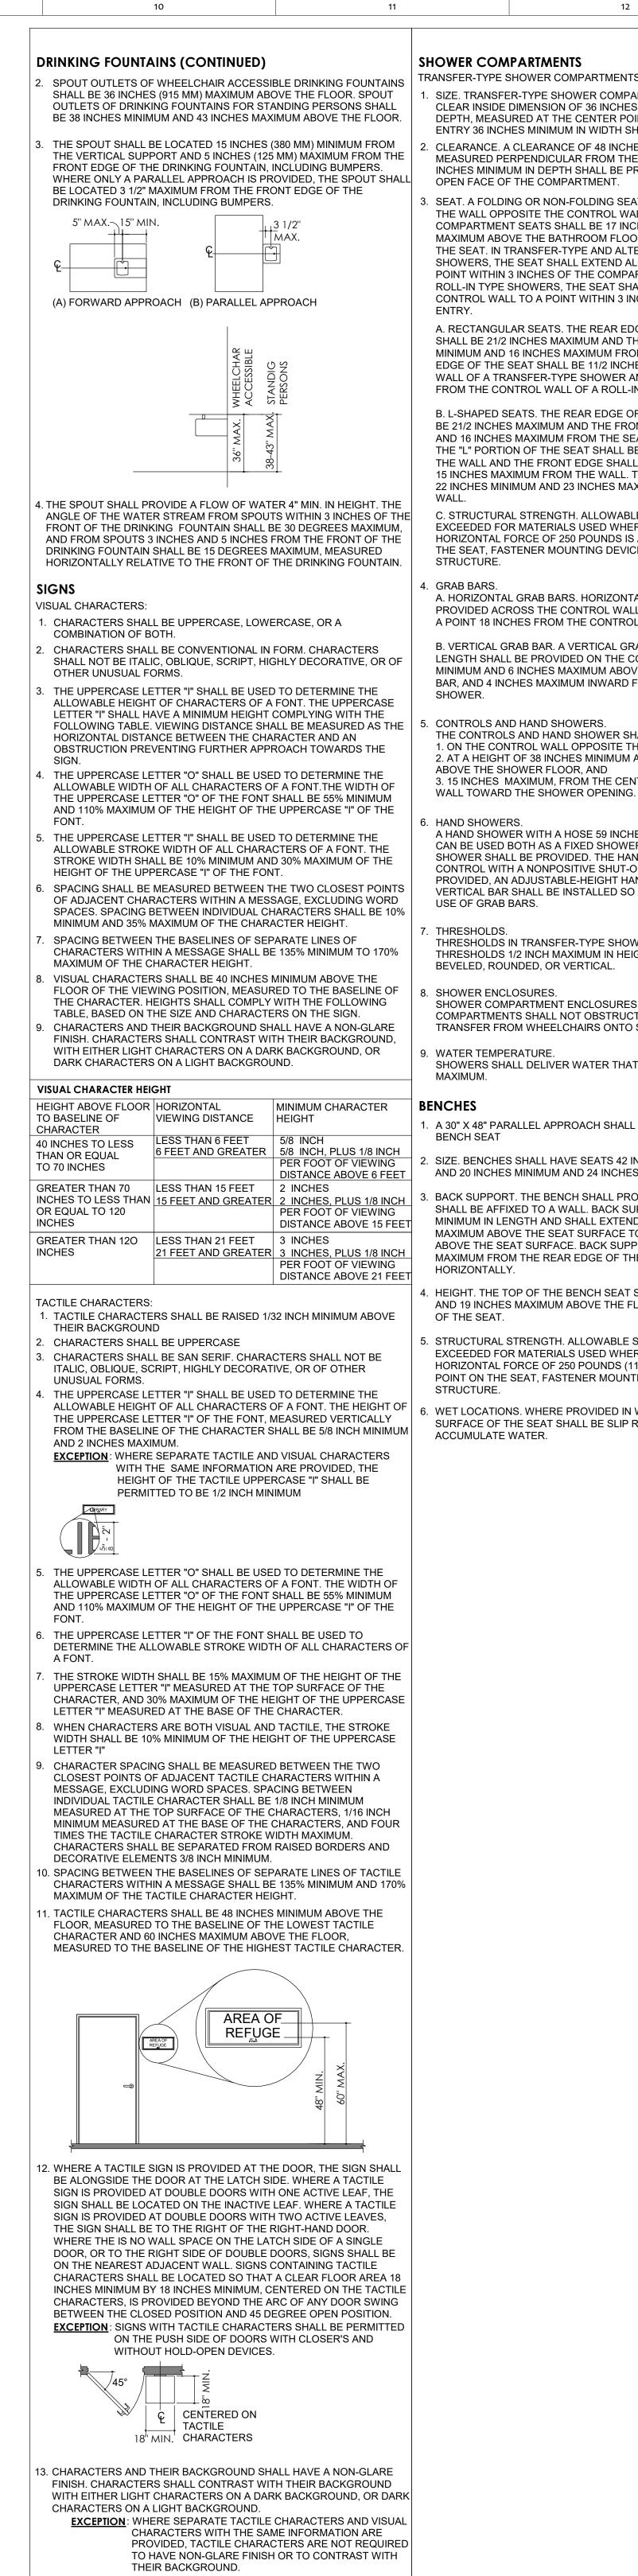

9

SHOWER COMPARTMENTS RANSFER-TYPE SHOWER COMPARTMENTS:

1. SIZE. TRANSFER-TYPE SHOWER COMPARTMENTS SHALL HAVE A CLEAR INSIDE DIMENSION OF 36 INCHES IN WIDTH AND 36 INCHES IN DEPTH, MEASURED AT THE CENTER POINT OF OPPOSING SIDES. AN ENTRY 36 INCHES MINIMUM IN WIDTH SHALL BE PROVIDED. CLEARANCE. A CLEARANCE OF 48 INCHES MINIMUM IN LENGTH

12

- MEASURED PERPENDICULAR FROM THE CONTROL WALL, AND 36 INCHES MINIMUM IN DEPTH SHALL BE PROVIDED ADJACENT TO THE OPEN FACE OF THE COMPARTMENT.
- SEAT. A FOLDING OR NON-FOLDING SEAT SHALL BE PROVIDED ON THE WALL OPPOSITE THE CONTROL WALL. THE HEIGHT OF SHOWER COMPARTMENT SEATS SHALL BE 17 INCHES MINIMUM AND 19 INCHES MAXIMUM ABOVE THE BATHROOM FLOOR, MEASURED TO THE TOP OF THE SEAT. IN TRANSFER-TYPE AND ALTERNATE ROLL-IN-TYPE SHOWERS, THE SEAT SHALL EXTEND ALONG THE SEAT WALL TO A POINT WITHIN 3 INCHES OF THE COMPARTMENT ENTRY. IN STANDARD ROLL-IN TYPE SHOWERS, THE SEAT SHALL EXTEND FROM THE CONTROL WALL TO A POINT WITHIN 3 INCHES OF THE COMPARTMENT FNTRY
- A. RECTANGULAR SEATS. THE REAR EDGE OF A RECTANGULAR SEAT SHALL BE 21/2 INCHES MAXIMUM AND THE FRONT EDGE 15 INCHES MINIMUM AND 16 INCHES MAXIMUM FROM THE SEAT WALL. THE SIDE EDGE OF THE SEAT SHALL BE 11/2 INCHES MAXIMUM FROM THE BACK WALL OF A TRANSFER-TYPE SHOWER AND 11/2 INCHES MAXIMUM FROM THE CONTROL WALL OF A ROLL-IN-TYPE SHOWER.
- BE 21/2 INCHES MAXIMUM AND THE FRONT EDGE 15 INCHES MINIMUM AND 16 INCHES MAXIMUM FROM THE SEAT WALL. THE REAR EDGE OF THE "L" PORTION OF THE SEAT SHALL BE 11/2 INCHES MAXIMUM FROM THE WALL AND THE FRONT EDGE SHALL BE 14 INCHES MINIMUM AND 15 INCHES MAXIMUM FROM THE WALL. THE END OF THE "L" SHALL BE 22 INCHES MINIMUM AND 23 INCHES MAXIMUM FROM THE MAIN SEAT
- C. STRUCTURAL STRENGTH. ALLOWABLE STRESSES SHALL NOT BE EXCEEDED FOR MATERIALS USED WHERE A VERTICAL OR HORIZONTAL FORCE OF 250 POUNDS IS APPLIED AT ANY POINT ON THE SEAT, FASTENER MOUNTING DEVICE, OR SUPPORTING STRUCTURE. GRAB BARS.
- A. HORIZONTAL GRAB BARS. HORIZONTAL GRAB BARS SHALL BE PROVIDED ACROSS THE CONTROL WALL AND ON THE BACK WALL TO A POINT 18 INCHES FROM THE CONTROL WALL. B. VERTICAL GRAB BAR. A VERTICAL GRAB BAR 18 INCHES MINIMUM IN LENGTH SHALL BE PROVIDED ON THE CONTROL END WALL 3 INCHES MINIMUM AND 6 INCHES MAXIMUM ABOVE THE HORIZONTAL GRAB
- BAR, AND 4 INCHES MAXIMUM INWARD FROM THE FRONT EDGE OF THE SHOWER. CONTROLS AND HAND SHOWERS. THE CONTROLS AND HAND SHOWER SHALL BE LOCATED: 1. ON THE CONTROL WALL OPPOSITE THE SEAT. 2. AT A HEIGHT OF 38 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE SHOWER FLOOR, AND 3. 15 INCHES MAXIMUM, FROM THE CENTERLINE OF THE CONTROL
- HAND SHOWERS. A HAND SHOWER WITH A HOSE 59 INCHES MINIMUM IN LENGTH, THAT CAN BE USED BOTH AS A FIXED SHOWER HEAD AND AS A HAND SHOWER SHALL BE PROVIDED. THE HAND SHOWER SHALL HAVE A CONTROL WITH A NONPOSITIVE SHUT-OFF FEATURE. WHERE USE OF GRAB BARS.
- THRESHOLDS THRESHOLDS IN TRANSFER-TYPE SHOWER COMPARTMENTS. THRESHOLDS 1/2 INCH MAXIMUM IN HEIGHT SHALL BE BEVELED, ROUNDED, OR VERTICAL.
- SHOWER ENCLOSURES. SHOWER COMPARTMENT ENCLOSURES FOR SHOWER COMPARTMENTS SHALL NOT OBSTRUCT CONTROLS OR OBSTRUCT TRANSFER FROM WHEELCHAIRS ONTO SHOWER SEATS.
- WATER TEMPERATURE. SHOWERS SHALL DELIVER WATER THAT IS 120°F MAXIMUM.

BENCHES A 30" X 48" PARALLEL APPROACH SHALL BE PROVIDED TO THE BENCH SEAT

- 2. SIZE. BENCHES SHALL HAVE SEATS 42 INCHES MINIMUM IN LENGTH, AND 20 INCHES MINIMUM AND 24 INCHES (610 MM) MAXIMUM IN DEPTH.
- BACK SUPPORT. THE BENCH SHALL PROVIDE FOR BACK SUPPORT OR SHALL BE AFFIXED TO A WALL. BACK SUPPORT SHALL BE 42 INCHES MINIMUM IN LENGTH AND SHALL EXTEND FROM A POINT 2 INCHES MAXIMUM ABOVE THE SEAT SURFACE TO A POINT 18 INCHES MINIMUM ABOVE THE SEAT SURFACE. BACK SUPPORT SHALL BE 21/2 INCHES MAXIMUM FROM THE REAR EDGE OF THE SEAT MEASURED HORIZONTALLY.
- HEIGHT. THE TOP OF THE BENCH SEAT SHALL BE 17 INCHES MINIMUM AND 19 INCHES MAXIMUM ABOVE THE FLOOR, MEASURED TO THE TOP OF THE SEAT.
- STRUCTURAL STRENGTH. ALLOWABLE STRESSES SHALL NOT BE EXCEEDED FOR MATERIALS USED WHERE A VERTICAL OR HORIZONTAL FORCE OF 250 POUNDS (1112 N) IS APPLIED AT ANY POINT ON THE SEAT, FASTENER MOUNTING DEVICE, OR SUPPORTING STRUCTURE.
- WET LOCATIONS. WHERE PROVIDED IN WET LOCATIONS THE SURFACE OF THE SEAT SHALL BE SLIP RESISTANT AND SHALL NOT ACCUMULATE WATER.

12

11

10

