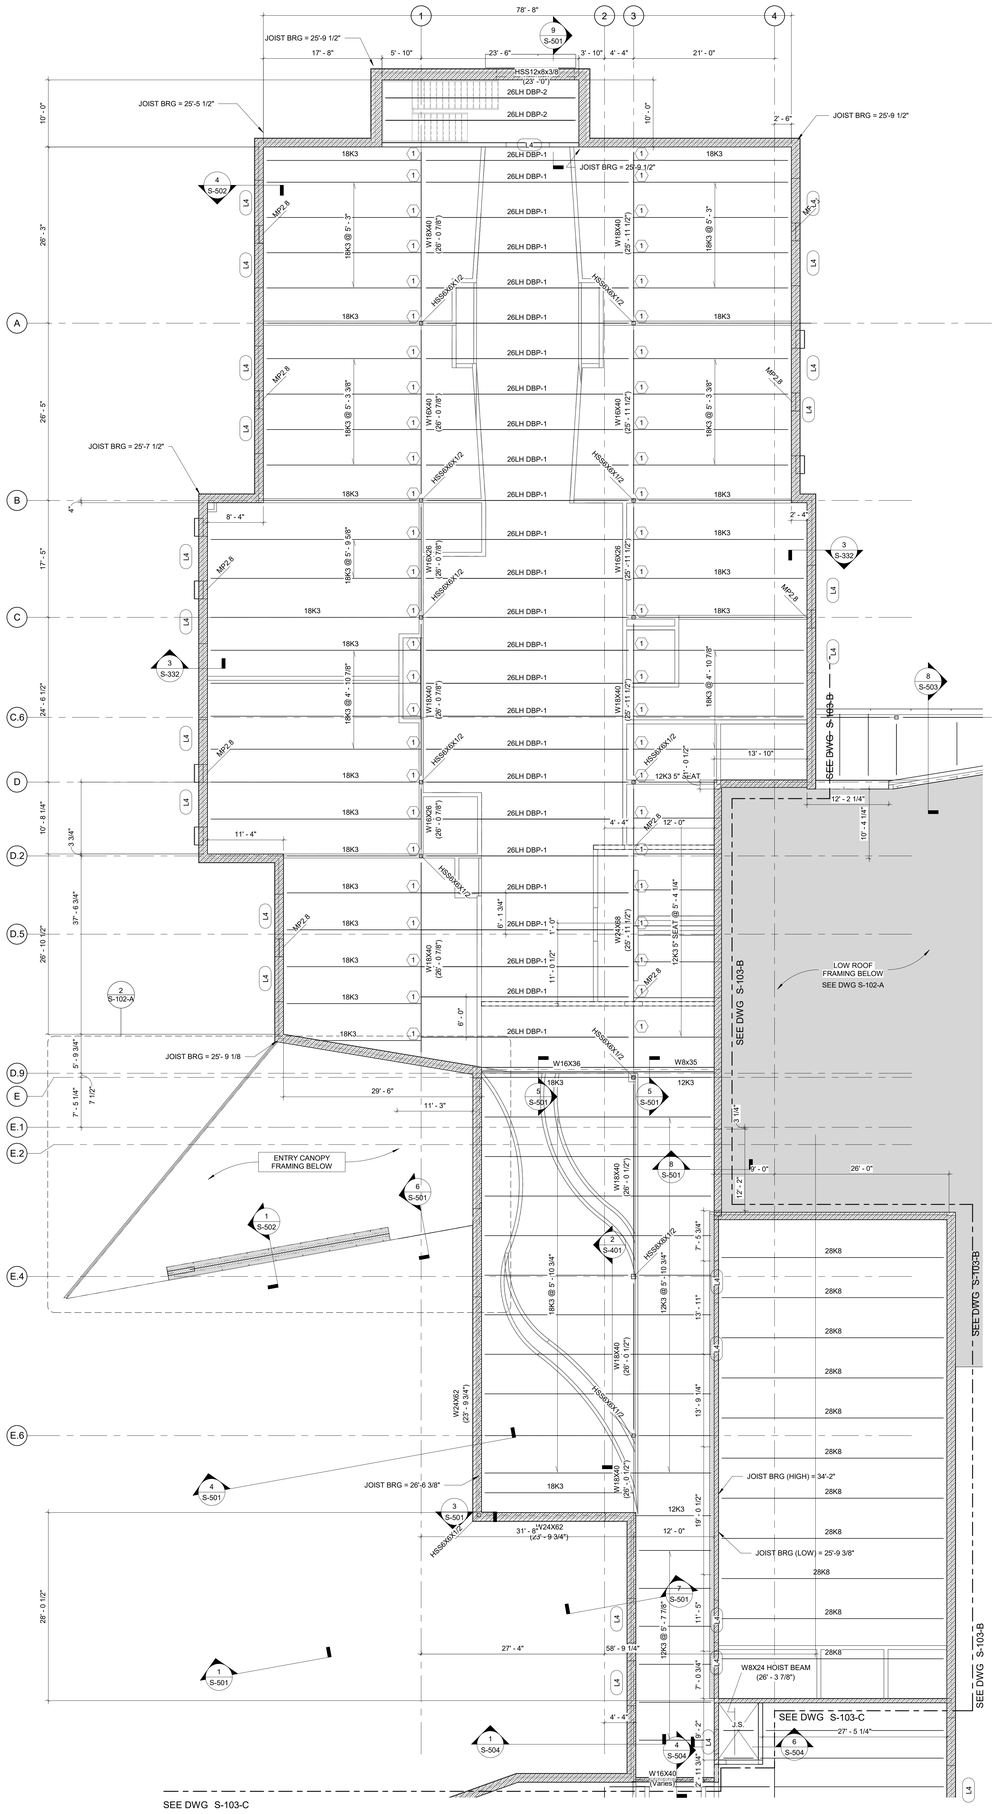

1 HIGH ROOF FRAMING PLAN - UNIT A

SCALE: 1/8" = 1'-0"

PLAN NORTH

0 1' 2' 4' 8'

ROOF FRAMING NOTES

1. REFERENCE: GENERAL NOTES - S-001 - S-002, TYPICAL DETAILS - S-300 SERIES
2. VERIFY ALL ELEVATIONS AND DIMENSIONS SHOWN WITH ARCHITECTURAL DRAWINGS AND EQUIPMENT SUPPLIERS SHOP DRAWINGS PRIOR TO FABRICATION AND INSTALLATION OF STRUCTURAL STEEL
3. ROOF CONSTRUCTION:
   - A. TYPICAL ROOF DECK: 1 1/2"x20GA TYPE B, GALVANIZED AND PRIMED, WIDE RIB METAL ROOF DECK WITH A MINIMUM THREE SPAN CONDITION.
   - B. CAFETERIA AND GYMNASIUM ROOF DECK: 3"x20GA TYPE BA, GALVANIZED AND PRIMED, WIDE RIB METAL ACOUSTIC ROOF DECK WITH A MINIMUM THREE SPAN CONDITION.
   - C. SEE GENERAL NOTES FOR DECK FASTENING PATTERN.
   - D. COORDINATE ALL ROOF SLOPES, ELEVATIONS, AND DRAINAGE LOCATIONS WITH ARCHITECTURAL AND PLUMBING DRAWINGS.
   - E. COORDINATE LOCATION, SIZE, AND QUANTITY OF ROOF OPENINGS AND PENETRATIONS (HATCHES, EXHAUST FAN, ETC.) WITH ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS. MARK LOCATIONS AND SIZE OF OPENINGS ON SHOP DRAWINGS PRIOR TO SUBMITTING FOR REVIEW.
   - F. PROVIDE ROOF OPENING FRAMING FOR ALL OPENINGS AND PENETRATIONS THROUGH THE ROOF PER TYPICAL DETAIL.
4. GENERAL CONTRACTOR SHALL COORDINATE ROOF TOP EQUIPMENT DIMENSIONS WITH APPROVED MANUFACTURER DRAWINGS.
   - A. SUPPORT FRAMING SHOWN IS FOR THE EQUIPMENT SPECIFIED ON MECHANICAL DRAWINGS. IF A DIFFERENT UNIT IS TO BE USED, CONTACT STRUCTURAL ENGINEER BEFORE PROCEEDING.
   - B. SET EQUIPMENT CURB ON ROOF FRAMING MEMBERS OR SUPPORT MEMBERS RUNNING BETWEEN THEM. DO NOT PLACE CURB ON UNSUPPORTED ROOF DECK. REFER TO DETAILS 9 AND 10 ON S-332.
5. FIELD VERIFY ALL DIMENSIONS PRIOR TO FINAL DETAILING AND FABRICATION. IF ANY EXISTING CONDITION IS NOT AS SHOWN, CONTACT A/E BEFORE PROCEEDING WITH WORK.
6. LINTELS ARE REQUIRED AT ALL MASONRY OPENINGS. COORDINATE ALL MASONRY OPENINGS WITH ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS AND REFER TO TYPICAL LINTEL SCHEDULE AND TYPICAL LINTEL DETAILS, UNO. NOTE: NOT ALL OPENINGS ARE SHOWN ON PLAN.
   - A. L# DENOTES STEEL LINTEL. STEEL LINTELS ARE REQUIRED AT ALL MASONRY OPENINGS GREATER THAN 4'-0". SEE LINTEL SCHEDULE ON S-320 AND GENERAL NOTES.
   - B. MLP DENOTES MASONRY LINTEL. MASONRY LINTEL MAY BE USED AT OPENINGS LESS THAN 4'-0". SEE LINTEL SCHEDULE ON S-320 AND GENERAL NOTES.
   - C. COORDINATE REQUIRED CLOSURE PLATES AND DIMENSIONS AT VARIOUS FINISHES WITH ARCHITECTURAL DRAWINGS. MINIMUM PLATE THICKNESS IS 3/8" AND IS TO BE WELDED TO STEEL LINTEL.
7. 1 DENOTES TAGGED END OF JOIST TO RECEIVE JOIST SEAT DEPTH TO MATCH ADJACENT DBL. PITCHED JOIST SEAT.

LEVEL SCHEDULE

Name	Elevation
TOM MECHANICAL ROOM	33' - 4"
ROOF	26' - 0"
T/STL ENTRY CANOPY	23' - 8"
T/CMU CAFETERIA	22' - 0"
SECOND FLOOR	13' - 4"
T/STL SECOND FLOOR	12' - 4"
FIRST FLOOR	0' - 0"
T/FOUNDATION (TYP UNO)	-1' - 4"



PROJECT NO
2203-2

ARCHITECTURAL VISION GROUP, LTD
ARCHITECTS • PLANNERS
23850 SPERRY DRIVE CLEVELAND, OHIO 44145

PROFESSIONAL SEAL:
STATE OF OHIO
MICHAEL G. LINDAWAN
PE.82391
REGISTERED
PROFESSIONAL ENGINEER

CONSULTANTS:
OSBORN ENGINEERING
1100 Superior Avenue - Suite 300 | Cleveland, OH 44114
216.861.6200
www.osborn-eng.com

MASSILLON CITY SCHOOLS
MASSILLON EAST ELEMENTARY PK-3
1 PAUL E BROWN DRIVE SE, MASSILLON, OHIO 44646
MASSILLON CITY SCHOOL DISTRICT MASSILLON, OHIO

MARK	DATE	DESCRIPTION
	7.22.22	100% BID PROMAT SET

ISSUED AS:

PROJECT NO	2203-2
DRAWN BY	OEC
CHECKED BY	OEC
DATE	

HIGH ROOF FRAMING PLAN UNIT A

SCALE: 1/8" = 1'-0"

SHEET NO
S-103-A