

PROJECT NO

2203-2

○ CODED PLAN NOTES

4. PROVIDE 4-POST TECHNOLOGY DISTRIBUTION RACK.

10. 2U 48-PORT PATCH PANEL FOR BACKBONE CABLING.

11. 2U 48-PORT PATCH PANEL FOR CAT 6 UTP CABLING.

12. 2U 48-PORT PATCH PANEL FOR CAT 6A UTP CABLING.

13. SPACE FOR OWNER-PROVIDED NETWORK SWITCH

2. PROVIDE TELECOMMUNICATIONS MAIN GROUNDING BUSBAR

3. PROVIDE 4' x 8' AC GRADE PLYWOOD BACKBOARD. MOUNT BOARDS 6" AFF WITH "A" SIDE FACING TOWARDS USER (TYPICAL).

5. PROVIDE 6" WIDE VERTICAL WIRE MANAGER ON BOTH ENDS OF LINE OF RACKS AND 10" WIDE VERTICAL WIRE MANAGERS BETWEEN

6. BOND EACH RACK WITH A DEDICATED BONDING CONDUCTOR WITH A CABLE SIZED AT 2 KCMIL PER LINEAR FOOT OF CONDUCTOR TO TMGB. BONDING CONDUCTOR SHALL BE NO LESS THAN #6 AWG.

7. STAIRCASE ON FLOOR ABOVE INTERSECTS WITH CEILING SPACE OF THIS TELECOMMUNICATIONS ROOM. CONTRACTOR SHALL MAKE ALL NECESSARY ADJUSTMENTS TO EQUIPMENT INSTALLATION AND CABLE ROUTING TO AVOID DISRUPTING OR PENETRATING

1. PROVIDE 18" W CABLE RUNWAY.


EACH RACK.


STAIRCASE.


9. 2U HORIZONTAL WIRE MANAGER

14. SPACE FOR OWNER-PROVIDED UPS.


2U FIBER LIU










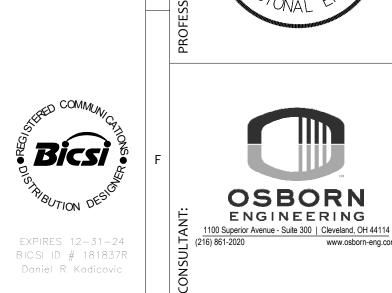



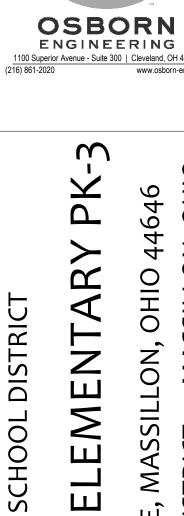

PROJECT NO 2203-2 DRAWN BY DRK

TECHNOLOGY ENLARGED PLANS AND <sup>A</sup> ELEVATIONS

SCALE: As indicated

SHEET NO T-401