


2
T6.06

GYMNASIUM AUDIO/VISUAL/CONTROL SYSTEM RISER DIAGRAM

SCALE: NONE

RISER DIAGRAM NOTES:

1. DIAGRAM IS REPRESENTATIONAL ONLY. CONTRACTOR SHALL VERIFY EXISTING CABLING REQUIREMENTS, ESTABLISH A PROJECT SPECIFIC RISER DIAGRAM AND SUBMIT SAME FOR APPROVAL BY THE ENGINEER. CONTRACTOR SHALL INSTALL PER THE APPROVED DIAGRAM AND THE MANUFACTURER'S RECOMMENDATIONS AND INSTRUCTIONS.
2. DIAGRAM IS REPRESENTATIONAL OF (2) SYSTEMS.
3. ALL INSTALLATION, MATERIALS AND WORKMANSHIP SHALL BE PER LOCAL, STATE AND FEDERAL CODES AND REGULATIONS, INCLUDING, BUT NOT LIMITED TO NFPA 70 (NEC), AND NFPA 101, AS WELL AS INDUSTRY STANDARDS.
4. AUDIO VISUAL SYSTEM CONTRACTOR SHALL COORDINATE EXACT POWER REQUIREMENTS AND CONNECTIONS WITH THE ELECTRICAL CONTRACTOR.
5. AUDIO VISUAL SYSTEM CONTRACTOR SHALL PROVIDE ALL JUMPERS AND CABLING REQUIRED TO COMPLETE ALL INTERCONNECTIONS OF THE SYSTEM. ALL ETHERNET NETWORK CABLING BOTH COPPER AND FIBER SHALL BE COMPLIANT WITH THE STRUCTURED CABLING SPECIFICATION SECTION, AND SHALL MATCH THE MANUFACTURER AND PERFORMANCE RATINGS OF THE STRUCTURED CABLING REQUIREMENTS. VERIFY THESE REQUIREMENTS WITH THE STRUCTURED CABLING CONTRACTOR.

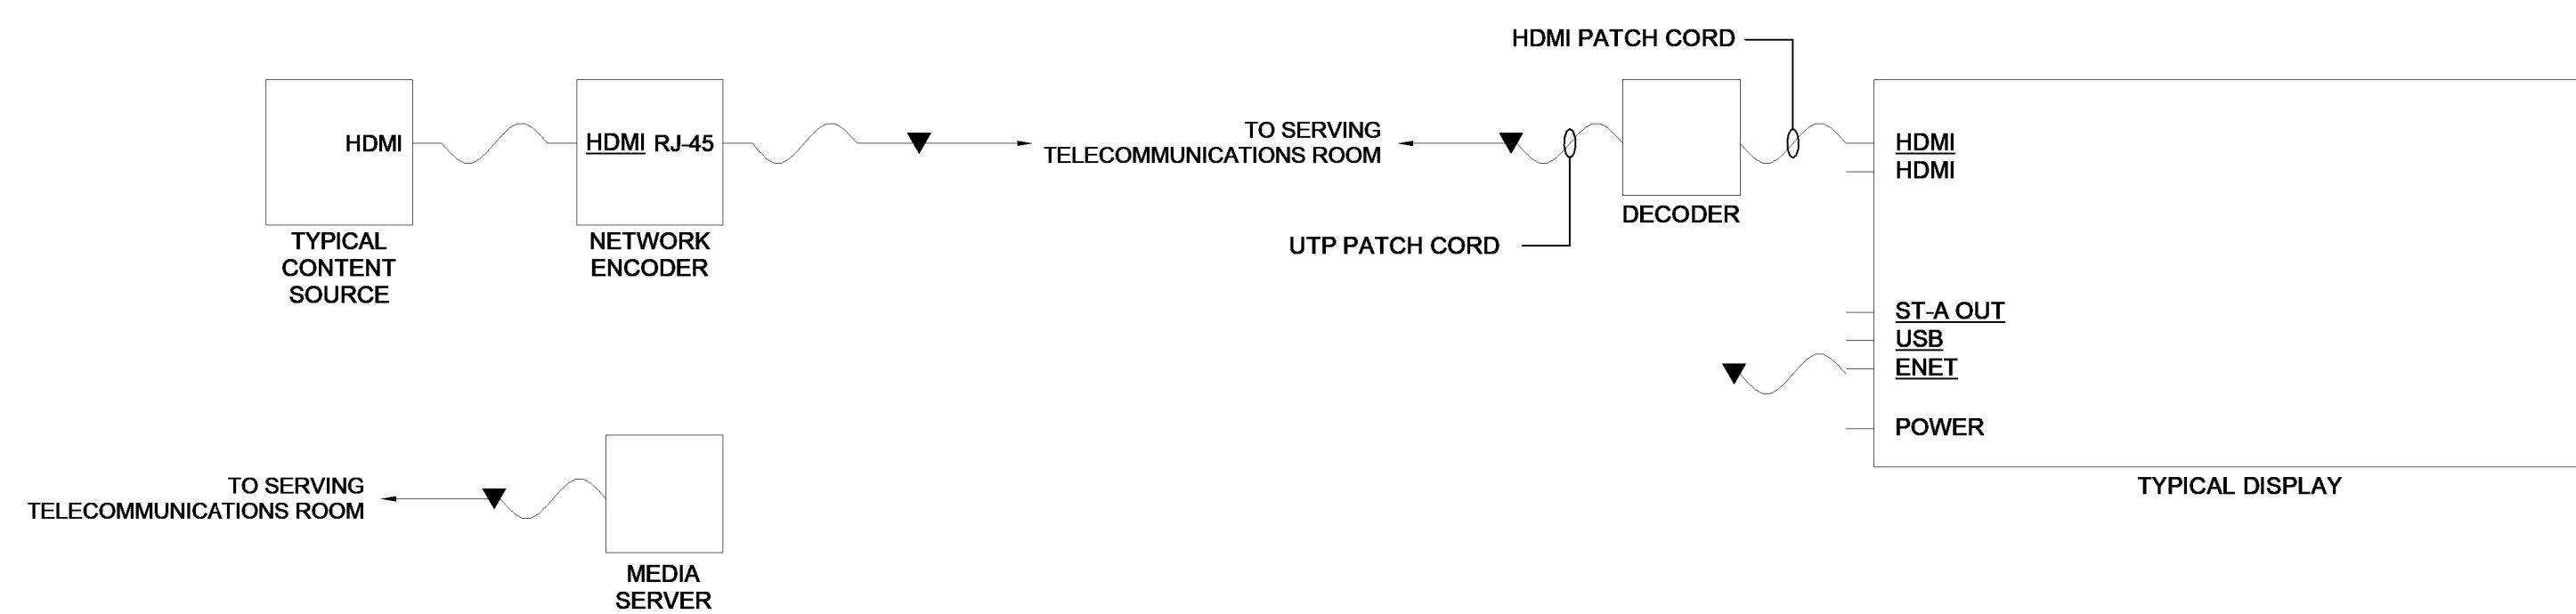

1
T6.06

MISCELLANEOUS A/V SYSTEMS RISER DIAGRAM

SCALE: NONE

[illegible]