




1 TECHNOLOGY SITE PLAN
SCALE: NONE

CODED PLAN NOTES

- APPROXIMATE LOCATION OF MAIN TELECOMMUNICATIONS ROOM.
- APPROXIMATE LOCATION OF HANDHOLE. PROVIDE QUARTZITE TIER 6 OR 15 (BASED ON ACTUAL INSTALLED LOCATION IN GRASSY AREA) HANDHOLE. FLARED WALL ASSEMBLY. OPEN BOTTOM. WITH A "COMMUNICATIONS" COVER. HANDHOLE SHALL BE SIZED TO ACCEPT UNDERGROUND CONDUITS IN FROM CAMERA LOCATIONS AND OUT TO MAIN TELECOMMUNICATIONS ROOM.
- PROVIDE (1) 2" CONDUIT FROM CAMERA LOCATION TO HANDHOLE.
- PROVIDE (2) 4" CONDUITS FROM HANDHOLE LOCATION TO MAIN TELECOMMUNICATIONS ROOM.
- PROVIDE (1) 4" CONDUIT FROM HANDHOLE TO MAIN TELECOMMUNICATIONS ROOM.

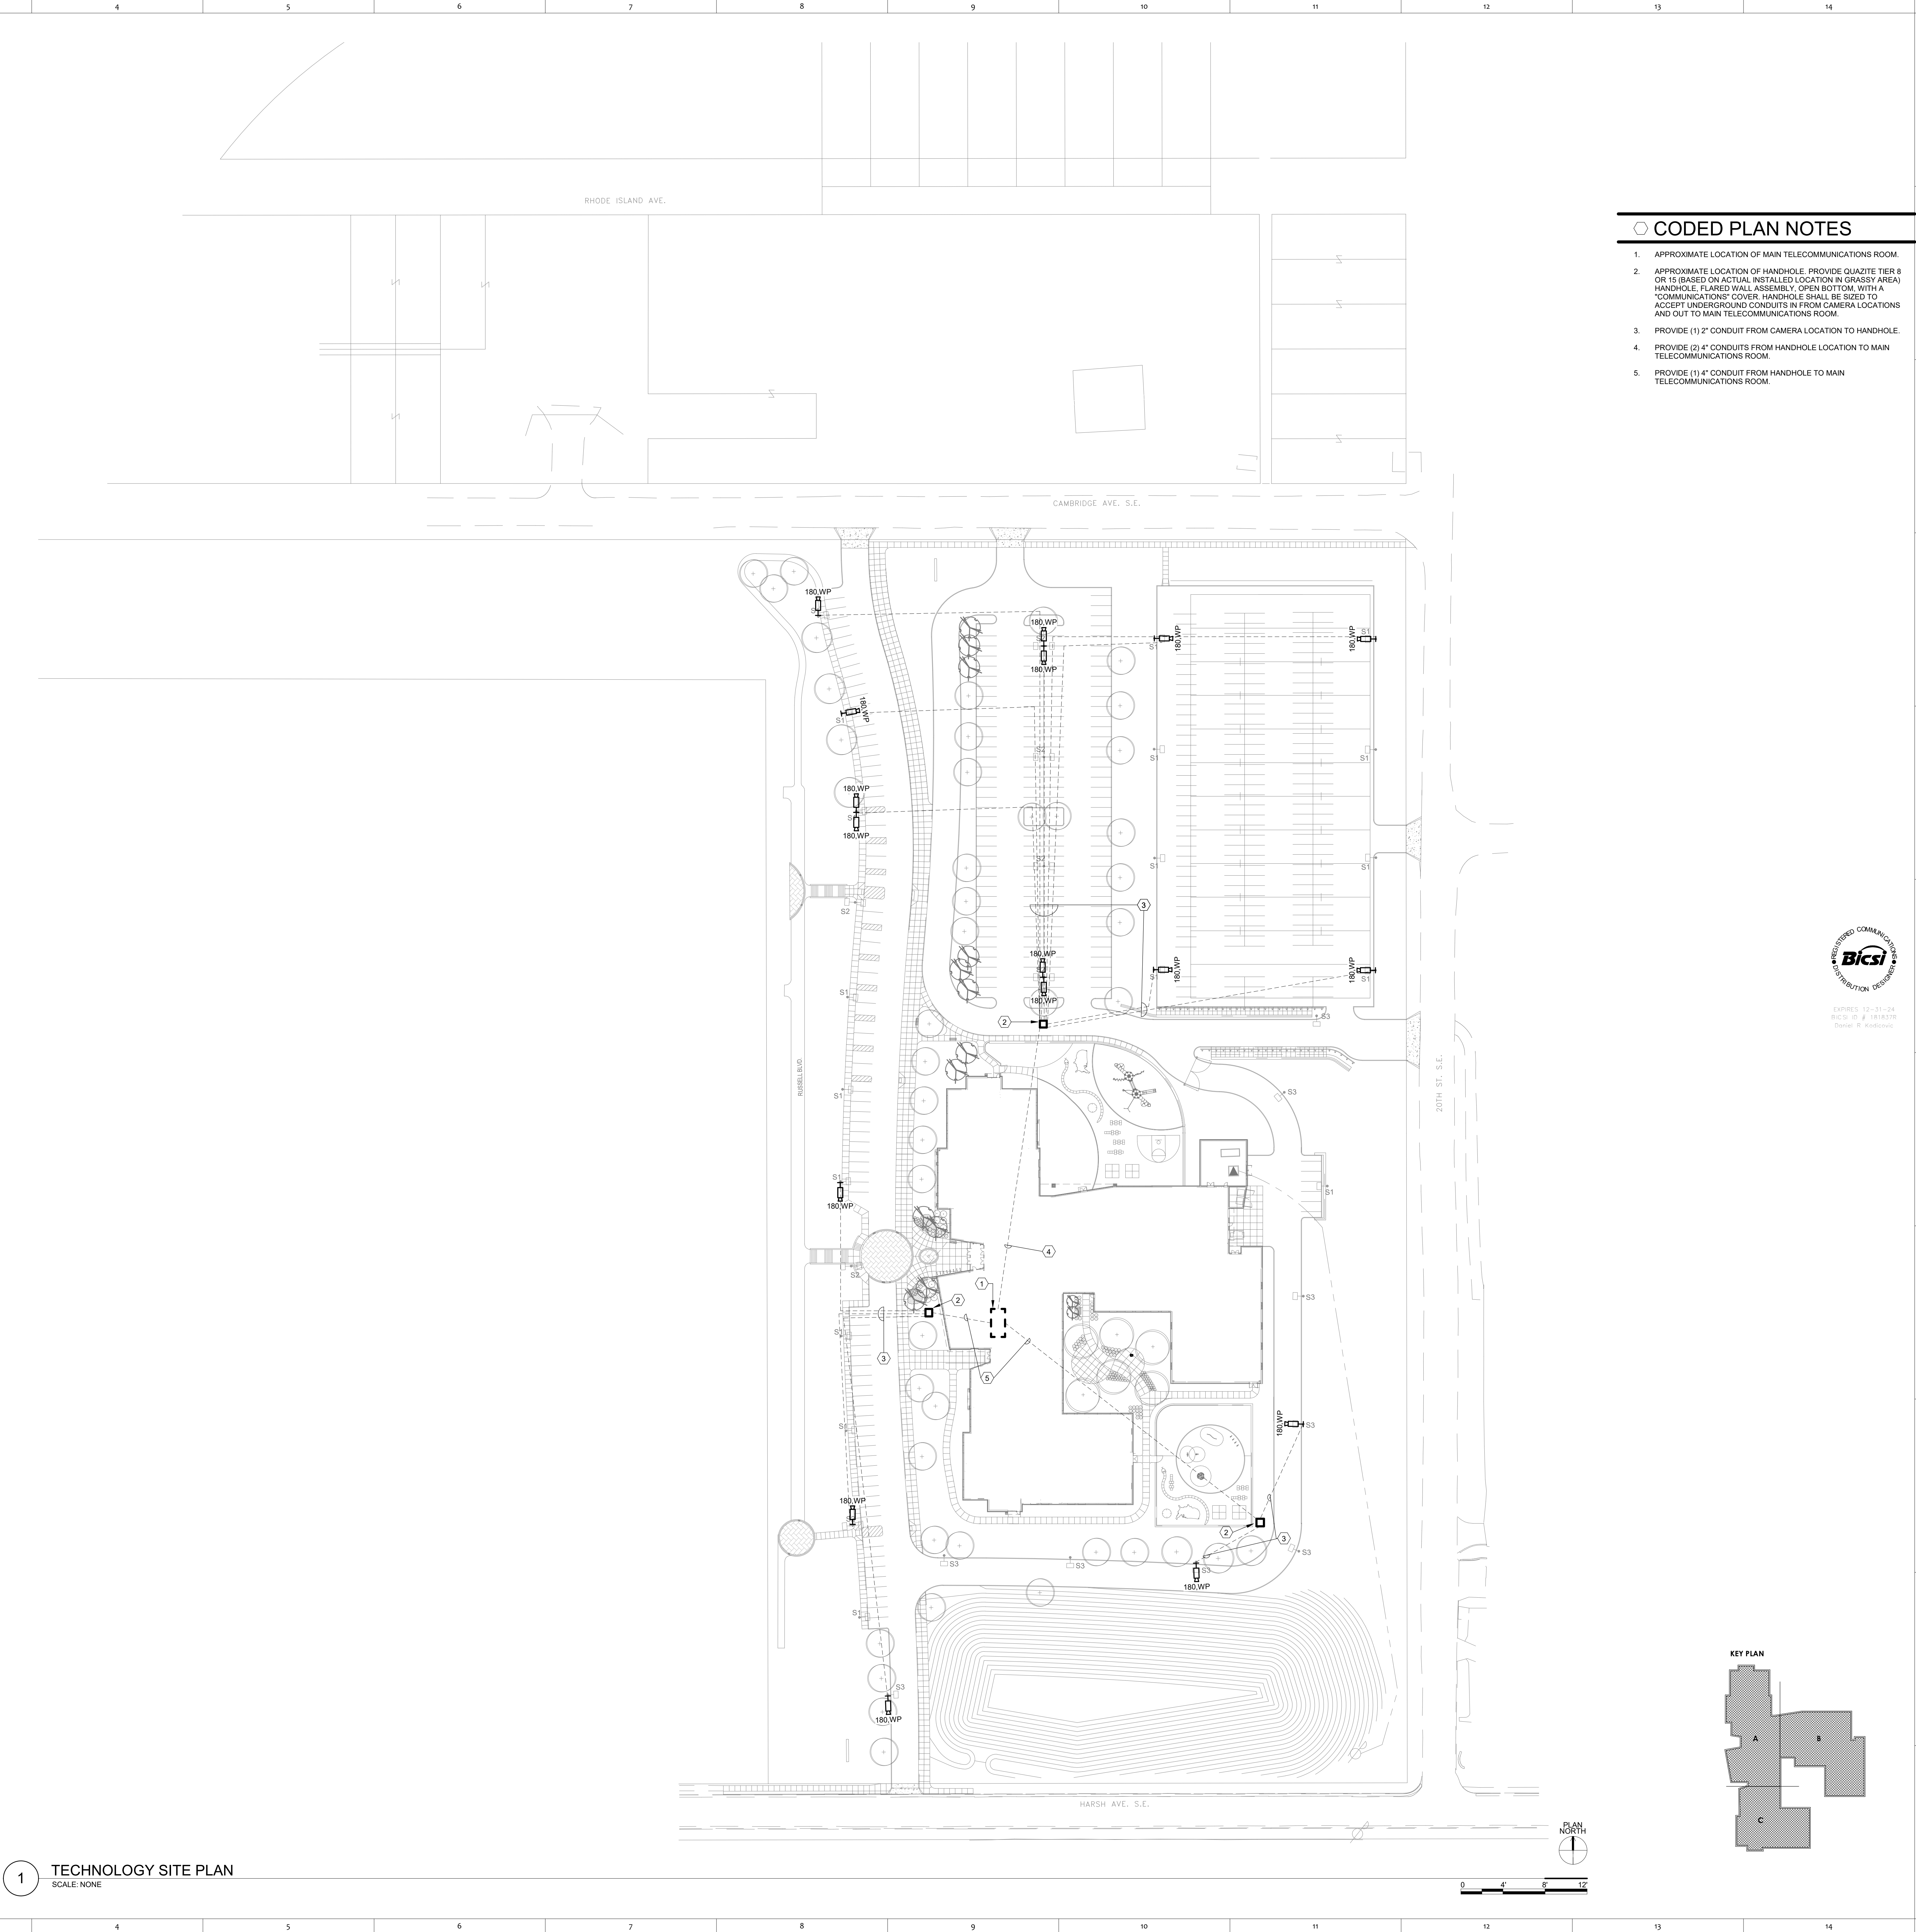

PROJECT NO
2203-2

ARCHITECTURAL VISION GROUP, LTD
ARCHITECTS
23850 SPERRY DRIVE
CLEVELAND, OHIO 44145

OSBORN
ENGINEERING
1800 Sperry Avenue, Suite 202, Cleveland, OH 44114
(216) 891-2020
www.osborn-eng.com

MASSILLON CITY SCHOOL DISTRICT
MASSILLON EAST ELEMENTARY PK-3
1 PAULE BROWN DRIVE SE, MASSILLON, OHIO 44646
MASSILLON CITY SCHOOL DISTRICT MASSILLON, OHIO

NO.	DATE	ISSUES/AS	DESCRIPTION
07/12/23	07/12/23	100% BID PERMIT SET	

PROJECT NO
2203-2

DRAWN BY
DRK

CHECKED BY
AMW

DATE
07/12/23

TECHNOLOGY
SITE PLAN

SCALE: 1" = 50'-0"

SHEET NO
TS-100