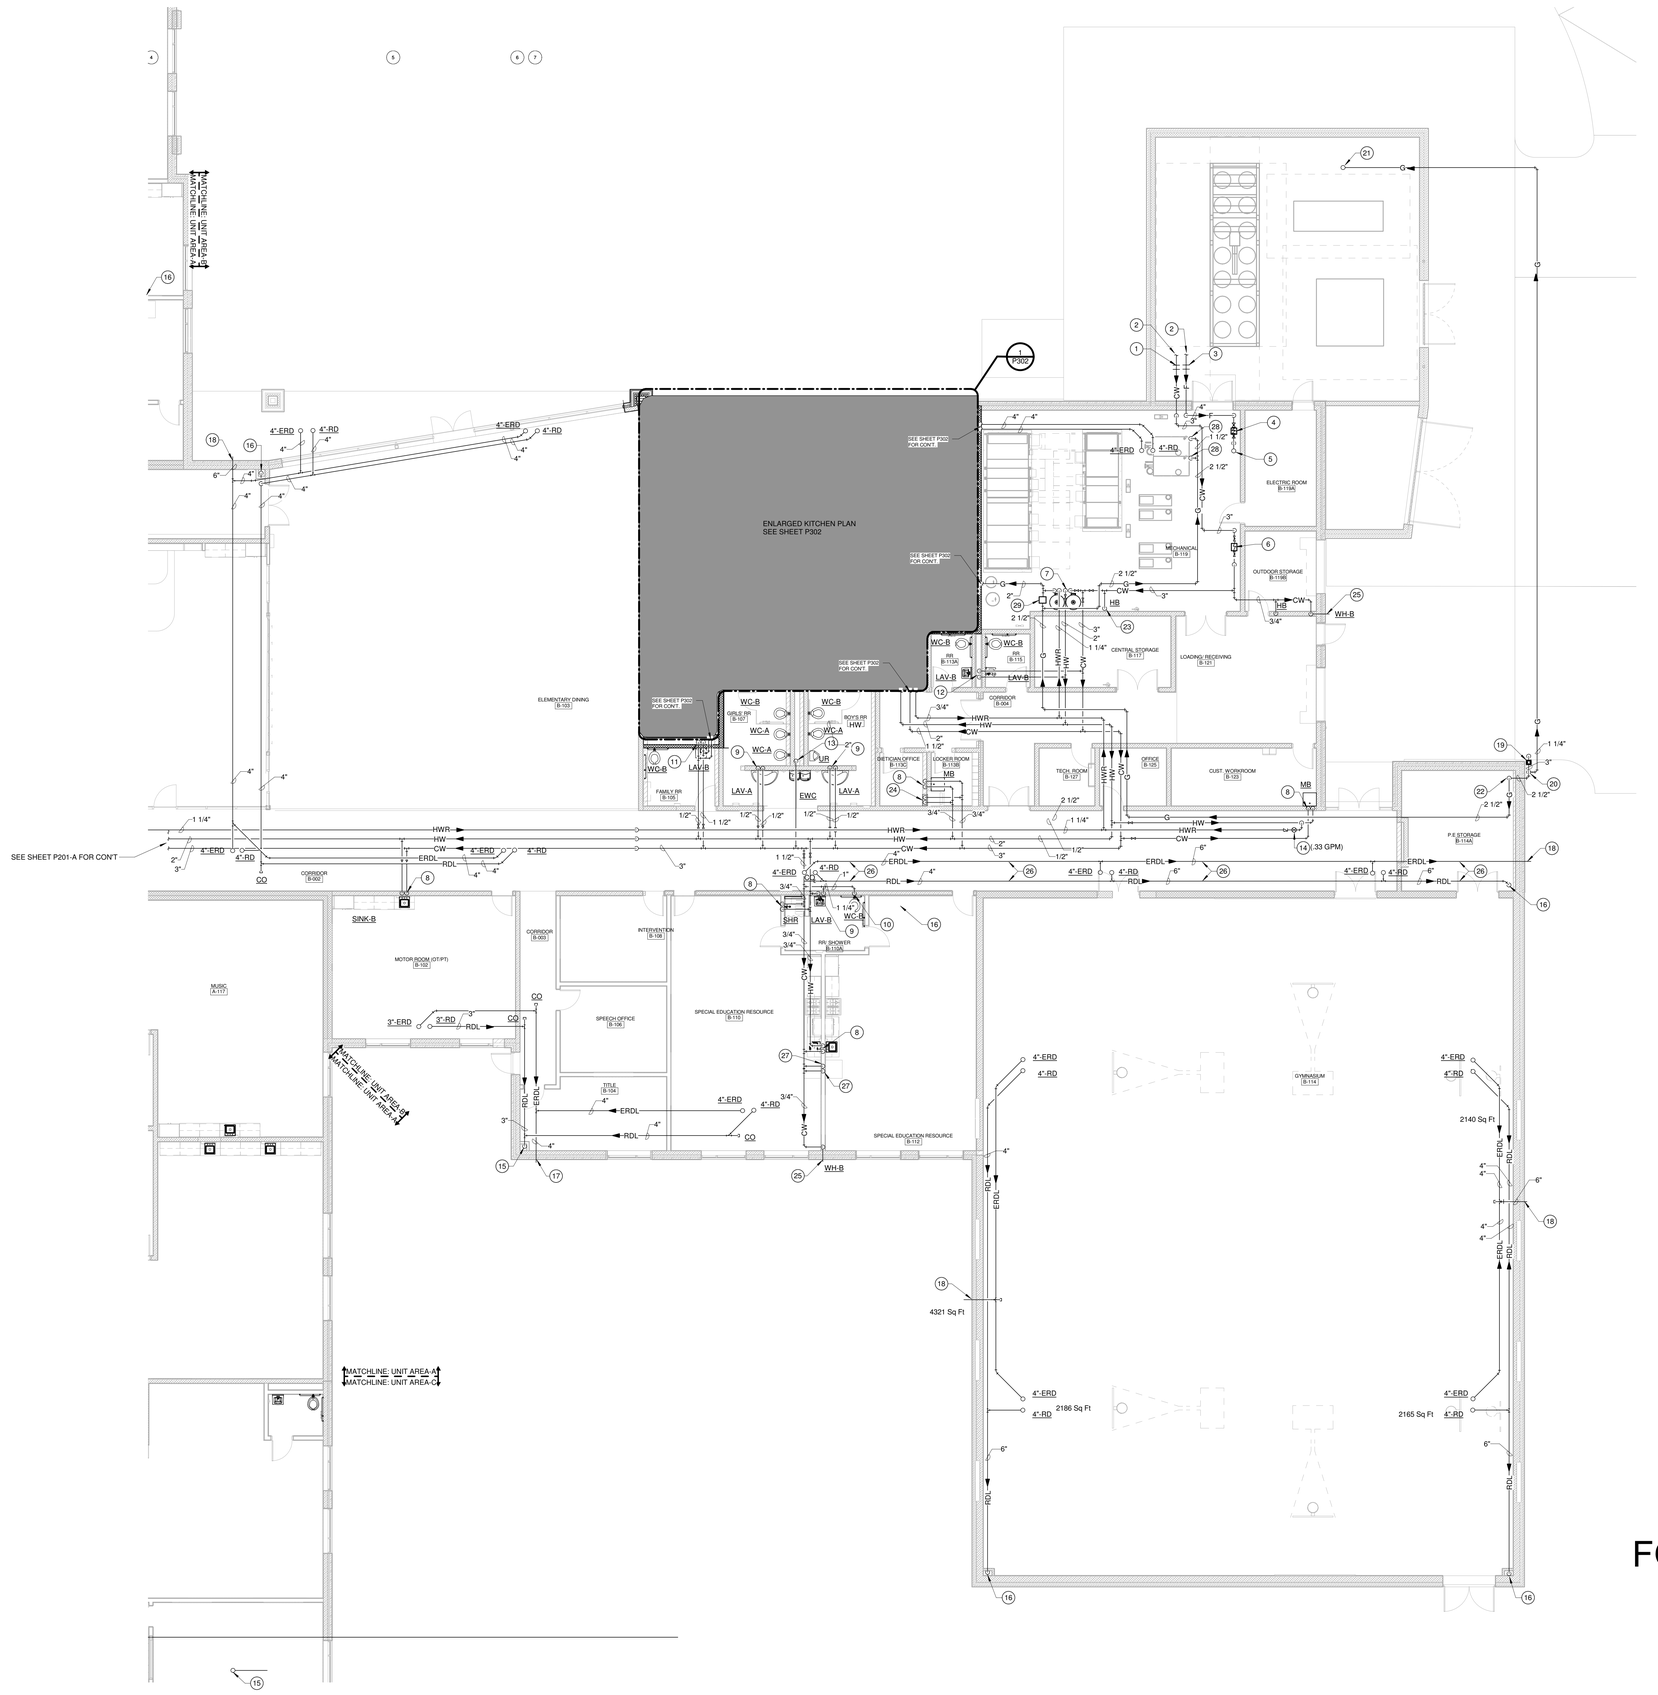

CODED NOTES: SANITARY

1 FINAL CONNECTION TO SITE WATER LINE BY PLUMBING CONTRACTOR.

2 SITE WATER LINE BY SITE UTILITIES CONTRACTOR.

3 FINAL CONNECTION TO SITE WATER LINE BY FIRE SPRINKLER CONTRACTOR.

4 INCOMING FIRE SERVICE. SEE DETAIL ON SHEET FP000.

5 4" FIRE LINE DOWN AND ROUTED TO FDC. SEE SHEET FP000 FOR DETTAILS AND SEE CIVIL PLANS FOR LOCATION.

6 INCOMING WATER SERVICE. SEE DETAIL ON SHEET P001.

7 2" CW, HW, 1 1/4" HWR AND 1 1/4 GAS LINE DOWN TO HWH. SEE DETAIL ON SHEET P001.

8 1/2" CW AND HW LINE DOWN FOR CONNECTION TO FIXTURE.

9 1/2" CW AND HW LINE DOWN FOR CONNECTION TO FIXTURE WITH J.R. SMITH 5005 CW AND HW WATER HAMMER ARRESTER.

10 1" CW LINE DOWN FOR CONNECTION TO FIXTURE WITH J.R. SMITH 5005 CW WATER HAMMER ARRESTER.

11 1 1/4" CW AND 1/2" HW LINE DOWN IN CHASE AND HEADER FULL SIZE WITH J.R. SMITH 5010 CW AND 5005 HW WATER HAMMER ARRESTER.

12 1 1/2" CW AND 1/2" HW LINE DOWN IN CHASE AND HEADER FULL SIZE WITH J.R. SMITH 5010 CW AND 5005 HW WATER HAMMER ARRESTER.

13 2" CW LINE DOWN IN CHASE AND HEADER FULL SIZE WITH J.R. SMITH 5020 CW WATER HAMMER ARRESTER.

14 BALANCE VALVE AND CHECK VALVE. SET BALANCE VALVE TO FLOW INDICATED ON DRAWING.

15 4" RDL DOWN. SEE SHEET P101-B FOR CON'T.

16 6" RDL DOWN. SEE SHEET P101-B FOR CON'T.

17 4" EMERGENCY ROOF DRAIN LEADER THRU WALL ABOVE CEILING WITH J.R. SMITH (WATTS OR ZURN) NO. 1770 DOWNSPOUT NOZZLE.

18 6" EMERGENCY ROOF DRAIN LEADER THRU WALL ABOVE CEILING WITH J.R. SMITH (WATTS OR ZURN) NO. 1770 DOWNSPOUT NOZZLE.

19 PLUMBING CONTRACTOR'S RESPONSIBILITY BEGINS AT PURCHASING AND INSTALLING GAS METER BAR/SET. PER GAS COMPANY DIRECTION (VERIFY EXACT LOCATION OF METER). COORDINATE INSTALLATION OF GAS LINE WITH OTHER UTILITIES

20 1 1/4" (2 PSI) GAS LINE DOWN WITH ANODELESS RISER AND ROUTED TO GAS GENERATOR.

21 1 1/4" (2 PSI) GAS LINE UP WITH ANODELESS RISER TO GAS GENERATOR WITH UNION, SHUT OFF VALVE AND DIRT LEG. INSTALL REGULATOR AS REQUIRED.

22 2 1/2" (2 PSI) GAS LINE UP INTO CEILING SPACE.

23 3/4" CW LINE DOWN FOR CONNECTION TO HB AT 2'-0" A.F.F.

24 1/2" CW AND HW DOWN TO WASHER SUPPLY AND DRAIN CABINET.

25 3/4" CW LINE DOWN FOR CONNECTION TO WH AT 2'-0" A.F.F.

26 ROUTE RDL AND ERDL AT 1/16" PER FOOT.

27 1/2" CW LINE DOWN TO WALL BOX AND SHUT OFF VALVE AT 4.0' A.F.F. FOR CONNECTION TO REFRIGERATOR.

28 1 1/2" (2 PSI) GAS LINE DOWN TO GAS EQUIPMENT WITH UNION, SHUT OFF VALVE AND DIRT LEG. INSTALL REGULATOR AS REQUIRED AND VENT TO OUTDOOR.

29 2 PSI TO 7"-14" W.C. REGULATOR. VENT TO OUTDOORS AS REQUIRED.

FOR REFERENCE ONLY

FIRST FLOOR PLAN - PLUMBING - AREA - B

SCALE: 1/8" = 1'-0"

PROJECT NO 2203-2

ARCHITECTURAL VISION GROUP, LTD
ARCHITECTS • PLANNERS
23850 SPERRY DRIVE CLEVELAND, OHIO 44145

PROFESSIONAL SEAL: FOR PROGRESS ONLY

CONSULTANT: J.M. VEROSTKO, INC.
ENGINEERS • ARCHITECTS • PLANNERS
2781 DELL'OMMO ROAD
MINERVA, OHIO 44659

MASSILLON CITY SCHOOLS
MASSILLON EAST ELEMENTARY PK-3
1 PAUL E BROWN DRIVE SE, MASSILLON, OHIO 44646
MASSILLON CITY SCHOOL DISTRICT MASSILLON, OHIO

MARK	DATE	DESCRIPTION
ISSUED AS:		

PROJECT NO	2203-2
DRAWN BY	ADO
CHECKED BY	CWH
DATE	

FIRST FLOOR PLAN - PLUMBING - AREA - B

SCALE: 1/8" = 1'-0"

SHEET NO P201-B