
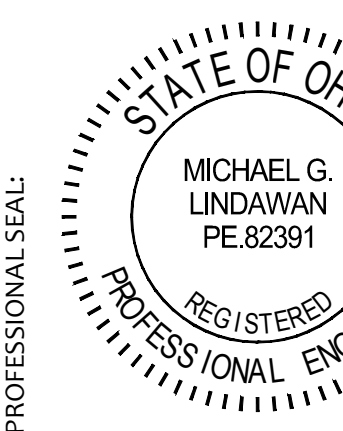


- ROOF FRAMING NOTES**
- REFERENCE: GENERAL NOTES - S-001 - S-002, TYPICAL DETAILS - S-300 SERIES
 - VERIFY ALL ELEVATIONS AND DIMENSIONS SHOWN WITH ARCHITECTURAL DRAWINGS AND EQUIPMENT SUPPLIERS SHOP DRAWINGS PRIOR TO FABRICATION AND INSTALLATION OF STRUCTURAL STEEL
 - ROOF CONSTRUCTION:
 - TYPICAL ROOF DECK: 1 1/2"x20GA TYPE B, GALVANIZED AND PRIMED, WIDE RIB METAL ROOF DECK WITH A MINIMUM THREE SPAN CONDITION.
 - CAFETERIA AND GYMNASIUM ROOF DECK: 3"x20GA TYPE BA, GALVANIZED AND PRIMED, WIDE RIB METAL ROOF DECK WITH A MINIMUM THREE SPAN CONDITION.
 - SEE GENERAL NOTES FOR DECK FASTENING PATTERN.
 - COORDINATE ALL ROOF SLOPES, ELEVATIONS, AND DRAINAGE LOCATIONS WITH ARCHITECTURAL AND PLUMBING DRAWINGS.
 - COORDINATE LOCATION, SIZE, AND QUANTITY OF ROOF OPENINGS AND PENETRATIONS (HATCHES, EXHAUST FAN, ETC.) WITH ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS. MARK LOCATIONS AND SIZE OF OPENINGS ON SHOP DRAWINGS PRIOR TO SUBMITTING FOR REVIEW.
 - PROVIDE ROOF OPENING FRAMING FOR ALL OPENINGS AND PENETRATIONS THROUGH THE ROOF PER TYPICAL DETAIL.
 - GENERAL CONTRACTOR SHALL COORDINATE ROOF TOP UNIT DIMENSIONS WITH APPROVED RTU MANUFACTURER DRAWINGS.
 - SUPPORT FRAMING SHOWN IS FOR THE RTUS SPECIFIED ON MECHANICAL DRAWING. IF A DIFFERENT UNIT IS TO BE USED, CONTACT STRUCTURAL ENGINEER BEFORE PROCEEDING.
 - SET UNIT CURB ON ROOF FRAMING MEMBERS OR SUPPORT MEMBERS RUNNING BETWEEN THEM. DO NOT PLACE CURB ON UNSUPPORTED ROOF DECK.
 - FIELD VERIFY ALL DIMENSIONS PRIOR TO FINAL DETAILING AND FABRICATION. IF ANY EXISTING CONDITION IS NOT AS SHOWN, CONTACT A/E BEFORE PROCEEDING WITH WORK.
 - INTELS ARE REQUIRED AT ALL MASONRY OPENINGS. COORDINATE ALL MASONRY OPENINGS WITH ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS AND REFER TO TYPICAL INTEL SCHEDULE AND TYPICAL INTEL DETAILS. UNO. NOTE: NOT ALL OPENINGS ARE SHOWN ON PLAN.
 - LF / DENOTES STEEL INTEL. STEEL INTELS ARE REQUIRED AT ALL MASONRY OPENINGS GREATER THAN 4'-0". SEE INTEL SCHEDULE ON S-320 AND GENERAL NOTES.
 - MLF / DENOTES MASONRY INTEL. MASONRY INTELS MAY BE USED AT OPENINGS LESS THAN 4'-0". SEE INTEL SCHEDULE ON S-320 AND GENERAL NOTES.
 - 1 / DENOTES TAGGED END OF JOIST TO RECEIVE JOIST SEAT DEPTH TO MATCH ADJACENT DBL. PITCHED JOIST SEAT.


PROJECT NO
2203-1

ARCHITECTURAL VISION GROUP, LTD
PLANNERS
ARCHITECTS
23850 SPERRY DRIVE
CLEVELAND, OHIO 44145

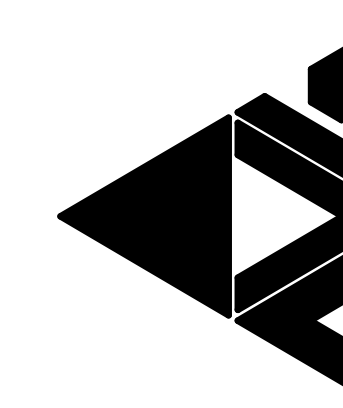

MASSILLON CITY SCHOOL
MASSILLON WEST ELEMENTARY
PK-3
250 29TH STREET NW, MASSILLON, OHIO 44646
MASSILLON CITY SCHOOL DISTRICT MASSILLON, OHIO

LEVEL SCHEDULE	
NAME	ELEVATION
ROOF FRAMING - MECH ROOM	52'-0"
ROOF FRAMING PLAN	28'-0"
SECOND FLOOR	13'-4"
FIRST, SECOND FLOOR	12'-4"
FIRST FLOOR	0'-0"
TI FOUNDATION (TYP UNO)	-1'-4"

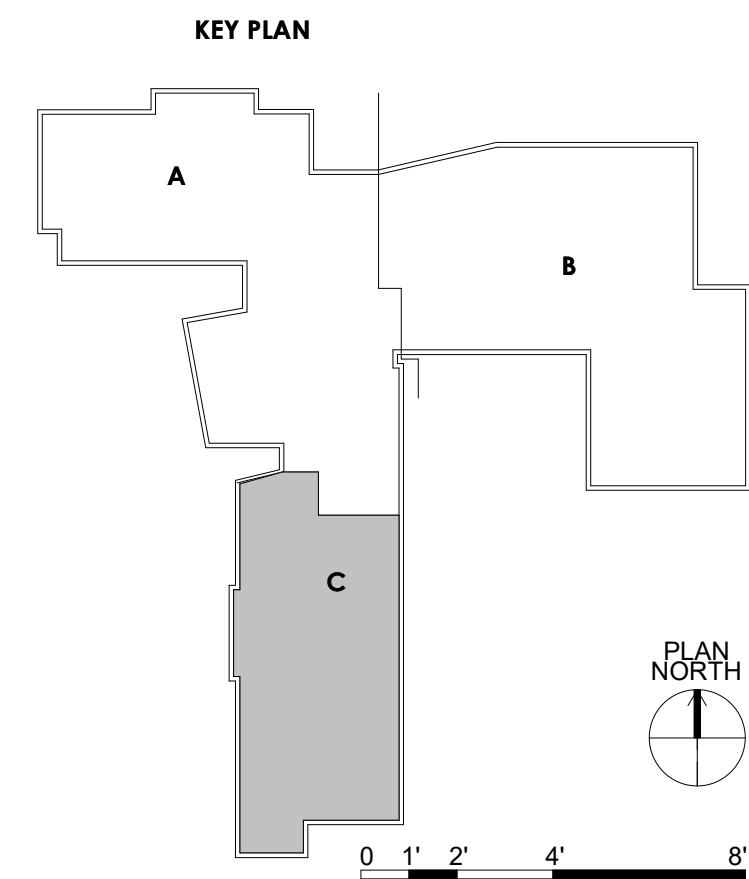

PROJECT NO 2203-1
DRAWN BY Author
CHECKED BY Checker
DATE

HIGH ROOF
FRAMING PLAN
UNIT C

SCALE: 1/8" = 1'-0"
SHEET NO
S-103-C