


FIRST FLOOR PLAN - DOMESTIC PLUMBING PLAN - UNIT B
SCALE: 1/8" = 1'-0"



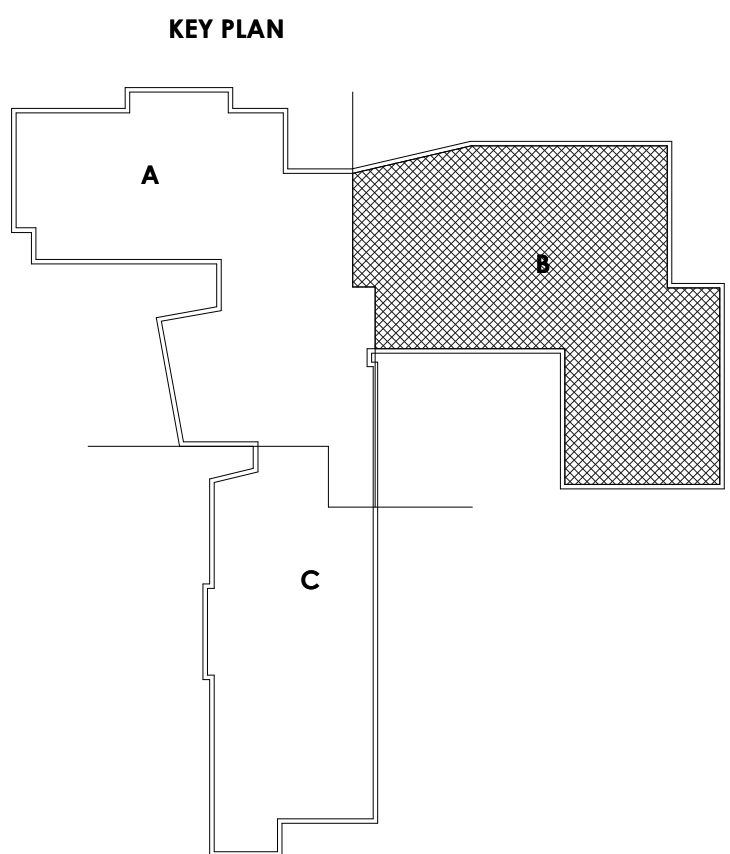


CODED NOTES:

- 3" WATER MAIN BY SITE UTILITY CONTRACTOR.
- FINAL CONNECTION TO SITE WATER LINE BY PLUMBING CONTRACTOR.
- 6" FIRE MAIN BY SITE UTILITY CONTRACTOR.
- 4" WATER SERVICE. SEE DETAIL ON SHEET P-001.
- 2" CW, 2" HW, 1 1/4" HWR, AND 1 1/4" GAS LINES DOWN FOR CONNECTION TO HW. SEE DETAIL ON SHEET P-001.
- 1/2" CW AND HW LINES DOWN FOR CONNECTION TO FIXTURE.
- 1 1/4" CW AND 1/2" HW LINES DOWN INTO CHASE AND HEADER FULL SIZE WITH J.R. SMITH 5010 CW AND 5005 HW WATER HAMMER ARRESTERS.
- 2" CW LINE DOWN INTO CHASE AND HEADER FULL SIZE WITH J.R. SMITH 5020 WATER HAMMER ARRESTER.
- PLUMBING CONTRACTOR'S RESPONSIBILITY BEGINS AT PURCHASING AND INSTALLING GAS METER BARSET PER GAS COMPANY DIRECTION. VERIFY EXACT LOCATION OF METER. COORDINATE INSTALLATION OF GAS LINE WITH OTHER UTILITIES.
- SEE SHEET P-301 FOR CONNECTION.
- 4" STORM LINE DOWN IN CHASE TO B.F.F. PROVIDE CLEANOUT AT BASE OF STACK.
- 6" STORM LINE DOWN IN CHASE TO BELOW FLOOR. PROVIDE CLEANOUT AT BASE OF STACK.
- 6" EMERGENCY ROOF DRAIN LEADER TRU WALL ABOVE CEILING WITH J.R. SMITH (WATTS OR ZURN) NO. 1770 DOWNSPOUT NOZZLE.
- 2 1/2" (2 PSI) GAS LINE UP INTO CEILING SPACE.
- GAS MONITORING METER WITH BYPASS.
- 1 1/4" (2 PSI) GAS LINE DOWN WITH ANODELESS RISER AND ROUTED TO GAS GENERATOR.
- 1 1/4" (2 PSI) GAS LINE UP WITH ANODELESS RISER TO GAS GENERATOR WITH UNION, SHUT OFF VALVE, AND DIRT LEG. INSTALL REGULATOR AS REQUIRED.
- 1 1/2" (2 PSI) GAS LINE DOWN TO EQUIPMENT WITH UNION, SHUT OFF VALVE, AND DIRT LEG. INSTALL REGULATOR AS REQUIRED AND VENT TO OUTDOOR.
- 1/2" CW AND HW DOWN TO WASHER SUPPLY AND DRAIN CABINET.
- INCOMING FIRE SERVICE WITH 6" BFP. SEE DETAIL ON SHEET PP000.
- 6" FIRE LINE DOWN AND ROUTED TO FDC. SEE SHEET PP000 FOR DETAIL. SEE CIVIL PLANS FOR LOCATION OF FDC.
- TRANSITION 3" CW LINE TO 4" LINE AT FLOOR PENETRATION.
- CW MONITORING METER WITH BYPASS. SUPPLY SHUT OFF VALVES BEFORE AND AFTER MONITORING METER.
- 3/4" CW LINE DOWN FOR CONNECTION TO HB AT 2'-0" A.F.F.
- HW MONITORING METER WITH BYPASS. SUPPLY SHUT OFF VALVES BEFORE AND AFTER MONITORING METER.
- 2 PSI TO 7'-14" W.C. REGULATOR. VENT TO OUTDOORS AS REQUIRED.

PROJECT NO
2203-1

ARCHITECTURAL VISION GROUP, LTD
ARCHITECTS
PLANNERS
23850 SPERRY DRIVE
CLEVELAND, OHIO 44145

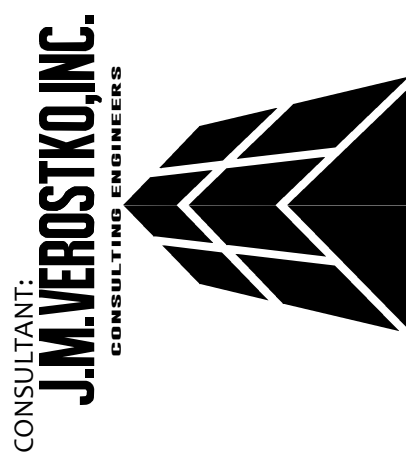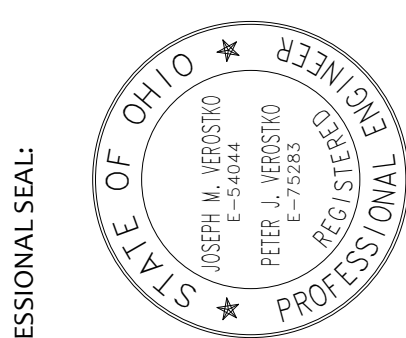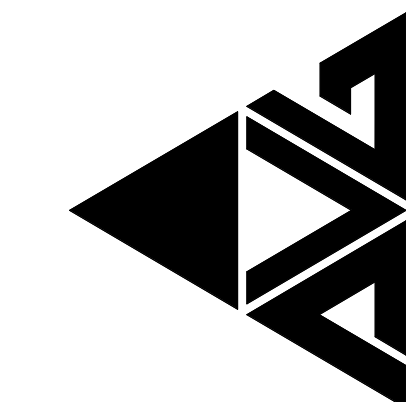

MASSILLON CITY SCHOOL
MASSILLON WEST ELEMENTARY
PK-3
250 29TH STREET NW, MASSILLON, OHIO 44646

MARK	DATE	DESCRIPTION
ISSUED AS:		
PROJECT NO	2203-1	
DRAWN BY	JRS	
CHECKED BY	WMS	
DATE	07/12/23	

FIRST FLOOR
PLAN -
PLUMBING - UNIT
B

SCALE: 1/8" = 1'-0"
SHEET NO
P-201-B