
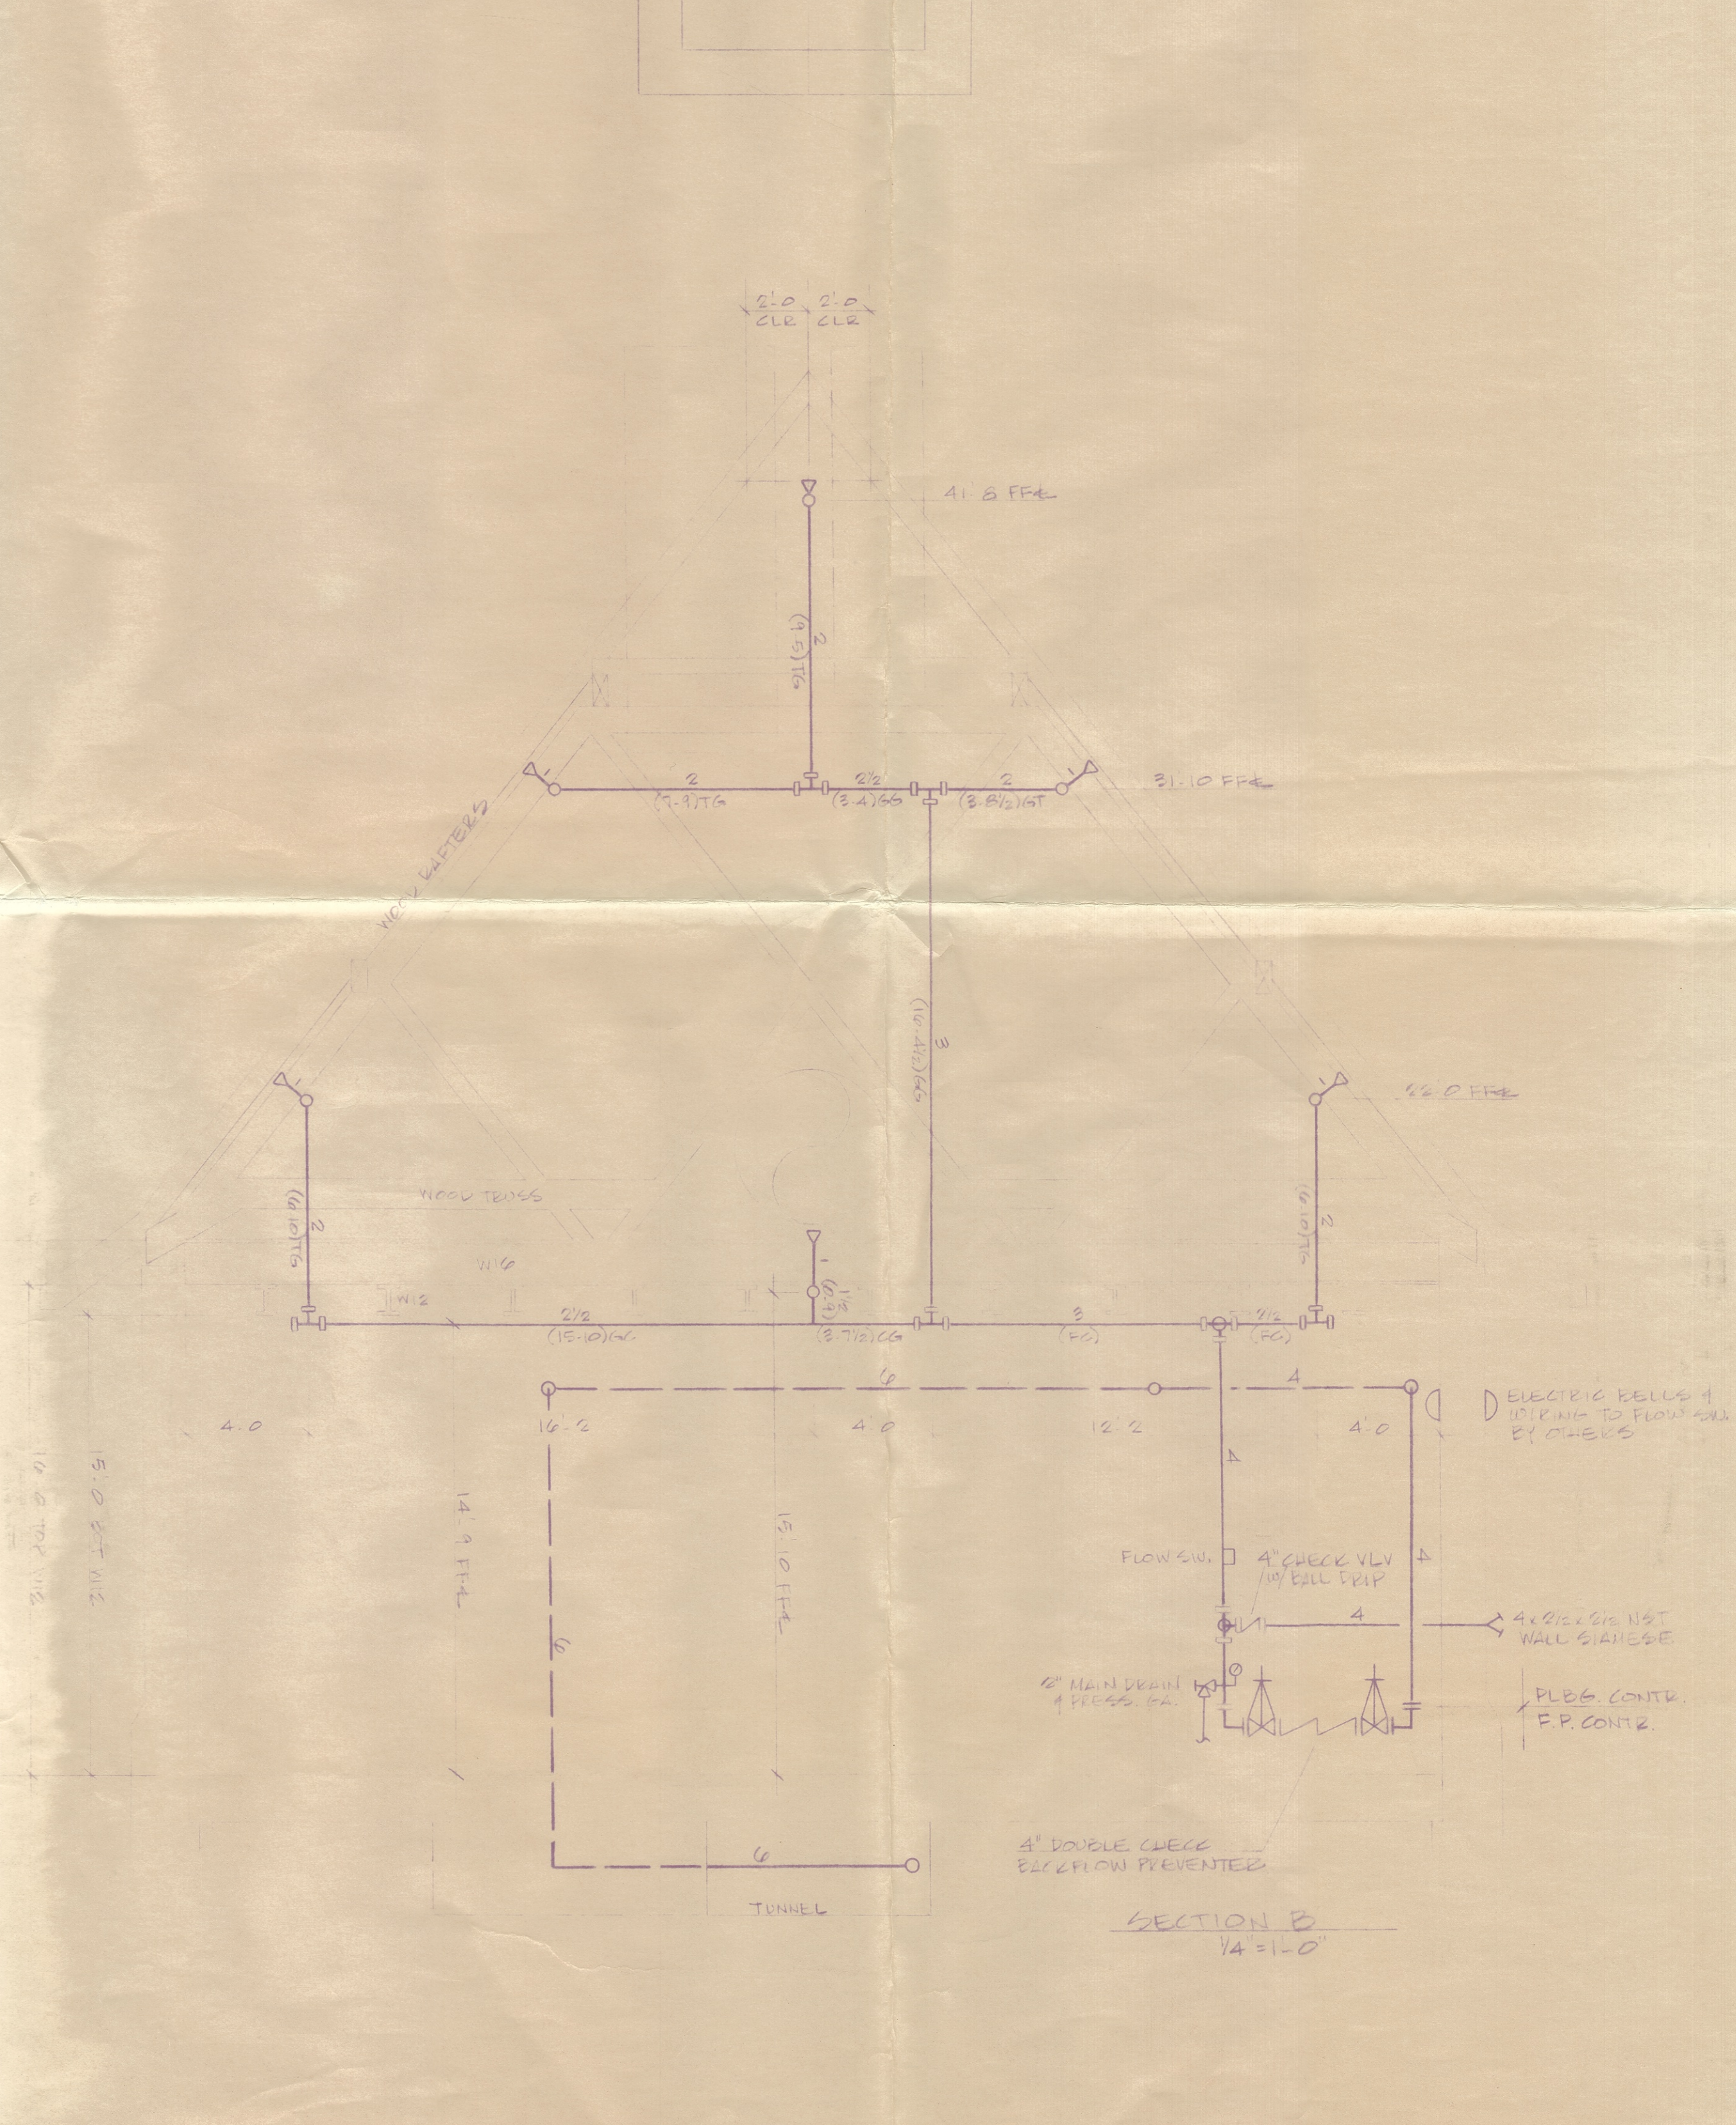


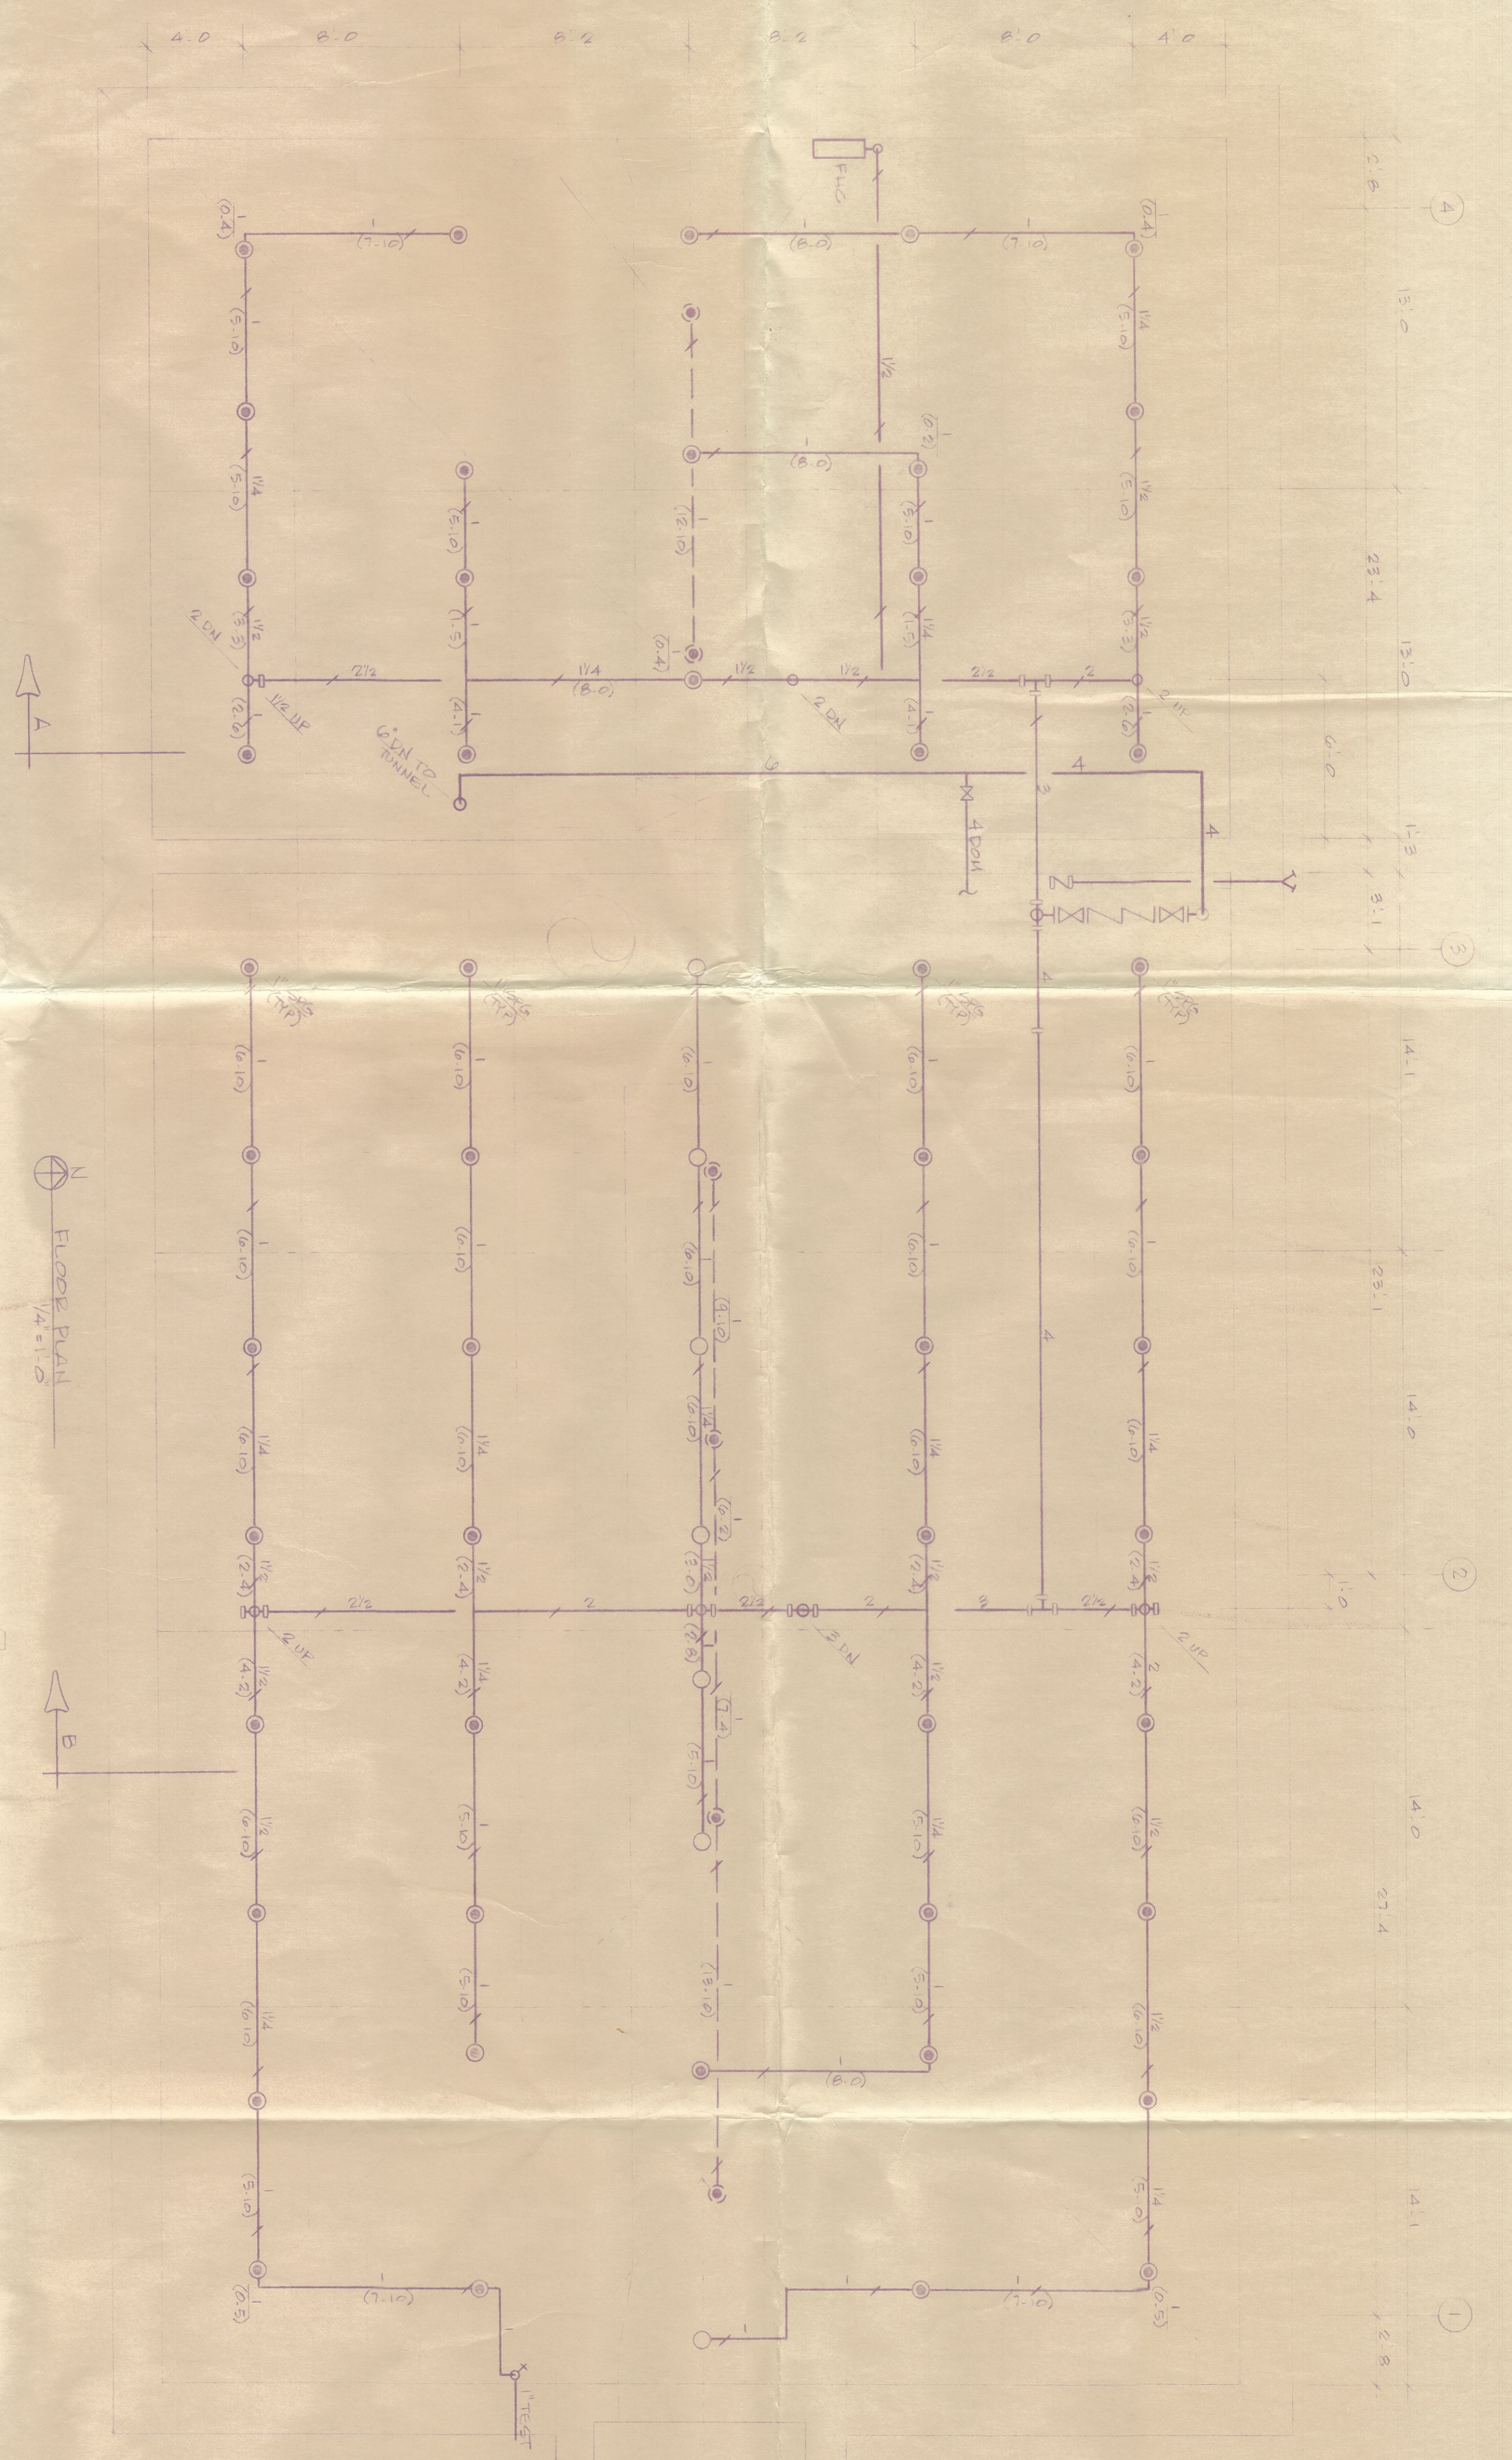

Inspector's Copy
Stack Co.
P.D. 4285

COLECTIVE FIELD & TTS
 NORTH CANTON OHIO
 FIRE PROTECTION PLAN
 NATION PSYCHIATRIC CENTER
 STATE OF OHIO
 DEPT. ADMINISTRATIVE SERVICES
 DIV. PUBLIC WORKS

PLANS APPROVED SUBJECT TO REQUIREMENTS OF:
 Ohio Building Code, (10-51) Plumbing,
 Ohio Fire Code, (10-52) Local Health Department,
 Ohio Boiler and Unfired Vessel Rules,
 Ohio Electrical Code,
 And all other requirements of the Ohio Revised Code
 By a third party inspection agency.
 DIVISION OF FACTORY AND BUILDING INSPECTION
 DEPARTMENT OF INDUSTRIAL RELATIONS
 STATE OF OHIO

STATE OF OHIO
 DEPARTMENT OF FACTORY AND BUILDING INSPECTION
APPROVED
2/24/85
 DATE APR 30 1985
 BY WINDYBROOK

STACK
907623

The design and calculation for the sprinkler system in these plans have not been examined. The efficiency of the design and calculation to meet all code test and the status. The installed fire protection system will be inspected by our field inspectors, and the operation of the system will be verified by the local fire authority or a third party inspection agency.
 DESIGNER: ROBERT L. WATKINS, P.E.
 CONSULTANT: 550 SOUTH G. 88th ST. (45.455 - 80.0)
 CLEVELAND, OHIO 44102
 1-4-81 L.S.D. by Paul Soto

1 1/2\"/>