


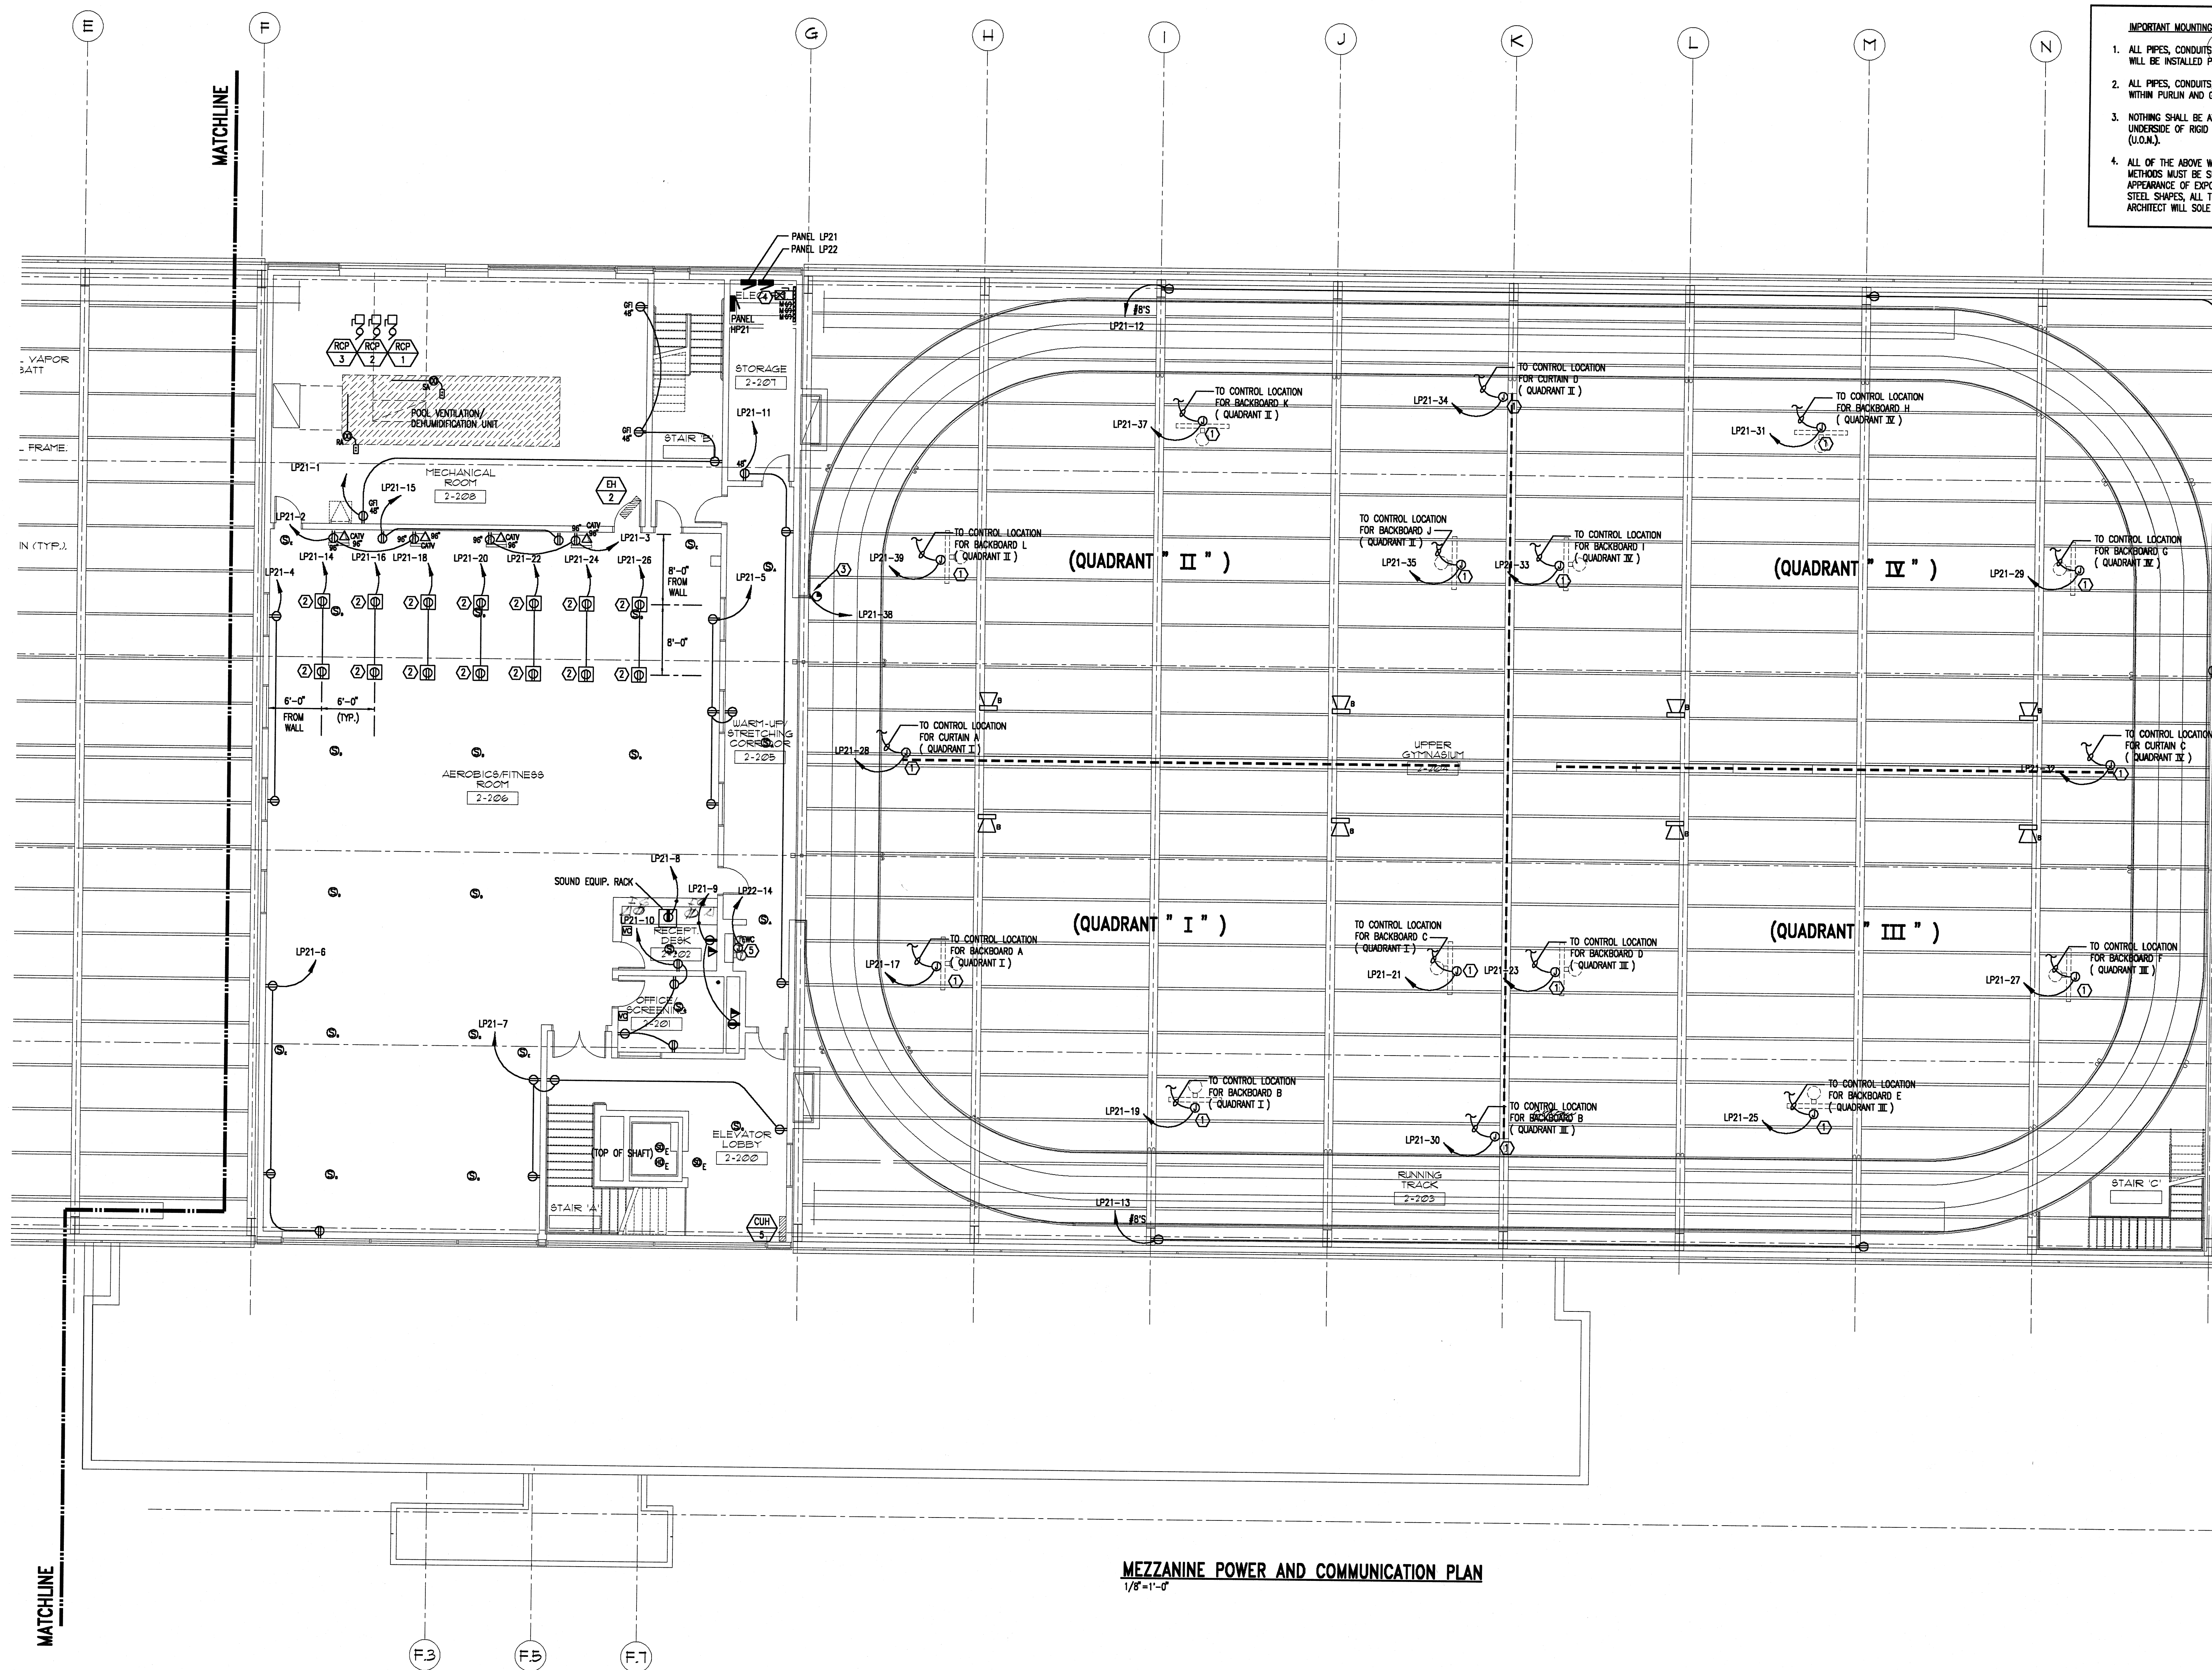


- IMPORTANT MOUNTING NOTES FOR THE E.G.:**
1. ALL PIPES, CONDUITS, DEVICES, JUNCTION BOXES, & ACCESSORIES WILL BE INSTALLED PARALLEL OR PERPENDICULAR TO BUILDING LINES.
 2. ALL PIPES, CONDUITS, DEVICES, & ACCESSORIES WILL BE LOCATED WITHIN FURLIN AND GIRT SPACES.
 3. NOTHING SHALL BE ATTACHED TO INSIDE FACE OF COLUMNS OR UNDERSIDE OF RIGID FRAME EXCEPT MAIN FIRE LINE AND DUCTS (U.O.N.).
 4. ALL OF THE ABOVE WILL BE PAINTED. ALL FASTENING & HANGING METHODS MUST BE SUBMITTED AND APPROVED TO ASSURE ORDERLY APPEARANCE OF EXPOSED ITEMS IN POOL & GYM UNISTRUT HANGER. STEEL SHAPES, ALL THREAD RODS, ETC. WILL NOT BE PERMITTED. ARCHITECT WILL SOLE JUDGE ON APPEARANCE.

Issued / Revised		
No.	Date	Description
1	2/15/201	ISSUE FOR BIDDING & PERMIT

- GENERAL NOTES:**
1. ALL RECEPTACLES MOUNTED ABOVE COUNTER TOPS OR WITHIN MILL WORK SHALL BE COORDINATED WITH THE ARCHITECTURAL ELEVATIONS PRIOR TO ROUGH-IN.
 2. CONDUITS ROUTED THROUGH EXPOSED CEILING AREAS SHALL NOT BE MOUNTED BELOW THE BOTTOM CHORD OF THE JOIST. CONDUITS SHALL BE ROUTED BELOW THE TOP CHORD OF THE JOIST, OR IN THE UPPER PART OF THE JOIST SPACE. DEVIATIONS MUST BE APPROVED BY THE ARCHITECT. THIS INCLUDES AND IS NOT LIMITED TO THE FOLLOWING AREAS: POOL, GYMNASIUM, ETC.
 3. ALL ELECTRICAL DEVICES AND RACEWAYS MOUNTED OR ROUTED THROUGH EXPOSED CEILING AREAS (CONDUITS, PULLBOXES, DISCONNECT SWITCHES, ETC.) SHALL BE LABELED USING A LAMACOD STYLE LABELING METHOD AS DESCRIBED IN THE ELECTRICAL SPECIFICATIONS. MARKER TYPE LABELING SHALL NOT BE PERMITTED WHERE THE DEVICES ARE LOCATED IN AN EXPOSED CEILING AREA.

- CODED NOTES:**
- ① CURTAIN OR BACKBOARD - PROVIDE A SURFACE MOUNTED 4" SQUARE JUNCTION BOX FOR BACKBOARD OR CURTAIN POWER. (LOCATIONS SHOWN ARE GRAPHICAL. LOCATE DEVICES PER THE ARCHITECT'S BOXED NOTES IN THE UPPER RIGHT HAND CORNER OF THE DRAWING FOR ALL ELECTRICAL DEVICES WITHIN THE GYMNASIUM AREA.) CONCRETE AND RECEPTACLE SHALL BE PROVIDED WITH THE EQUIPMENT. E.C. SHALL INSTALL AND FURNISH ALL REQUIRED POWER AND CONTROL WIRING AS REQUIRED FOR A COMPLETE SYSTEM. E.C. SHALL MOUNT THE JUNCTION BOX WITHIN 3'-0" OF THE WHICH LOCATION. WIRING SHALL BE SIZED PER MANUFACTURER'S SPECIFICATIONS. SEE DRAWING #E2-2 FOR KEYSWITCH CONTROL LOCATIONS.
 - ② PROVIDE A SINGLE GANG CAST IRON SEMI-ADJUSTABLE SHALLOW (2" MAX. DEEP) RECTANGULAR FLOOR BOX WITH SIDE KNOCKOUTS FOR CONDUIT ENTRY FOR EXERCISE EQUIPMENT POWER. FLOOR BOX SHALL BE FULLY RECESSED WITH A CARPET FLANGE TYPE COVERPLATE, AND A NEMA 5-20R DUPLEX RECEPTACLE. POWER CONDUITS SHALL BE ROUTED WITHIN THE FLOOR CONCRETE TOPPING.
 - ③ CLOCK OUTLET - COORDINATE THE ROUGH-IN LOCATION WITH THE OWNER/ARCHITECT.
 - ④ GROUP MOUNT STARTERS FOR EXHAUST FANS EF-1, EF-2, EF-3, AND EF-4 ON 4'-0" x 8'-0" x 3/4" FIRE TREATED PLYWOOD BACKBOARD.
 - ⑤ PROVIDE A RECESSED JUNCTION BOX FOR A HARD WIRED DRINKING FOUNTAIN. COORDINATE ROUGH-IN LOCATION WITH PLUMBING CONTRACTOR. BRANCH TO UNIT AS RECOMMENDED BY UNIT MANUFACTURER.

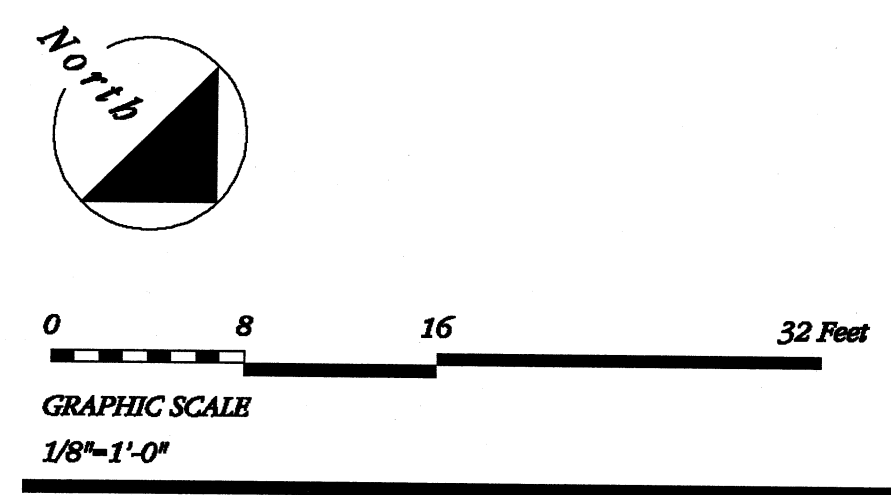

City of Massillon
Recreation Center

Commission #99083.01

1st Street N.W. & Cherry Road N.W.
Massillon, Ohio 44647

van Dijk Pace Westlake
Architects

The Huntington Building
925 Euclid Avenue, Suite 1900
Cleveland, Ohio
44115-1407
216 522-1350

MEZZANINE POWER
AND COMMUNICATION
PLAN

CD
E2-3

THORSON BAKER & Associates, Inc.
Consulting Engineers

3030 West Stradshire Road
Rustburg, Ohio 44280


(330) 656-6888 Ph.
(330) 656-6875 Fax

Drawn by: _____
Checked by: _____
Date: Feb. 15, 2001 Time: 3:58 pm


Issued / Revised		
No.	Date	Description
	2/15/20	ISSUE FOR BIDDING & PERMIT

GENERAL NOTES:

- COORDINATE MOUNTING OF RECEPTACLES AT HVAC EQUIPMENT WITH UNIT SPECIFICATIONS.
- DUCT TYPE SMOKE DETECTOR REMOTE TEST STATIONS SHALL BE WALL MOUNTED AT THE MEZZANINE LEVEL BELOW THEIR RESPECTIVE HVAC UNITS. FIELD COORDINATE THE LOCATIONS, AND MOUNT PER NFPA AND MANUFACTURER'S REQUIREMENTS.

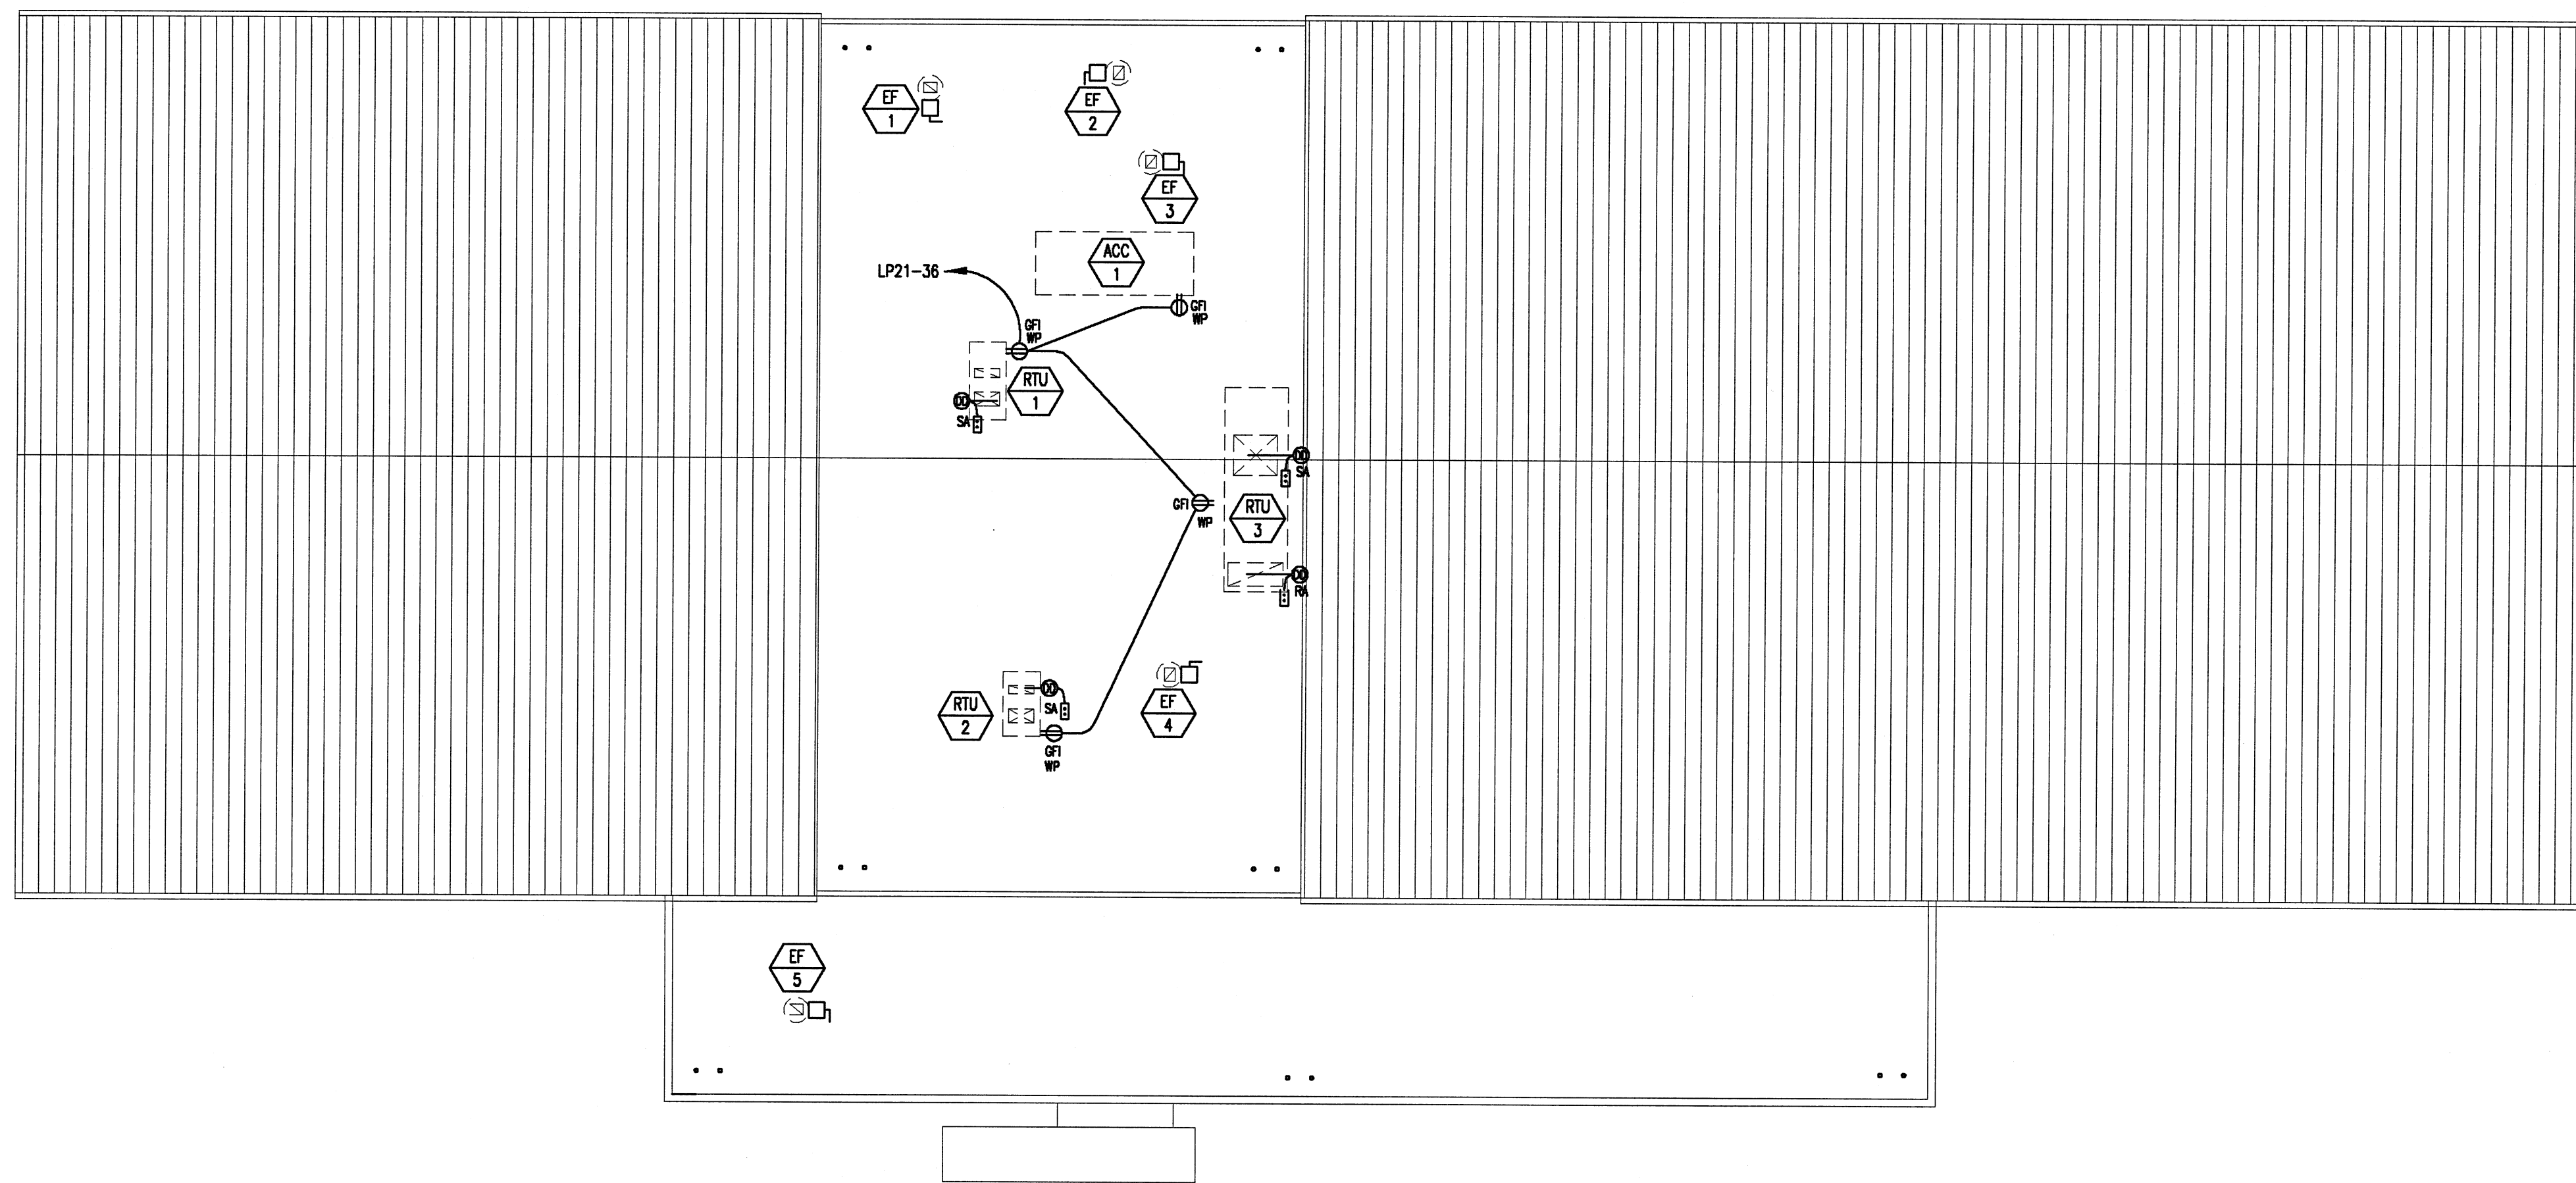

ROOF ELECTRICAL PLAN
1/16" = 1'-0"



0 16 32 64 Feet
GRAPHIC SCALE
1/16" = 1'-0"

City of Massillon
Recreation Center

Commission #99083.01

1st Street N.W. & Cherry Road N.W.
Massillon, Ohio 44647

van Dijk Pace Westlake
Architects

The Huntington Building
925 Euclid Avenue, Suite 1900
Cleveland, Ohio
44115-1407
216 522-1350

ROOF ELECTRICAL
PLAN

THORSON BAKER & Associates, Inc.
Consulting Engineers
3030 West Streetshore Road
Richfield, Ohio 44286
(330) 898-6888 (F)
(330) 898-6875 (F)

CD
E2-4

Issued / Revised		
No.	Date	Description
	2/15/01	ISSUE FOR BIDDING & PERMIT
1	3/14/01	ADDENDUM NO. 1
2	8/16/01	REVISIONS
3	9/16/01	FR #1
4	11/1/01	FR #1 - REV. #2


GENERAL NOTES:

- ALL RECEPTACLES MOUNTED ABOVE COUNTER TOPS OR WITHIN MILL WORK SHALL BE COORDINATED WITH THE ARCHITECTURAL ELEVATIONS PRIOR TO ROUGH-IN.
- CONDUITS ROUTED THROUGH EXPOSED CEILING AREAS SHALL NOT BE MOUNTED BELOW THE BOTTOM CHORD OF THE JOIST. CONDUITS SHALL BE ROUTED BELOW THE TOP CHORD OF THE JOIST, OR IN THE UPPER PART OF THE JOIST SPACE. DEVIATIONS MUST BE APPROVED BY THE ARCHITECT. THIS INCLUDES AND IS NOT LIMITED TO THE FOLLOWING AREAS: POOL, GYMNASIUM, ETC.
- ALL ELECTRICAL DEVICES AND RACEWAYS MOUNTED OR ROUTED THROUGH EXPOSED CEILING AREAS (CONDUITS, PULLBOXES, DISCONNECT SWITCHES, ETC.) SHALL BE LABELED USING A LAMACOID STYLE LABELING METHOD AS DESCRIBED IN THE ELECTRICAL SPECIFICATIONS. MARKER TYPE LABELING SHALL NOT BE PERMITTED WHERE THE DEVICES ARE LOCATED IN AN EXPOSED CEILING AREA.
- COORDINATE MOUNTING OF RECEPTACLES AT HVAC EQUIPMENT WITH UNIT SPECIFICATIONS.
- DUCT TYPE SMOKE DETECTOR REMOTE TEST STATIONS SHALL BE WALL MOUNTED AT THE MEZZANINE LEVEL BELOW THEIR RESPECTIVE HVAC UNITS. FIELD COORDINATE THE LOCATIONS, AND MOUNT PER NFPA AND MANUFACTURER'S REQUIREMENTS.

CODED NOTES:

- NOT USED.
- MOUNT COMBINATION STARTER ABOVE CEILING NEAR EXHAUST FAN EF-6.
- SEE DRAWING #E2-2 FOR CIRCUITING.
- VERIFY THE HEIGHT OF THE HAND DRYERS WITH ARCHITECTURAL PLANS PRIOR TO ROUGH-IN.
- PROVIDE A NEMA 14-50R GROUNDING RECEPTACLE FOR A DOMESTIC ELECTRIC RANGE. PROVIDE 2/0, 1Ø(N), 1Ø(G)-1" C. VERIFY THAT THE PLUG INCLUDED WITH THE UNIT MATCHES THE SPECIFIED RECEPTACLE PRIOR TO ROUGH-IN.
- RELOCATE TYPE SB FIXTURE, EXIT SIGN, AND REMOTE HEAD SHOWN ON DRAWING #E1-2 TO NEW EXTERIOR DOOR LOCATION. EXTEND CIRCUITING AS REQUIRED.
- DEDICATED ISOLATED GROUND TYPE RECEPTACLE MOUNTED AT 60" A.F.F. FOR COMMUNITY ROOM SHELF MOUNTED SOUND SYSTEM.

Is there a sound system for Alternate #3, Community Room?
Only power for a Community Room sound system is provided at this time.



0 8 16 32 Feet
GRAPHIC SCALE
1/8"=1'-0"

City of Massillon
Recreation Center

Commission #99083.01

1st Street N.W. & Cherry Road N.W.
Massillon, Ohio 44647


van Dijk Pace Westlake
Architects

The Huntington Building
925 Euclid Avenue, Suite 1900
Cleveland, Ohio
44115-1407
216 522-1350


ADD ALTERNATE #3
COMMUNITY ROOM
ELECTRICAL PLANS

CD


E2-5

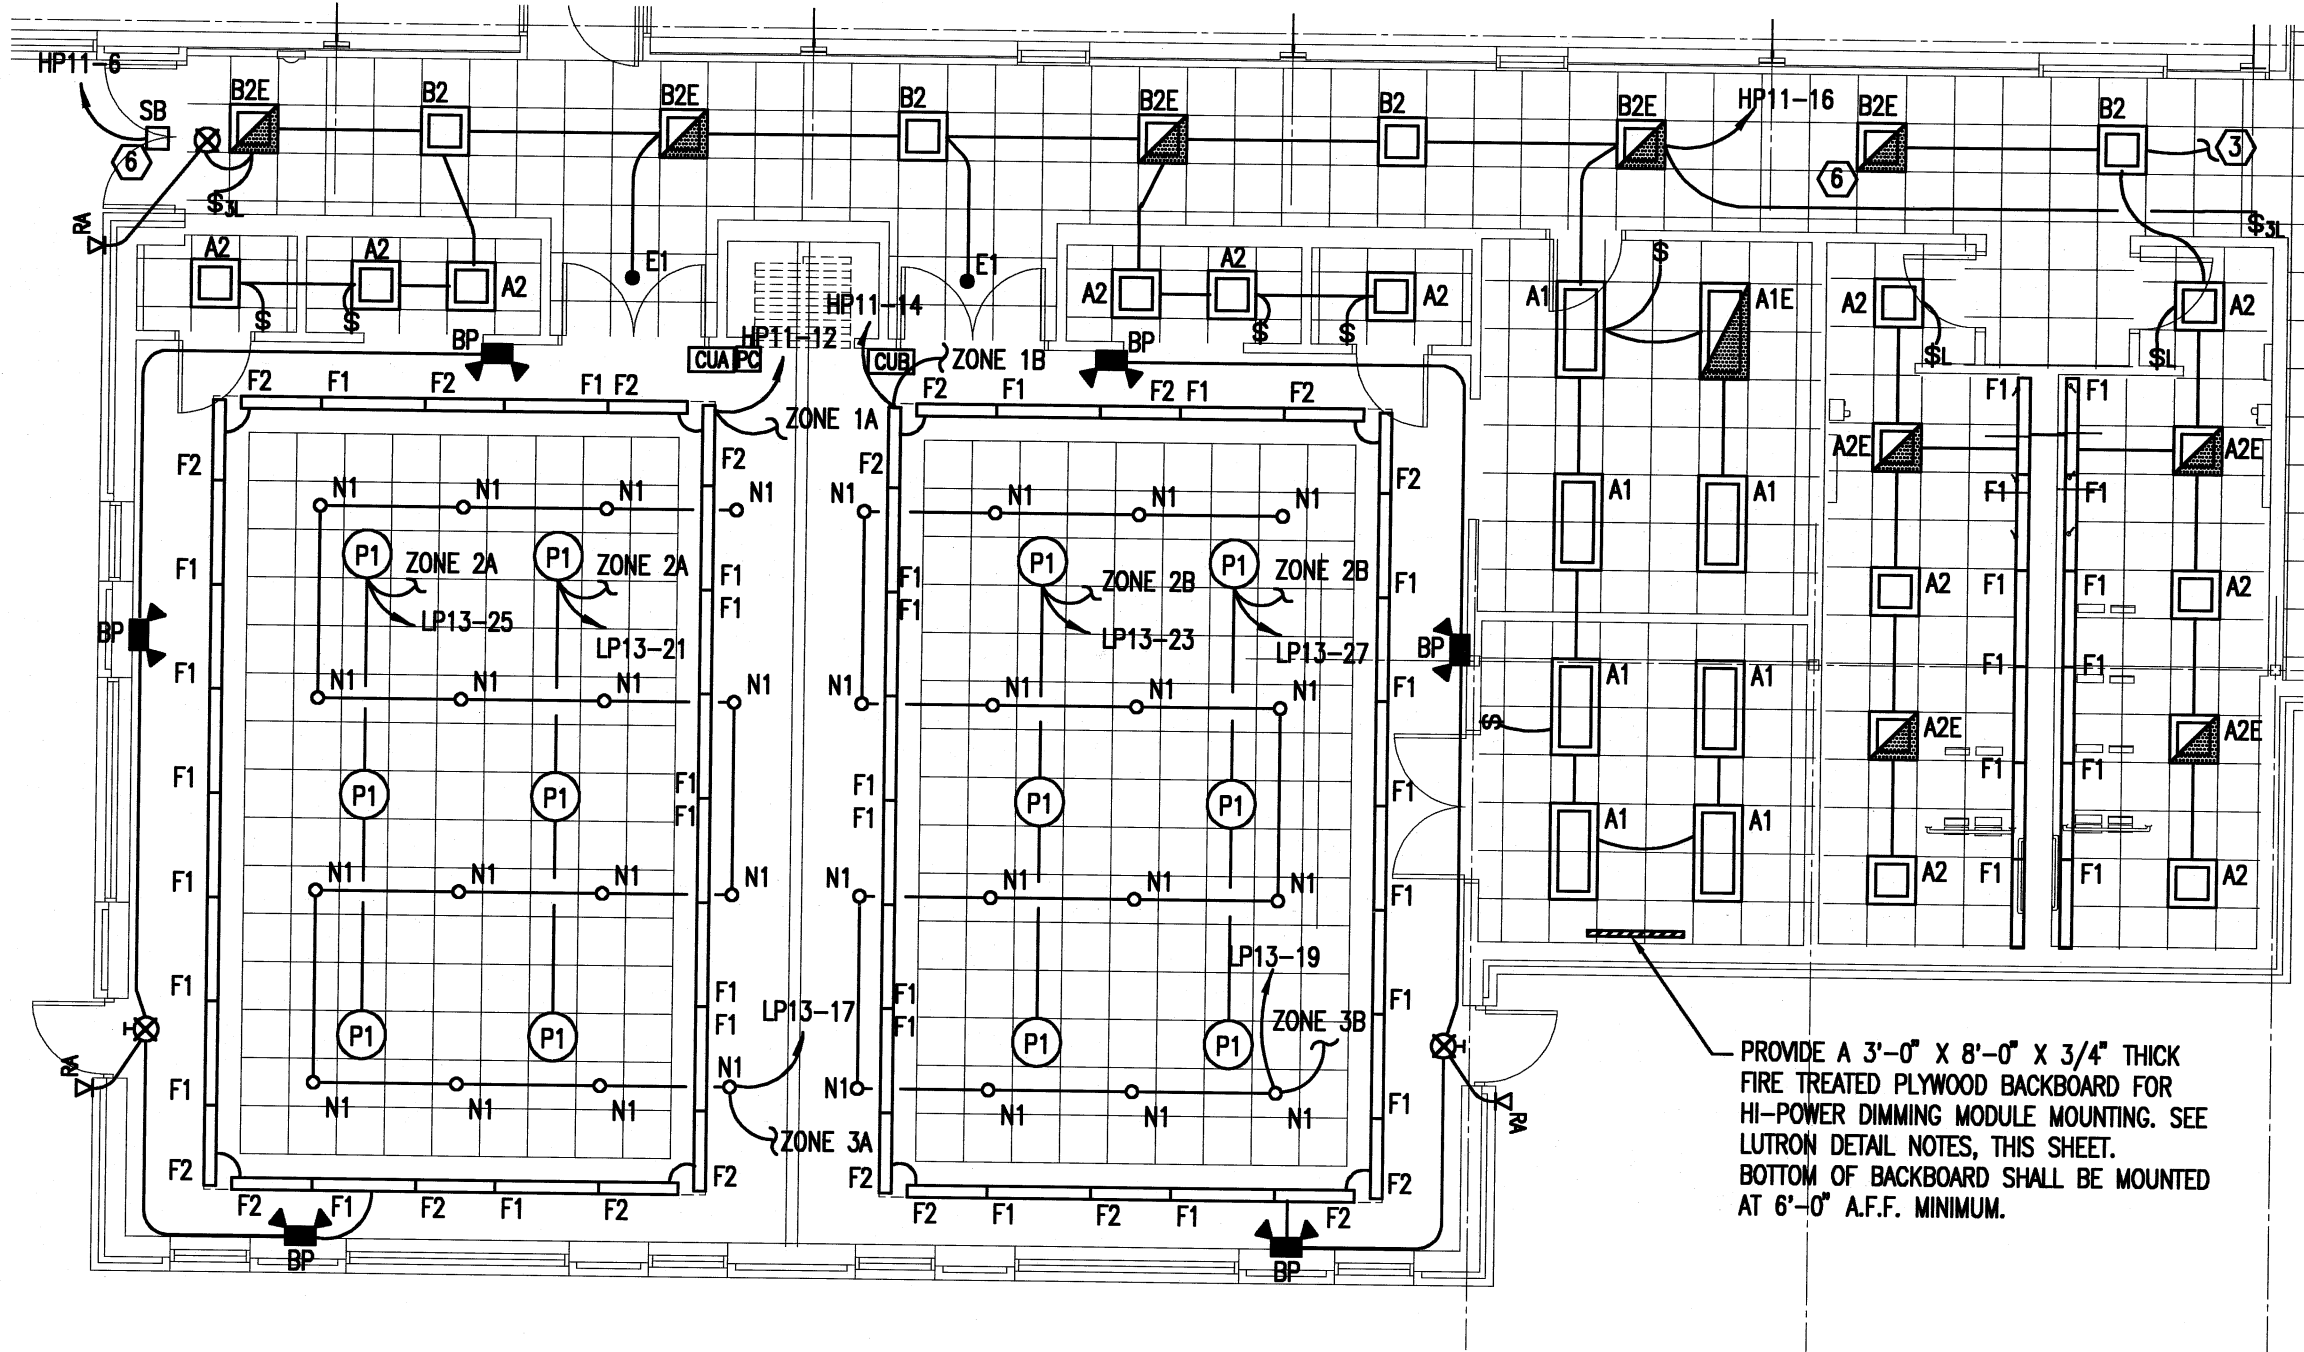

ALTERNATE #3 - COMMUNITY ROOM LIGHTING PLAN
1/8" = 1'-0"

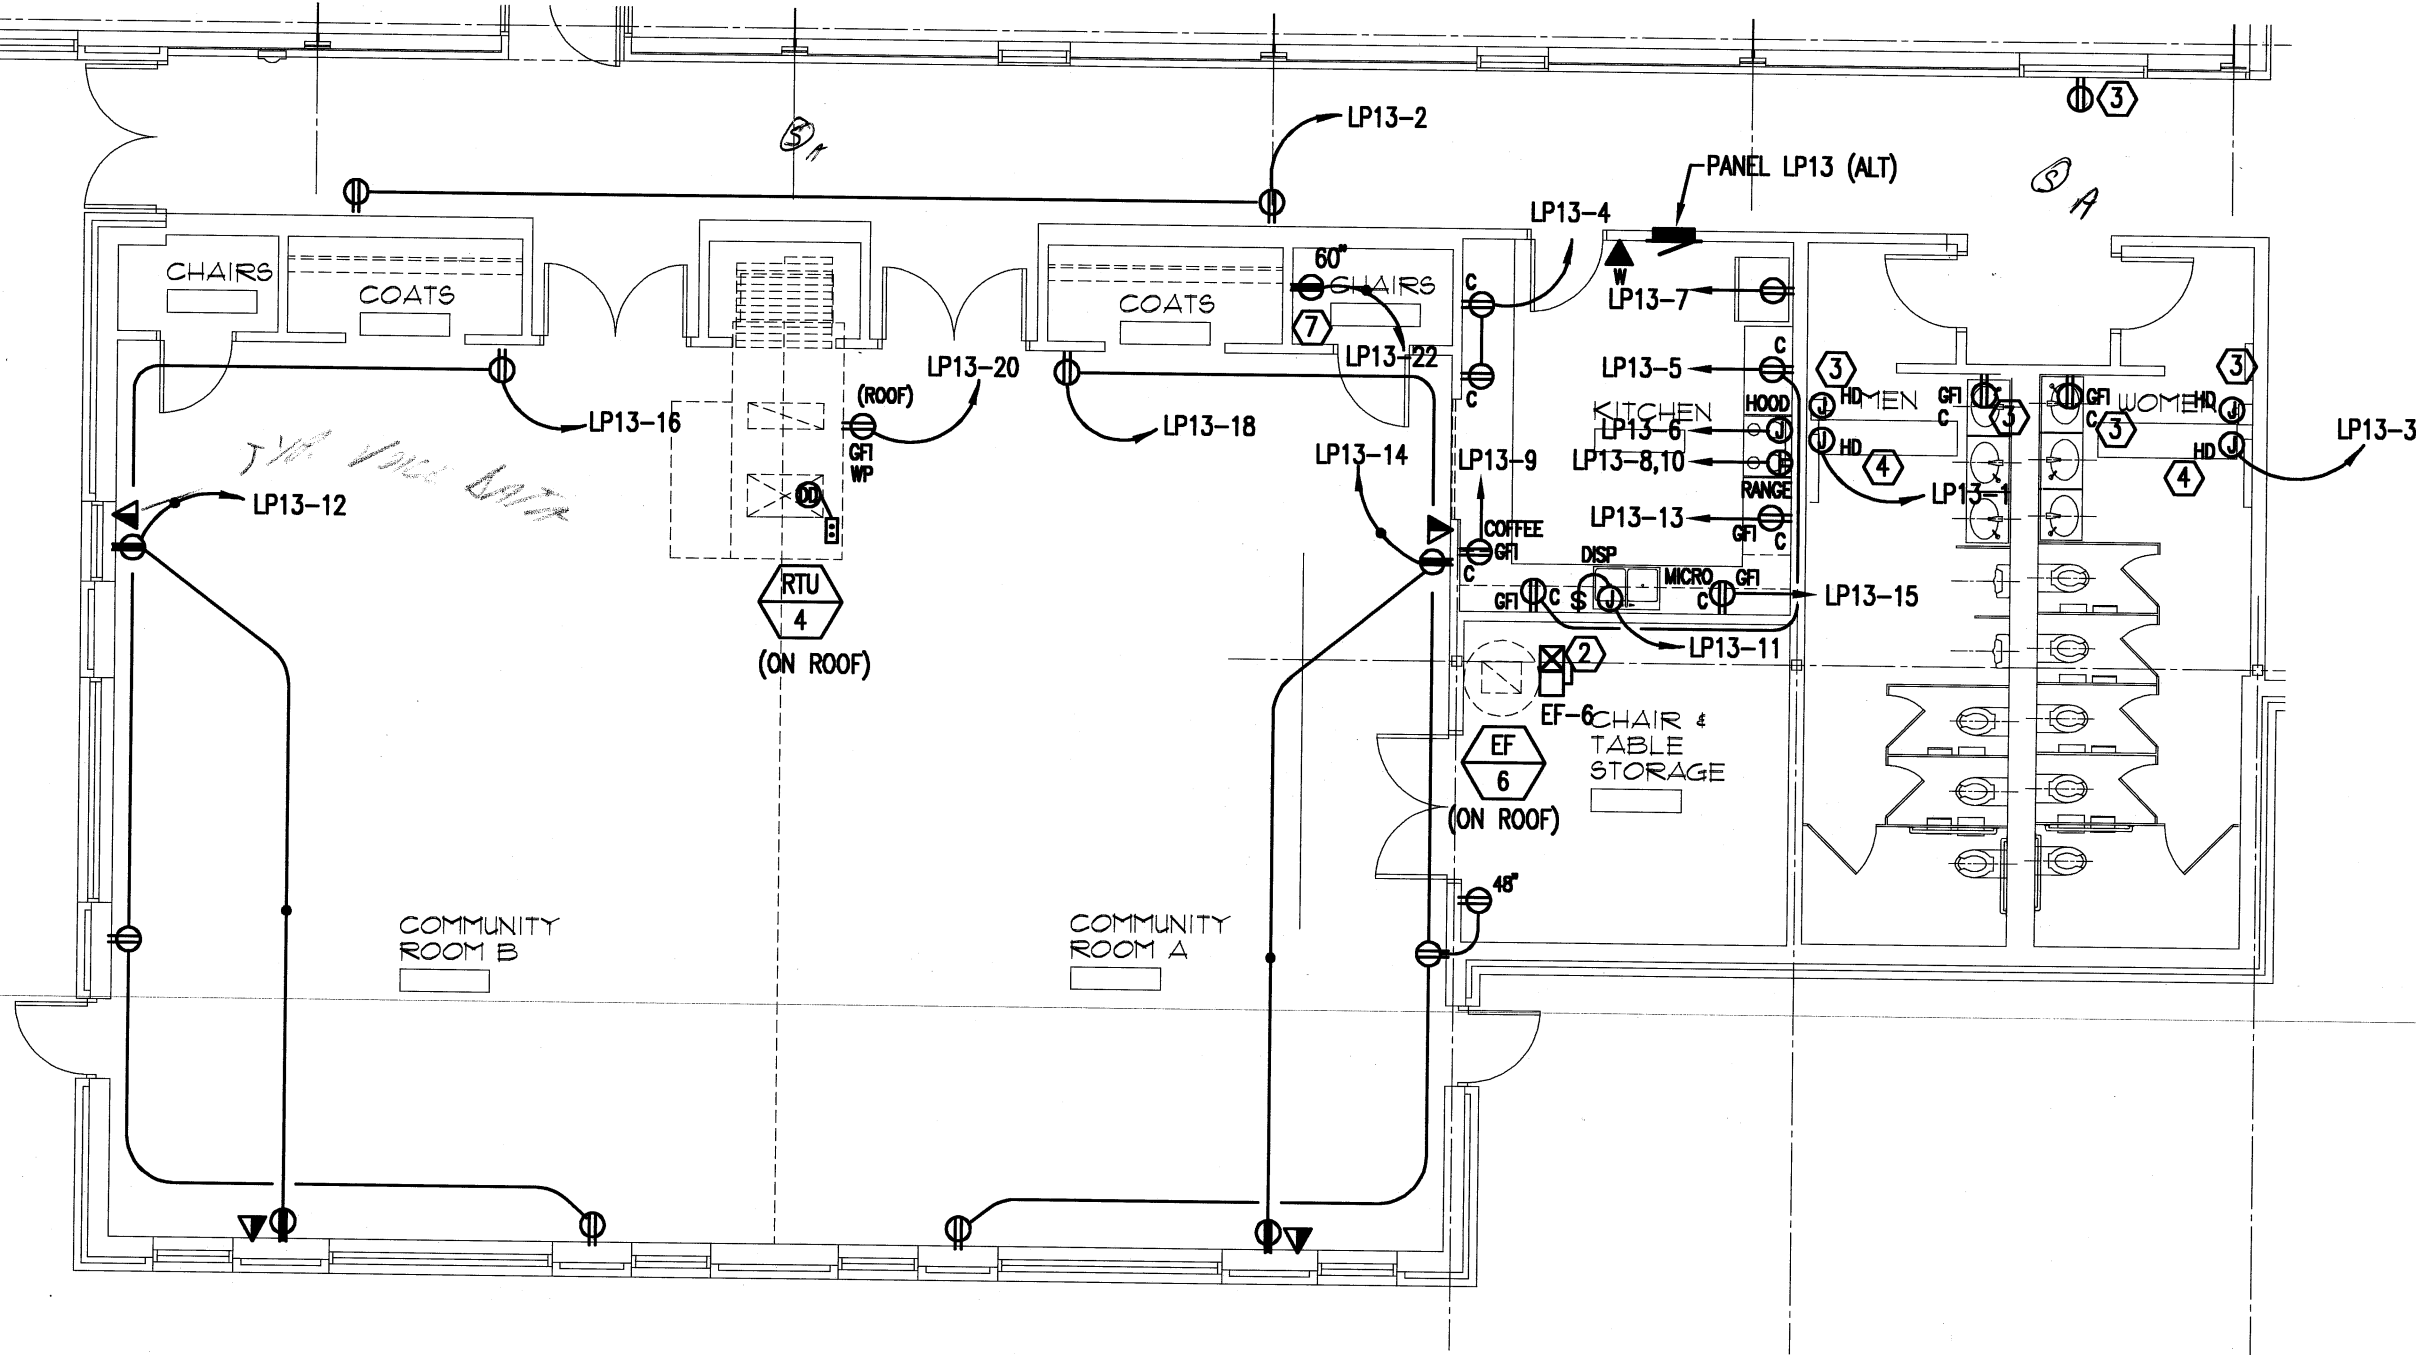

ALTERNATE #3 - COMMUNITY ROOM POWER AND COMMUNICATION PLAN
1/8" = 1'-0"

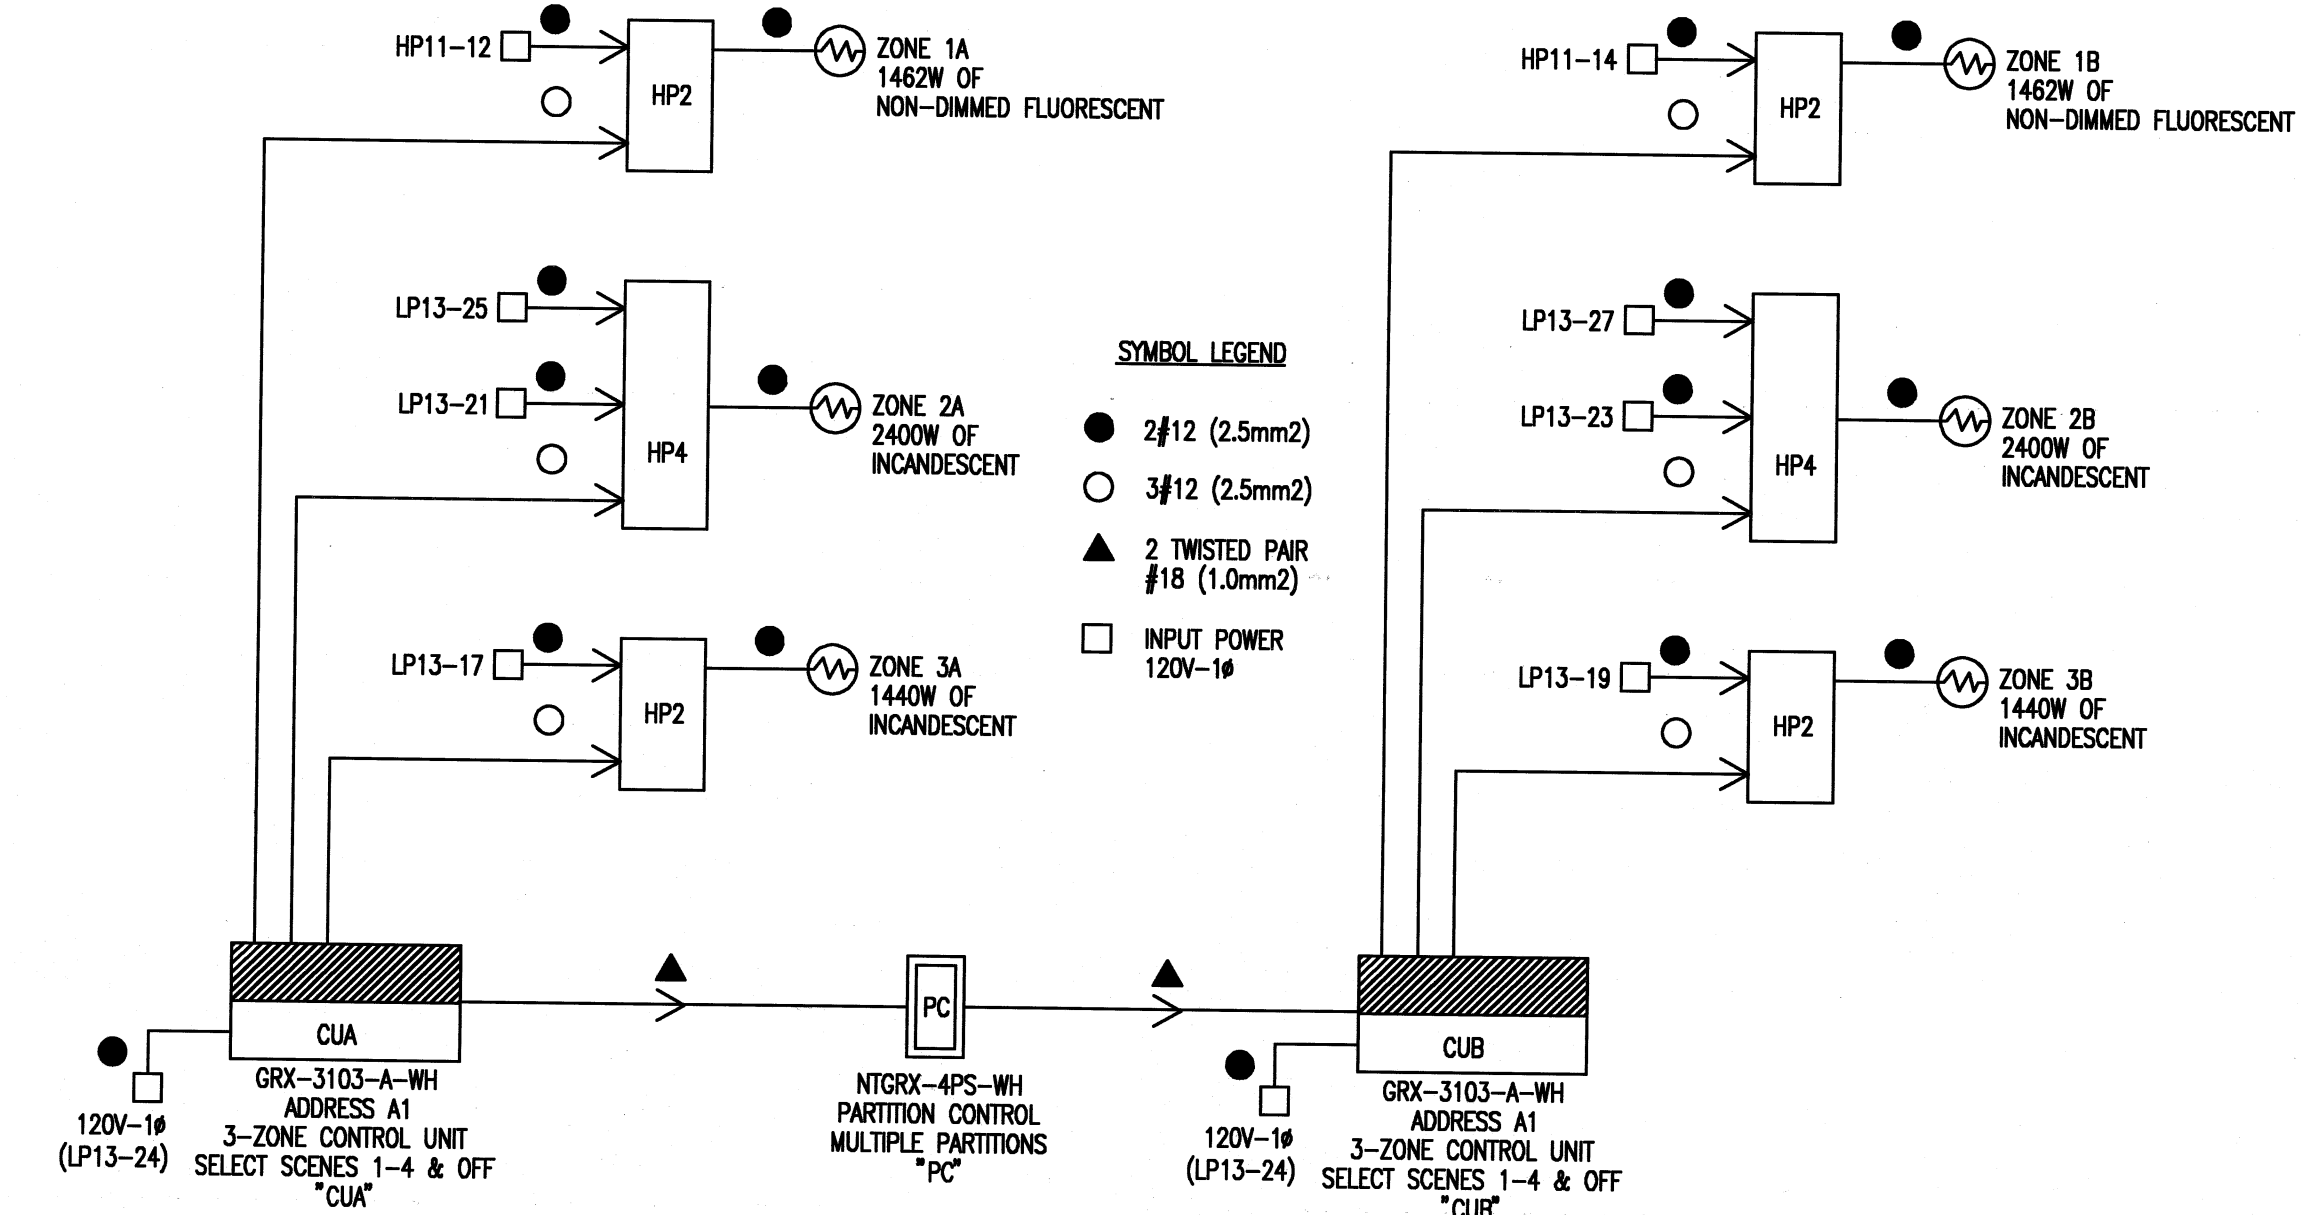

COMMUNITY ROOM DIMMING SYSTEM

NO SCALE

DIMMING SYSTEM GENERAL NOTES:


- VERIFY ALL REQUIREMENTS AND WIRING WITH SYSTEM MANUFACTURER PRIOR TO BIDDING. ALL COMPONENTS ARE BASED ON LUTRON GRAVITY EYE DIMMING SYSTEM.
- COORDINATE PROGRAMMING OF DIMMING SYSTEM WITH MANUFACTURER'S REPRESENTATIVE.
- CONTROL POWER IS REQUIRED TO ALL CONTROL UNITS AND HI POWER (HP2) MODULES. IT IS CRITICAL THAT THE CONTROL POWER TO ALL DEVICES IS ON THE SAME ELECTRICAL PHASE OF THE ELECTRICAL SYSTEM.
- MOUNT HI POWER (HP2) MODULES AT LEAST 6'-0" AWAY FROM ALL SENSITIVE ELECTRONIC EQUIPMENT AND ASSOCIATED WIRING INCLUDING THE SOUND SYSTEM.
- MAINTAIN ALL MANUFACTURER RECOMMENDED CLEARANCES AROUND ALL DIMMER MODULES FOR PROPER COOLING. ALLOW A MINIMUM OF 6" SPACE IN FRONT AND ABOVE MODULE FOR AIR CIRCULATION.
- RUN POWER AND CONTROL WIRES IN SEPARATE RACEWAYS TO ENSURE PROPER OPERATION.
- USE SEPARATE NEUTRALS FOR EACH INPUT AND LOAD CIRCUIT.
- MOUNT HI POWER MODULES VERTICALLY. DO NOT STACK MORE THAN FOUR MODULES VERTICALLY. MOUNT ON PLYWOOD BACKBOARD WHERE INDICATED ON PLANS.
- MODULE WILL PRODUCE A SLIGHT AUDIBLE NOISE DURING OPERATION. MOUNT MODULE WHERE SUCH NOISE IS ACCEPTABLE TO THE OWNER.

ALTERNATE #3 - COMMUNITY ROOM


THE E.C. SHALL PROVIDE AN ADD ALTERNATE PRICE FOR ALL ELECTRICAL RELATED WORK INDICATED ABOVE, INCLUDING ALL WIRING MODIFICATIONS TO THE CONTRACT DOCUMENTS REQUIRED TO COMPLETE THE COMMUNITY ROOM ELECTRICAL WORK.

THORSON BAKER & Associates, Inc.
Consulting Engineers
3030 West Streeshorne Road
Burlington, Ohio 44206
(330) 658-6888 Pk.
(330) 658-6875 Fax


Drawn by: [blank]
Checked by: [blank]
1/8" = 1'-0" Scale: Nov. 08, 2001 Time: 1:53 pm
1/8" = 1'-0" Scale: Nov. 08, 2001 Time: 1:53 pm

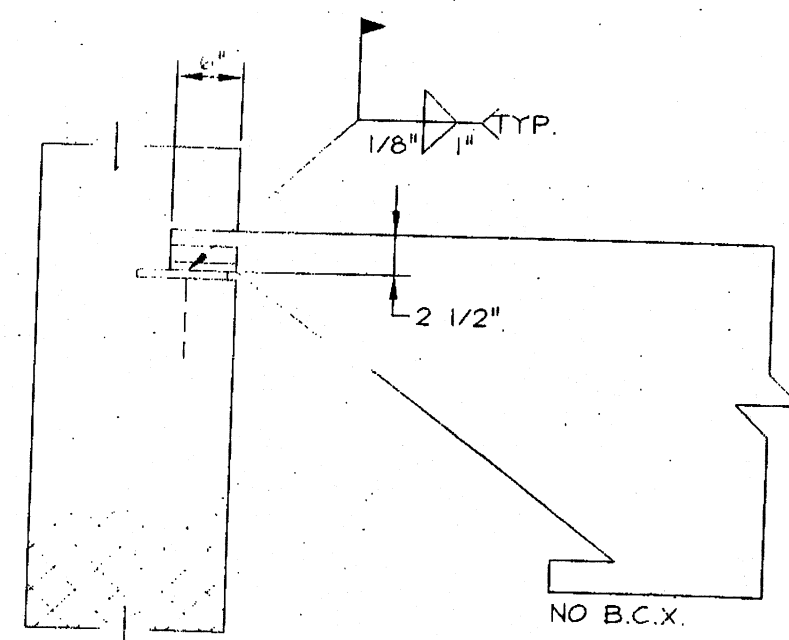


SECTION 1

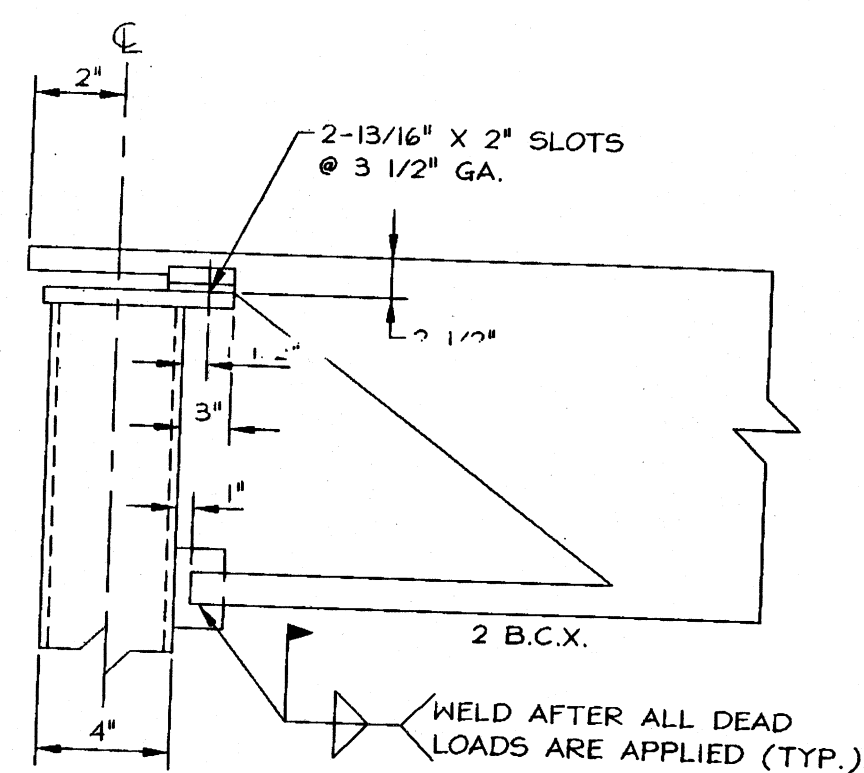


SECTION 2

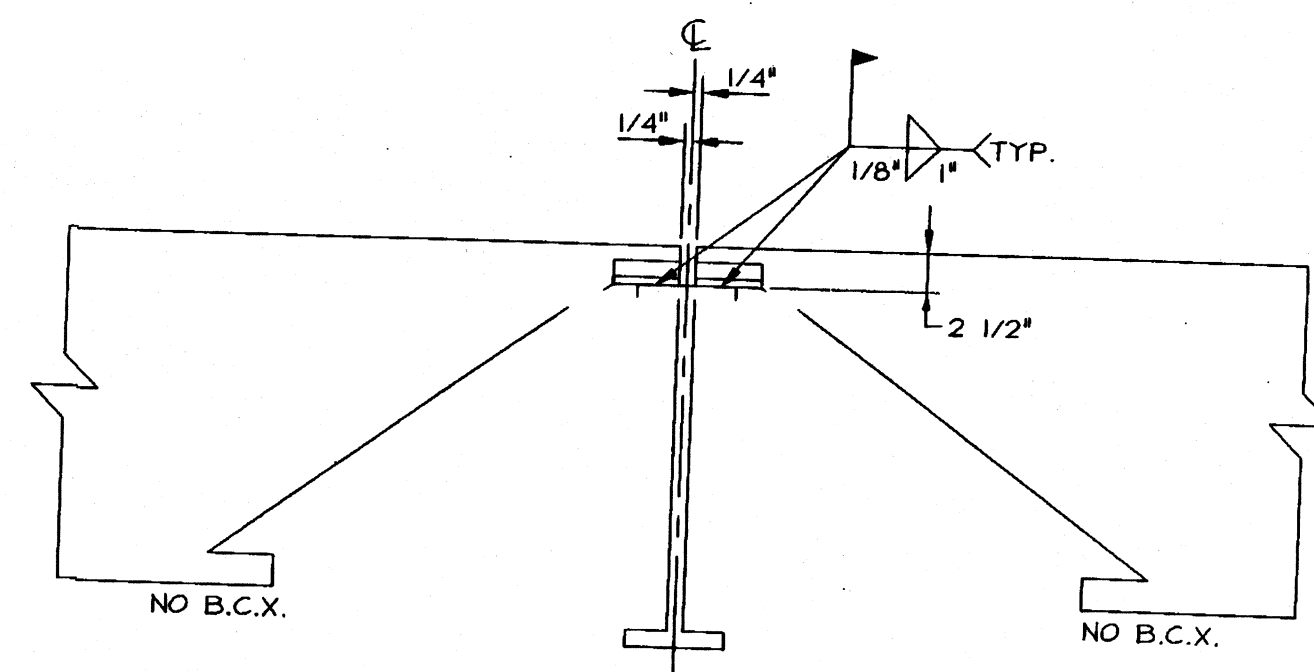


SECTION 3

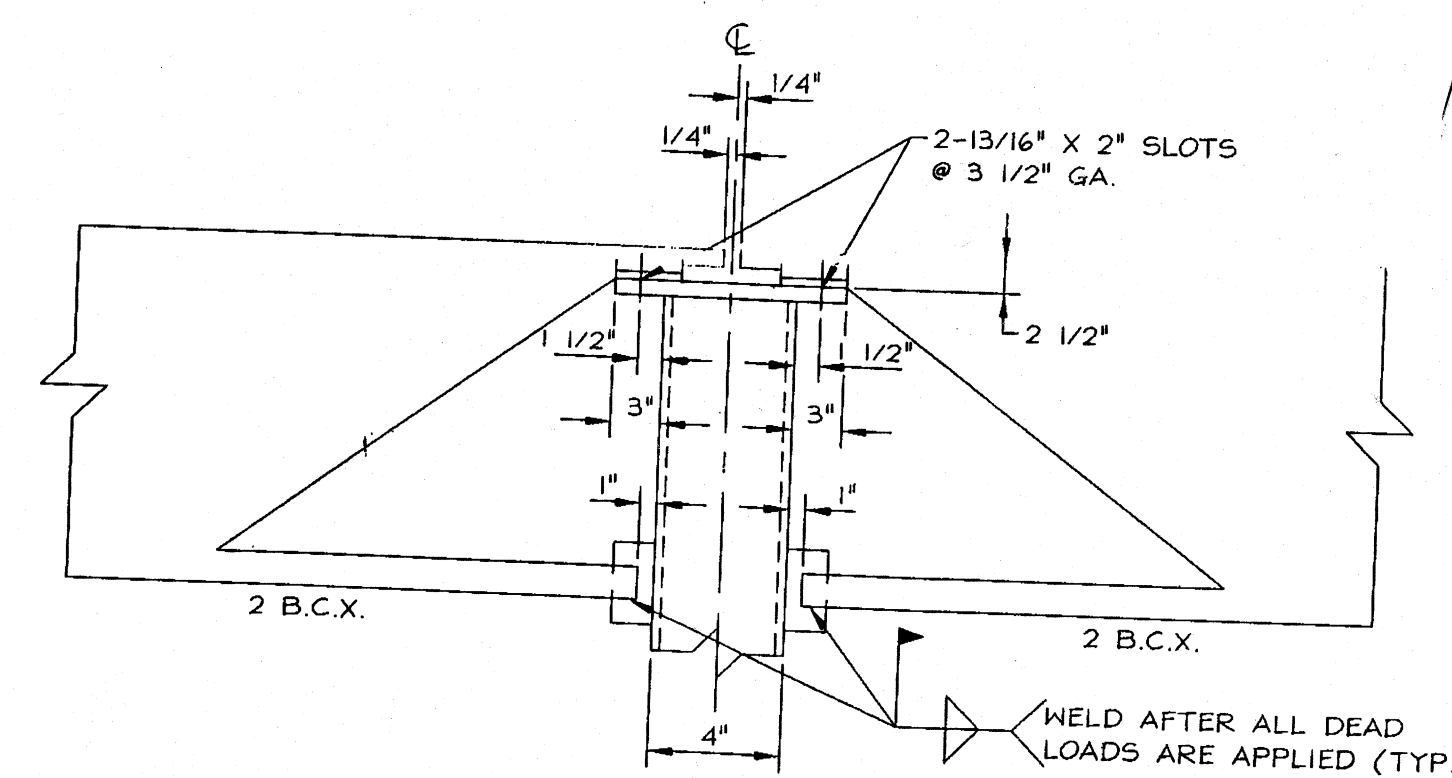

SECTION 4

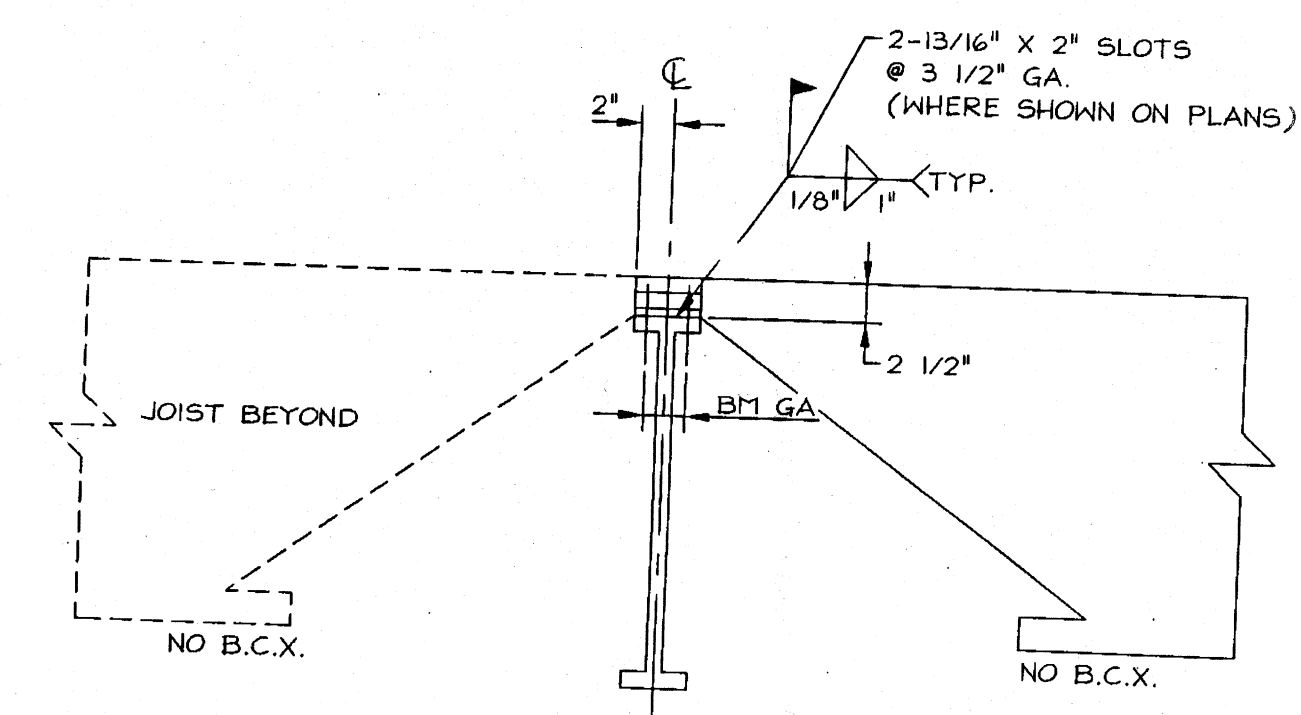


SECTION 5

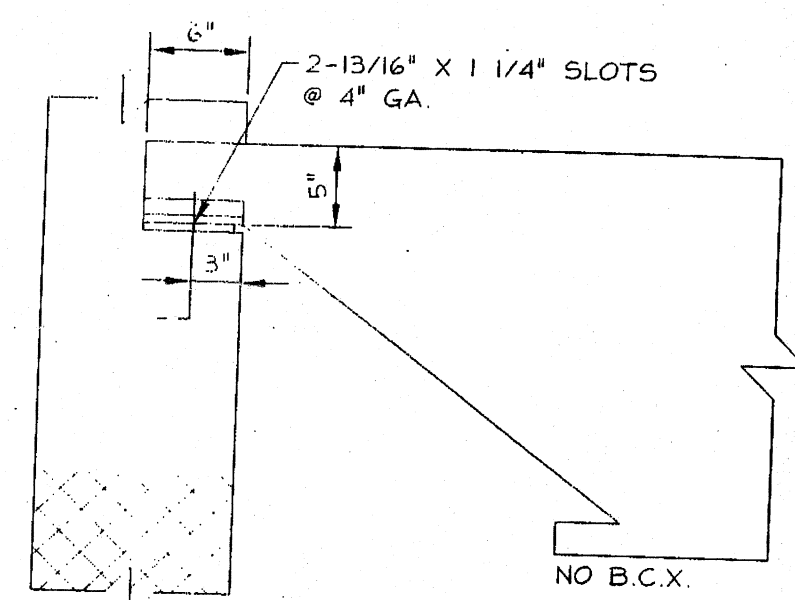


SECTION 6

FOR INFO

CUSTOMER JOB NO.: X				Joist Sections			
				JOB NAME: Indoor Recreation Center			
				LOCATION: Massillon, OH			
				CUSTOMER: Burghardt Metal Fab., Inc.			
				NICHOLAS J. BOURAS, INC.			
				P.O. Box 31, Old Highway 15			
				New Columbia, PA 17856			
				Phone: 670-568-6713			
				Fax: 670-568-2092			
				E-mail: kmabus@bourasind.com			
3/1		7/13/01		FIELD USE			
3/1		6/1/01		APPROVAL			
NO.	DATE	FOR	NO.	DATE	DESCRIPTION		
PRINTS ISSUED			REVISIONS				

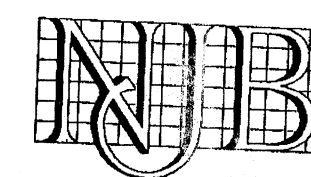




Issued / Revised		
No.	Date	Description
1	2/15/01	ISSUE FOR BIDDING & PERMIT
2	3/14/01	ADDENDUM #1
3	8/10/01	REVISION/COORDINATION
4	9/6/01	REVISIONS- FR # 11

General Notes:

- ALL DIMENSIONS ARE FROM FINISH TO FINISH, OR TO COLUMN CENTERLINE, UNLESS NOTED OTHERWISE. ALL WALL THICKNESSES ARE NOMINAL DIMENSIONS.
- ALL DOOR OPENINGS ARE DIMENSIONED TO SCHEDULED DOOR OPENINGS.
- SEE A3-11 FOR INTERIOR WALL TYPES.
- SEE A3-11 FOR DOOR DETAILS.
- SEE REFLECTED CEILING PLAN FOR CEILING & SOFFIT HEIGHTS.

Key Notes:

- FROST FREE SLAB
- THRESHOLD
- LINE OF CANOPY ABOVE
- LINE OF GYP. BD. ABOVE
- EQUIPMENT BY OWNER
- COURT MARKINGS- SEE SHEET A1-4
- OPEN BELOW
- ROOF BELOW
- CONCRETE BENCH
- WALK-OFF MAT
- MECHANICAL EQUIPMENT- SEE MECHANICAL
- MECHANICAL DUCTWORK- SEE MECHANICAL
- LINE OF RUNNING TRACK ABOVE
- BASKETBALL BACKSTOP ABOVE (RETRACTABLE)
- FREE-ENGINEERED STEEL BUILDING
- FIRE EXTINGUISHER CABINET
- MAPLE WOOD GYMNASIUM FLOORING- SEE SCHEDULED FINISH
- COLORLED CONCRETE FLOOR- SEE SCHEDULED FINISH
- POOL EQUIPMENT
- KIDPIE POOL
- LAP POOL
- LAZY RIVER-POOL
- SPLASH-DOWN/ MULTI-PURPOSE POOL
- CONCRETE SIDEWALK- SEE CIVIL
- GYMNASIUM DIVIDER CURTAIN
- SCORE KEEPER'S TABLE (N.C.)
- SOUND SYSTEM JACKS, SCOREBOARD CONTROL JACKS
- 4 GANG BACKSTOP & CURTAIN CONTROLS
- SCOREBOARD
- VOLEYBALL FLOOR SLEEVE INSERT (TYP. OF 6)
- 2X6" PAINTED STRIP
- PAINTED STRIPE COURT MARKINGS- SEE SPEC'S



0 8 16 32 Feet
GRAPHIC SCALE
1/8"=1'-0"

City of Massillon
Massillon Recreation Center

Commission #99083.00

1st Street N.W. & Cherry Road N.W.
Massillon, Ohio 44647

van Dijk Pace Westlake
Architects

The Huntington Building
925 Euclid Avenue, Suite 1900
Cleveland, Ohio
44115-1407
216 522-1350

Gymnasium Plan &
Locker Rooms-First Floor


CD
A1-4

Drawn by: Checked by:

ALTERNATE ROOF PLAN

1/8" = 1'-0"

8
-9|-5

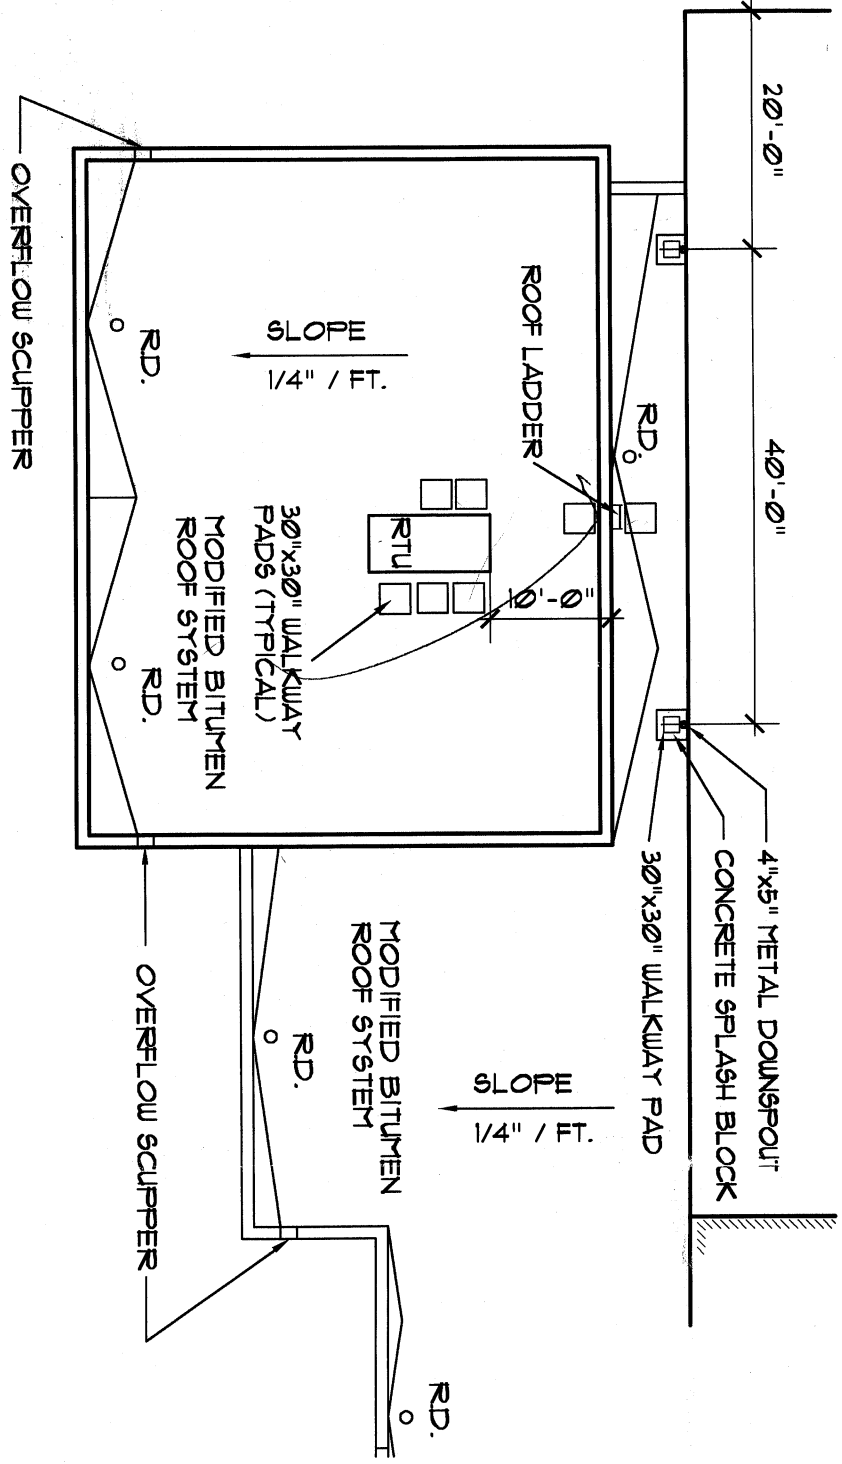

ALTERNATE REFLECTED CEILING PLAN


1/8" = 1'-0"

2
-1|-5

D-3

E-1

F-1

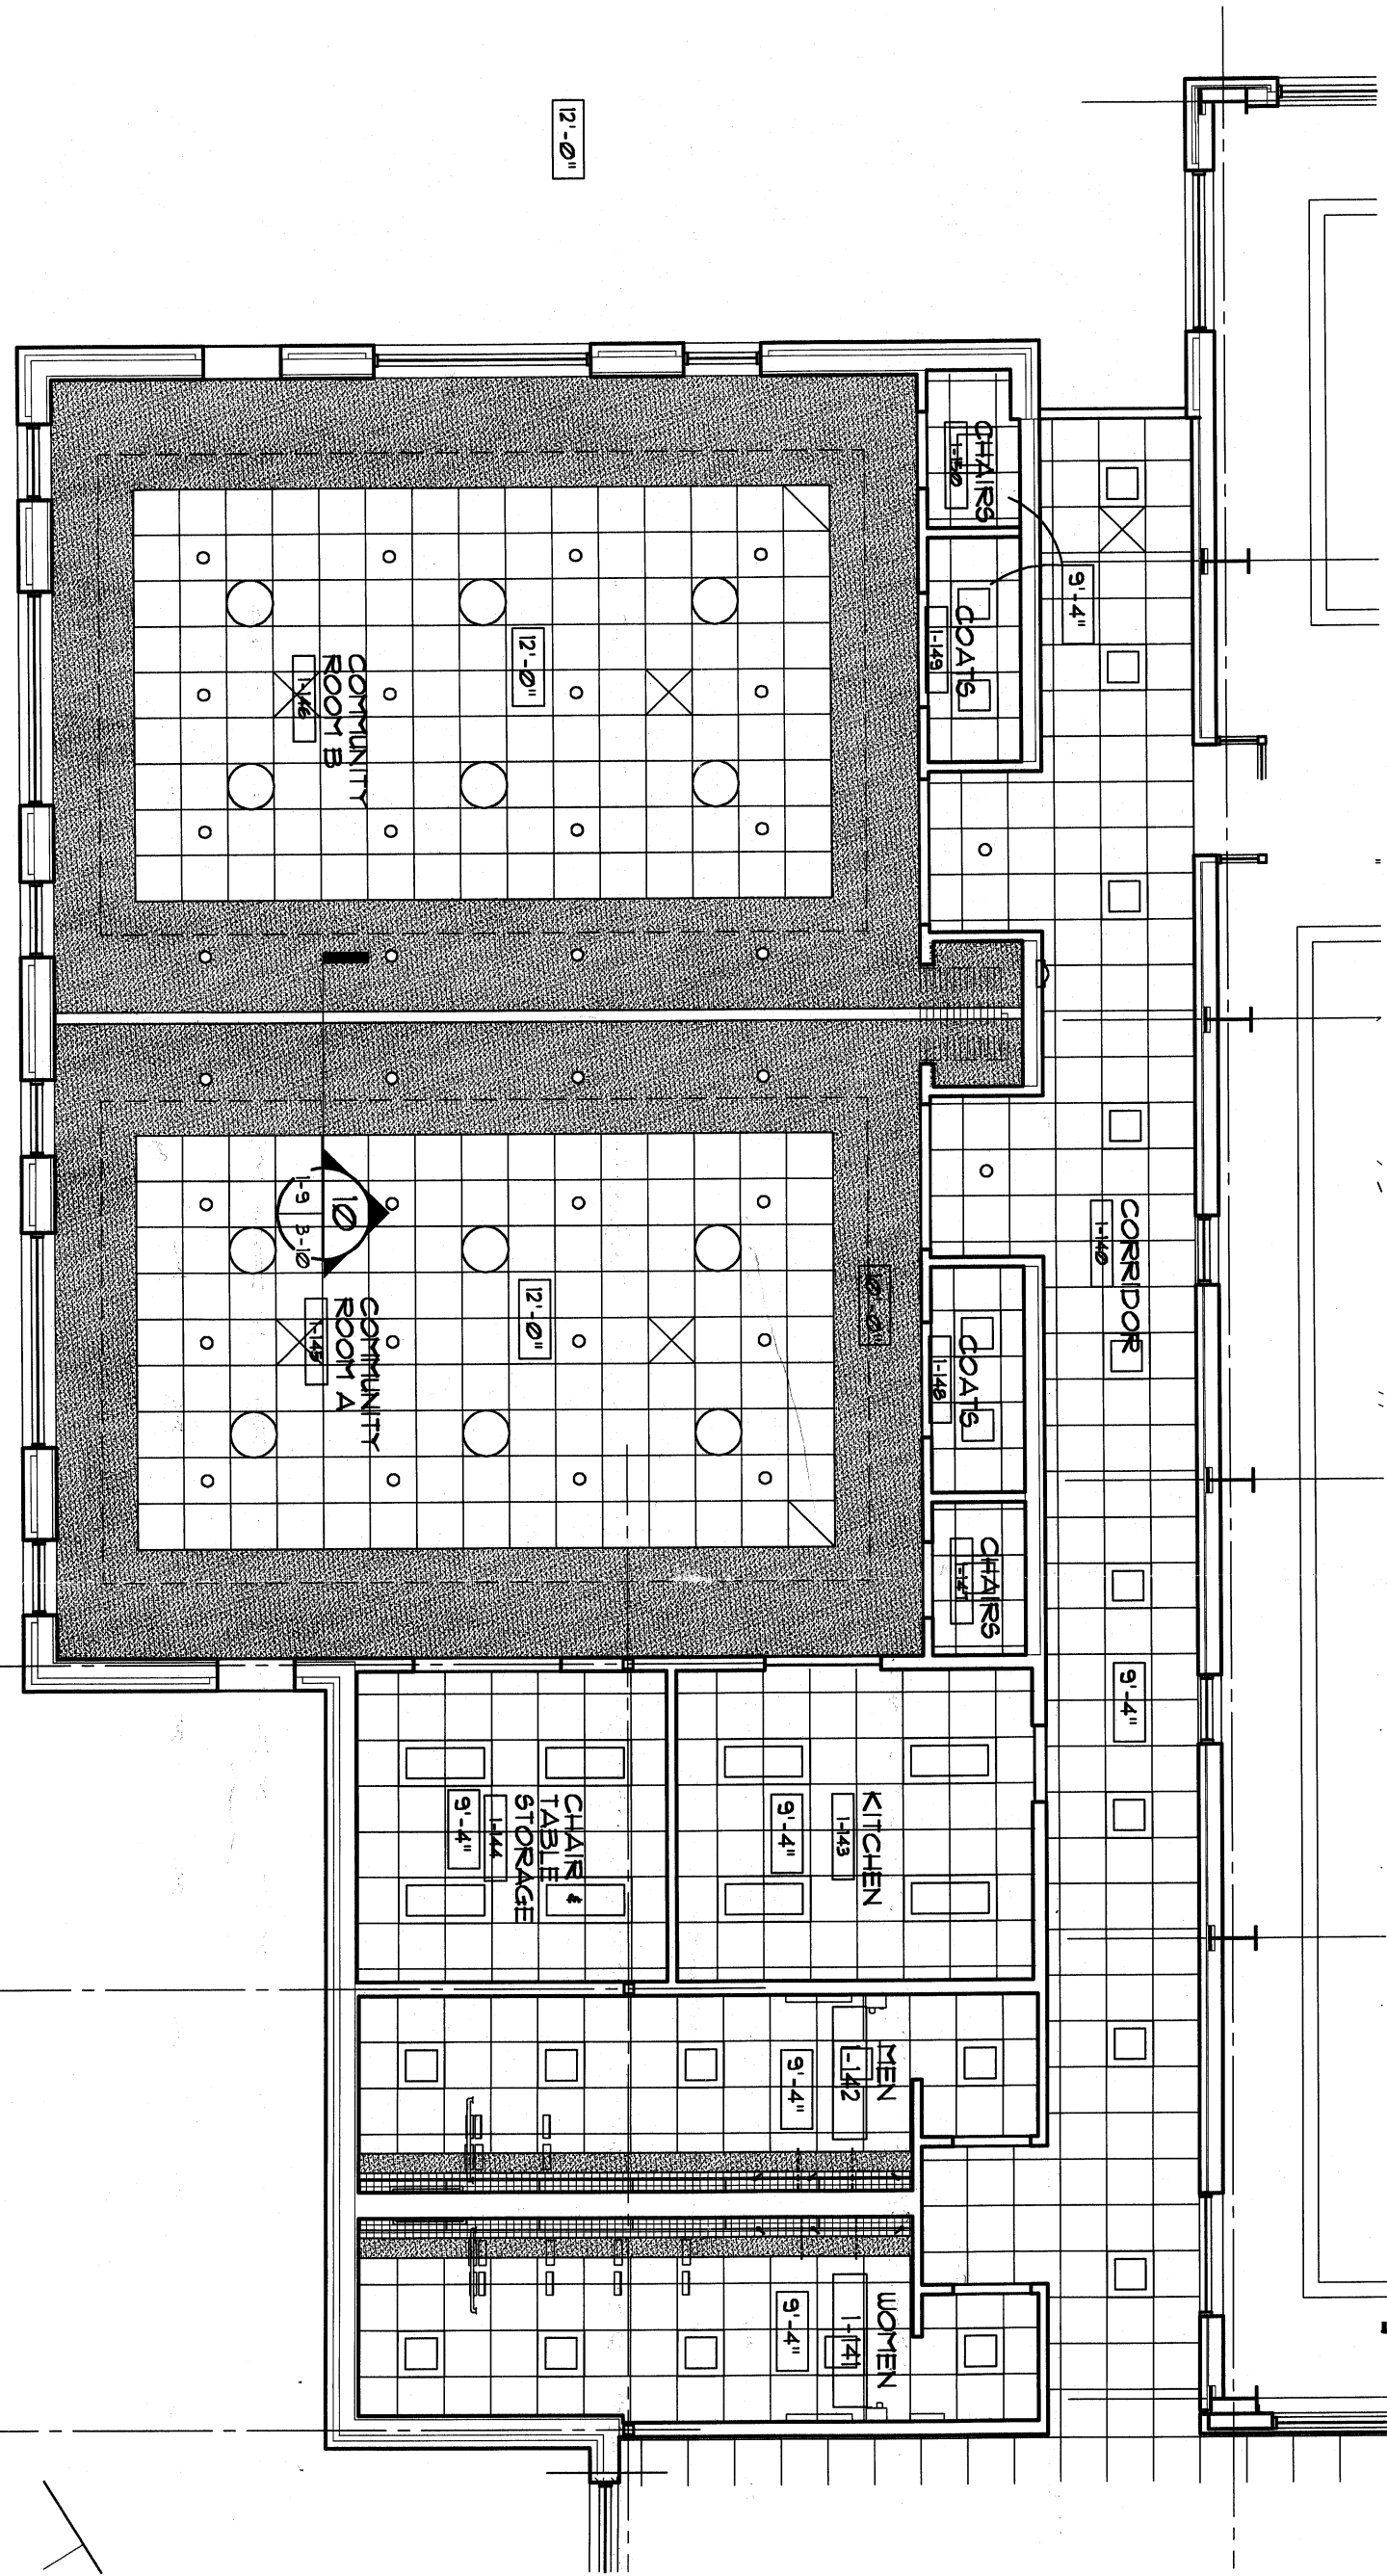

ALTERNATE FLOOR PLAN


1/8" = 1'-0"




1
-9|-5

D-3

E-1

F-1

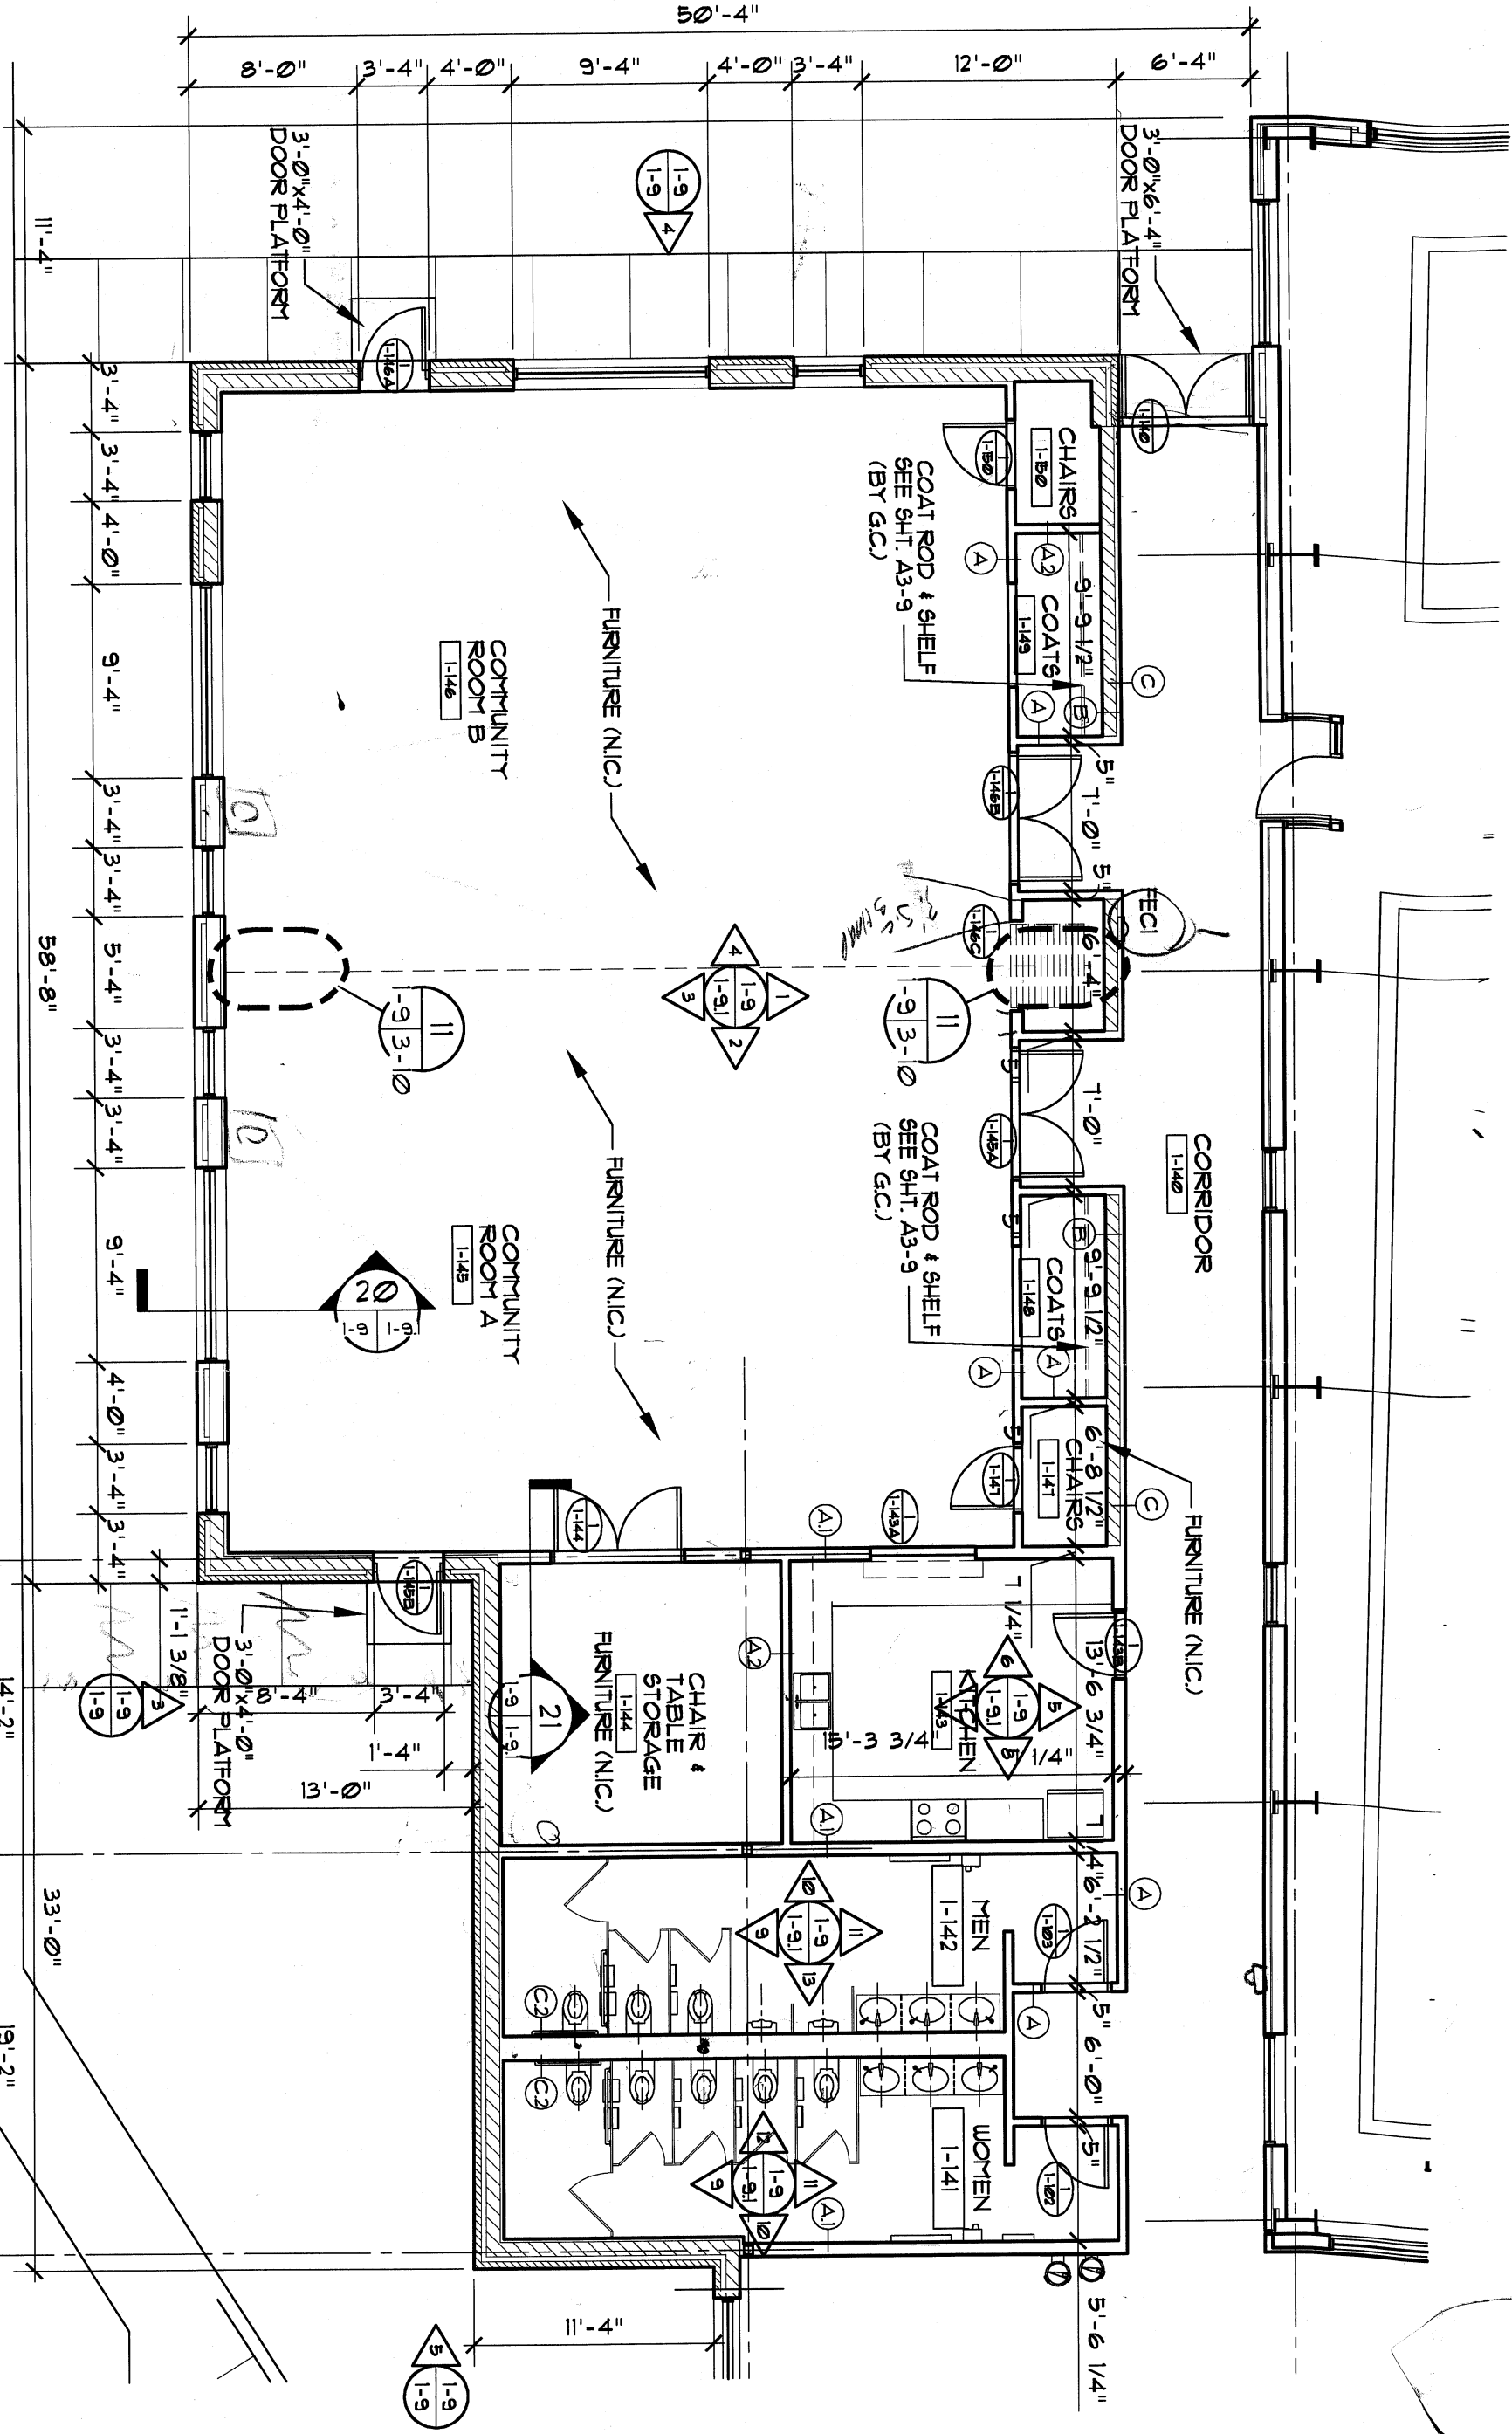

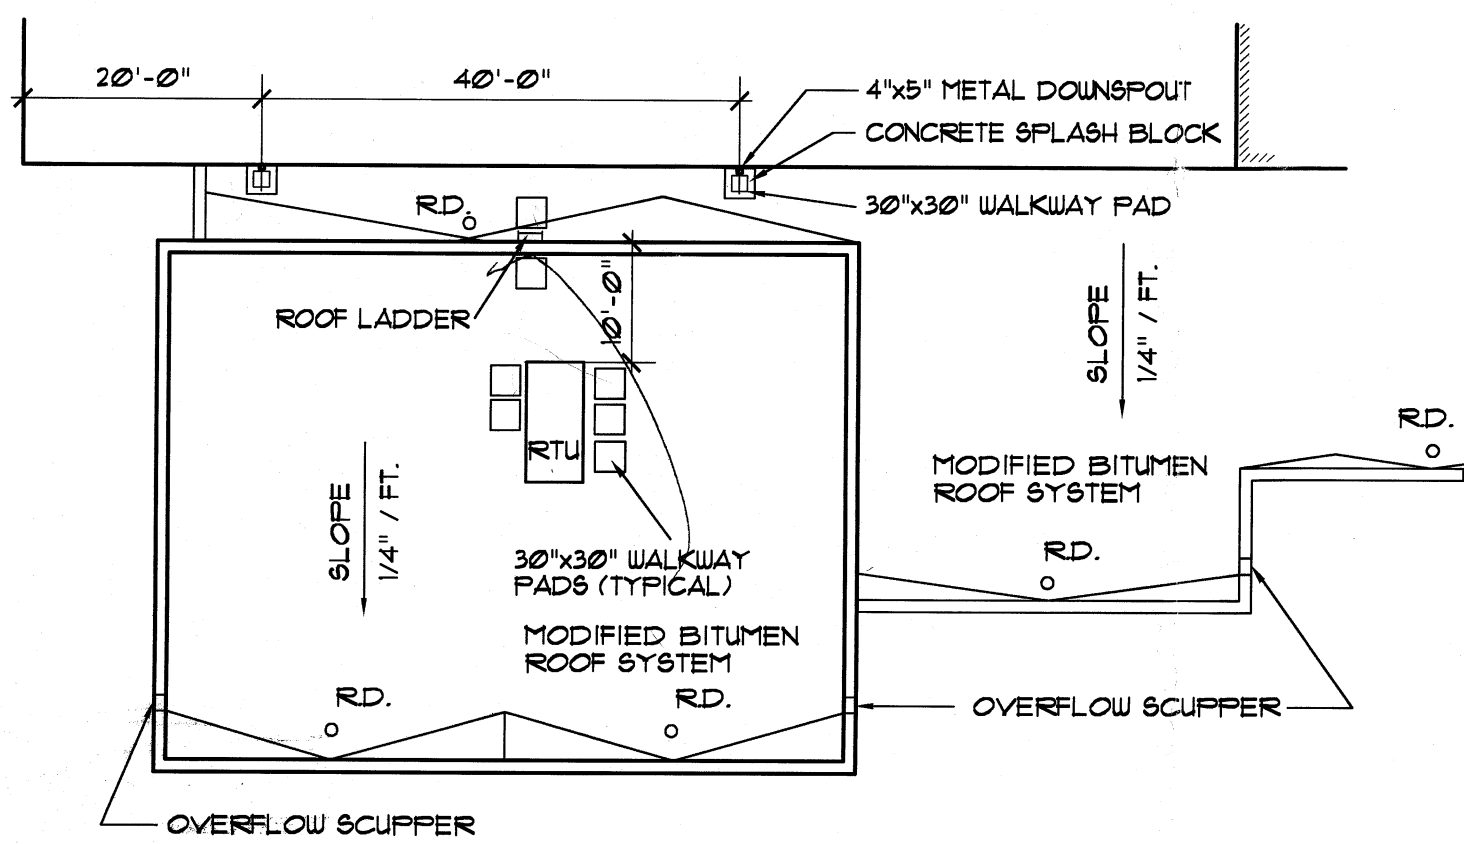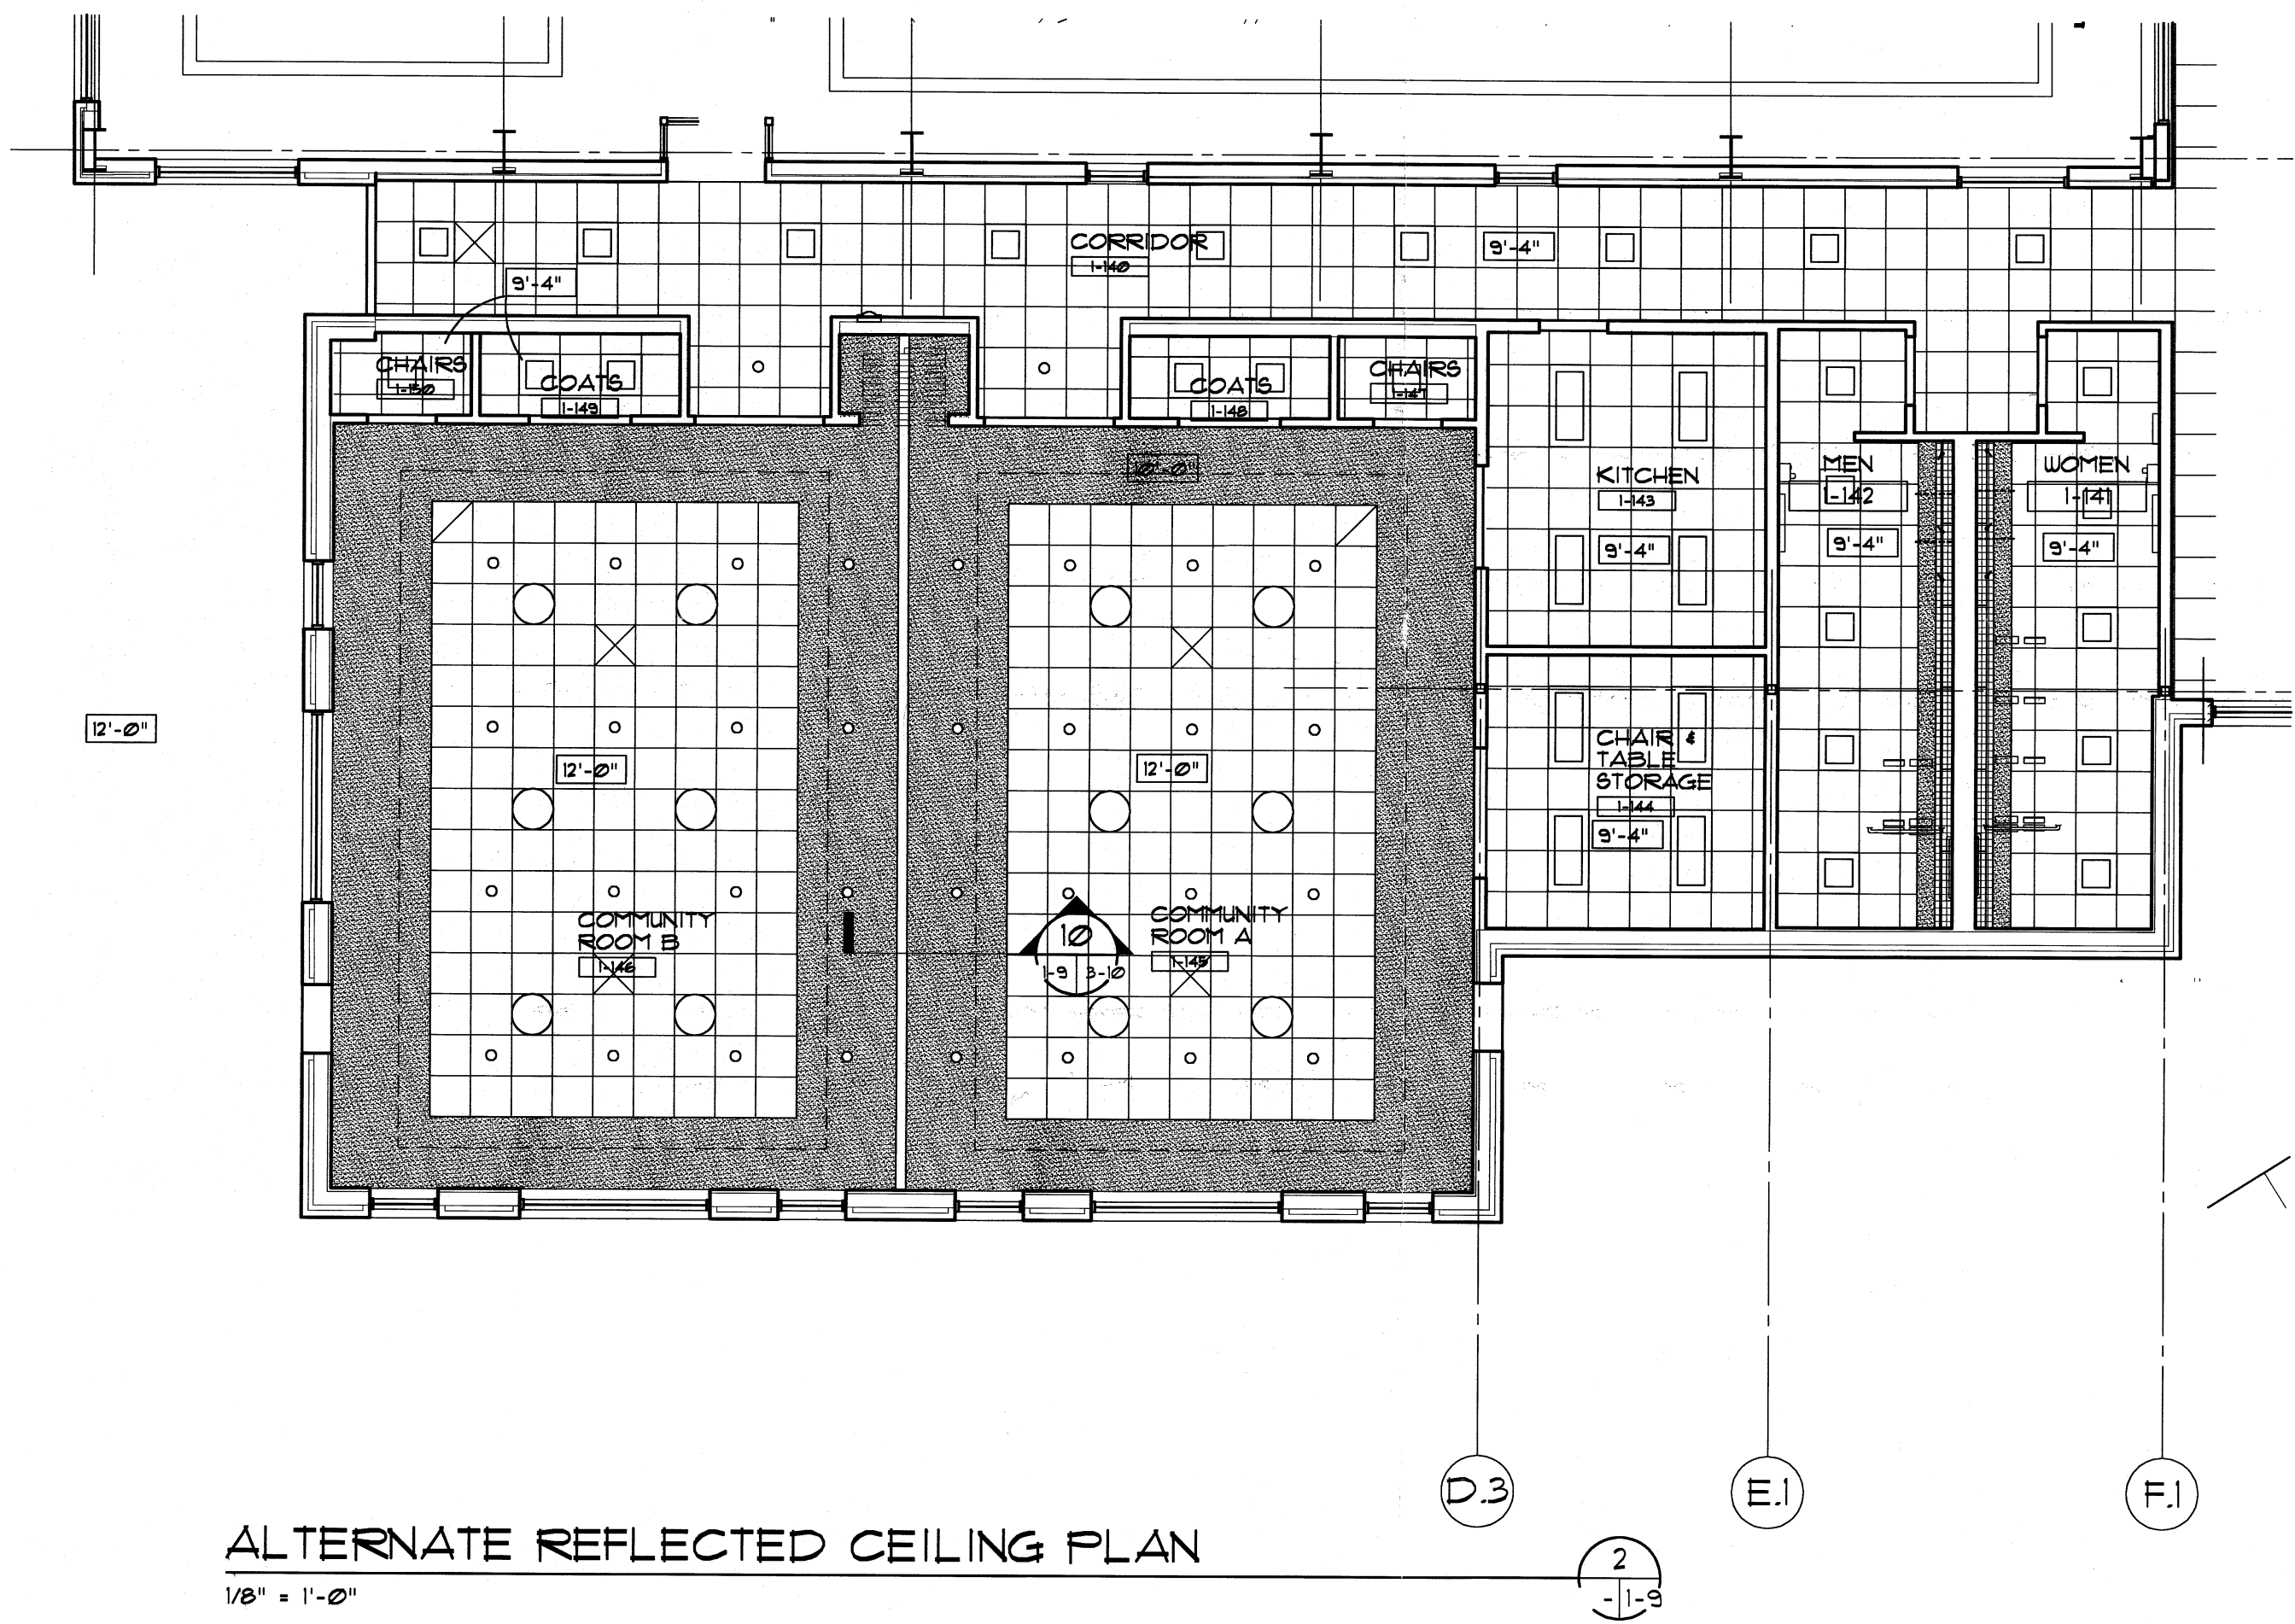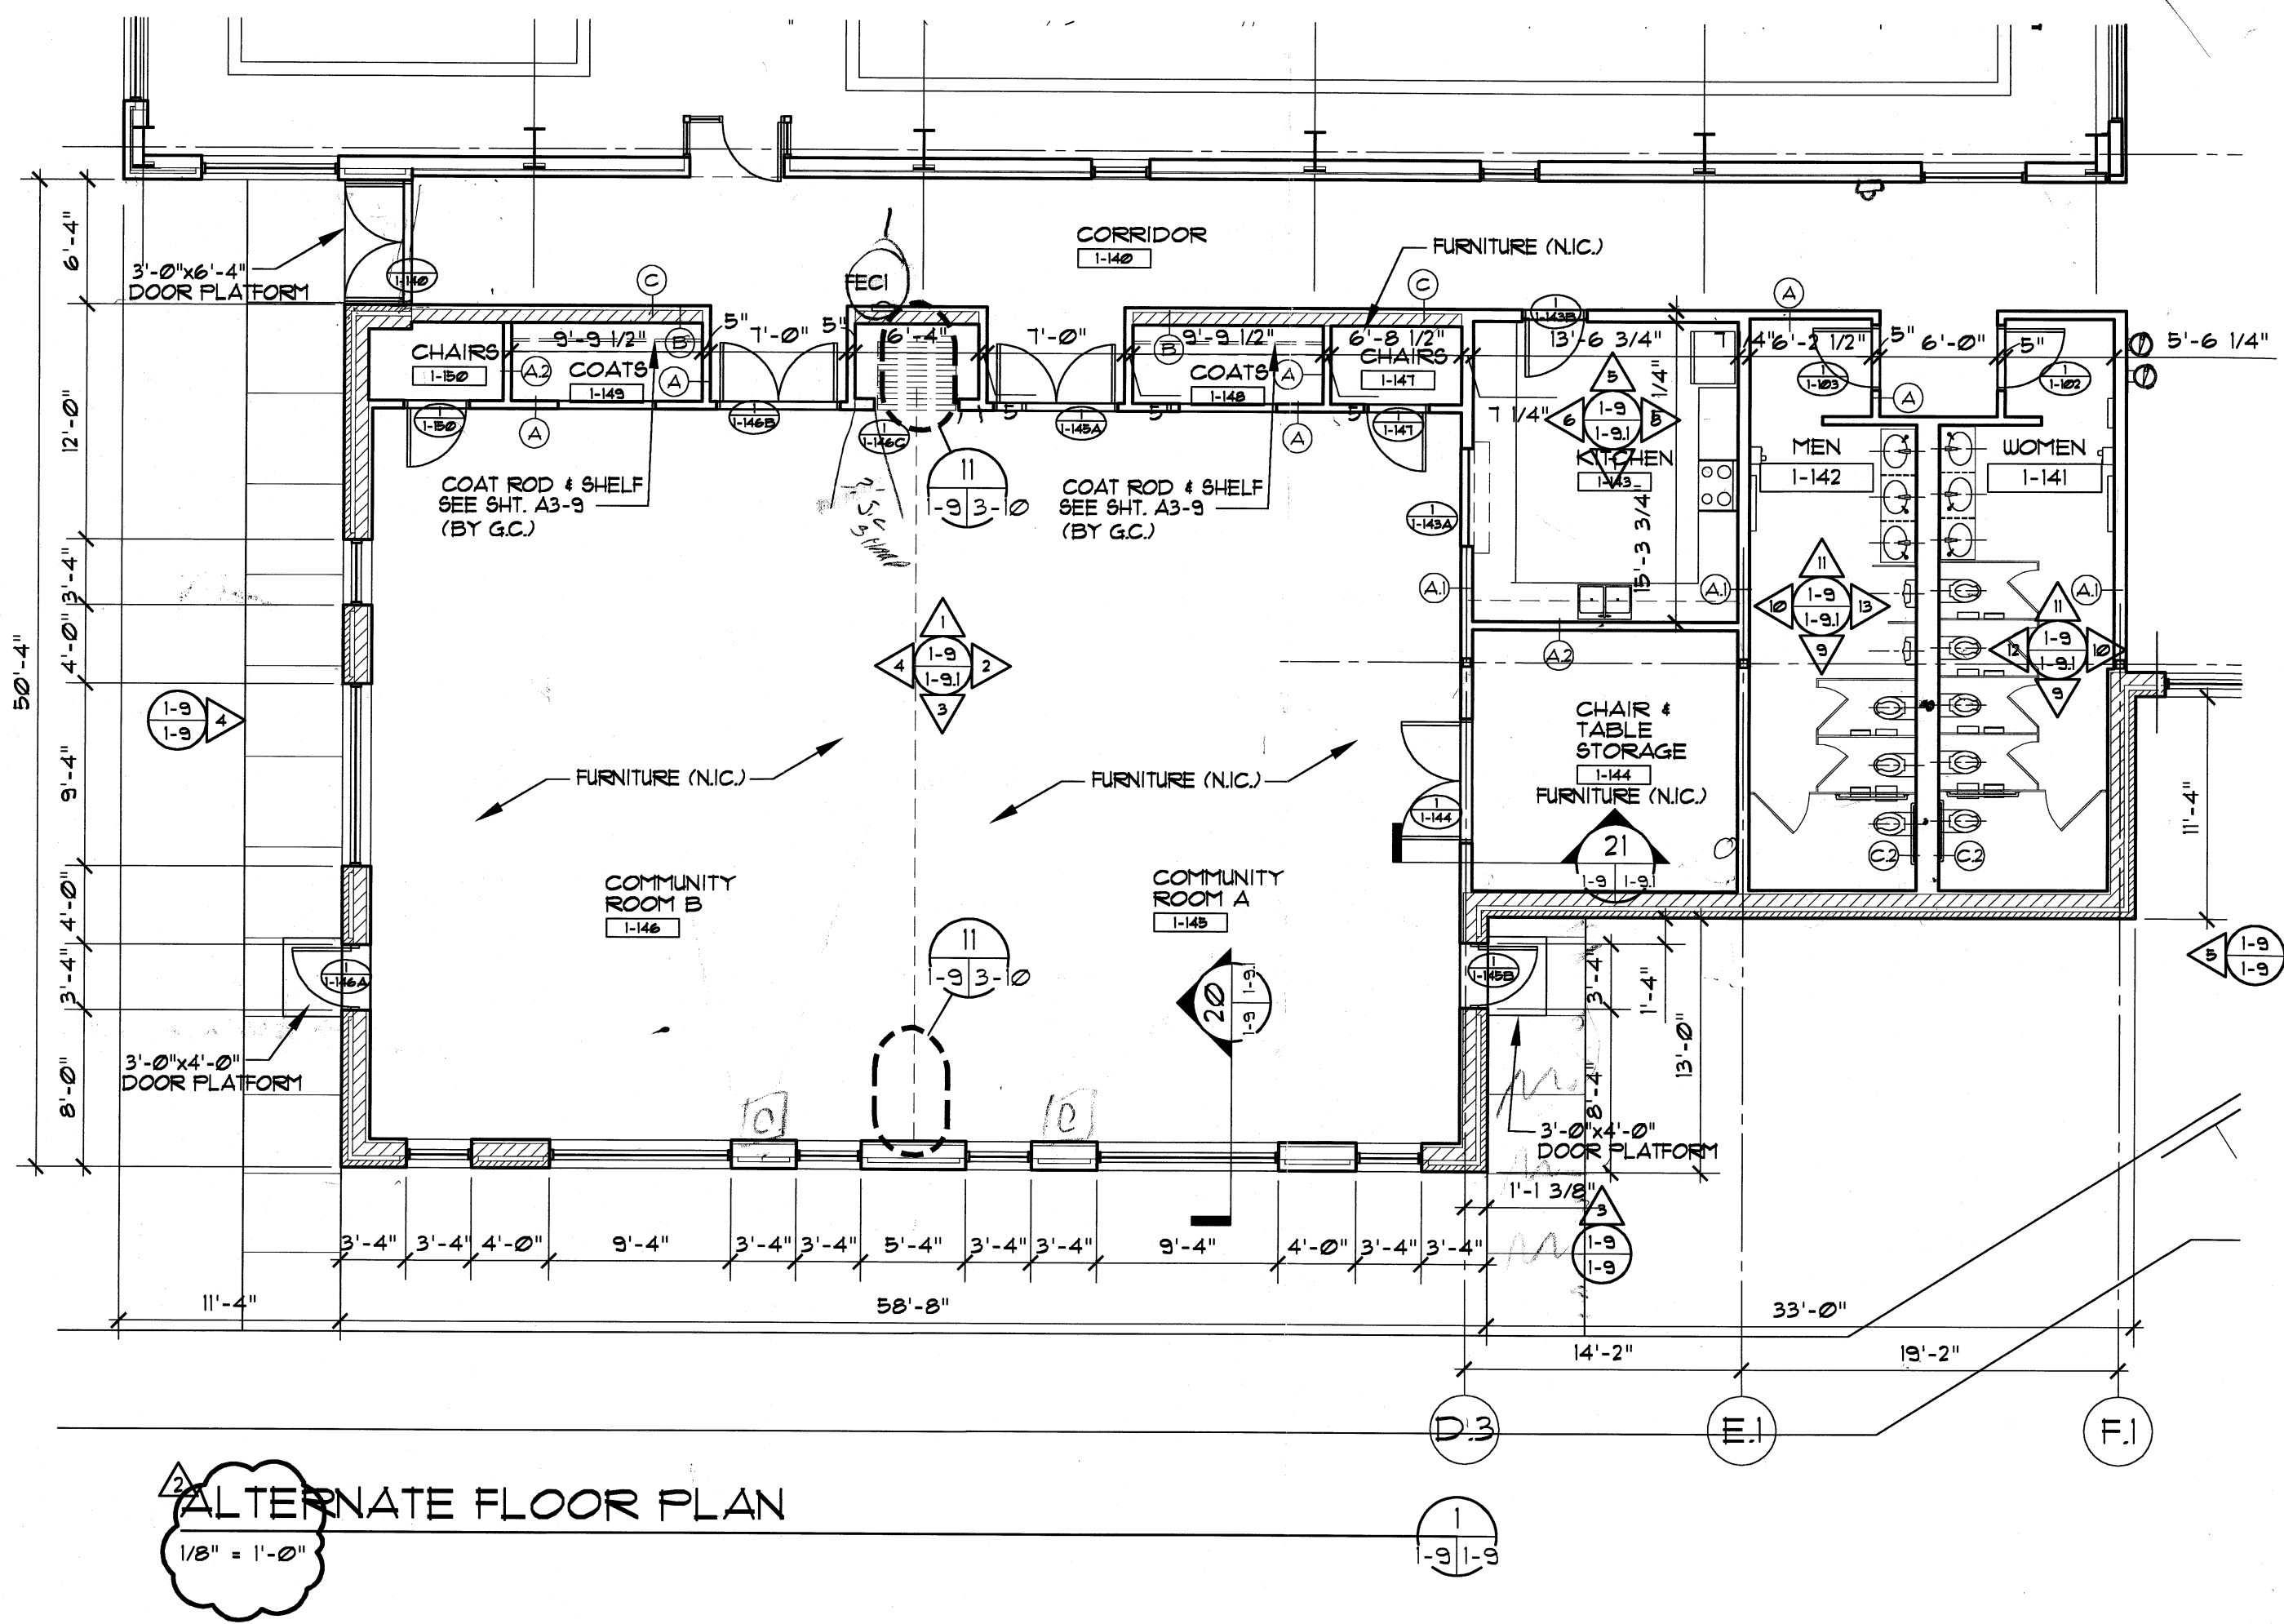


Alternate #3 Plan- Community /
Multi-Purpose Room

CD
A1-9


ELECTRICAL SITE PLAN

E3-1

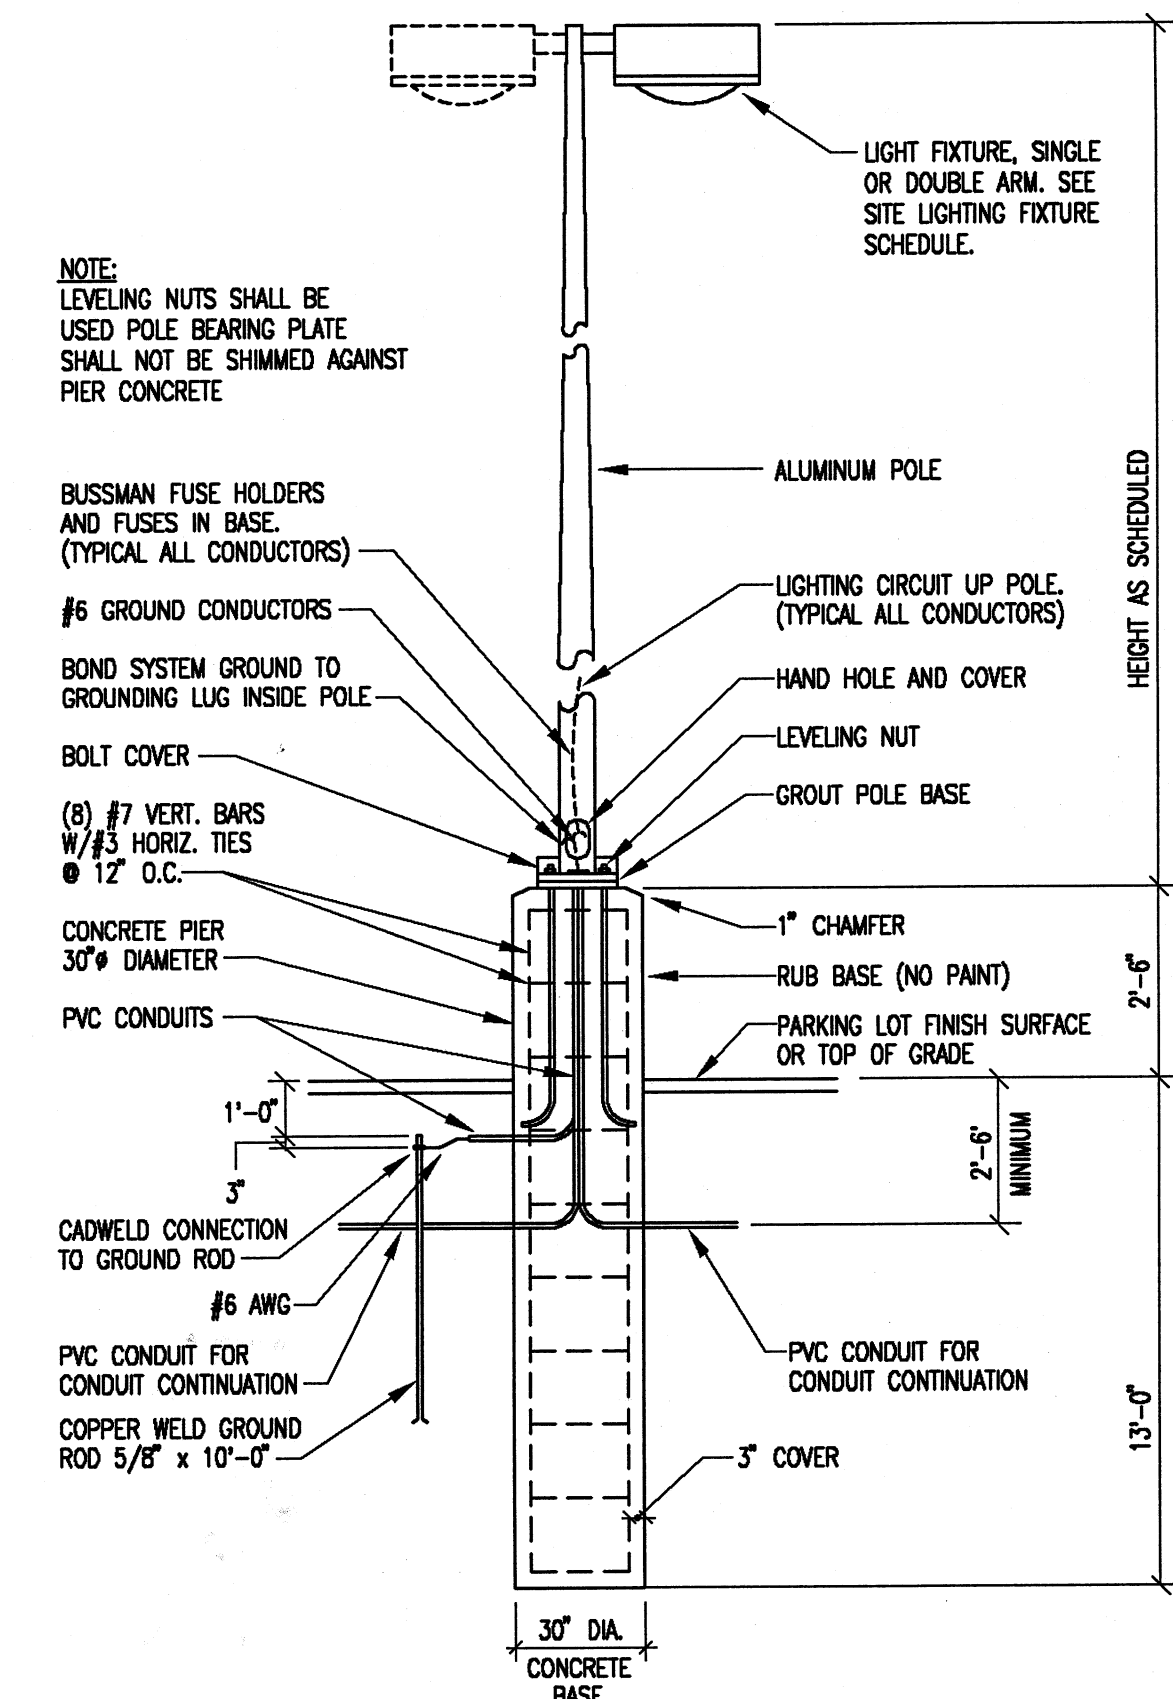

NOTES:

- NOTES:
1. 3500 P.S.I. MIN. 28 DAY COMPRESSIVE STRENGTH CONCRETE WITH GRADE 60 REINFORCING STEEL.
 2. IF WATER IS PRESENT IN HOLE, REMOVE BEFORE POURING CONCRETE.
 3. FOUNDATION EXCAVATION SHALL BE BY 18" AUGER IN UNDISTURBED OR PROPERLY COMPACTED FILL PER SPECIFICATIONS.
 4. FOUNDATION SHALL HAVE A MINIMUM ALLOWABLE END BEARING OF 2000 P.S.F., INCREASE BASE DEPTH AS REQUIRED.
 5. THIS POLE BASE DETAIL MUST BE REVIEWED AND APPROVED BY THE STRUCTURAL ENGINEER PRIOR TO INSTALLATION.

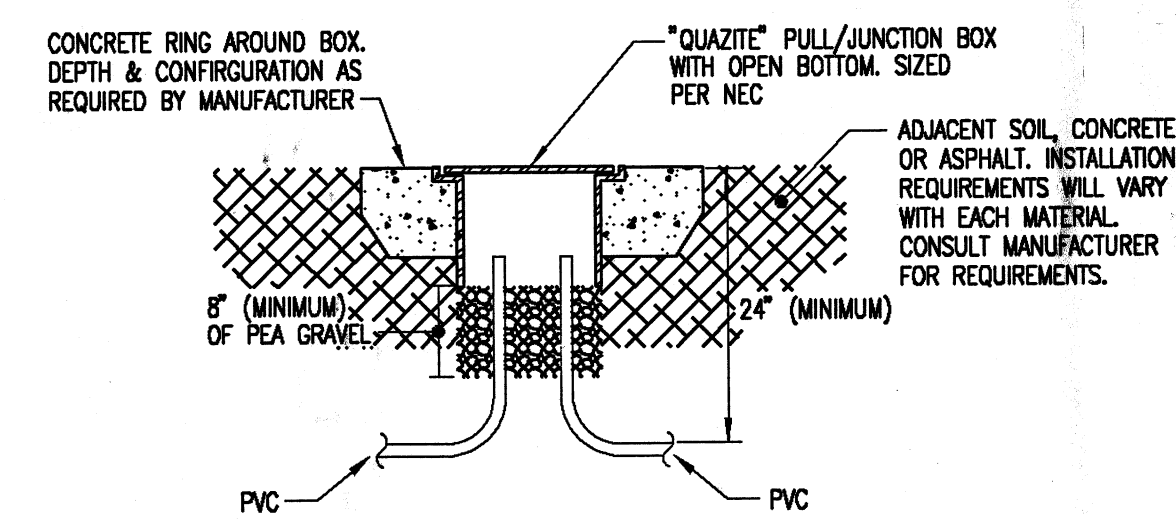

NOT TO SCALE

- NOTES:**
1. SPLICES SHALL BE AVOIDED WHERE POSSIBLE. WHERE REQUIRED, SPLICES SHALL BE MADE WITH WATERPROOF CONNECTORS.
 2. CONCRETE ENCASEMENT TO BE 3,000 PSI MINIMUM.
 3. DO NOT LOCATE BOXES IN HIGH VOLUME TRAFFIC APPLICATIONS.
 4. COMPACT SOIL AROUND BOX TO MANUFACTURER'S RECOMMENDATIONS.
 5. THIS DETAIL IS INTENDED TO SHOW GENERAL DESIGN INTENT ONLY. THE ELECTRICAL CONTRACTOR MUST VERIFY ALL INSTALLATION REQUIREMENTS WITH THE MANUFACTURER PRIOR TO THE BIDDING AND INSTALL ALL BOXES ACCORDINGLY.

THE E.C. SHALL PROVIDE AN ADD ALTERNATE PRICE FOR A LIGHTNING PROTECTION SYSTEM PER THE PERFORMANCE SPECIFICATION INCLUDED IN THE CONTRACT DOCUMENTS (ELECTRICAL SPECIFICATION SECTION 16070). THE SYSTEM SHALL COVER THE ROOF AREA OF THE MAIN BUILDING AND IMPO. THE EXIST. LIGHT. ALTERNATE #3 IS ACCEPTED. THE LIGHTNING PROTECTION SYSTEM SHALL ALSO COVER THE ROOF AREA OF ALTERNATE #3. OTHER AREAS OF FUTURE EXPANSION SHALL NOT BE INCLUDED.

NO SCALE

- NOTES**
- 3000 P.S.I. MIN. 28 DAY COMPRESSIVE STRENGTH CONCRETE WITH GRADE 60 REINFORCING STEEL
 - IF WATER IS PRESENT IN HOLE, REMOVE BEFORE POURING CONCRETE.
 - FOUNDATION EXCAVATION SHALL BE BY 30" AUGER IN UNDISTURBED OR PROPERLY COMPACTED FILL PER SPECIFICATIONS.
 - FOUNDATION SHALL HAVE A MINIMUM ALLOWABLE CTD BEARING 3000 P.S.I. MINIMUM, NAE DPM-1 AS REQUIRED.

<i>City of Massillon</i> <i>Massillon Recreation Center</i>	Proposal Request No. <i>Addendum #1</i>
<i>Construction (05000.00)</i>	Date <i>3/14/01</i>
<i>Item 10th Pace Westlake</i>	Ref. Drawing No. <i>E-3-1</i>
<i>The Huntington Building</i> <i>822 North Avenue Suite 1000</i> <i>Cleveland, OH 44115-1007</i>	Sketch No. <i>606-C-19</i>

THE E.C. SHALL PROVIDE AN ADD ALTERNATE PRICE FOR THE THREE ADDITIONAL LIGHTS AT THE LOWER PARKING AREA AND ALL RELATED GROUNDING, POWER WIRING, POLE BASES, ETC. AS REQUIRED FOR A COMPLETE INSTALLATION.

THE E.C. SHALL PROVIDE AN ADD ALTERNATE PRICE FOR THE THREE ADDITIONAL LIGHTS AT THE LOWER PARKING AREA AND ALL RELATED GROUNDING, POWER WIRING, POLE BASES, ETC. AS REQUIRED FOR A COMPLETE INSTALLATION.

THE E.C. SHALL PROVIDE AN ADD ALTERNATE PRICE FOR A LIGHTNING PROTECTION SYSTEM PER THE PERFORMANCE SPECIFICATION INCLUDED IN THE CONTRACT DOCUMENTS (ELECTRICAL SPECIFICATION SECTION 16670). THE SYSTEM SHALL COVER THE ROOF AREA OF THE MAIN BUILDING, CANOPY, AND ROOF AREA OF ALTERNATE #3 IF ACCEPTED. AREAS OF FUTURE EXPANSION SHALL NOT BE INCLUDED.

THE E.C. SHALL PROVIDE AN ADD ALTERNATE PRICE FOR A LIGHTNING PROTECTION SYSTEM PER THE PERFORMANCE SPECIFICATION INCLUDED IN THE CONTRACT DOCUMENTS (ELECTRICAL SPECIFICATION SECTION 16670). THE SYSTEM SHALL COVER THE ROOF AREA OF THE MAIN BUILDING, CANOPY, AND ROOF AREA OF ALTERNATE #3 IF ACCEPTED. AREAS OF FUTURE EXPANSION SHALL NOT BE INCLUDED.


THORSON BAKER & Associates, Inc.
Consulting Engineers

3030 West Streetboro Road
Birmingham, Ohio 44208

(330) 658-6688 Ph.
(330) 658-0875 Fax

<u>POWER COMPANY REPRESENTATIVE:</u>	<u>TELEPHONE COMPANY REPRESENTATIVE:</u>
OHIO EDISON	AMERITECH
MS. NORA SWANSON	MR. MARK MACISAAC
1910 WEST MARKET STREET	50 WEST BOWERY STREET, 6TH FL ENGINEERING
AKRON, OHIO 44313	AKRON, OHIO 44308
TEL: (330) 384-5090	TEL: (330) 384-4495
FAX: (330) 384-7912	FAX: (330) 384-9866

Drawn by: