


MAIN SWITCH			
1 TUNNEL LIGHTS	20A	2 STAIR LIGHTS	20A
3 TUNNEL LIGHTS	20A	4 4TH FLOOR OUTLETS	20A
5 4TH FLOOR LIGHTS	20A	6 1ST STAGE PUMP ROOM OUTLETS-HTR. UH-3	20A
7 ENTRANCE LIGHTS	20A	8 1ST STAGE PUMP ROOM LIGHTS-POLE LIGHT	20A
9 PIT LIGHTS	20A	10 OUTLETS & STAIRWELL LIGHTS-1ST FLOOR-SAMPLER	20A
11 LIGHTS-3RD FLOOR	20A	12 OUTLETS-3RD FLOOR	20A
13 40 FOOT POLE LIGHTS	20A	14 SPARE	20A
15 40 FOOT POLE LIGHTS	20A	16 UNIT HEATERS UH-3, 1ST FLOOR	20A
17 LIGHTS-2ND FLOOR	20A	18 OUTLETS-2ND FLOOR	20A
19 UNIT HEATER UH-4, 4TH FLOOR	20A	20 2ND FLOOR-UNIT HEATER UH-5, OUTLETS	20A
21 TANK HEATER-3RD FLOOR	20A	22 TANK HEATER-3RD FLOOR	20A
23 SPARE	20A	24 BUBBLER PANEL	20A
25 SPARE	20A	26 SHACK LIGHTS	20A
27 SHACK WEST OUTLETS	20A	28 SPARE	20A
29 LTS/OUTLETS/HTR, UH-3-1ST. FLOOR (ELEV.)	20A	30 SPARE	20A


NOTE:
THERMAL IMAGING REPORT INDICATES
BAD CONNECTIONS (HOT SPOTS) ON BREAKERS
#7 & #11. CLEAN CONNECTIONS & WIRES AND RECONNECT.

SKETCH "A"

SECOND FLOOR PRIMARY GALLERY BUILDING
SOUTH WALL

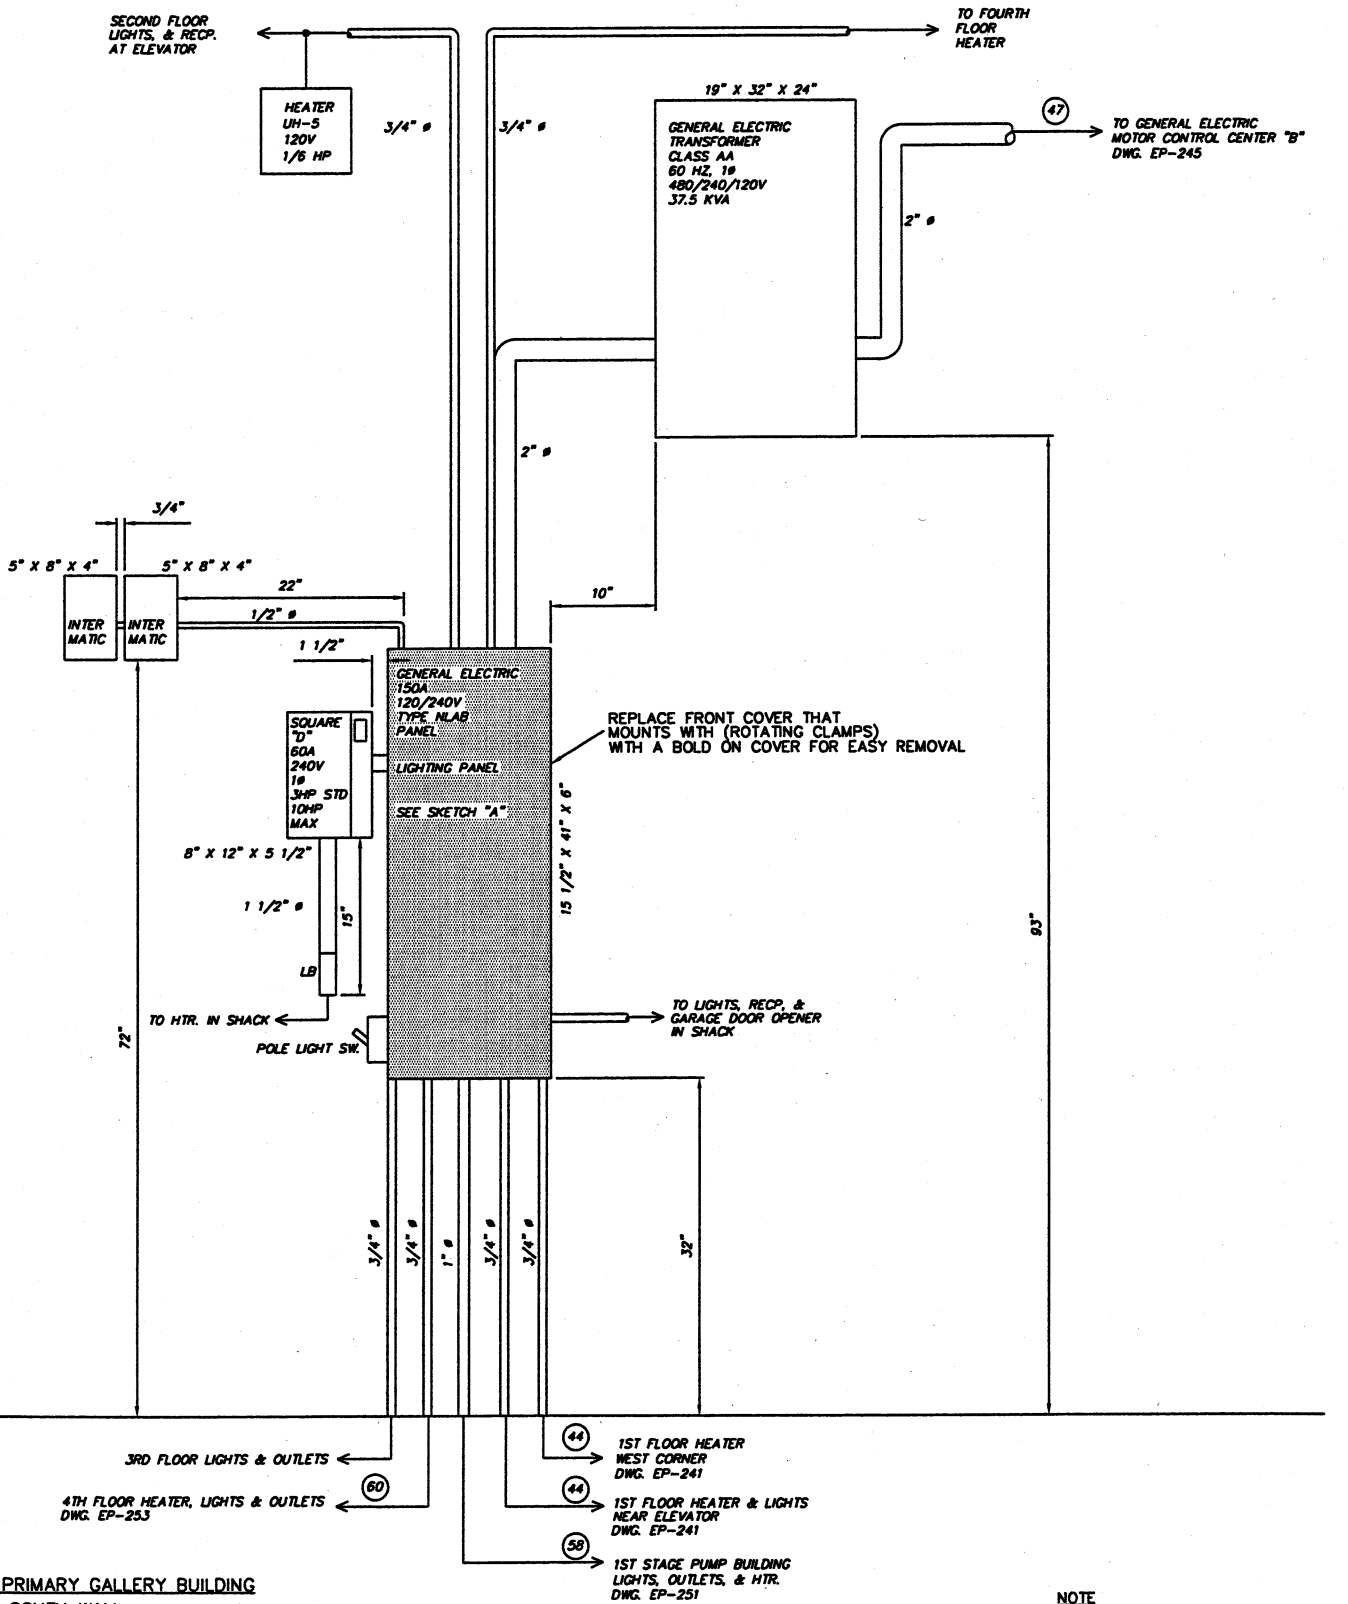

NOTE
1. ITEMS FOR DEMOLITION



REVISIONS		NO.	DESCRIPTIONS	DATE	BY	APP'D
DESIGNED BY	DRAWN BY					
STI/TSS	STI/ELC					
CHECKED BY	STI/TSS					
APPROVED BY	STI/R/L					

CTI ENVIRONMENTAL, INC.
ENGINEERS, WATER AND EARTH SCIENCES
UNIONTOWN, OHIO

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000

PRIMARY GALLERY CABINETS SECOND FLOOR DEMOLITION PLAN

JOB NO.
E9031
DATE
3/24/00
SCALE
1 1/2" = 12"
SHEET
EP246-D