


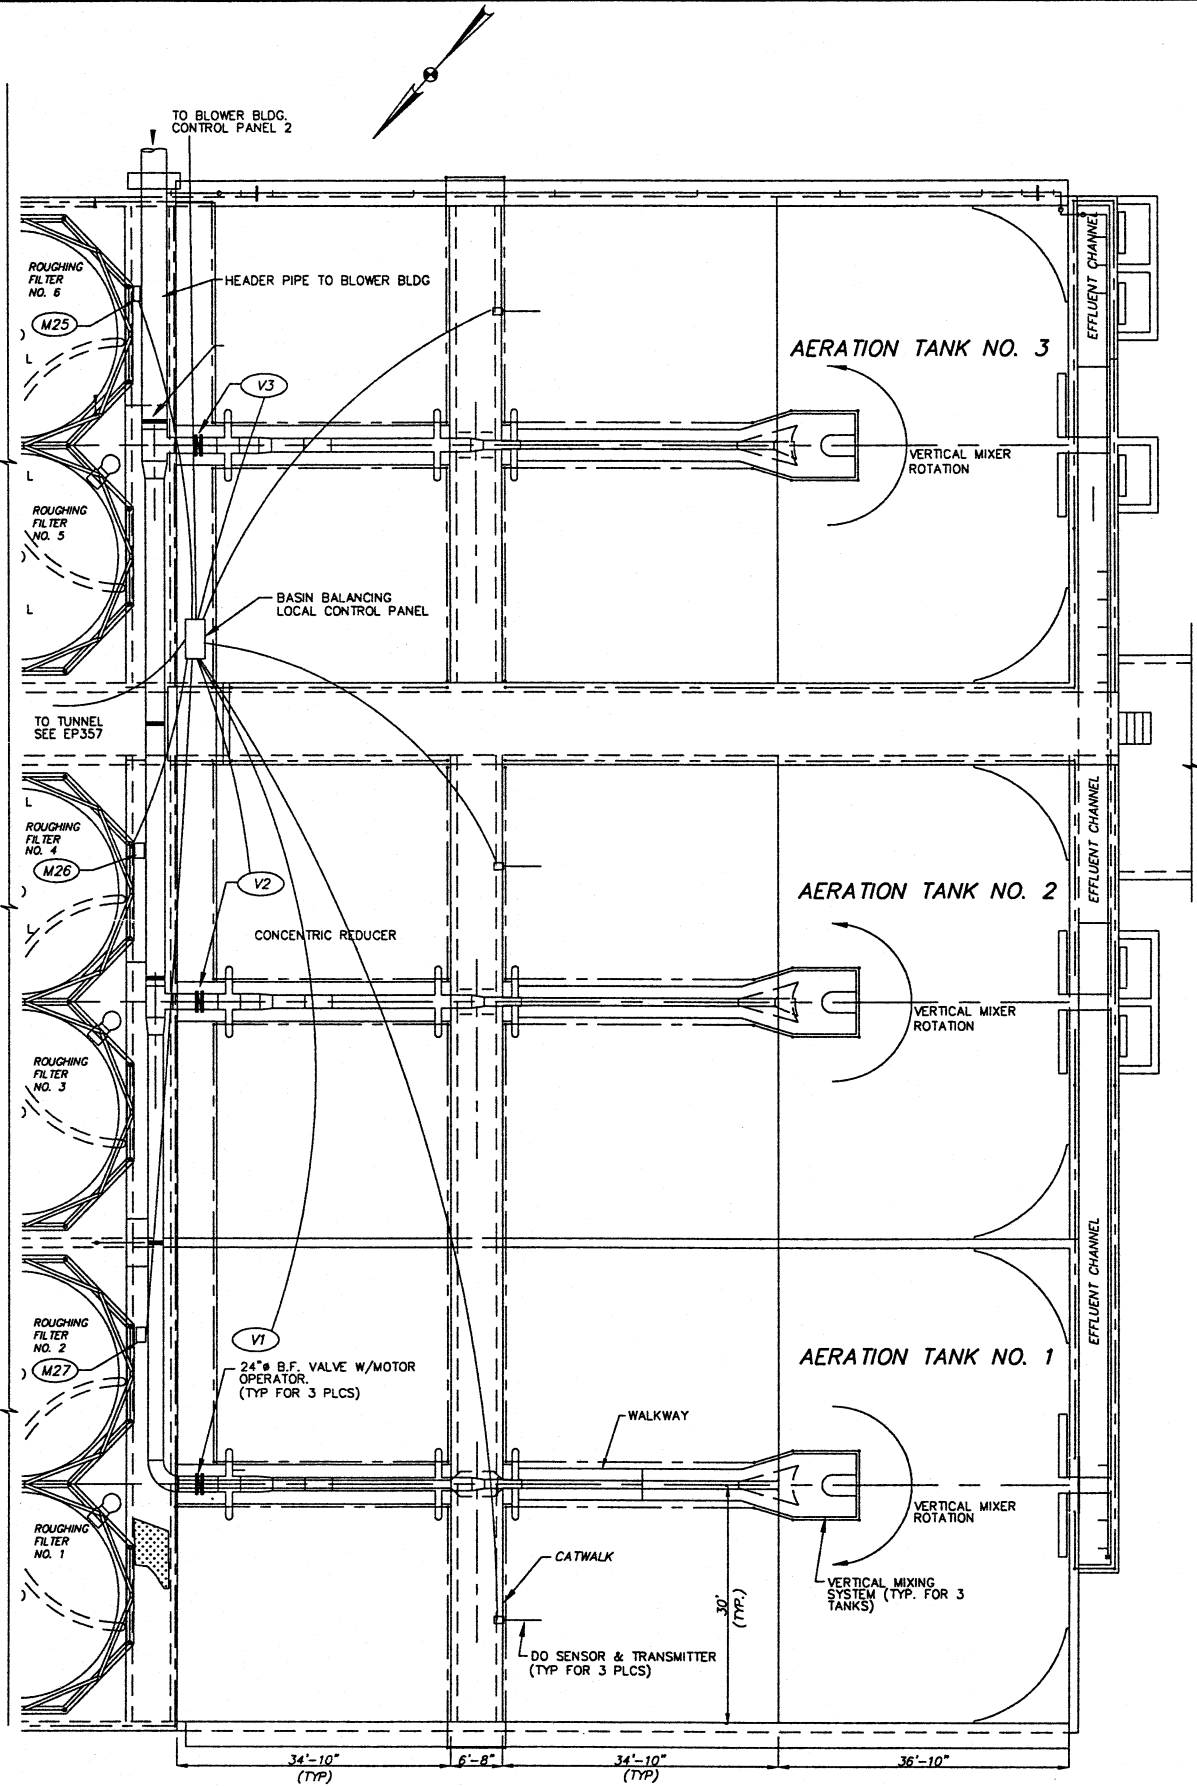

- NOTES:
1. ALL CONDUIT SHALL BE 3/4", UNLESS NOTED OTHERWISE
 2. ALL SIGNAL CABLE SHALL BE 2 CONDUCTOR, TWISTED, SHIELDED, 300V, 20 AWG MIN.
 3. USE 12" MIN. FLEX CONDUIT AT COMPONENT CONNECTIONS

PLAN
SCALE: 3/32"=1'-0"

CTI ENVIRONMENTAL, INC.
ENGINEERS IN WATER AND EARTH SCIENCES
UNIONTOWN, OHIO

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
AERATION TANK - CONDUIT PLAN VIEW

SEI/ETI TECHNOLOGIES, INC.
MASSILLON, OHIO
DATE: 5/6/74
BY: R.J.L.

DESIGNED BY		REVISIONS		DATE		BY	
R.J.L.		NO.	DESCRIPTIONS				APPD
R.J.L.							
R.J.L.							
R.J.L.							
R.J.L.							
R.J.L.							
R.J.L.							
R.J.L.							
R.J.L.							

JOB NO.
E9031
DATE
09/19/01
SCALE
AS NOTED
SHEET
EP256