


THICKENER #1 O.L.	THICKENER #2 O.L.	SLUDGE HOLDING TK. #1 L.W.L.	SLUDGE HOLDING TK. #1 H.W.L.	SLUDGE HOLDING TK. #2 L.W.L.	SLUDGE HOLDING TK. #2 H.W.L.
1	2	3	4	5	6
THICKENER #1 OVER TORQUE	THICKENER #2 OVER TORQUE	STRAINER PUMP #1 FAILURE	STRAINER PUMP #2 FAILURE	BOOSTER PUMP #1 FAILURE	BOOSTER PUMP #2 FAILURE
7	8	9	10	11	12
HEAT CONDITIONING ALARM	OXIDIZED SLUDGE TANK O.L.	DRAINAGE PUMP CHAMBER	BLANK	PRIMARY BLDG GENERAL ALARM	P.B. ACK
13	14	15	16	SECONDARY BLDG GENERAL ALARM 17	P.B. TEST
					18

ALARM PANEL



ALARM PANEL
LOCATED IN CENTER ROOM
SOLIDS HANDLING BLDG.

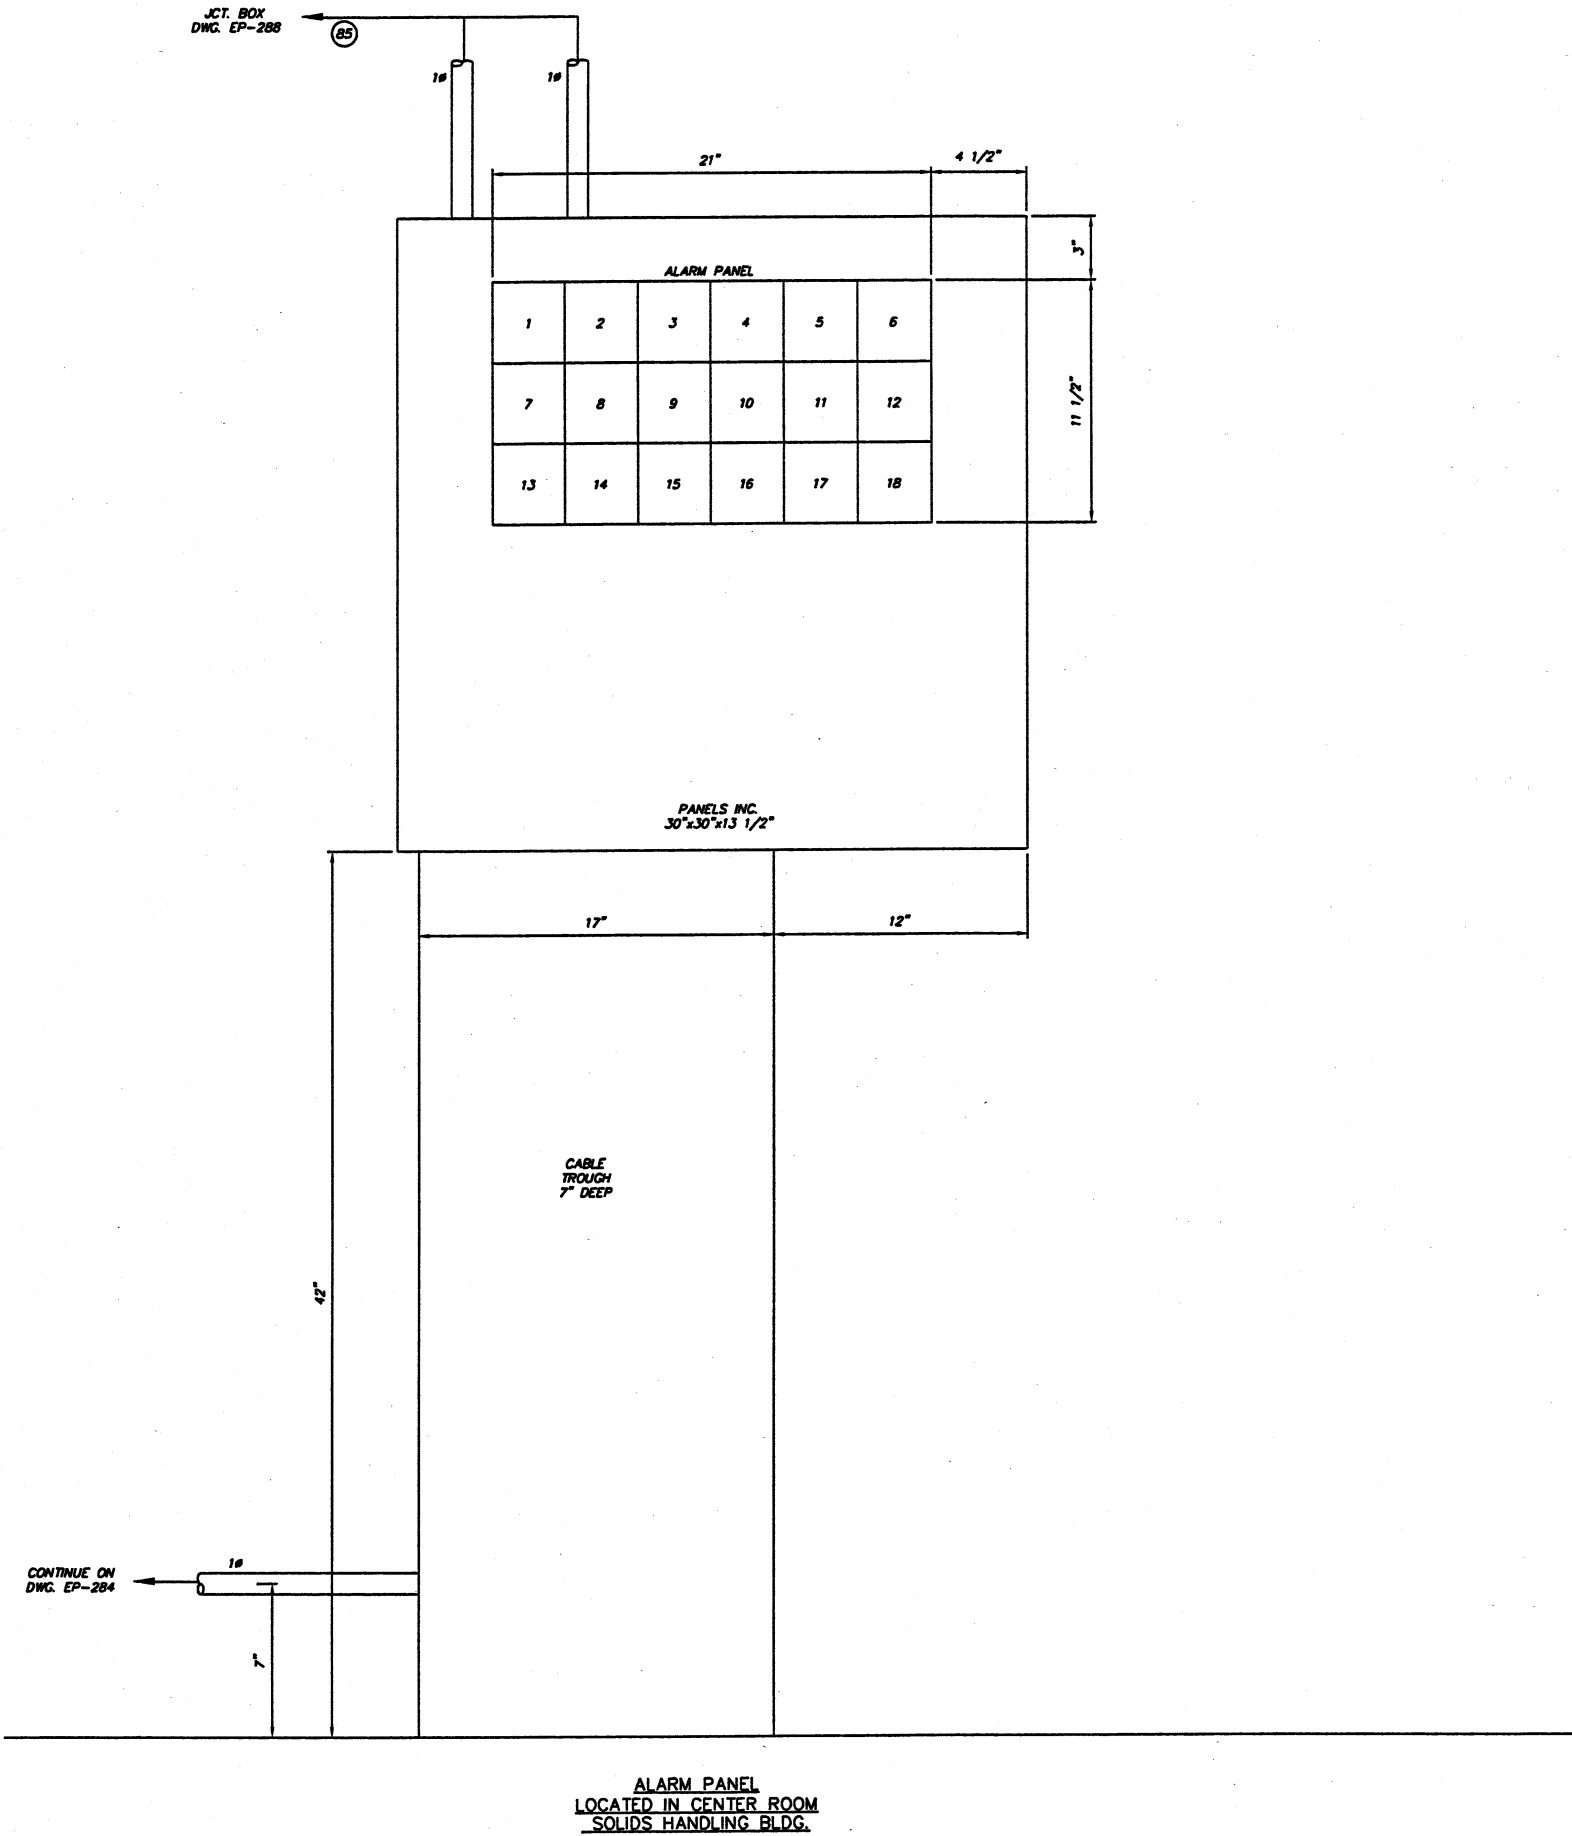

ENVIRONMENTAL, INC.
ENGINEERS IN WATER AND EARTH SCIENCES
UNIONTOWN, OHIO

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
TRANSFORMER "D1" ALARM PANEL LAYOUT
SOLIDS HANDLING BLDG.

DESIGNED BY
STI/TSS
DRAWN BY
STI/RRR
CHECKED BY
STI/TSS
APPROVED BY
STI/RJL

REVISIONS
NO. DESCRIPTIONS DATE BY APPD

SECRET TECHNOLOGIES, INC.
MASSILLON, OHIO
5674

JOB NO.
E9031
DATE
2/16/01
SCALE
3"=1"
SHEET
EP283

9031SPLE283.DWG