


W:\ACAD14\CTI Env\5674\Completed Dwg\200-299\9031SPLE286D.dwg Thu Aug 09 16:35:01 2001

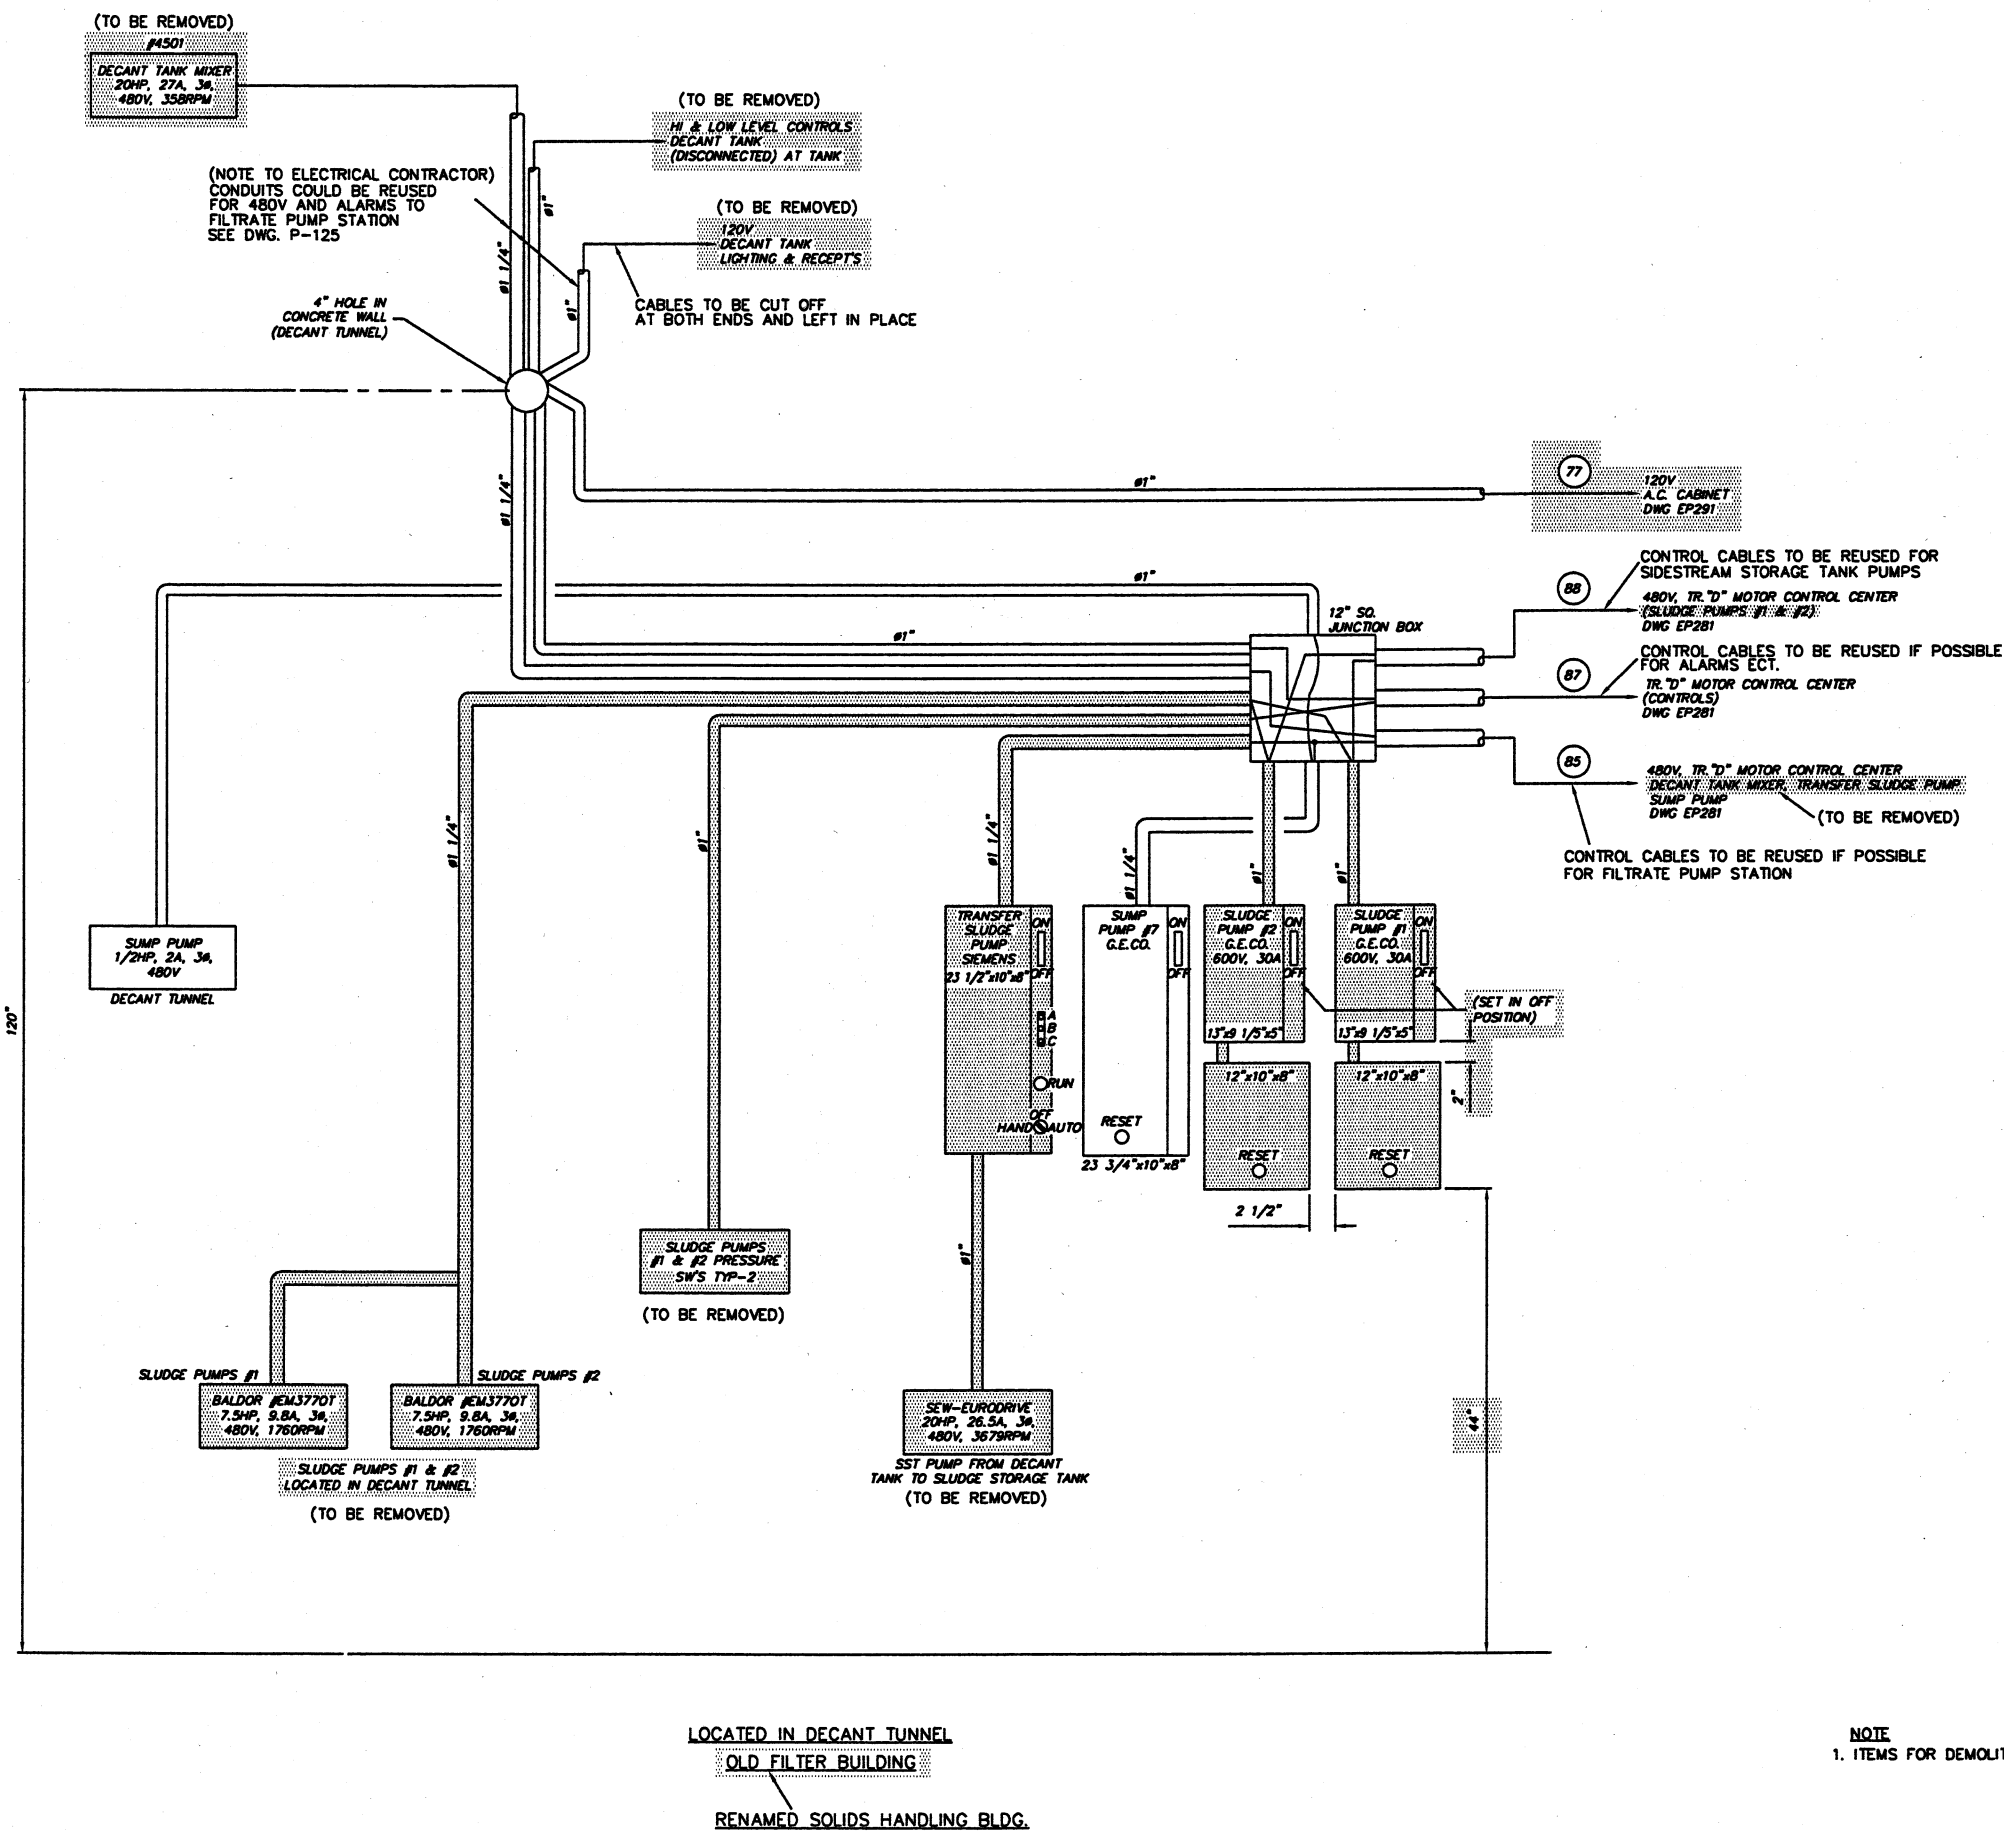

(TO BE REMOVED)
#450
DECANT TANK MIXER
20HP, 27A, 3ø
480V, 3580RPM

(TO BE REMOVED)
HI & LOW LEVEL CONTROLS
DECANT TANK
(DISCONNECTED) AT TANK

(TO BE REMOVED)
120V
DECANT TANK
LIGHTING & RECEP'TS

(NOTE TO ELECTRICAL CONTRACTOR)
CONDUITS COULD BE REUSED
FOR 480V AND ALARMS TO
FILTRATE PUMP STATION
SEE DWG. P-125

4\"/>

CABLES TO BE CUT OFF
AT BOTH ENDS AND LEFT IN PLACE

77
120V
A.C. CABINET
DWG EP281

88
CONTROL CABLES TO BE REUSED FOR
SIDESTREAM STORAGE TANK PUMPS
480V, TR. 'D' MOTOR CONTROL CENTER
(SLUDGE PUMPS #1 & #2)
DWG EP281

87
CONTROL CABLES TO BE REUSED IF POSSIBLE
FOR ALARMS ECT.
TR. 'D' MOTOR CONTROL CENTER
(CONTROLS)
DWG EP281

85
480V, TR. 'D' MOTOR CONTROL CENTER
DECANT TANK MIXER, TRANSFER SLUDGE PUMP
SLUMP PUMP
DWG EP281
(TO BE REMOVED)

CONTROL CABLES TO BE REUSED IF POSSIBLE
FOR FILTRATE PUMP STATION

SLUMP PUMP
1/2HP, 2A, 3ø
480V
DECANT TUNNEL

SLUDGE PUMPS #1
BALDOR #EM37701
7.5HP, 9.8A, 3ø
480V, 1760RPM

SLUDGE PUMPS #2
BALDOR #EM37701
7.5HP, 9.8A, 3ø
480V, 1760RPM


SLUDGE PUMPS #1 & #2
LOCATED IN DECANT TUNNEL
(TO BE REMOVED)

SLUDGE PUMPS
#1 & #2 PRESSURE
SW'S TP-2
(TO BE REMOVED)

SEW-EURODRIVE
20HP, 26.5A, 3ø
480V, 3679RPM
SST PUMP FROM DECANT
TANK TO SLUDGE STORAGE TANK
(TO BE REMOVED)

LOCATED IN DECANT TUNNEL
OLD FILTER BUILDING
RENAMED SOLIDS HANDLING BLDG.

NOTE
1. ITEMS FOR DEMOLITION



REVISIONS	DATE	BY	APP'D

DESIGNED BY	STI/TSS	CHECKED BY	STI/RRR	APPROVED BY	STI/RL

CTI ENVIRONMENTAL, INC.
ENGINEERS IN WATER AND EARTH SCIENCES
UNIONTOWN, OHIO

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
LOCATED IN DECANT TUNNEL
OLD FILTER BUILDING DEMOLITION PLAN

JOB NO.	E9031
DATE	06/05/00
SCALE	1 1/2" = 12"
SHEET	EP286-D