


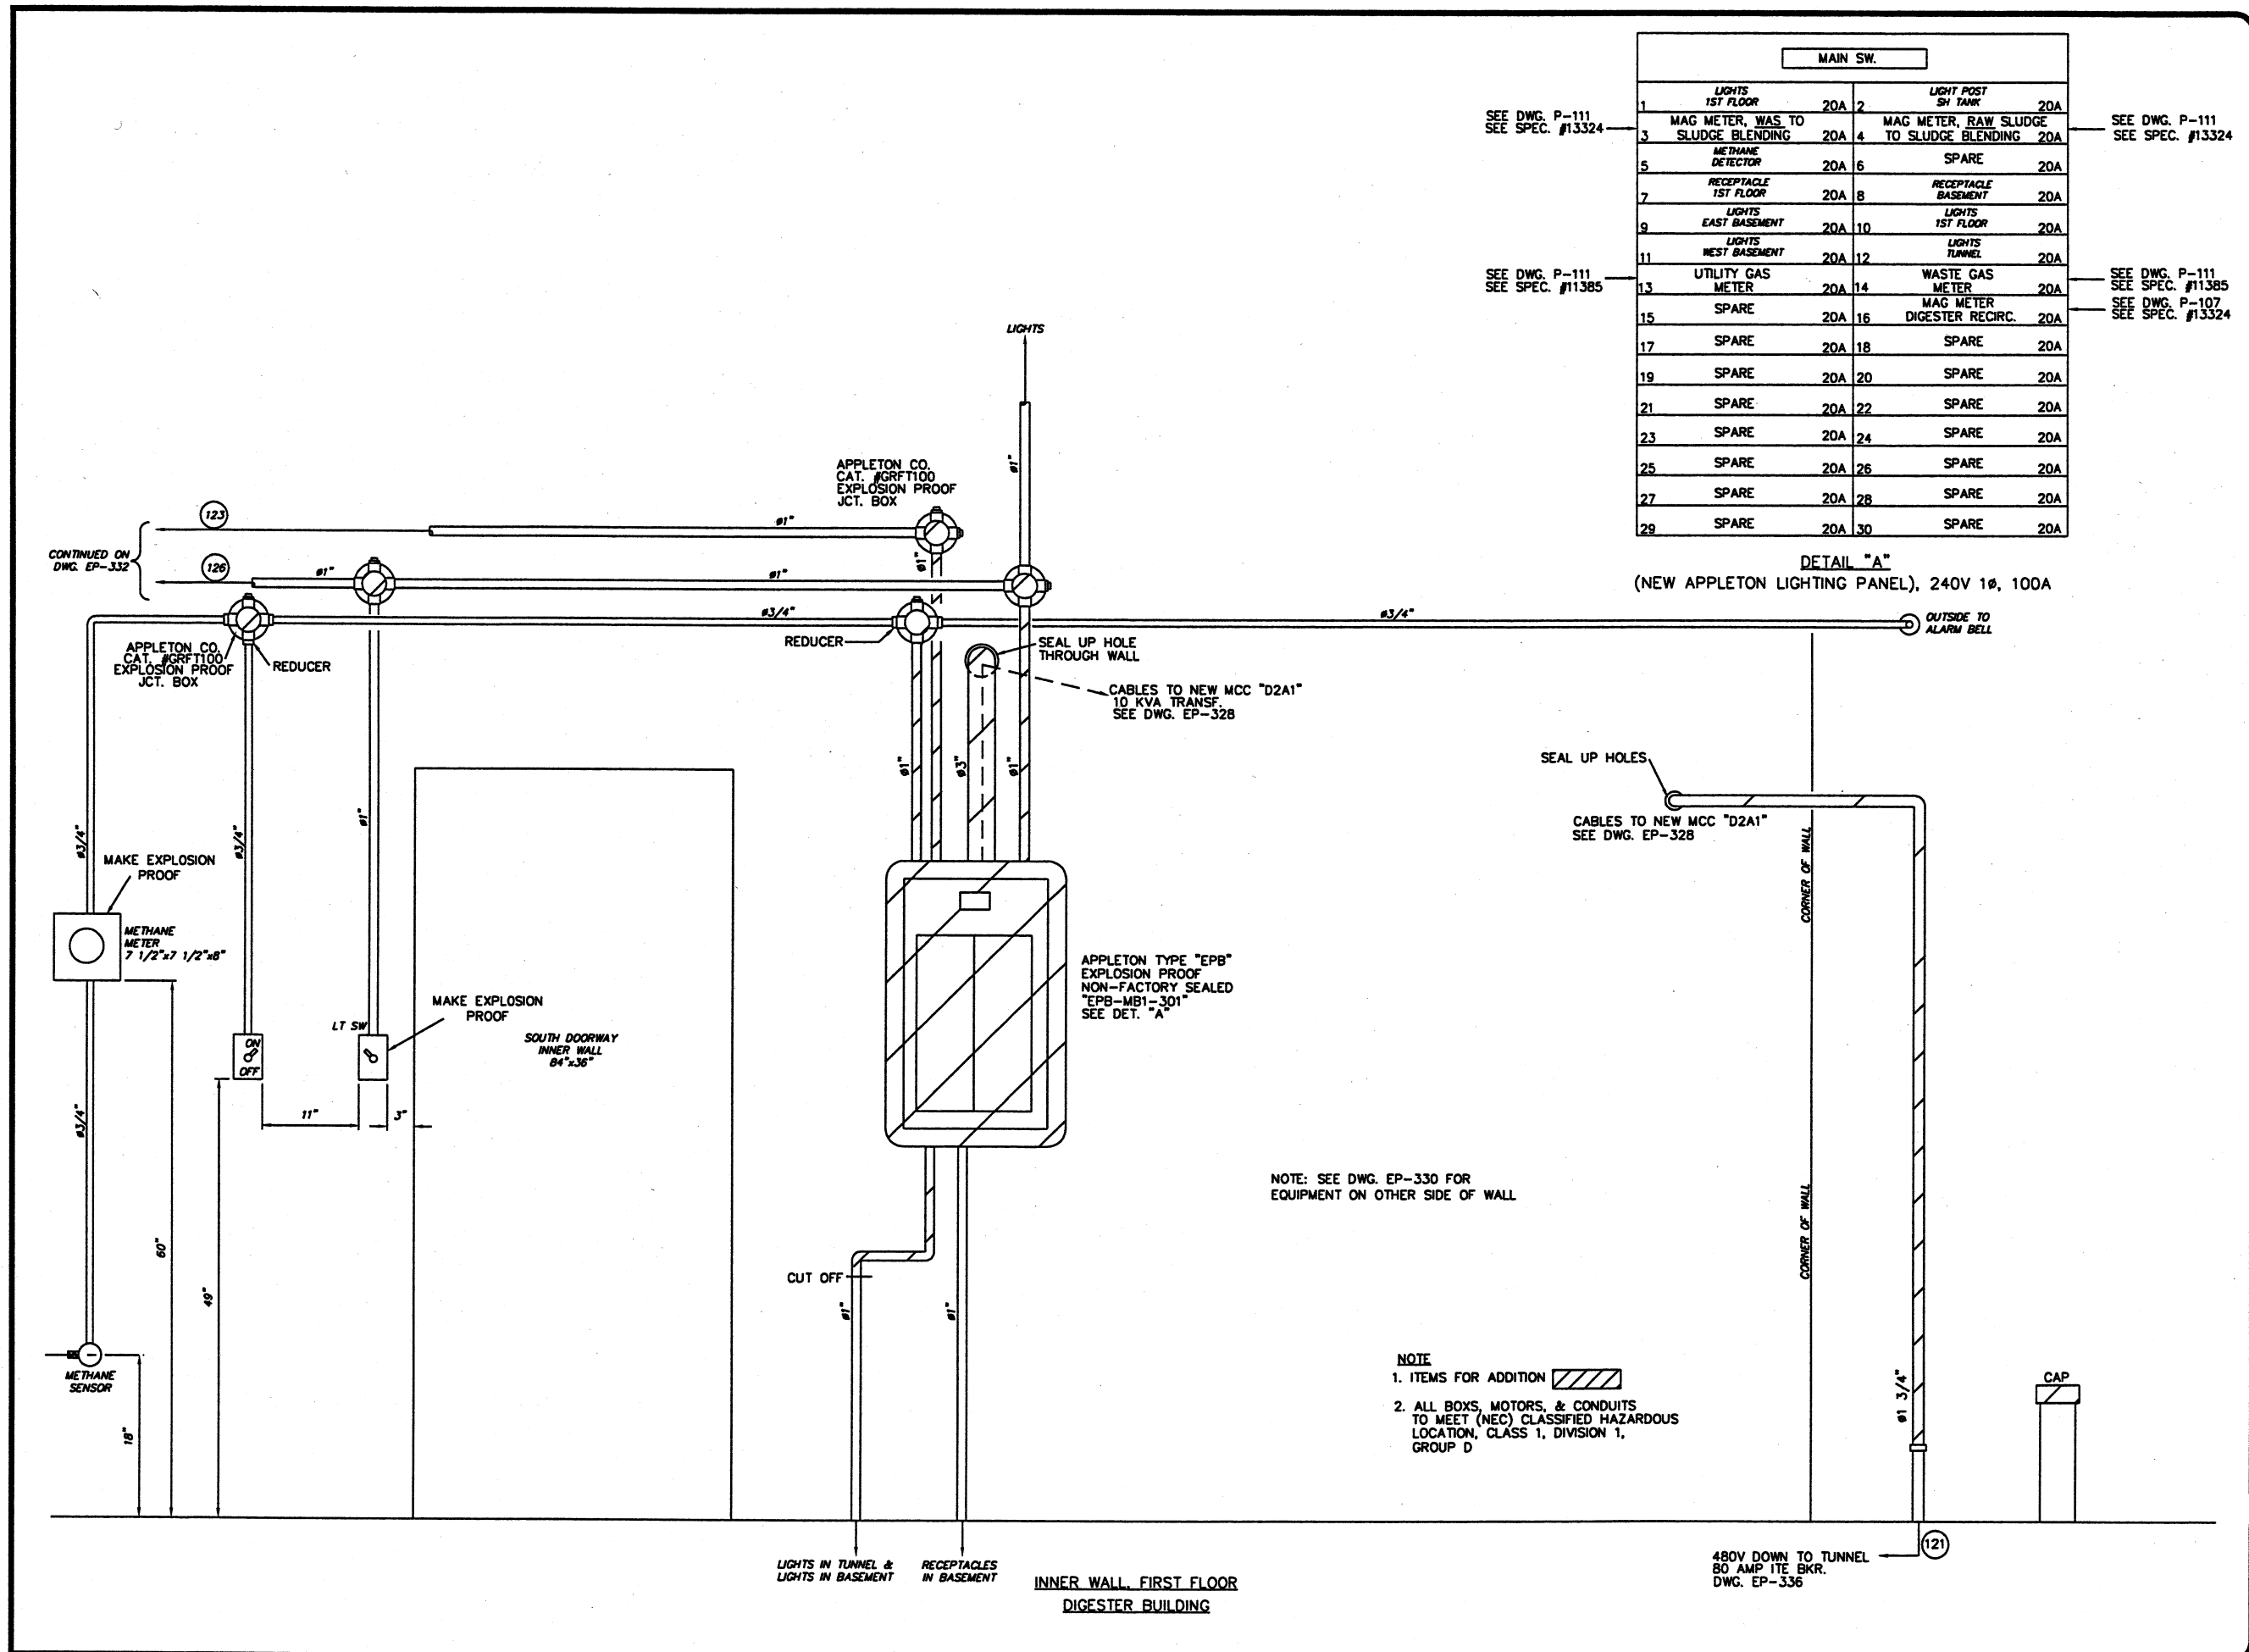

MAIN SW.					
1	LIGHTS 1ST FLOOR	20A	2	LIGHT POST SH TANK	20A
3	MAG METER, WAS TO SLUDGE BLENDING	20A	4	MAG METER, RAW SLUDGE TO SLUDGE BLENDING	20A
5	METHANE DETECTOR	20A	6	SPARE	20A
7	RECEPTACLE 1ST FLOOR	20A	8	RECEPTACLE BASEMENT	20A
9	LIGHTS EAST BASEMENT	20A	10	LIGHTS 1ST FLOOR	20A
11	LIGHTS WEST BASEMENT	20A	12	LIGHTS TUNNEL	20A
13	UTILITY GAS METER	20A	14	WASTE GAS METER	20A
15	SPARE	20A	16	MAG METER DIGESTER RECIRC.	20A
17	SPARE	20A	18	SPARE	20A
19	SPARE	20A	20	SPARE	20A
21	SPARE	20A	22	SPARE	20A
23	SPARE	20A	24	SPARE	20A
25	SPARE	20A	26	SPARE	20A
27	SPARE	20A	28	SPARE	20A
29	SPARE	20A	30	SPARE	20A

DETAIL "A"
(NEW APPLETON LIGHTING PANEL), 240V 1 ϕ , 100A

REVISIONS		DATE	BY	APP'D
NO.	DESCRIPTIONS			
STI/TSS	DRAWN BY			
STI/TSS	CHECKED BY			
STI/TSS	APPROVED BY			
STI/R/L				

ENVIRONMENTAL, INC.
ENGINEERS IN WATER AND EARTH SCIENCES
UNIONTOWN, OHIO

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
TR. "D2", MCC "D2A1" INNER WALL, FIRST FLOOR
DIGESTER BUILDING

JOB NO.
E9031
DATE
5/31/01
SCALE
1 1/2" = 12"
SHEET
EP331