


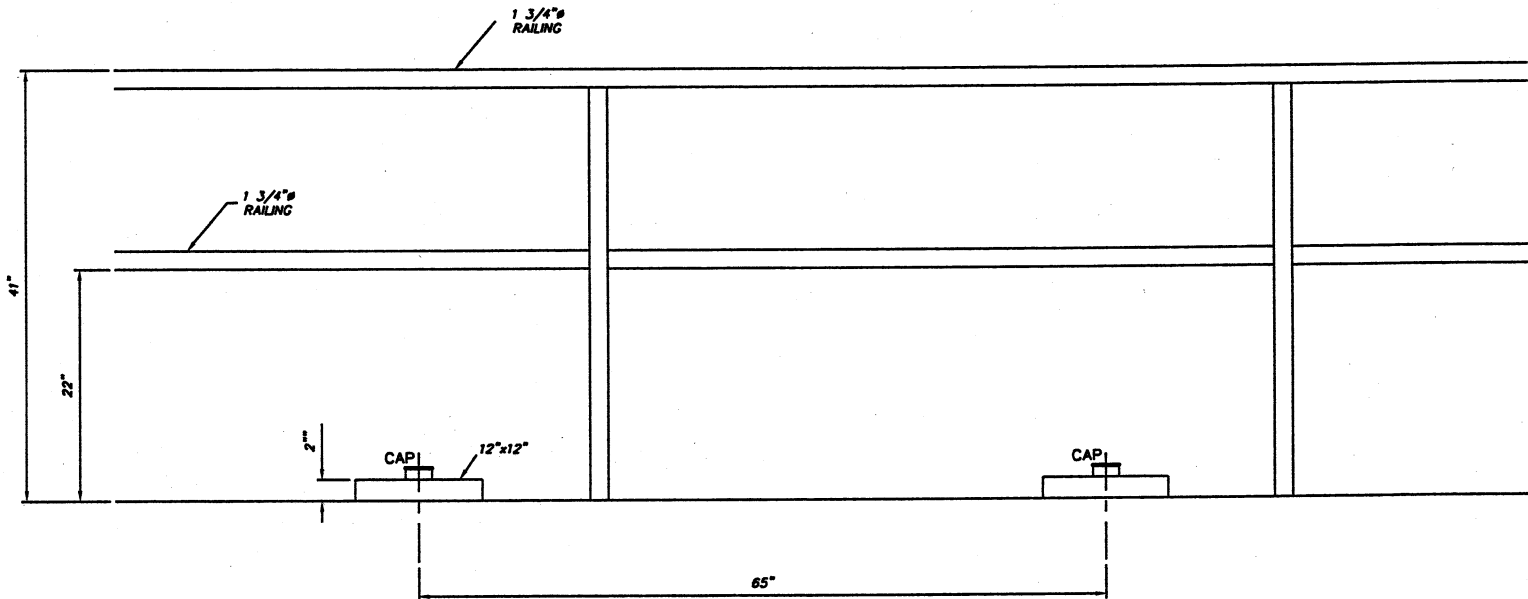

NOTE:
CHLORINE VALVES WERE REMOVED AND
ALL EQUIPMENT ON FAR SIDE OF RAILING
TO BE CALLED (HIGH RIVER PUMPING STATION)

CTI ENVIRONMENTAL, INC.
ENGINEERS IN WATER AND EARTH SCIENCES
UNIONTOWN, OHIO

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
TRANSFORMER "D2" HIGH RIVER PUMP STATION
SOUTH WEST CORNER OF LAB BLDG

DESIGNED BY		REVISIONS		DATE		BY	
STI/TSS	NO.	DESCRIPTIONS					APPD
STI/TSS							
STI/TSS							
STI/TSS							
STI/TSS							
STI/TSS							

STI/TSS
MASSILLON, OHIO
JAN 56/74
R.L.

JOB NO.
E9031
DATE
2/26/01
SCALE
1 1/2" = 12"
SHEET
EP354