



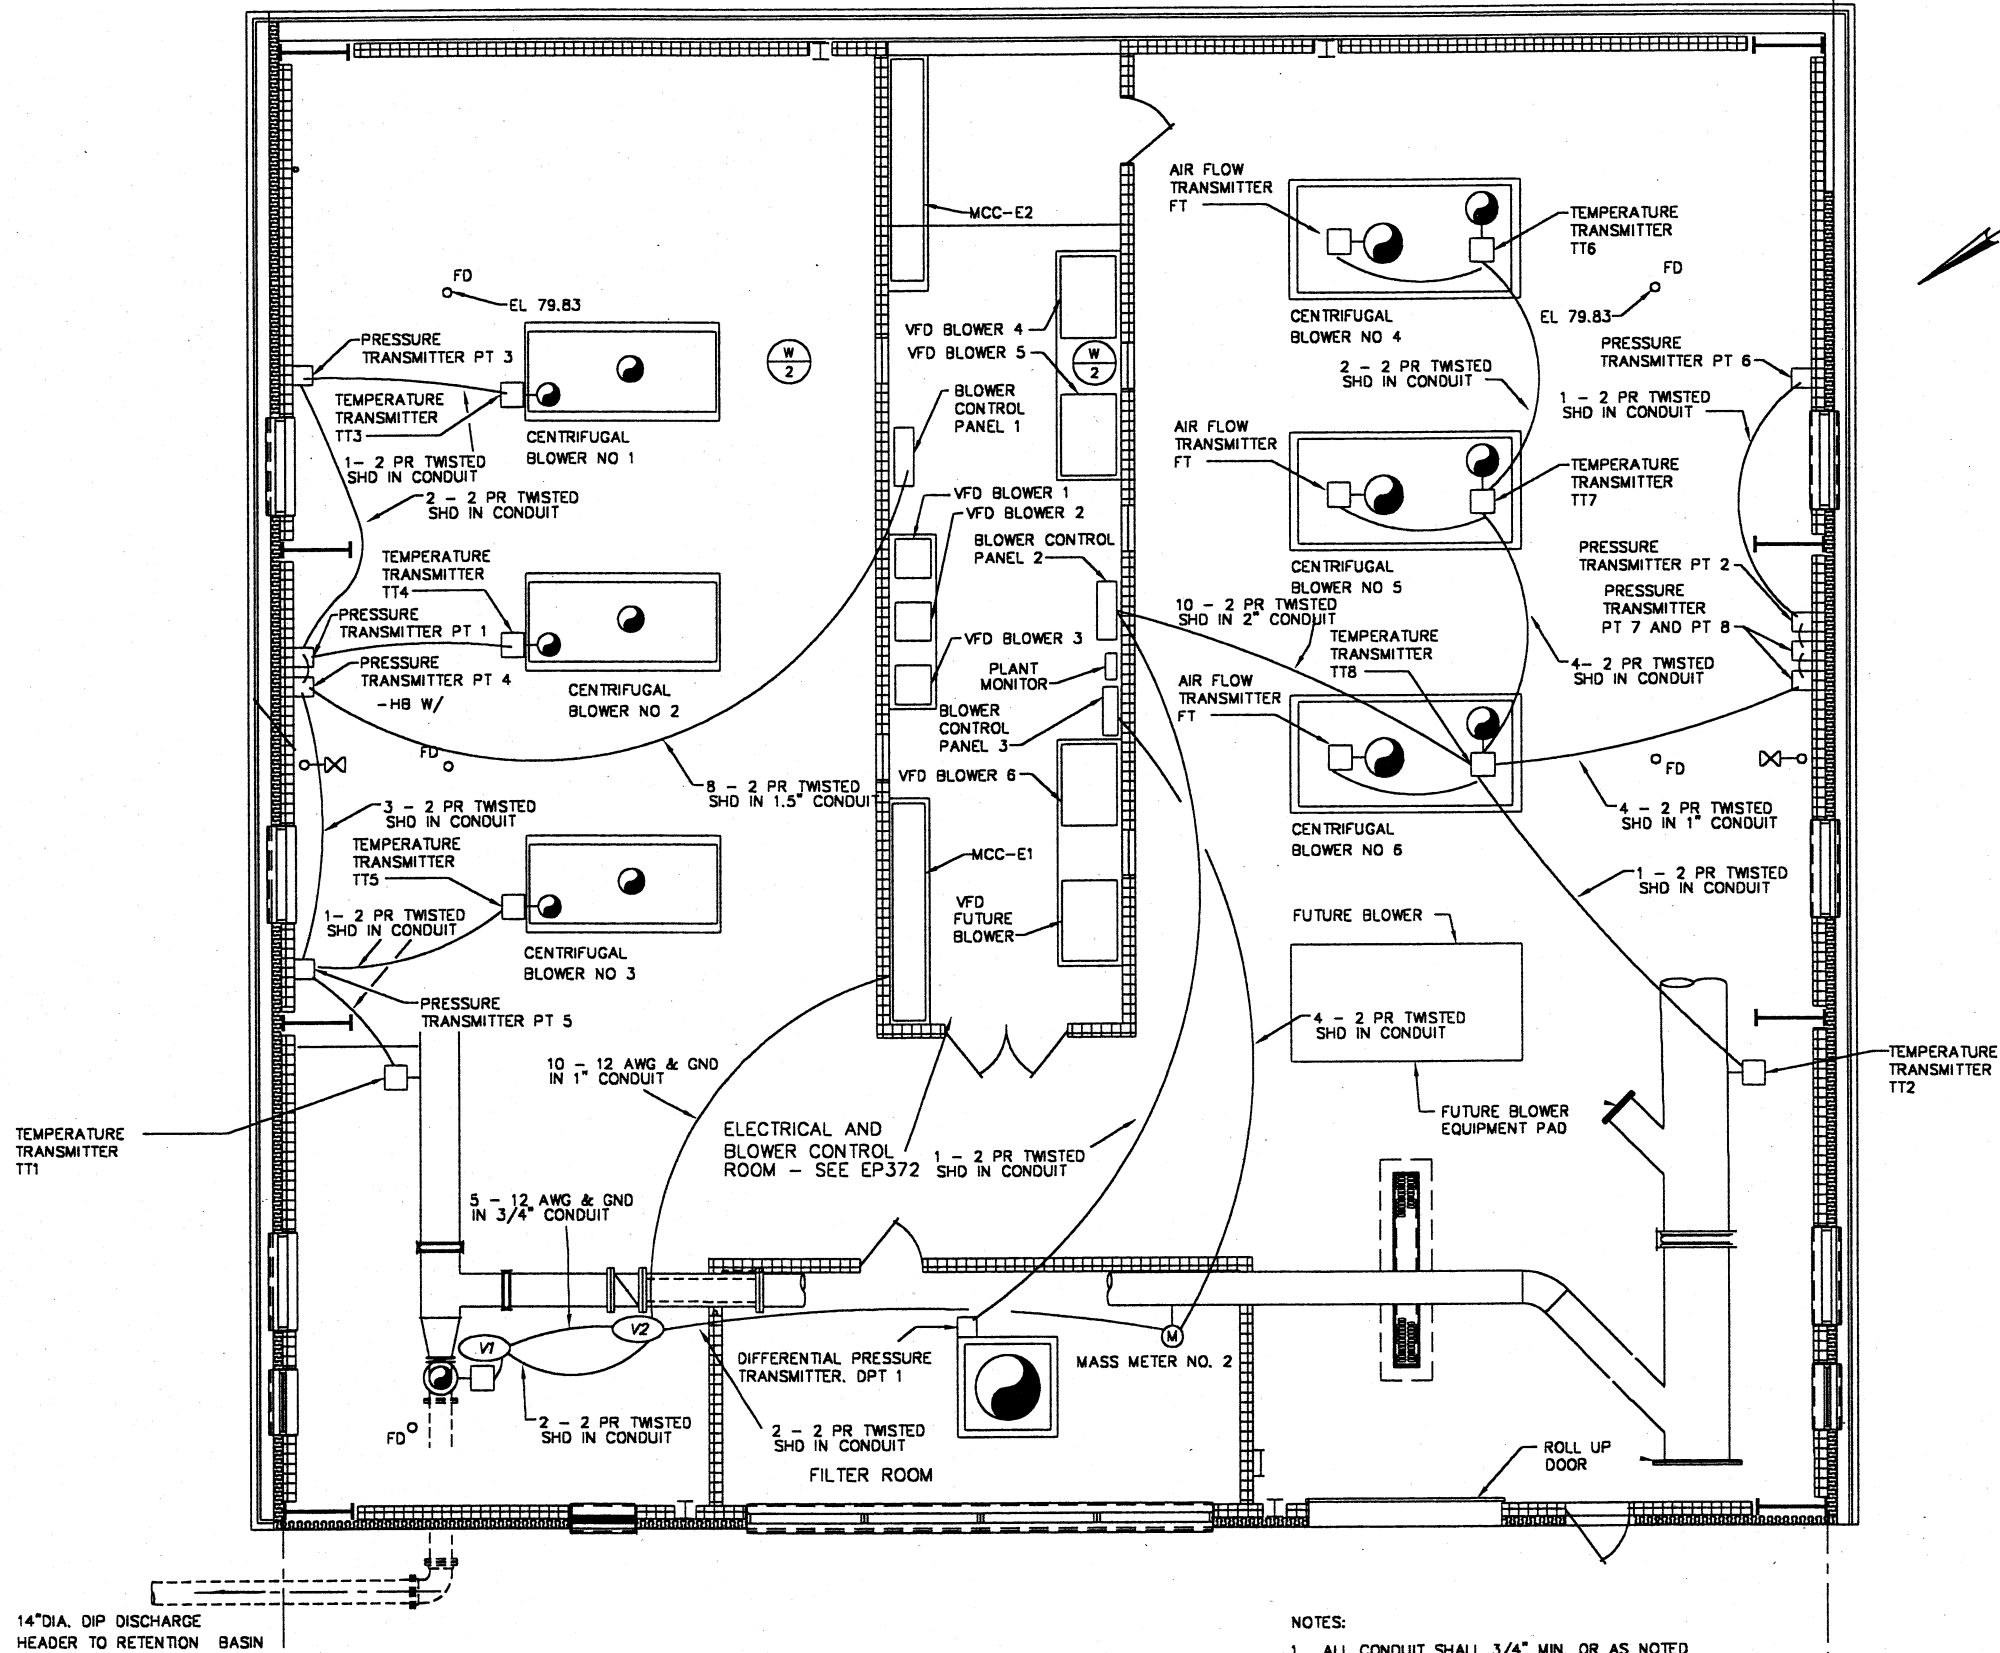

PLAN VIEW
SCALE: 3/16"=1'-0"

NOTES:

1. ALL CONDUIT SHALL 3/4" MIN. OR AS NOTED
2. USE MIN. 12 FLEX CONDUIT TO COMPONENTS MOUNTED ON DUCTING
3. ALL CABLE SHALL RATED TWISTED PAIR SHIELDED 20 AWG MIN., 300 V RATING
4. CABLES TO COMPONENTS REQUIRED 2 PAIR EACH, ONE PAIR FOR SIGNAL AND ONE PAIR FOR 24 VDC

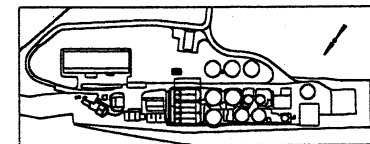

KEY PLAN

ENVIRONMENTAL, INC.
ENGINEERS IN WATER AND EARTH SCIENCES
UNIONTOWN, OHIO



CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
AERATION TANK BLOWER BLDG.
FIELD CONDUIT LAYOUT PLAN

JOB NO.
E9031
DATE
9/12/01
SCALE
AS NOTED
FIGURE
EP373