

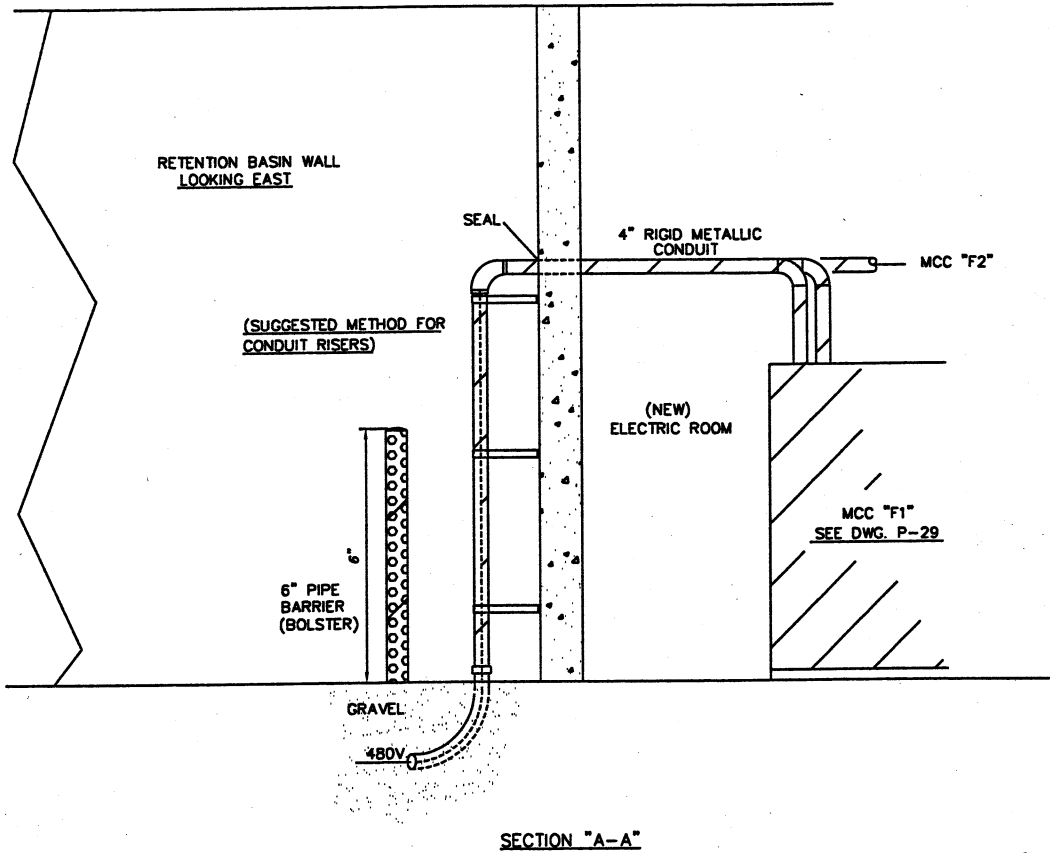


DETAIL "A"
SUGGESTED UG CABLE INSTALLATION
OR INSTALL AS PER N.E.C.
(TYPICAL FOR UG CABLE INSTALLATIONS)

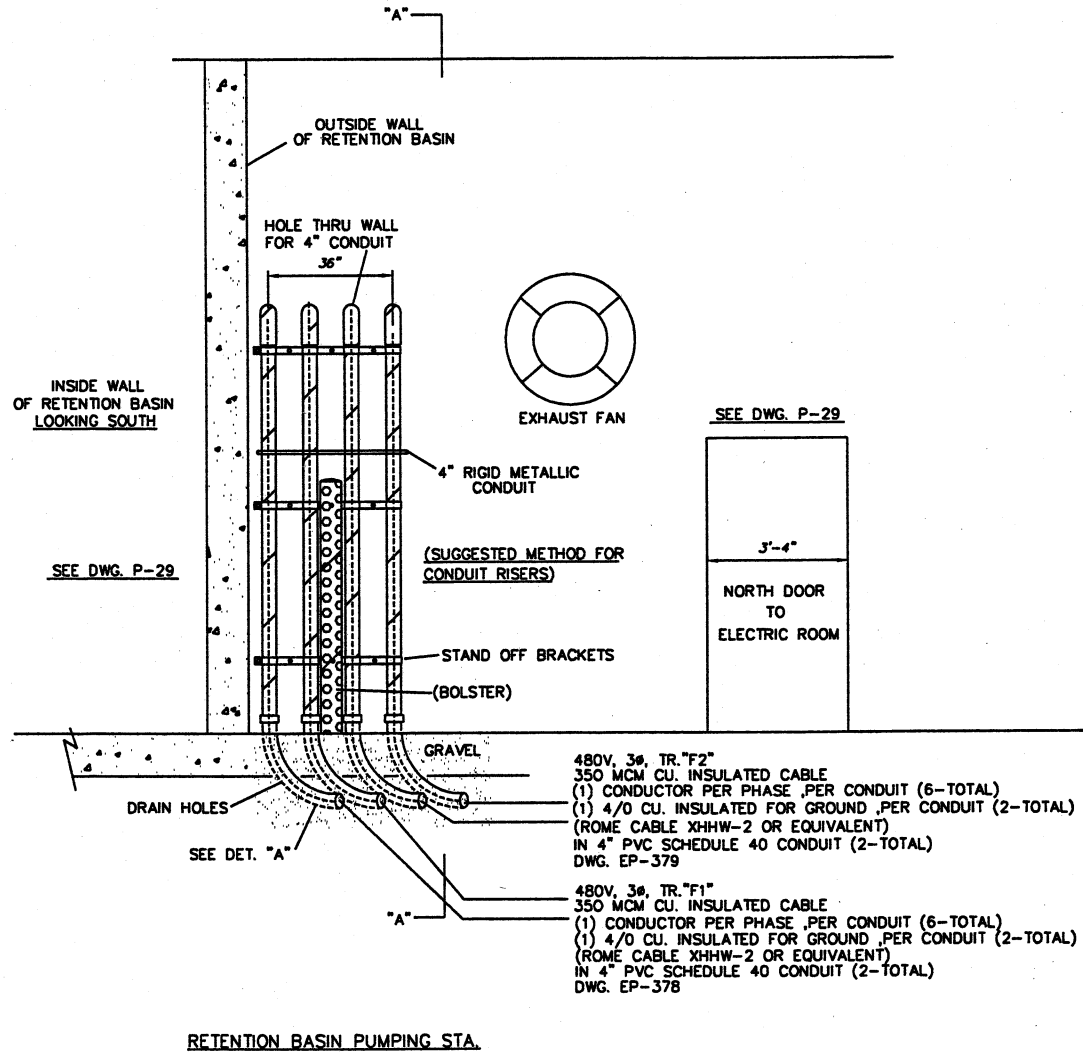

NOTE
1. ITEMS FOR ADDITION



DESIGNED BY		REVISIONS		DATE		BY	
STI/TSS	STI/TSS	NO.	DESCRIPTIONS				

ENVIRONMENTAL, INC.
WATER AND EARTH SCIENCES
MASSILLON, OHIO
CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000
CONDUIT RISERS, (LAYOUT 480V CABLE RUN)
RETENTION BASIN PUMPING STA.
TR. "F1" & "F2"

JOB NO.	E9031
DATE	6/25/01
SCALE	1"=1'
SHEET	EP380