



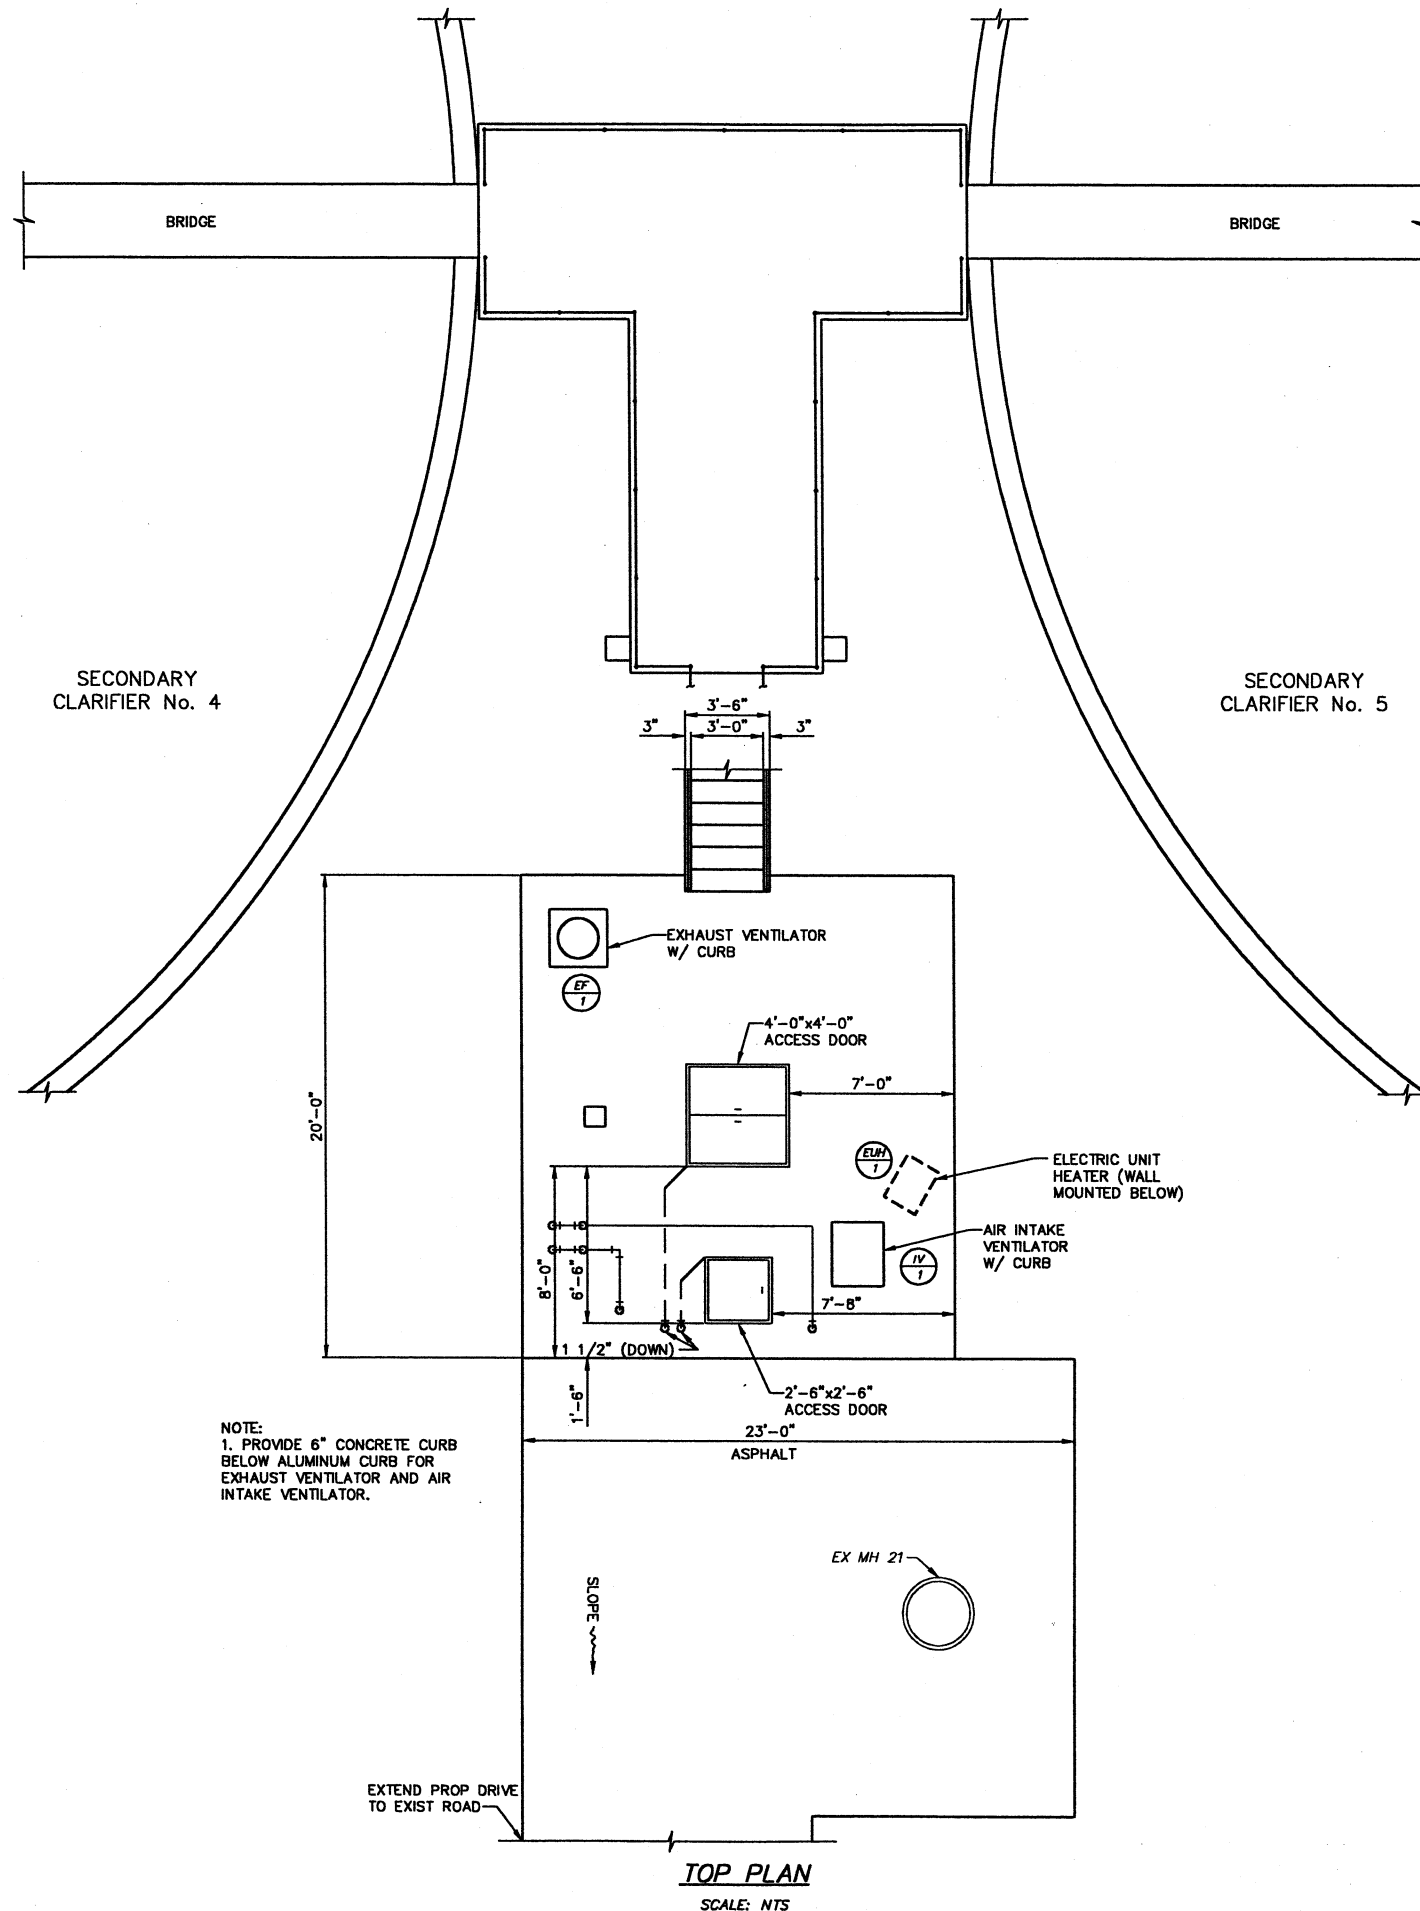

SECONDARY CLARIFIER No. 4

SECONDARY CLARIFIER No. 5

NOTE:
1. TERMINATE STEEL EXHAUST DUCT 1'-0" ABOVE FLOOR

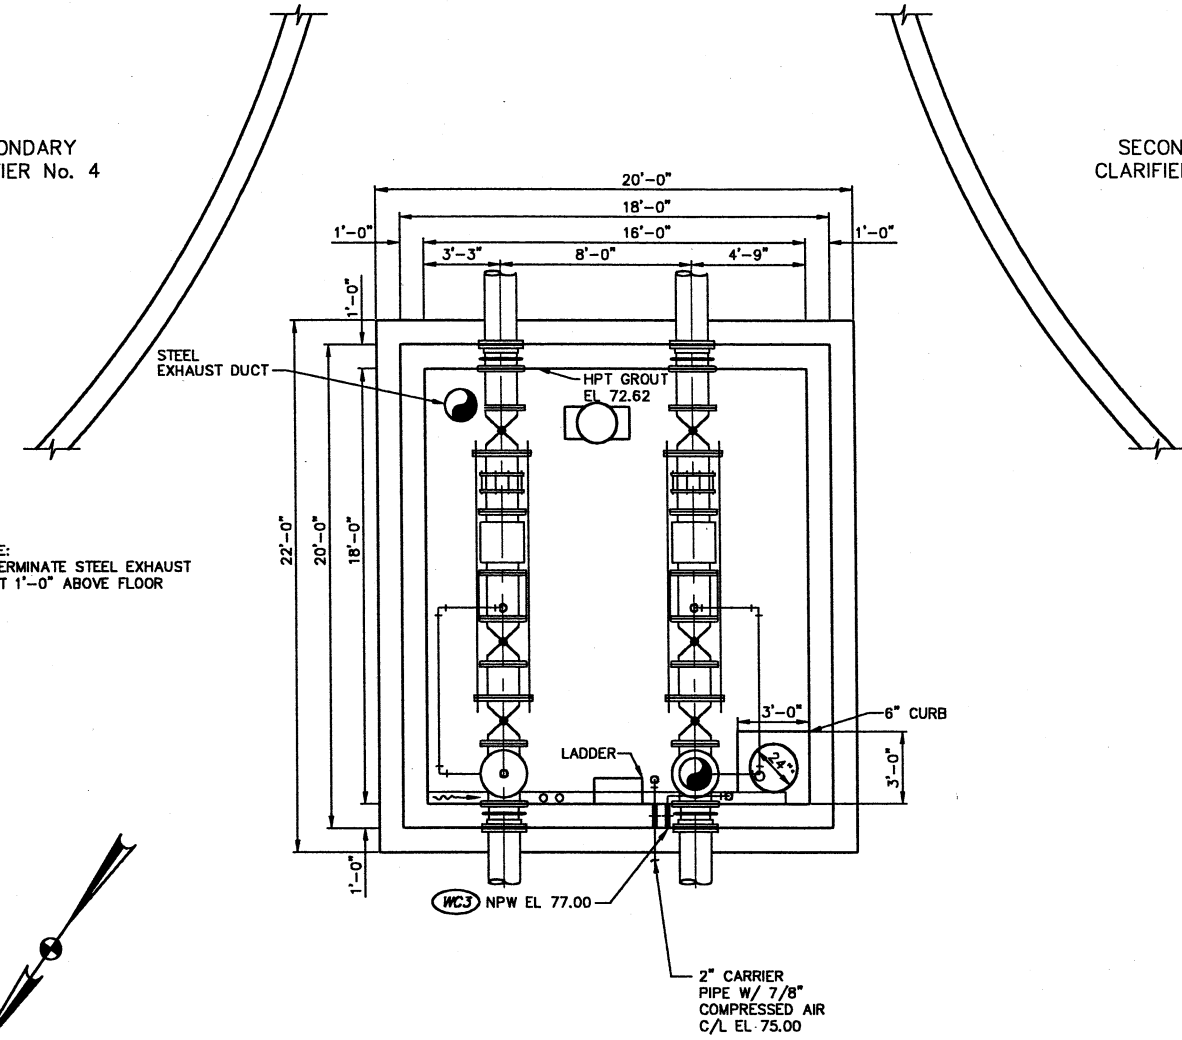

NOTE: 1. MECHANICAL CONTRACTOR SHALL PROVIDE EXHAUST VENTILATOR, AIR INTAKE VENTILATOR, ELECTRIC UNIT HEATER, THERMOSTATS, FREEZESTAT, CONTROLS AND APURTENANCES FOR HVAC EQUIPMENT.

ADDENDUM NO. 3

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000



SK-M16-001