


DATE	SYM	REVISION RECORD	AUTH	DR	CK
4/25/02	A	FOR APPROVAL	CUST	HR	DC

1301
1302
1303
1304
1305
1306
1307
1308
1309
1310
1311
1312
1313
1314
1315
1316
1317
1318
1319
1320
1321
1322
1323
1324
1325

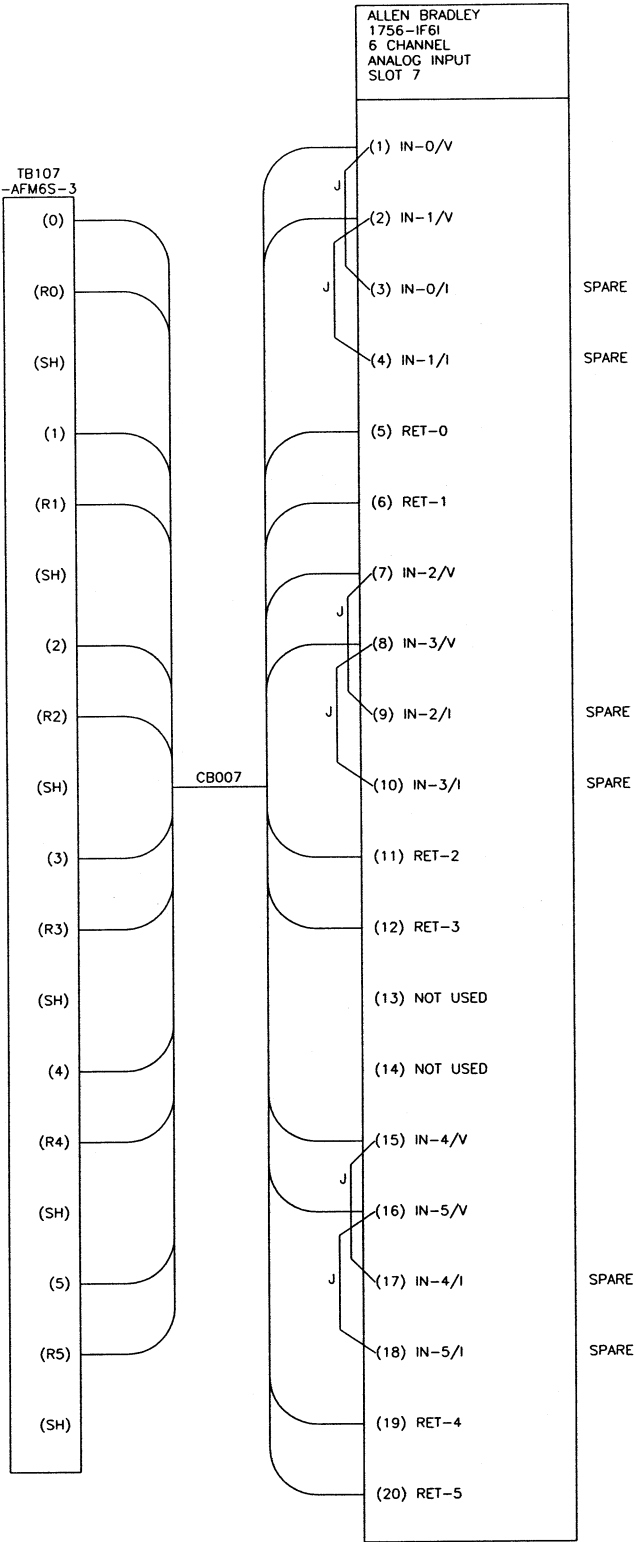

1326
1327
1328
1329
1330
1331
1332
1333
1334
1335
1336
1337
1338
1339
1340
1341
1342
1343
1344
1345
1346
1347
1348
1349
1350

05/19/03 13:47	WIRE LUGS - NO ☒ YES ☐	RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES		 DUBLIN TECHNICAL SYSTEMS, INC.			
	INSULATION: NYLON ☐ PVC ☒					DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031			SCALE	DRAWN BY
	WIRE SPECIFICATIONS:					± .03	NONE			APPROVED BY	
	USAGE	SIZE	COLOR	INSULATION	FRACTIONAL	TITLE					
	AC PANEL POWER	AWG #12	BLK.	THW/THHN	± 1/32"	OPERATOR'S LABORATORY ENCLOSURE					
	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN		PLC SLOT 7 SCHEMATIC					
	AC PANEL GROUND	AWG #12	GRN.	THW/THHN							
	AC CONTROL POWER	AWG #14	RED	THW/THHN							
	AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN							
	AC FOREIGN	AWG #14	YELLOW	THW/THHN							
	DC POWER	AWG #16	BLUE	THW/THHN							
	DC CONTROL	AWG #16	BLUE	THW/THHN							
	SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD	THW/THHN							
					ANGULAR	DATE	DRAWING NUMBER				
					± 1"	4/25/02	DTSI - 02040 - 013				