
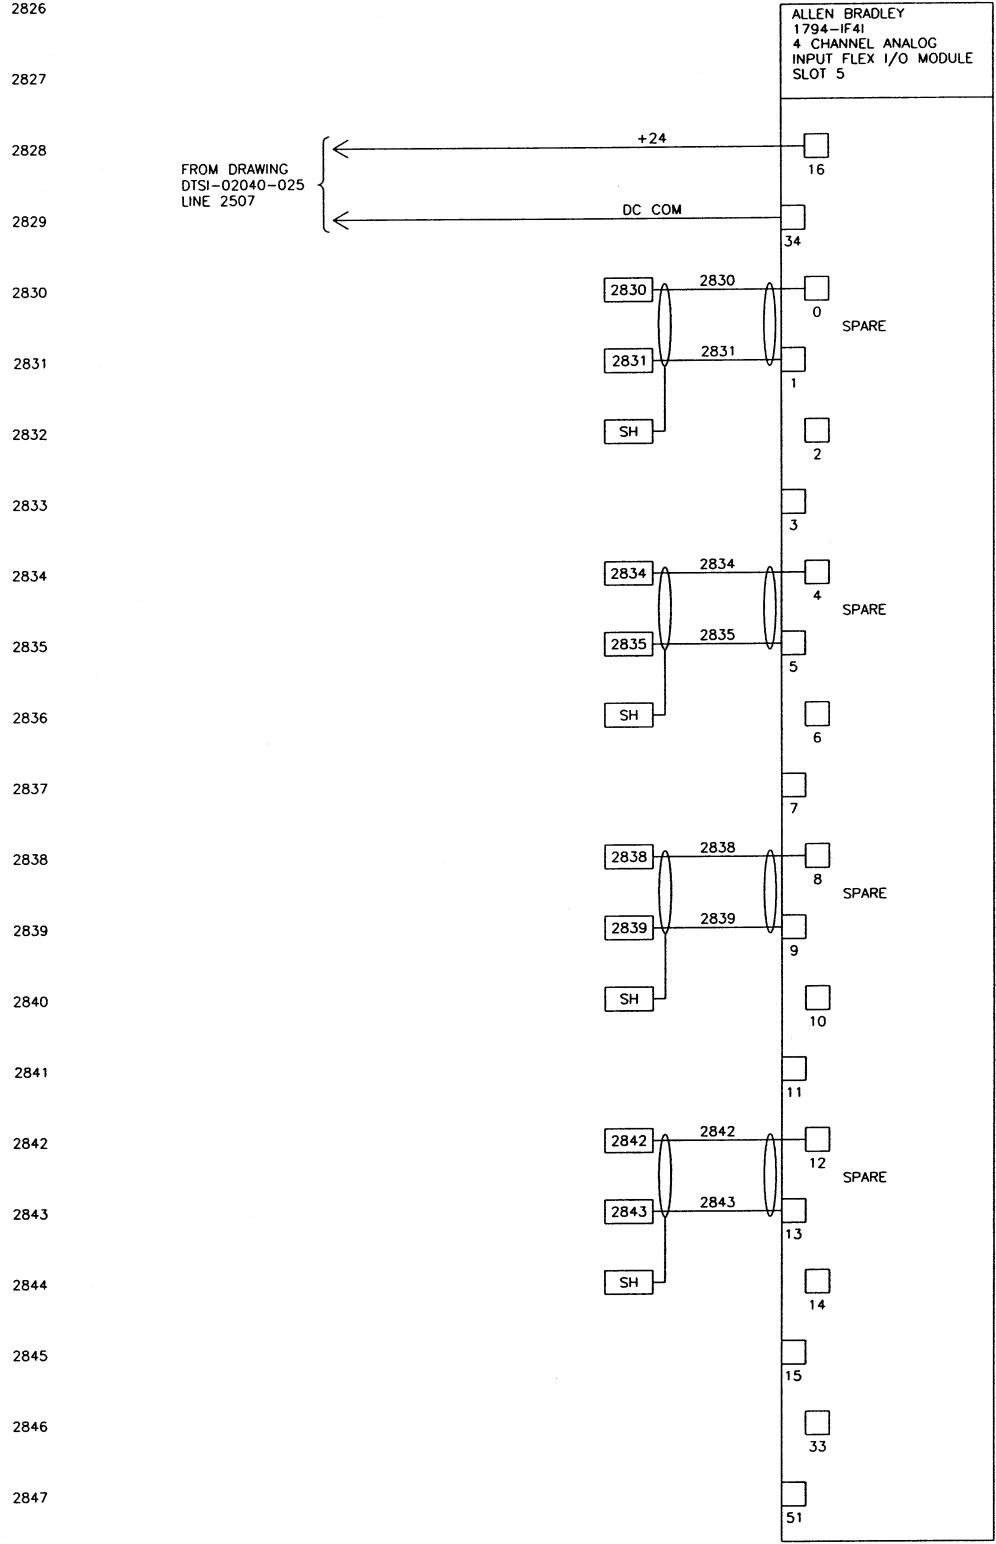
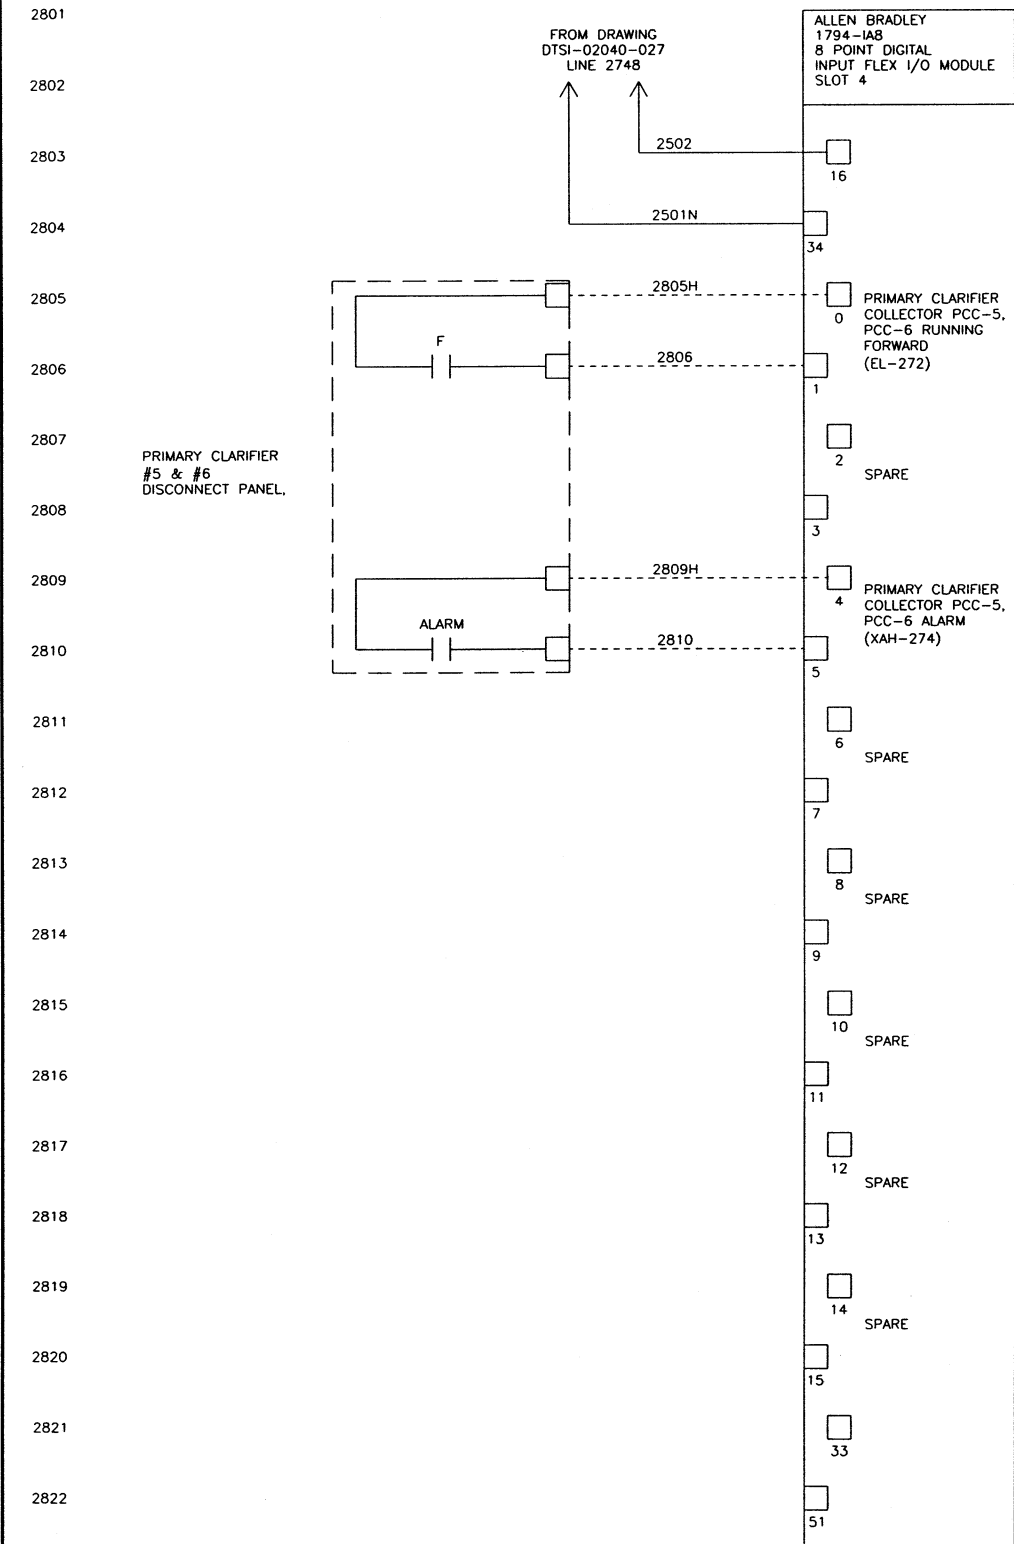



DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS



07/25/02 09:12	WIRE LUGS - NO ☒ YES ☐	RING ☐ LOCKING SPADE ☐			TOLERANCES		DUBLIN TECHNICAL SYSTEMS, INC.
	INSULATION: NYLON ☐ PVC ☒	DECIMAL ± .03			CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031		
	WIRE SPECIFICATIONS:	SIZE	COLOR	INSULATION	FRACTIONAL ± 1/32"	TITLE	TRANS A2 NODE 2 PRIMARY TREATMENT I/O WIRING DIAGRAM SLOTS 4 & 5
	AC PANEL POWER	AWG #12	BLK.	THW/THHN	ANGULAR ± 1"	DATE	4/08/02
	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN		DRAWING NUMBER	DTSI - 02040 - 028
	AC PANEL GROUND	AWG #12	GRN.	THW/THHN			
	AC CONTROL POWER	AWG #14	RED	THW/THHN			
	AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN			
	AC FOREIGN	AWG #14	YELLOW	THW/THHN			
	DC POWER	AWG #16	BLUE	THW/THHN			
	DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THHN			
		AWG #16	2 CONDUCTOR SHLD	THW/THHN			