



DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/6/03	A	FOR APPROVAL			

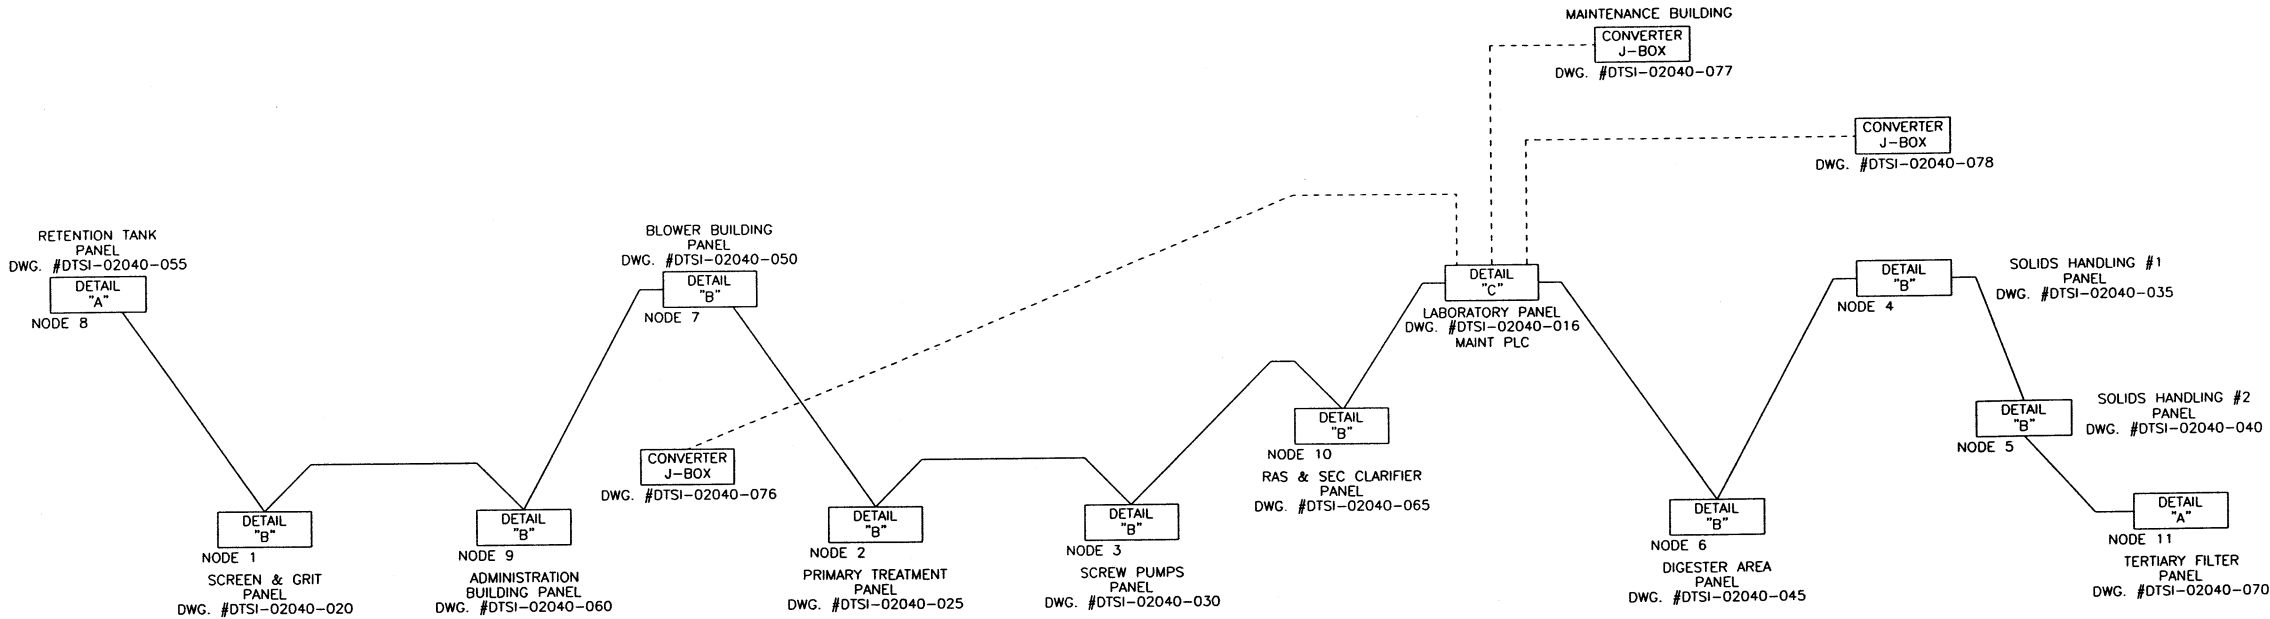


LEGEND


————— CONTROLNET
 - - - - - ETHERNET

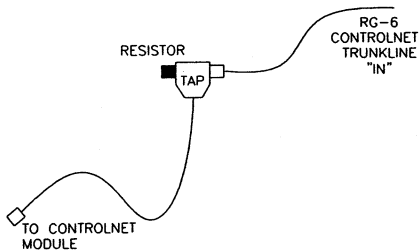


DETAIL "A"

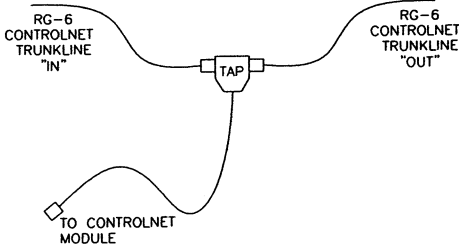

DETAIL "B"

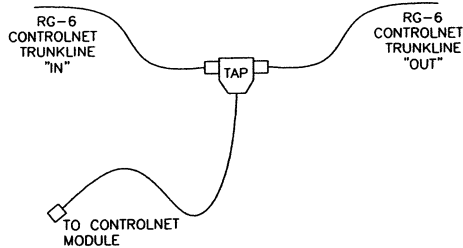

DETAIL "C"

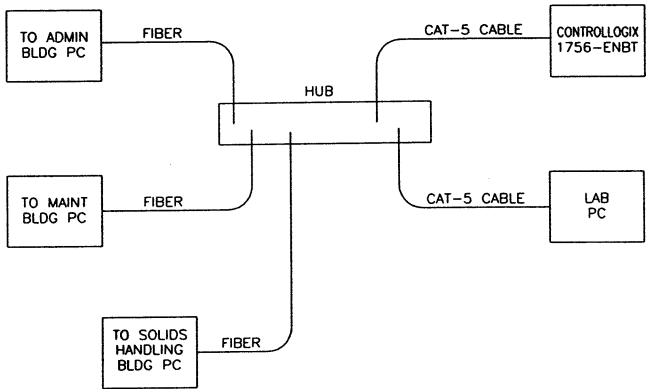

06/04/03 14:31

WIRE LUGS - NO ☐ YES ☐		RING ☐ LOCKING SPADE ☐	
INSULATION: NYLON ☐ PVC ☒			
WIRE SPECIFICATIONS:			
USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN.	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FOREIGN	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL	AWG #16	BLUE	THW/THHN
SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD	THW/THHN



KOKOSING
CONSTRUCTION CO.
P.O. #

DUBLIN TECHNICAL
SYSTEMS INC.
PROJECT # 02040

TOLERANCES		DUBLIN TECHNICAL SYSTEMS, INC.	
DECIMAL		CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031	SCALE NONE
FRACTIONAL		TITLE ETHERNET AND CONTROLNET ARCHITECTURE DRAWING	DRAWN BY HR
ANGULAR		DATE 5/6/02	APPROVED BY DG
		DRAWING NUMBER DTSI - 02040 - 005	