



DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/19/03	A	FOR APPROVAL	CUST	TL	DG

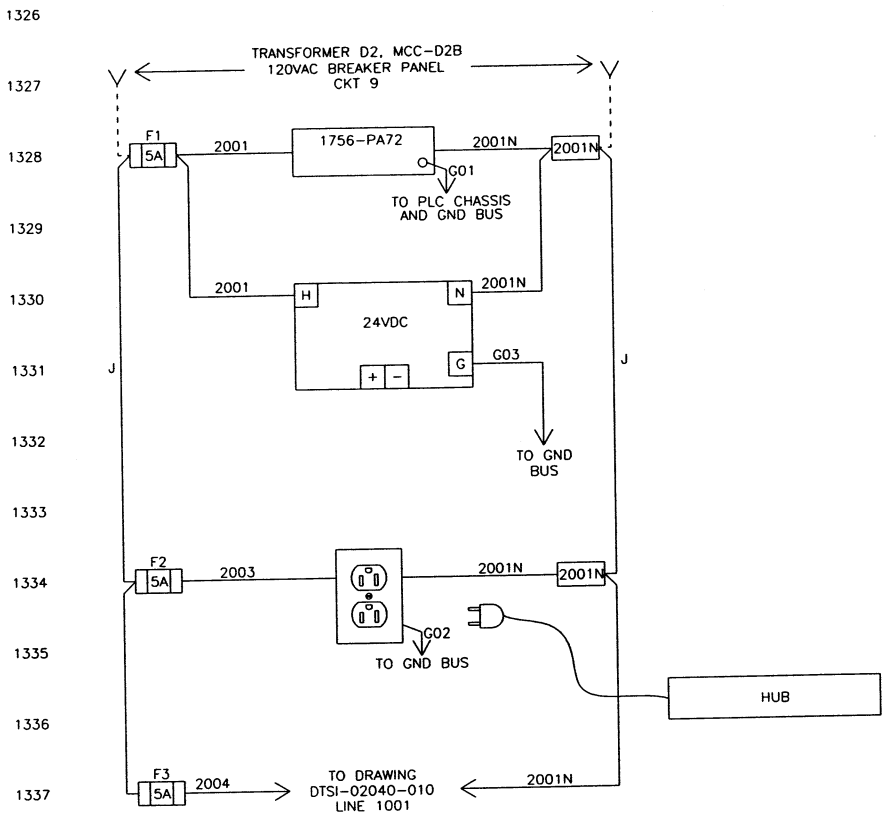

05/19/03 14:27

WIRE LUGS - NO ☒ YES ☐			RING ☐ LOCKING SPADE ☐		
INSULATION: NYLON ☐ PVC ☒					
WIRE SPECIFICATIONS:					
USAGE	SIZE	COLOR	INSULATION		
AC PANEL POWER	AWG #12	BLK.	THW/THHN		
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN		
AC PANEL GROUND	AWG #12	GRN.	THW/THHN		
AC CONTROL POWER	AWG #14	RED	THW/THHN		
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN		
AC FOREIGN	AWG #14	YELLOW	THW/THHN		
DC POWER	AWG #18	BLUE	THW/THHN		
DC CONTROL	AWG #18	BLUE	THW/THHN		
SIGNAL/INSTRUMENTS	AWG #18	2 CONDUCTOR SHLD	THW/THHN		

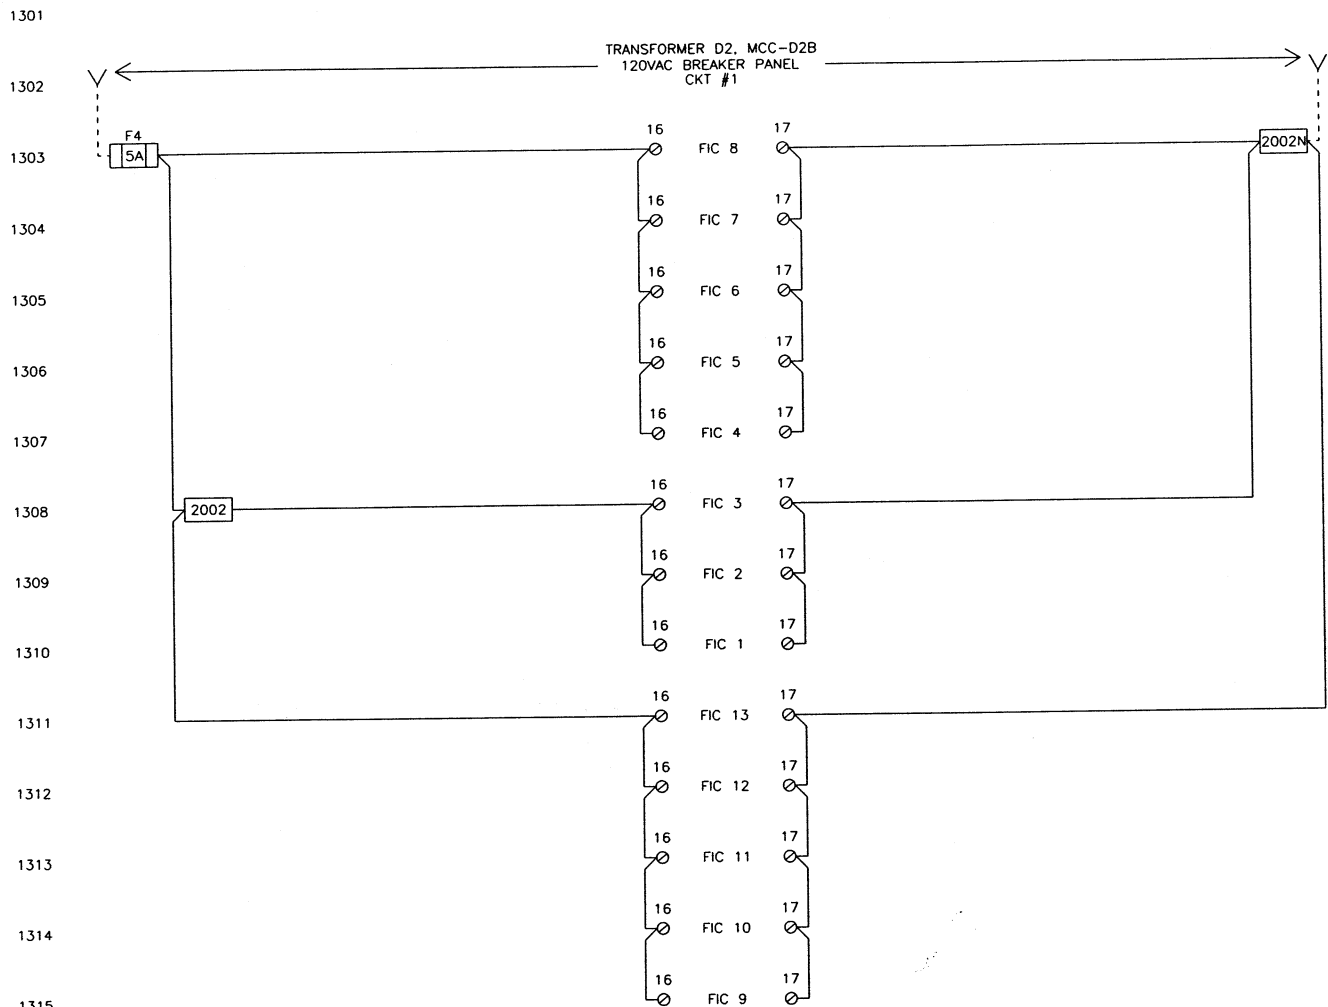

KOKOSING
CONSTRUCTION CO.
P.O. #

DUBLIN TECHNICAL
SYSTEMS INC.
PROJECT # 02040

TOLERANCES	DUBLIN TECHNICAL SYSTEMS, INC.		
+	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E3031	SCALE NONE	DRAWN BY TL
DECIMAL + .03			APPROVED BY DC
FRACTIONAL + 1/32"	TITLE OPERATOR'S LABORATORY ENCLOSURE SCHEMATIC DIAGRAMS	DATE 5/19/03	DRAWING NUMBER DTSI - 02040 - 015
ANGULAR + 1'			