
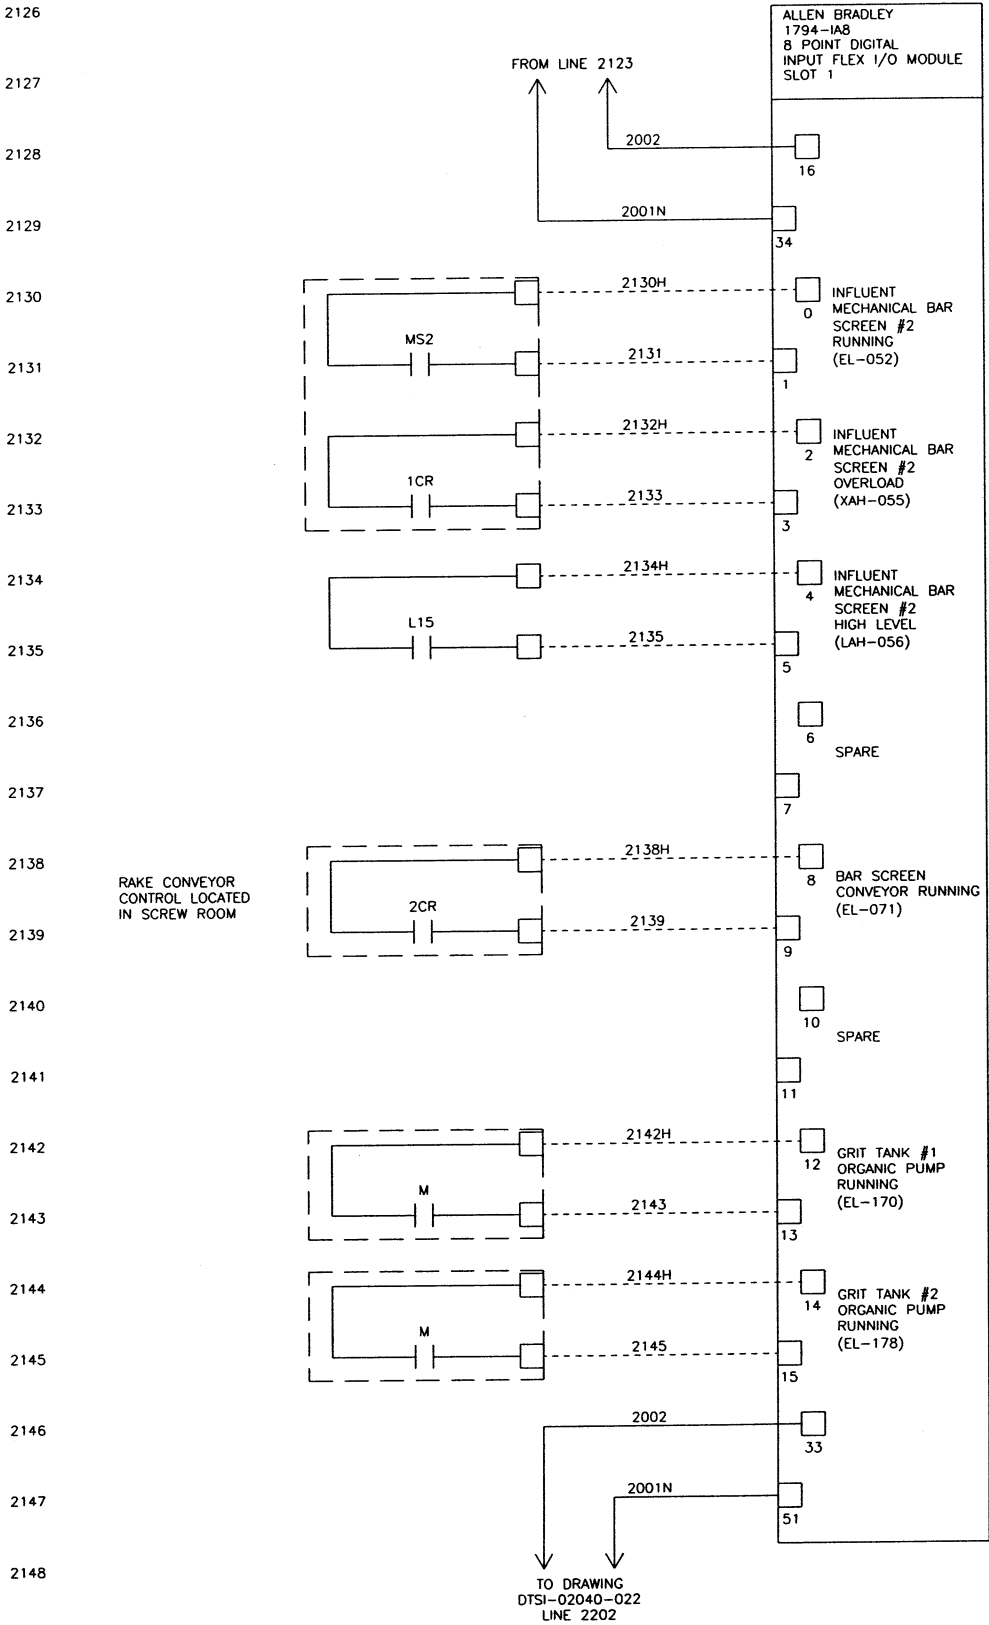


DATE	SYM	REVISION	RECORD	AUTH	DR	CK
5/12/03	A		FOR APPROVAL		CUST	TL

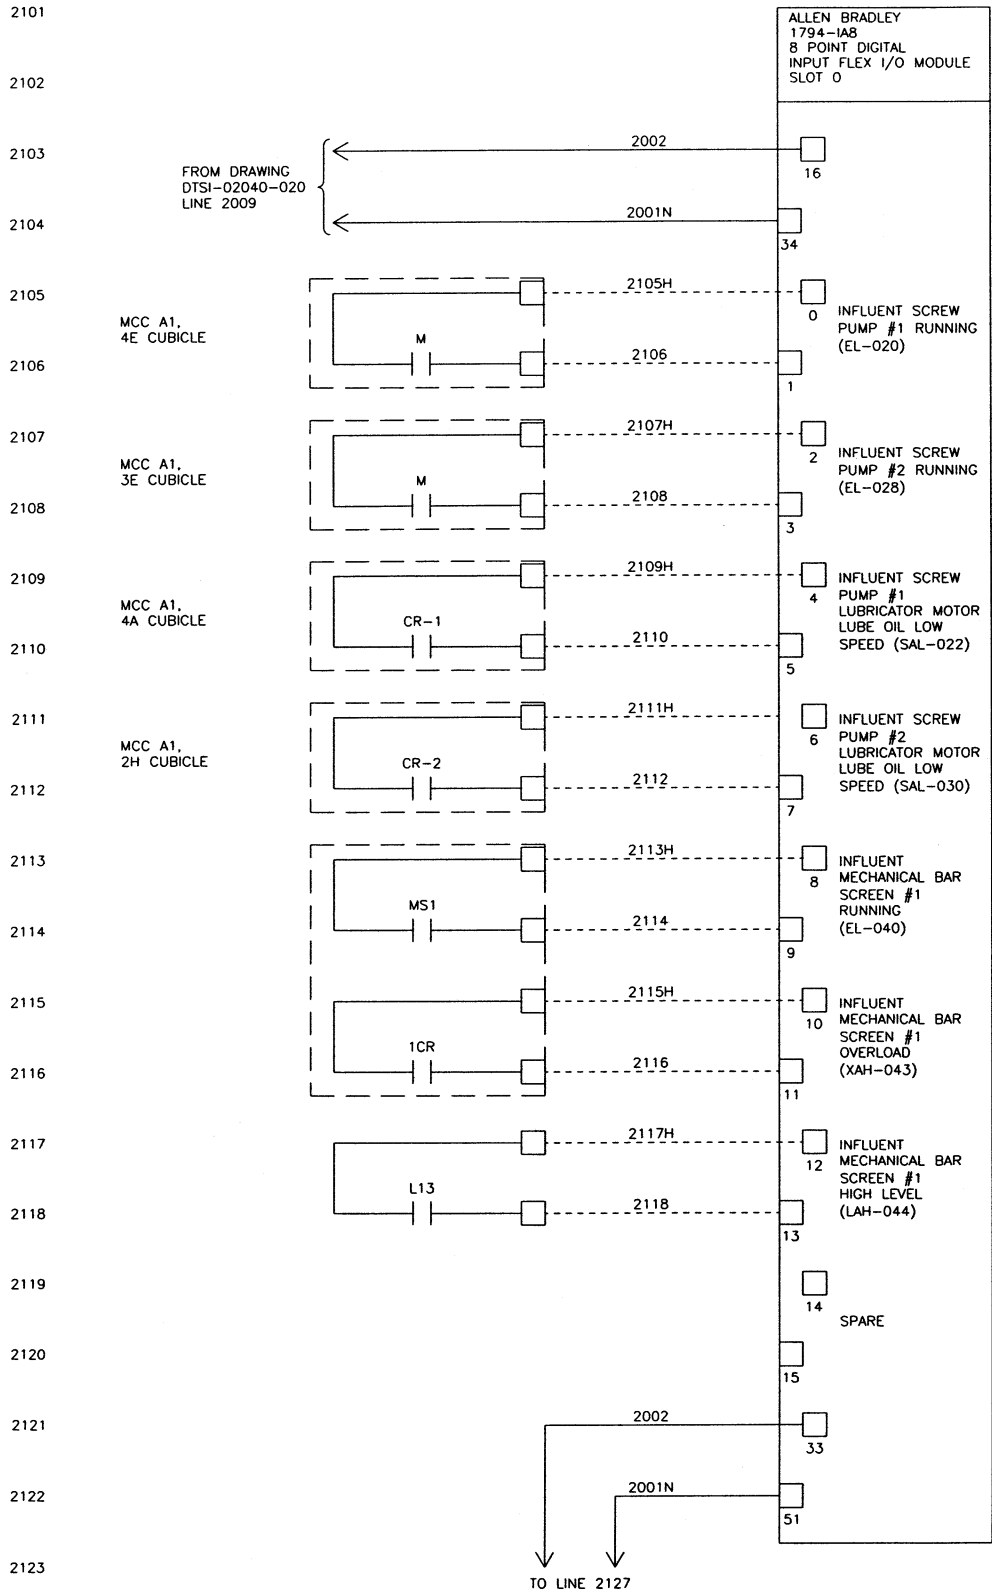

05/21/03 14:53	WIRE LUGS - NO ☒ YES ☐	INSULATION: NYLON ☐ PVC ☒	RING ☐ LOCKING SPADE ☐
	WIRE SPECIFICATIONS: USAGE SIZE COLOR INSULATION AC PANEL POWER AWG #12 BLK. THW/THHN AC PANEL NEUTRAL AWG #12 WHT. THW/THHN AC PANEL GROUND AWG #12 GRN. THW/THHN AC CONTROL POWER AWG #14 RED THW/THHN AC CONTROL NEUTRAL AWG #14 WHT. THW/THHN AC FOREIGN AWG #14 YEL. THW/THHN DC POWER AWG #16 BLUE THW/THHN DC CONTROL AWG #16 BLUE THW/THHN SIGNAL/INSTRUMENTS AWG #16 2 CONDUCTOR SHLD THW/THHN		
STATE OF OHIO REGISTERED PROFESSIONAL ENGINEER ROBERT A. LANDTHORN E-37992		KOKOSING CONSTRUCTION CO. P.O. #	
DUBLIN TECHNICAL SYSTEMS, INC. PROJECT # 02040		TOLERANCES DECIMAL ± .03 FRACTIONAL ± 1/32" ANGULAR ± 1°	DUBLIN TECHNICAL SYSTEMS, INC. CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E3031 SCALE NONE DRAWN BY HR APPROVED BY BS TITLE TRANS A1 NODE 1 SCREEN & GRIT I/O WIRING DIAGRAM SLOTS 0 & 1 DATE 4/08/02 DRAWING NUMBER DTSI - 02040 - 021