

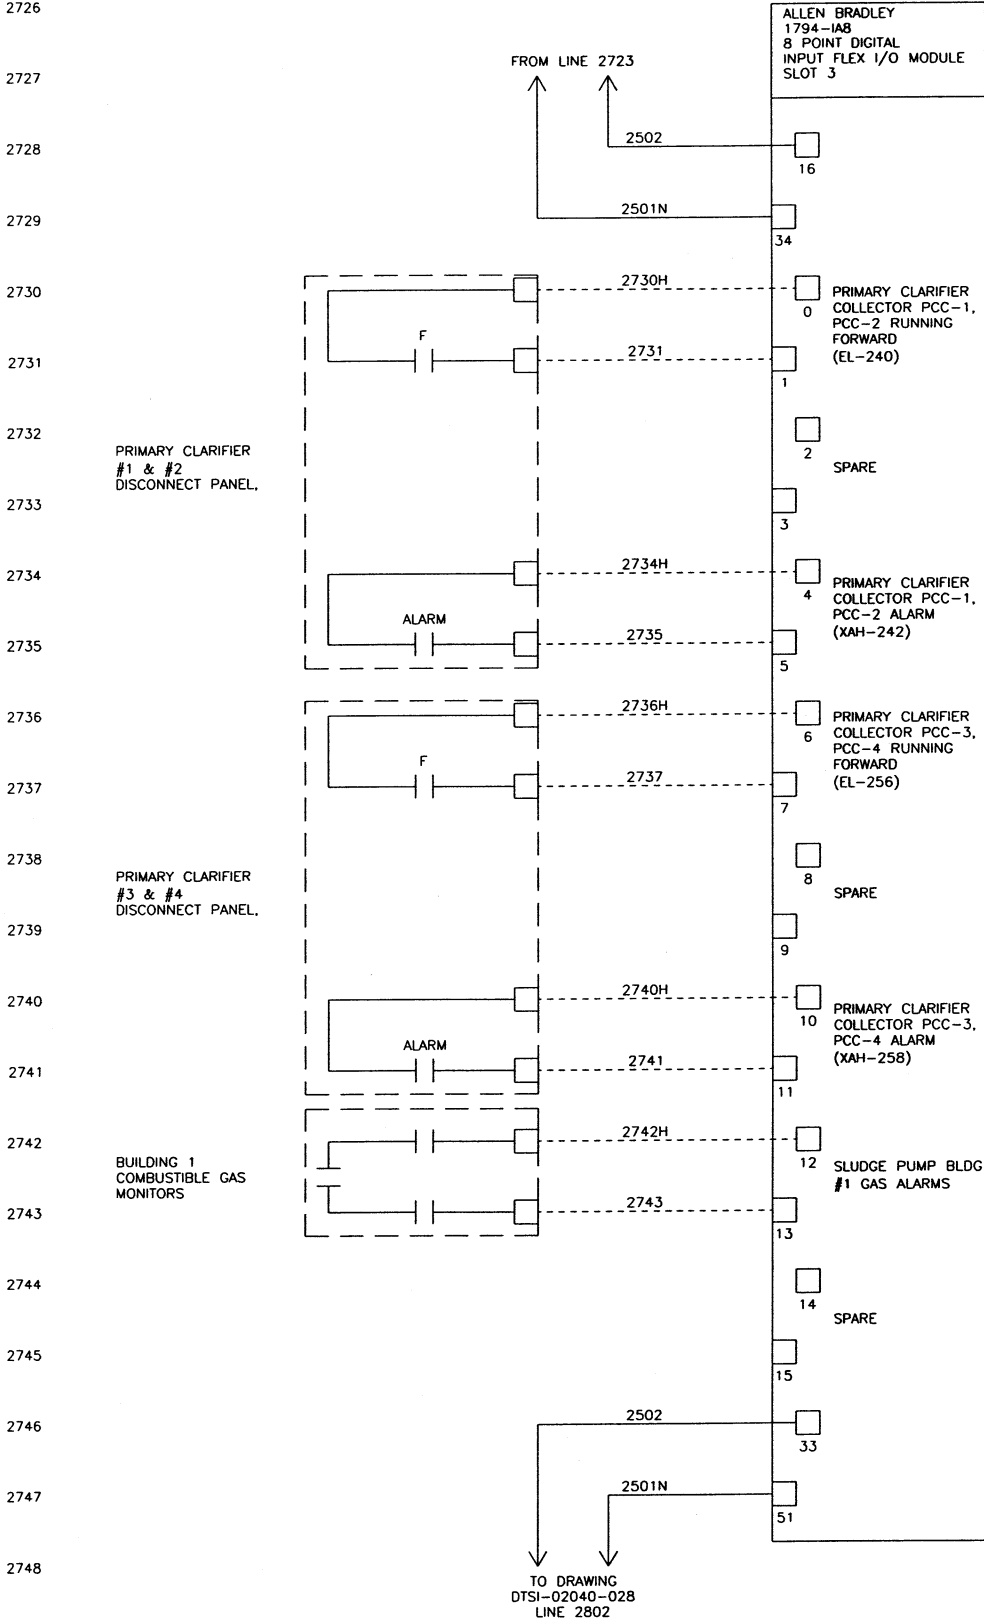


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

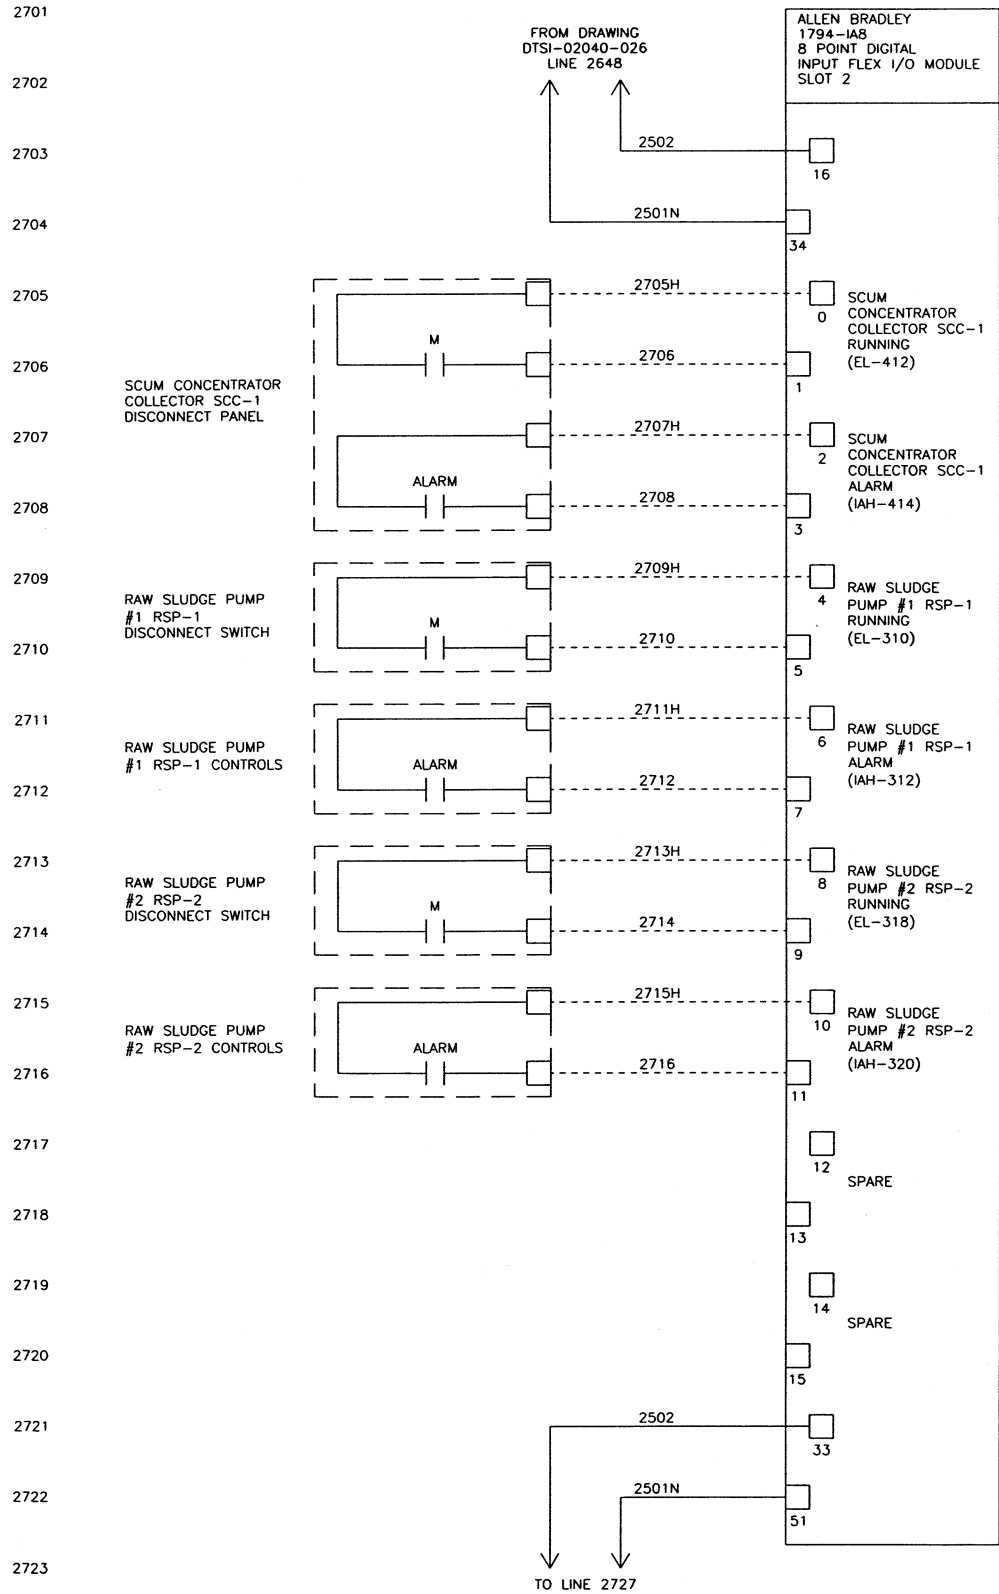

07/25/02 09:10

WIRE LUGS - NO ☒ YES ☐				RING ☐ LOCKING SPADE ☐			
INSULATION: NYLON ☐ PVC ☒							
WIRE SPECIFICATIONS:							
AC PANEL POWER	AWG #12	BLK.	THW/THIN	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THIN
AC PANEL GROUND	AWG #12	GRN.	THW/THIN	AC CONTROL POWER	AWG #14	RED	THW/THIN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THIN	AC FOREIGN	AWG #14	YELLOW	THW/THIN
DC POWER	AWG #16	BLUE	THW/THIN	DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THIN
				2 CONDUCTOR SHLD'D			



KOKOSING
CONSTRUCTION CO.
P.O. #

DUBLIN TECHNICAL
SYSTEMS, INC.
PROJECT # 02040

TOLERANCES	DUBLIN TECHNICAL SYSTEMS, INC.
± .03	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031
± .03	SCALE NONE
± 1/32"	DRAWN BY HR
± 1"	APPROVED BY BS
TITLE TRANS A2 NODE 2 PRIMARY TREATMENT I/O WIRING DIAGRAM SLOTS 2 & 3	
DATE 4/08/02	DRAWING NUMBER DTSI - 02040 - 027