


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

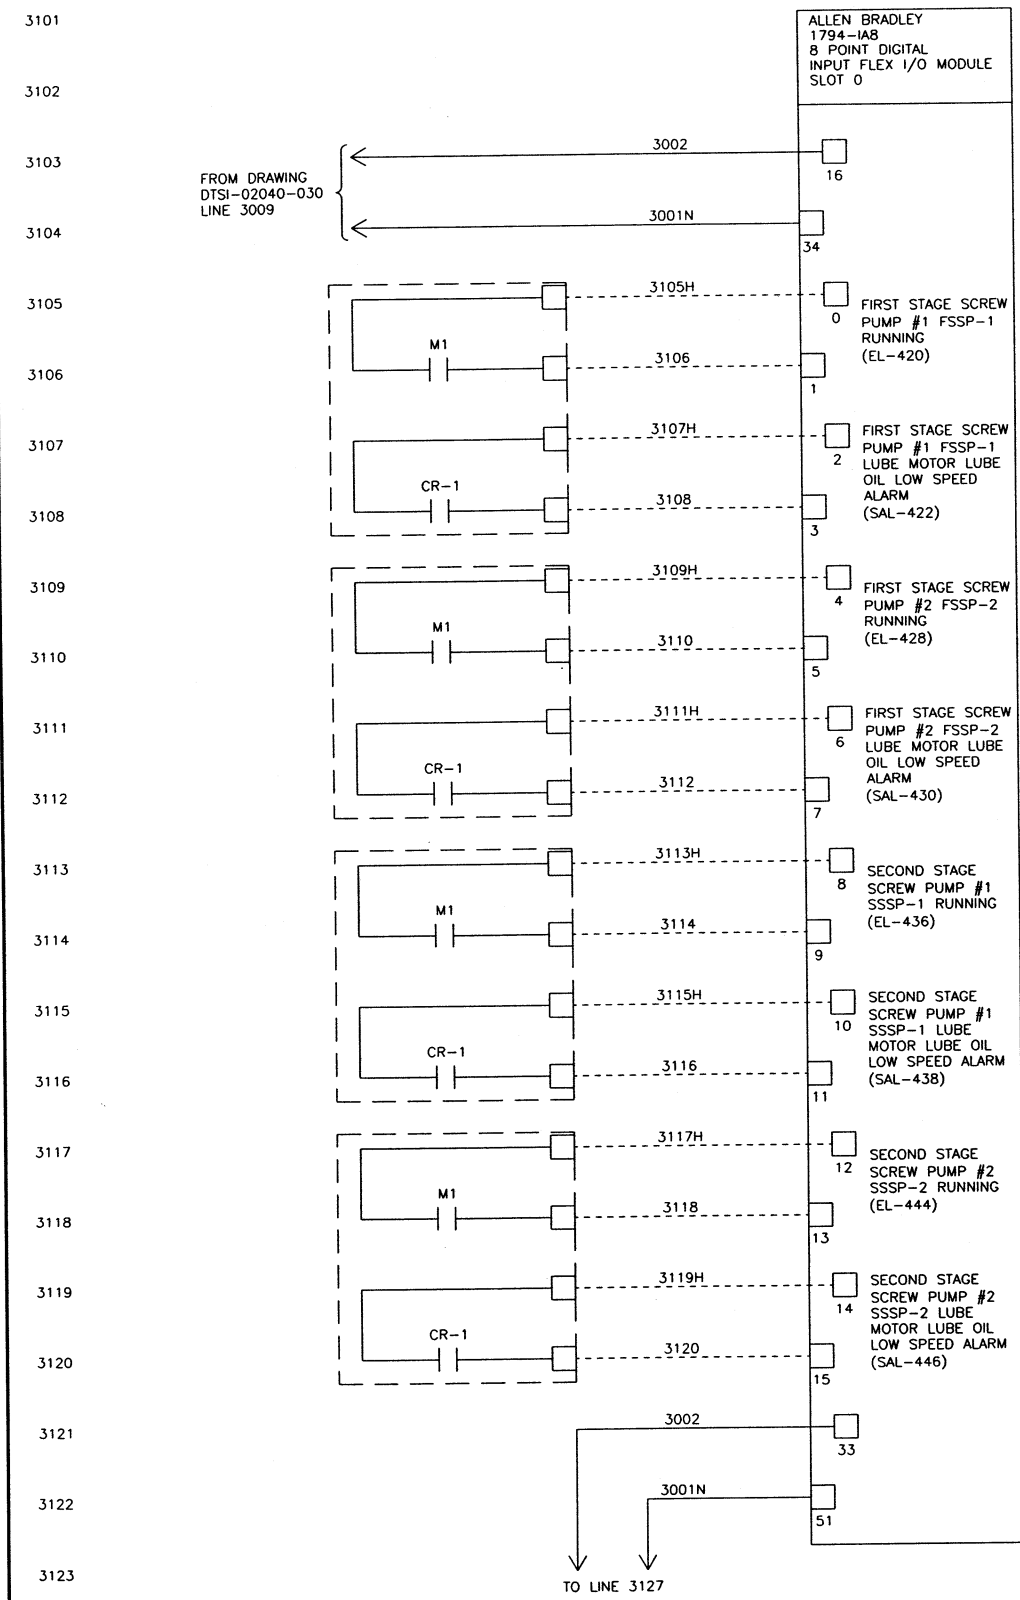

3126

3127

3128

3129

3130

3131

3132

3133

3134

3135

3136

3137

3138

3139

3140

3141

3142

3143

3144

3145

3146

3147

3148


3149


3150

VFD
MCC-B2, AERATION
TANK MIXER #1
CUBICLE 2C

VFD
MCC-B2, AERATION
TANK MIXER #2
CUBICLE 2H

VFD
MCC-B2, AERATION
TANK MIXER #3
CUBICLE 1D

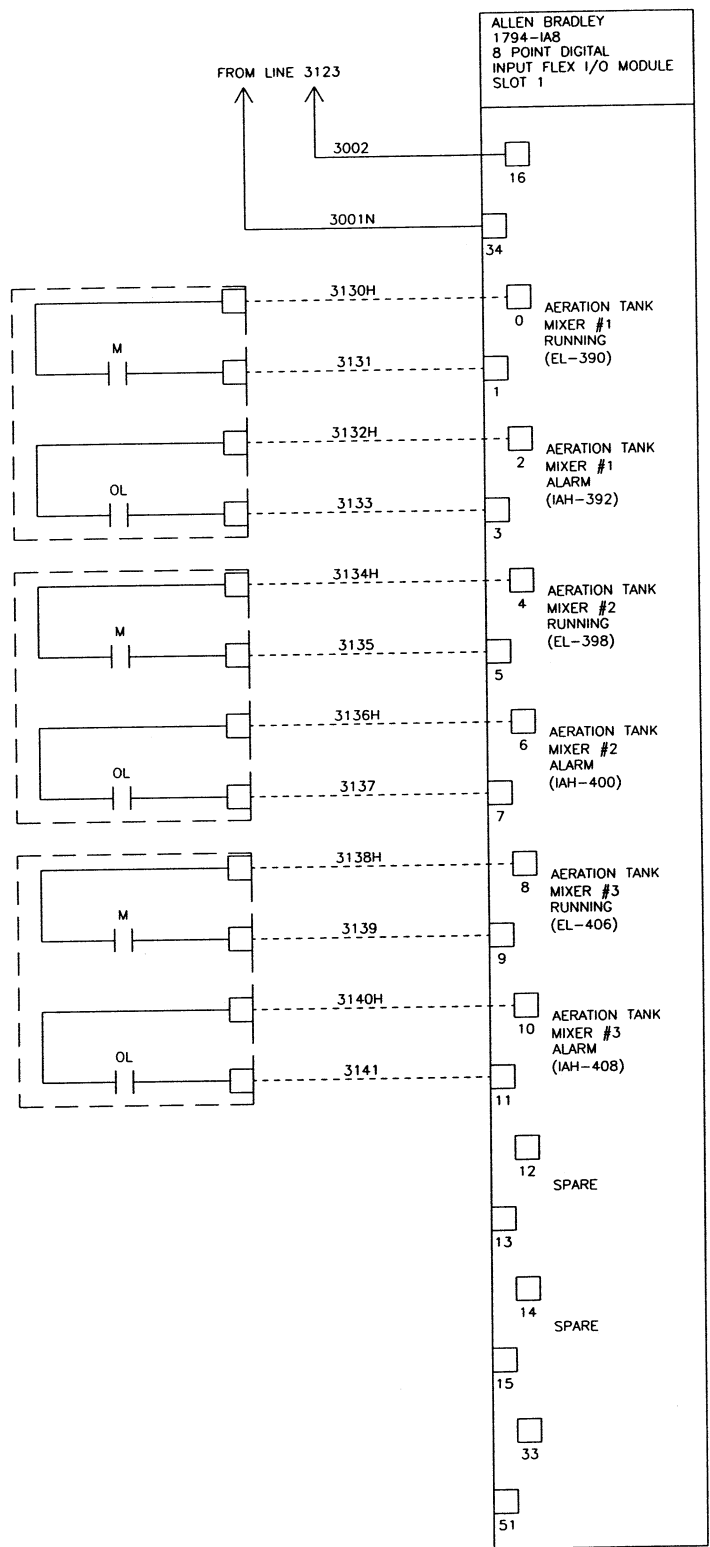

04/09/02 13:27	WIRE LUGS - NO ☒ YES ☐ RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES		 DUBLIN TECHNICAL SYSTEMS, INC.		
	INSULATION: NYLON ☐ PVC ☒				DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031		SCALE	DRAWN BY HR
	WIRE SPECIFICATIONS:				FRACTIONAL	TITLE		NONE	APPROVED BY BS
	USAGE				ANGULAR	DATE		DRAWING NUMBER	

SIZE	COLOR	INSULATION
AWG #12 BLK.	THW/THHN	
AWG #12 WHI.	THW/THHN	
AWG #12 GRN.	THW/THHN	
AWG #14 RED	THW/THHN	
AWG #14 WHI.	THW/THHN	
AWG #14 YELLOW	THW/THHN	
AWG #16 BLUE	THW/THHN	
AWG #16 BLUE	THW/THHN	
AWG #16 2 CONDUCTOR SHLD	THW/THHN	

DATE	4/08/02	DTSI - 02040 - 031	
------	---------	--------------------	--