
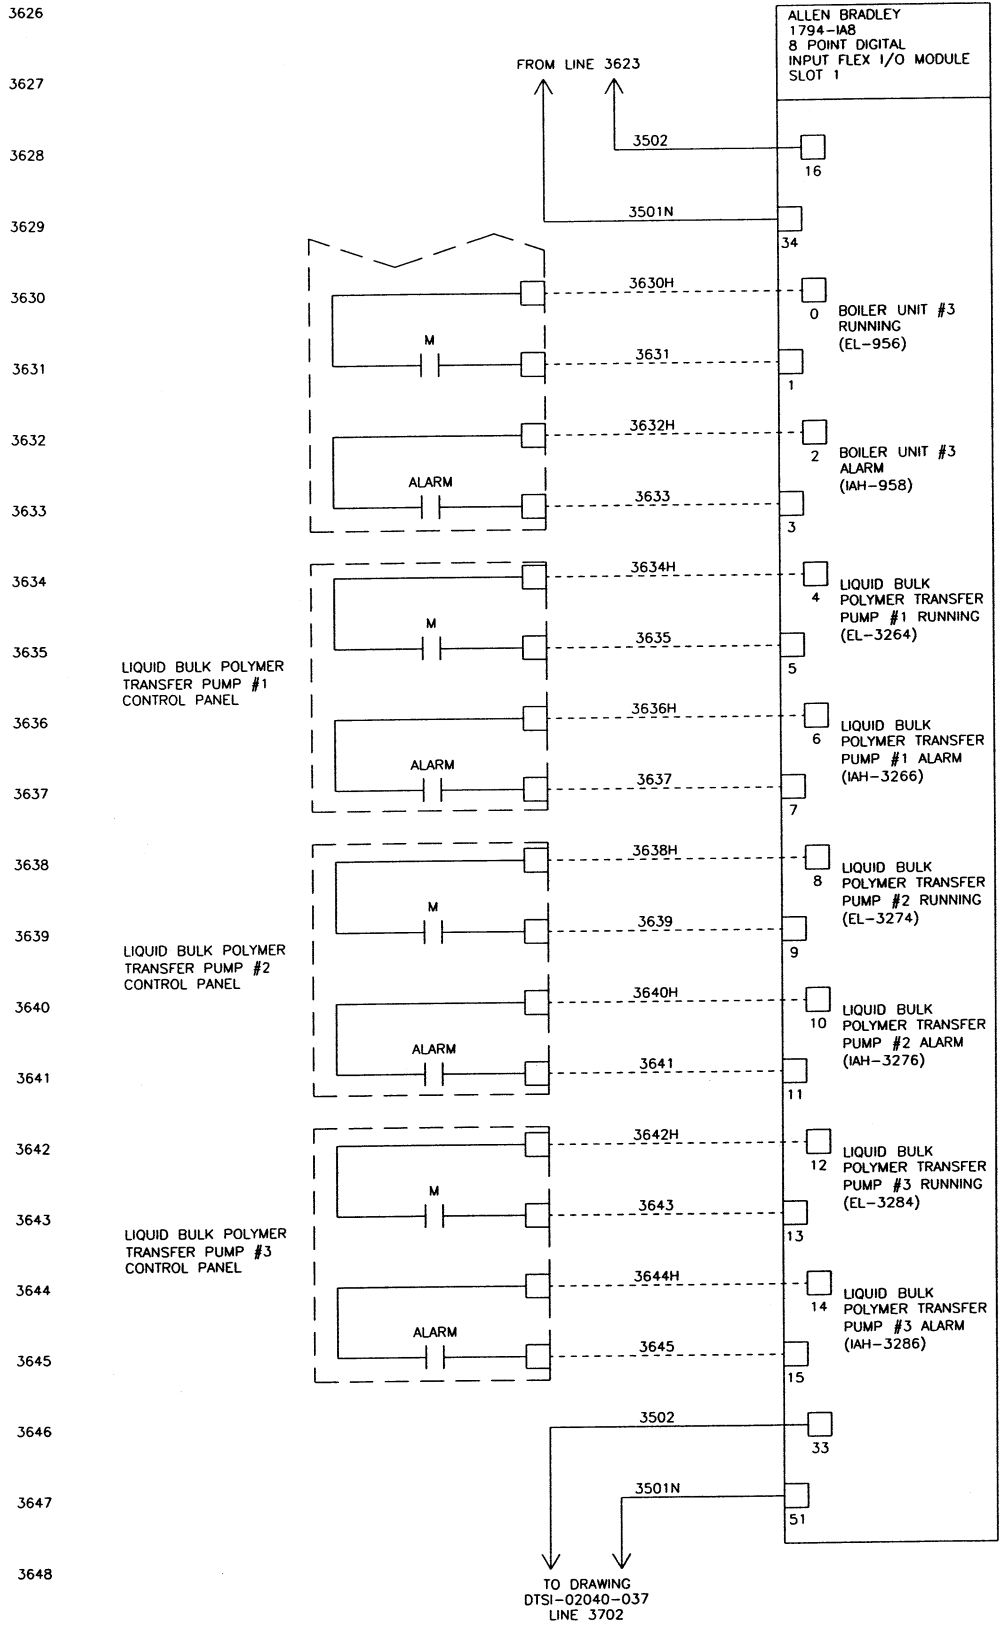
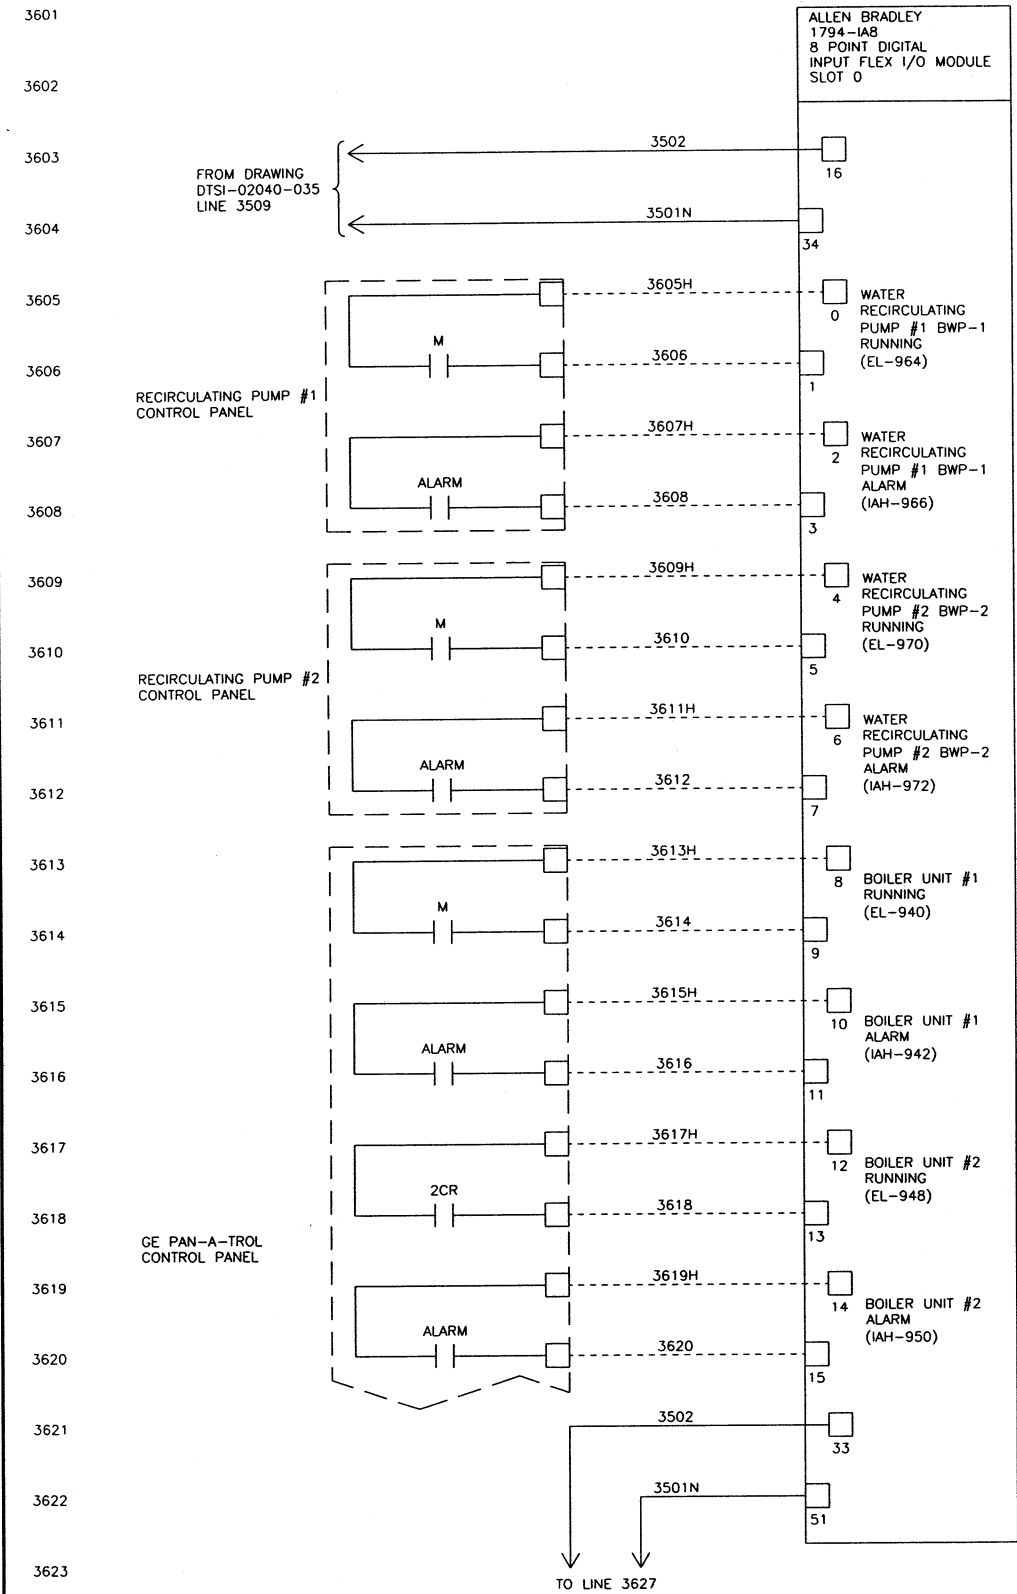



DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS



07/25/02 09:19	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES		 DUBLIN TECHNICAL SYSTEMS, INC.		
	INSULATION: NYLON ☐ PVC ☒						DECIMAL	CITY OF MASSILLON, OHIO	SCALE	DRAWN BY	HR
	WIRE SPECIFICATIONS:						± .03	REGIONAL WASTEWATER TREATMENT	NONE	APPROVED BY	BS
	USAGE						FRACTIONAL	PLANT - UPGRADE 2000			
	AC PANEL POWER						± 1/32"	PROJECT NO. E9031			
	AC PANEL NEUTRAL						ANGULAR				
	AC PANEL GROUND						± 1'				
	AC CONTROL POWER										
	AC CONTROL NEUTRAL										
	AC FOREIGN										
	DC POWER										
	DC CONTROL										
	SIGNAL/INSTRUMENTS										

SIZE	COLOR	INSULATION
AWG #12	BLK.	THW/THHN
AWG #12	WHI.	THW/THHN
AWG #12	GRN.	THW/THHN
AWG #14	RED	THW/THHN
AWG #14	WHI.	THW/THHN
AWG #14	YELLOW	THW/THHN
AWG #16	BLUE	THW/THHN
AWG #16	BLU	THW/THHN
AWG #16	2 CONDUCTOR SHLD	

DUBLIN TECHNICAL SYSTEMS INC.	
PROJECT # 02040	

TITLE	
TRANS DIA NODE 4 SOLIDS HANDLING UNIT #1	
I/O WIRING DIAGRAM SLOTS 0 & 1	
DATE	DRAWING NUMBER
4/08/02	DTSI - 02040 - 036