


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

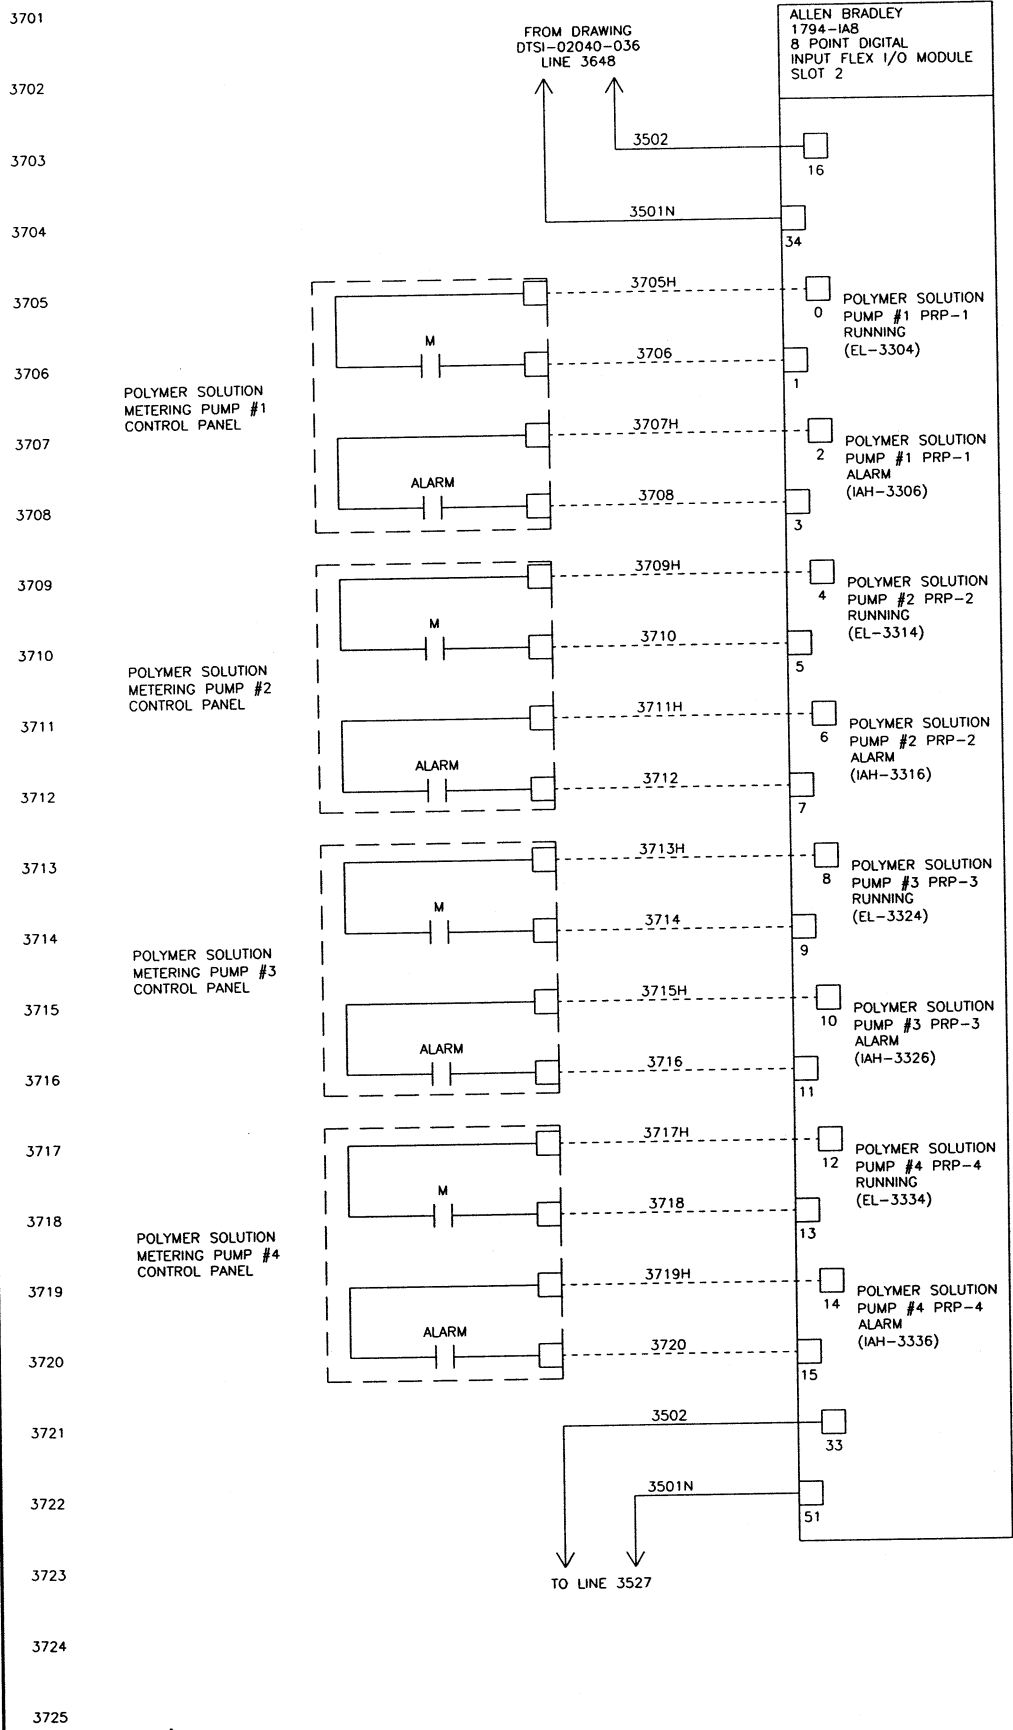

3726

3727

3728

3729

3730

3731

3732

3733

3734

3735

3736

3737

3738

3739

3740

3741

3742

3743

3744

3745


3746

3747

3748

3749

3750

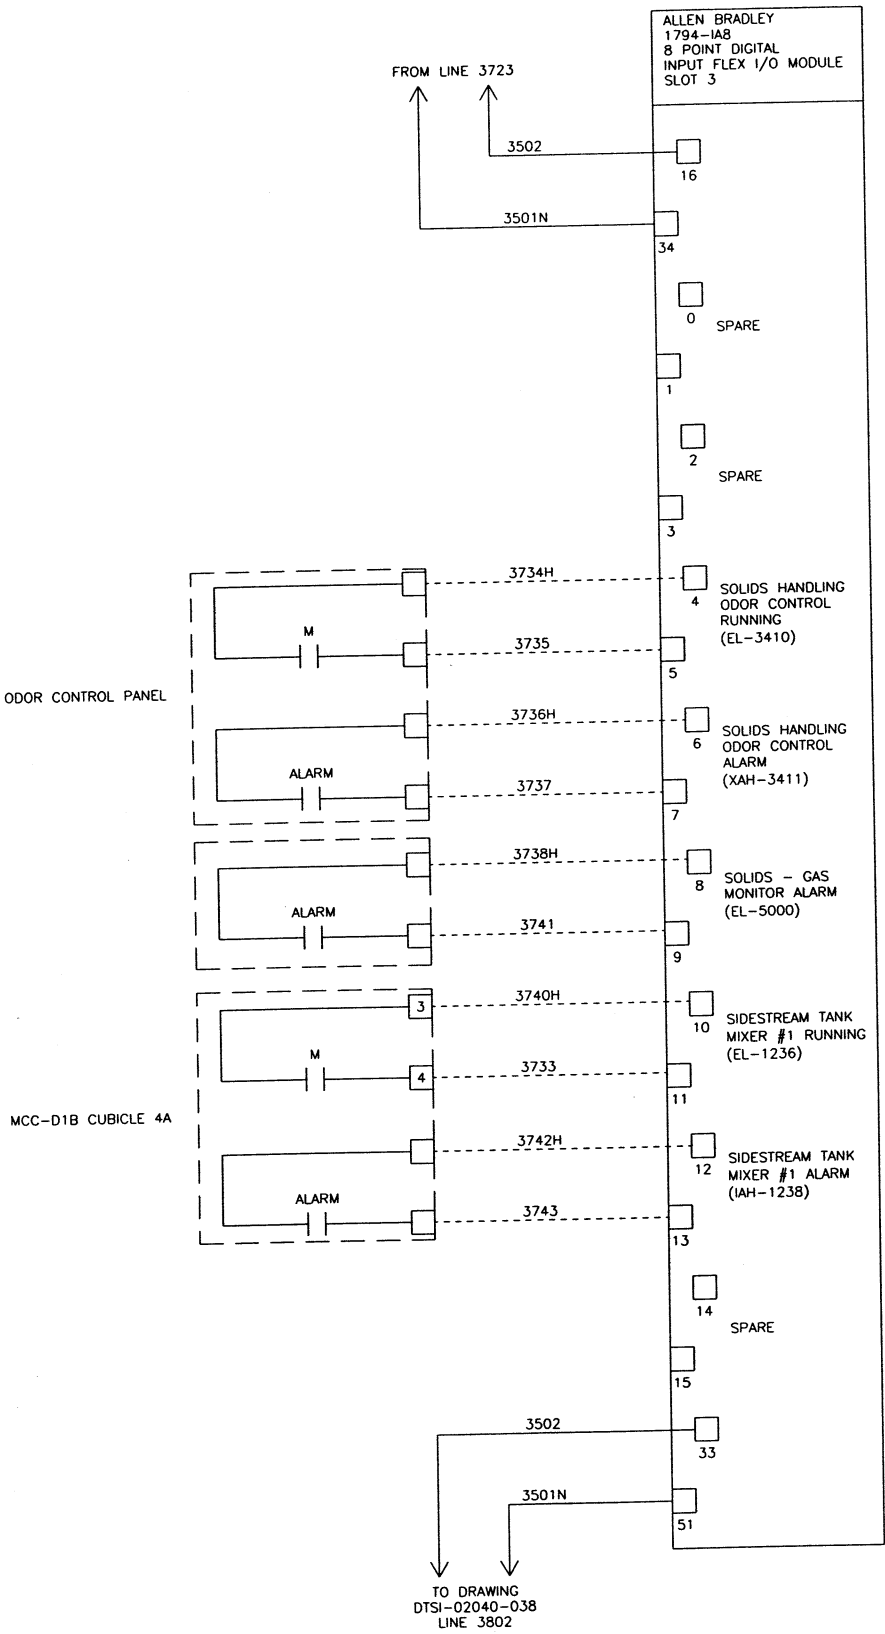

04/12/02 13:22	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐	
	INSULATION: NYLON ☐ PVC ☒			
	WIRE SPECIFICATIONS:			
	USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK	THW/THHN	
AC PANEL NEUTRAL	AWG #12	WHT	THW/THHN	
AC PANEL GROUND	AWG #12	GRN	THW/THHN	
AC CONTROL POWER	AWG #14	RED	THW/THHN	
AC CONTROL NEUTRAL	AWG #14	WHT	THW/THHN	
AC FOREIGN	AWG #14	YELLOW	THW/THHN	
DC POWER	AWG #16	BLUE	THW/THHN	
DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD	THW/THHN	
STATE OF OHIO REGISTERED PROFESSIONAL ENGINEER ROBERT A. LANDTHORN E-37992		KOKOSING CONSTRUCTION CO. P.O. #		
DUBLIN TECHNICAL SYSTEMS, INC. PROJECT # 02040		TOLERANCES DECIMAL ± .03 FRACTIONAL ± 1/32" ANGULAR ± 1"		
CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031		SCALE NONE DRAWN BY HR APPROVED BY BS		
TITLE TRANS D1A NODE 4 SOLIDS HANDLING UNIT #1 I/O WIRING DIAGRAM SLOTS 2 & 3		DATE 4/08/02 DRAWING NUMBER DTSI - 02040 - 037		