

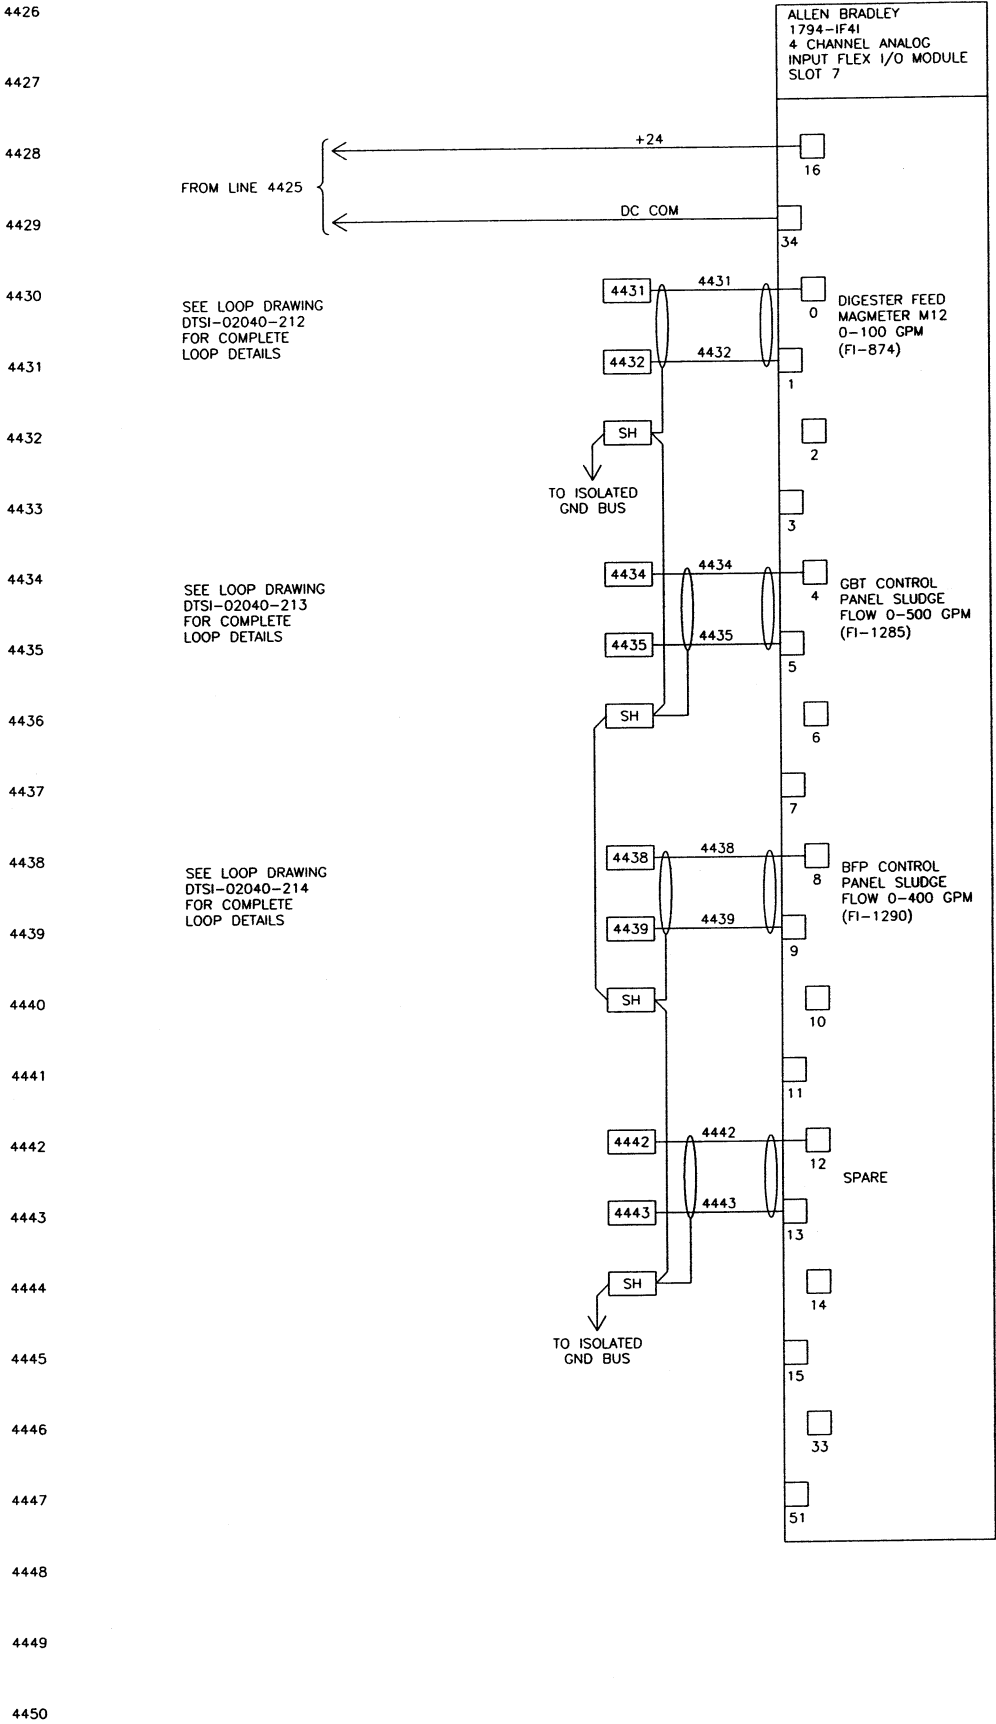


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

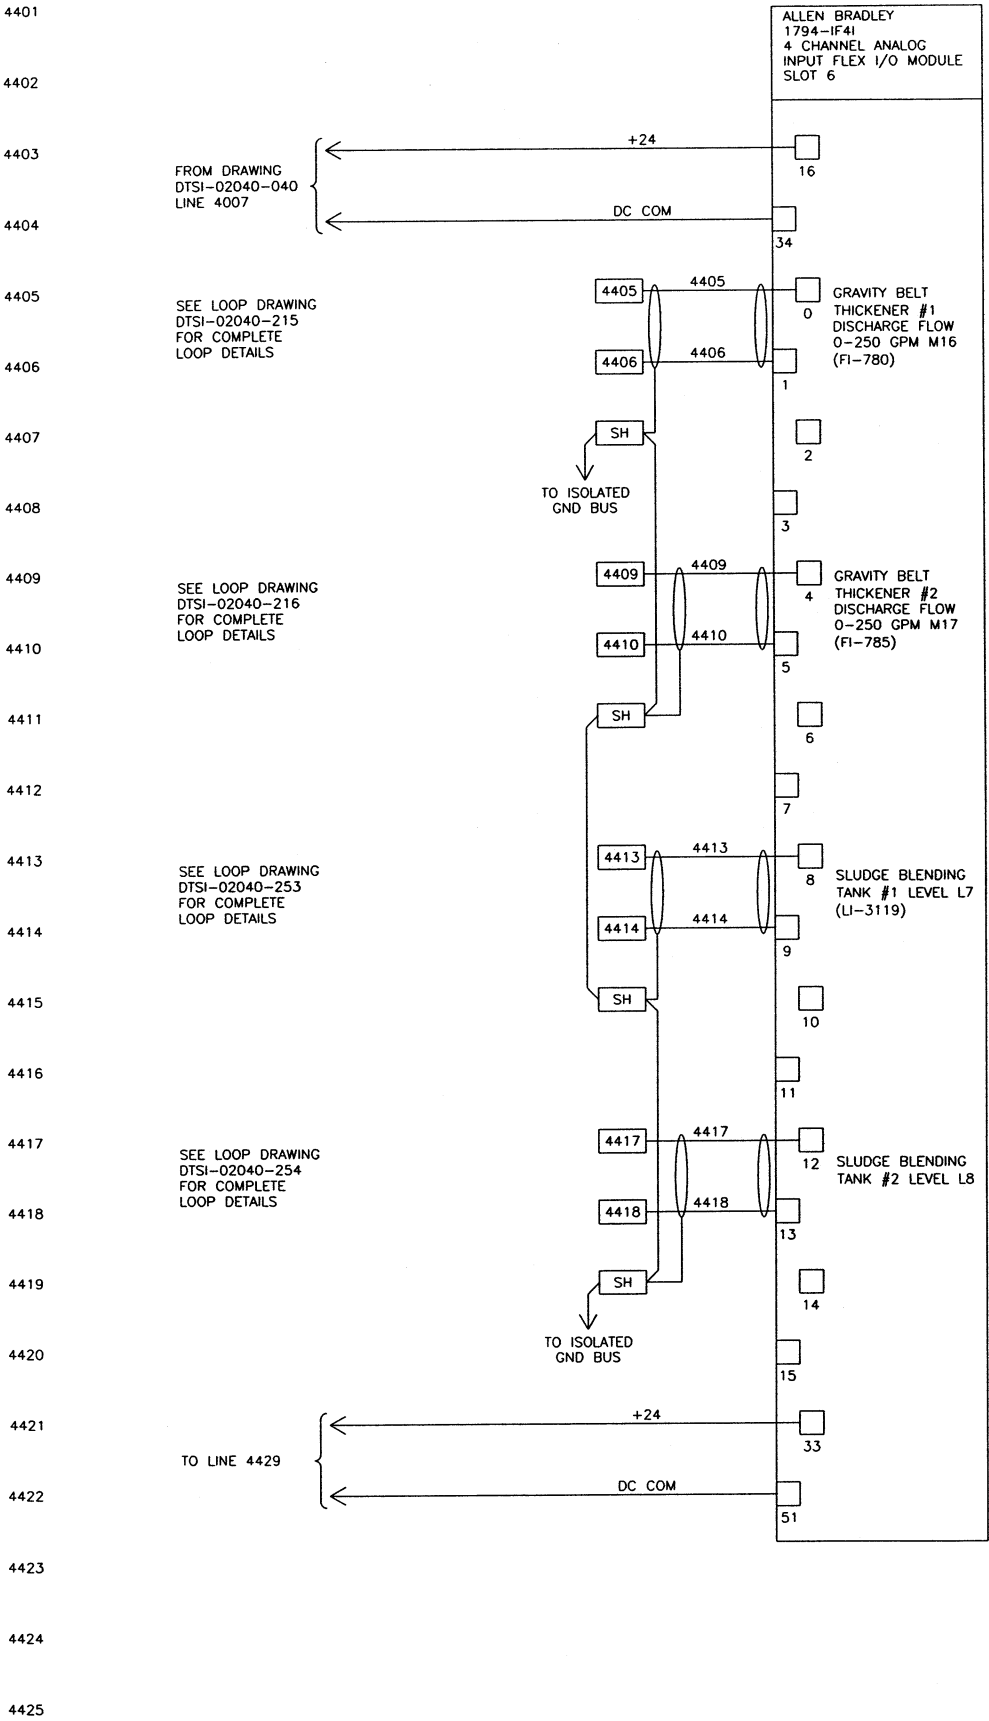

04/15/02 16:12

WIRE LUGS - NO ☒ YES ☐				RING ☐ LOCKING SPADE ☐			
INSULATION: NYLON ☐ PVC ☒							
WIRE SPECIFICATIONS:							
USAGE	SIZE	COLOR	INSULATION				
AC PANEL POWER	AWG #12	BLK	THW/THHH				
AC PANEL NEUTRAL	AWG #12	WHT	THW/THHH				
AC PANEL GROUND	AWG #12	GRN	THW/THHH				
AC CONTROL POWER	AWG #14	RED	THW/THHH				
AC CONTROL NEUTRAL	AWG #14	WHT	THW/THHH				
AC FORECH	AWG #14	YELLOW	THW/THHH				
DC POWER	AWG #16	BLUE	THW/THHH				
DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THHH				
				2 CONDUCTOR SHLD			



KOKOSING
CONSTRUCTION CO.
P.O. #

DUBLIN TECHNICAL
SYSTEMS INC.
PROJECT # 02040

TOLERANCES		DUBLIN TECHNICAL SYSTEMS, INC.	
±	DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. 02031	SCALE NONE
± .03	FRACTIONAL	TITLE TRANS D1B NODE 5 SOLIDS HANDLING UNIT #2 I/O WIRING DIAGRAM SLOTS 6 & 7	DRAWN BY HR
± 1/32"	ANGULAR	DATE 4/08/02	APPROVED BY BS
± 1"		DRAWING NUMBER DTSI - 02040 - 044	