
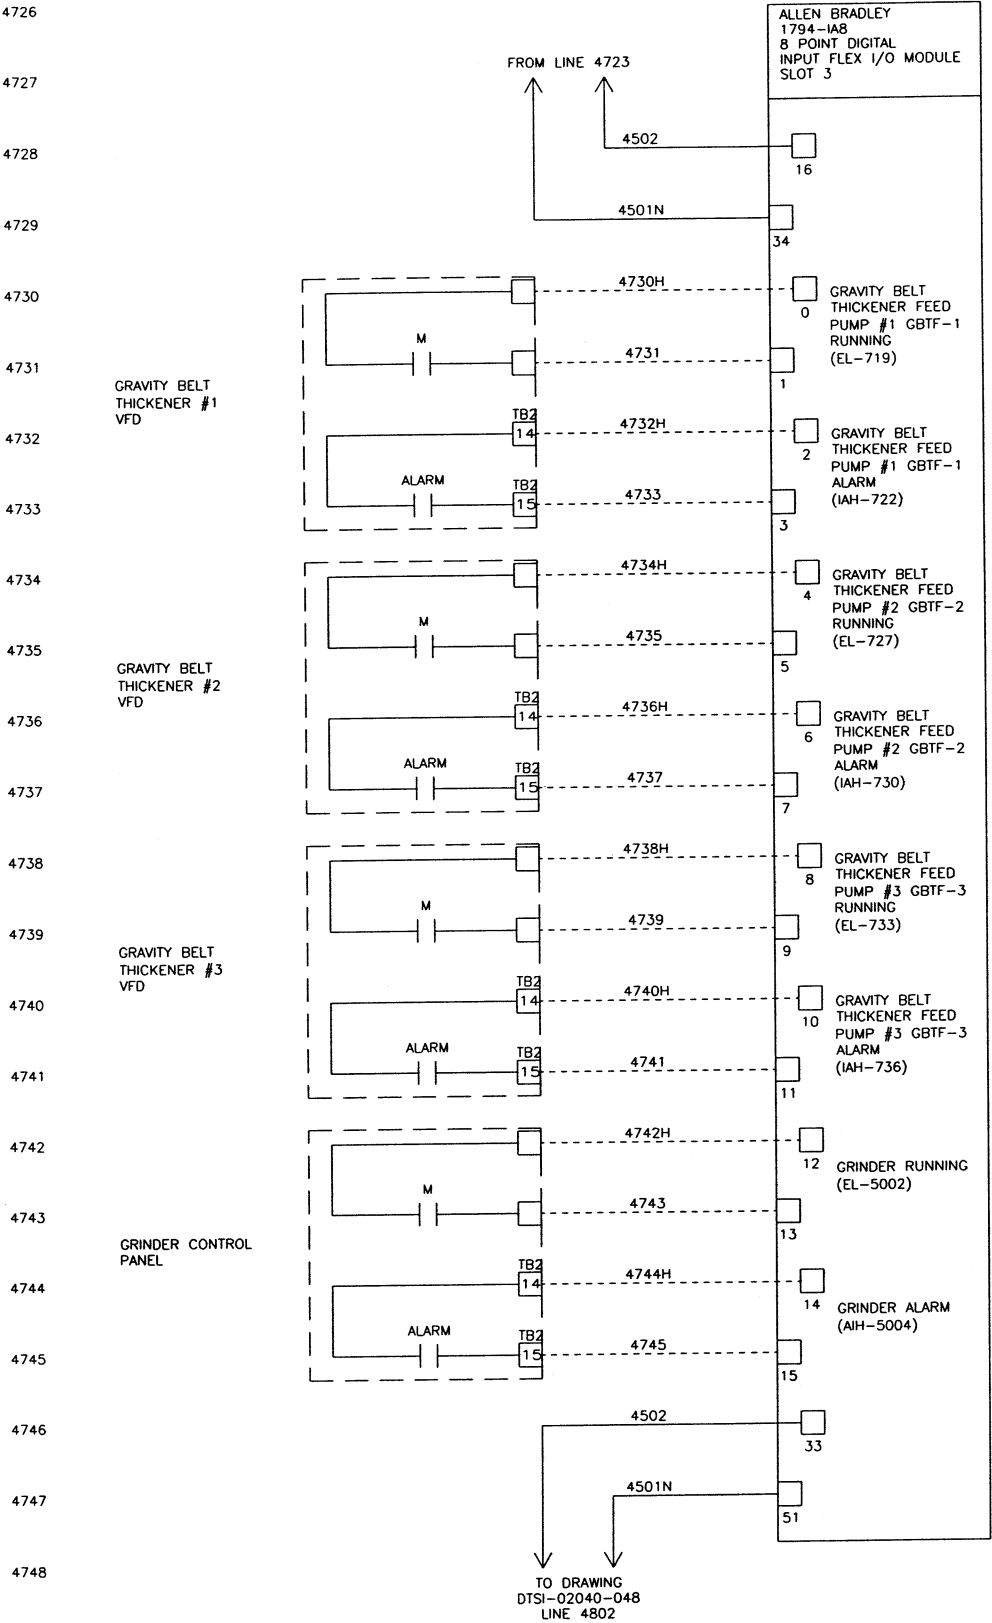


DATE	SYM	REVISION	RECORD	AUTH	DR	CK
4/08/02	A	FOR APPROVAL		CUST	HR	BS

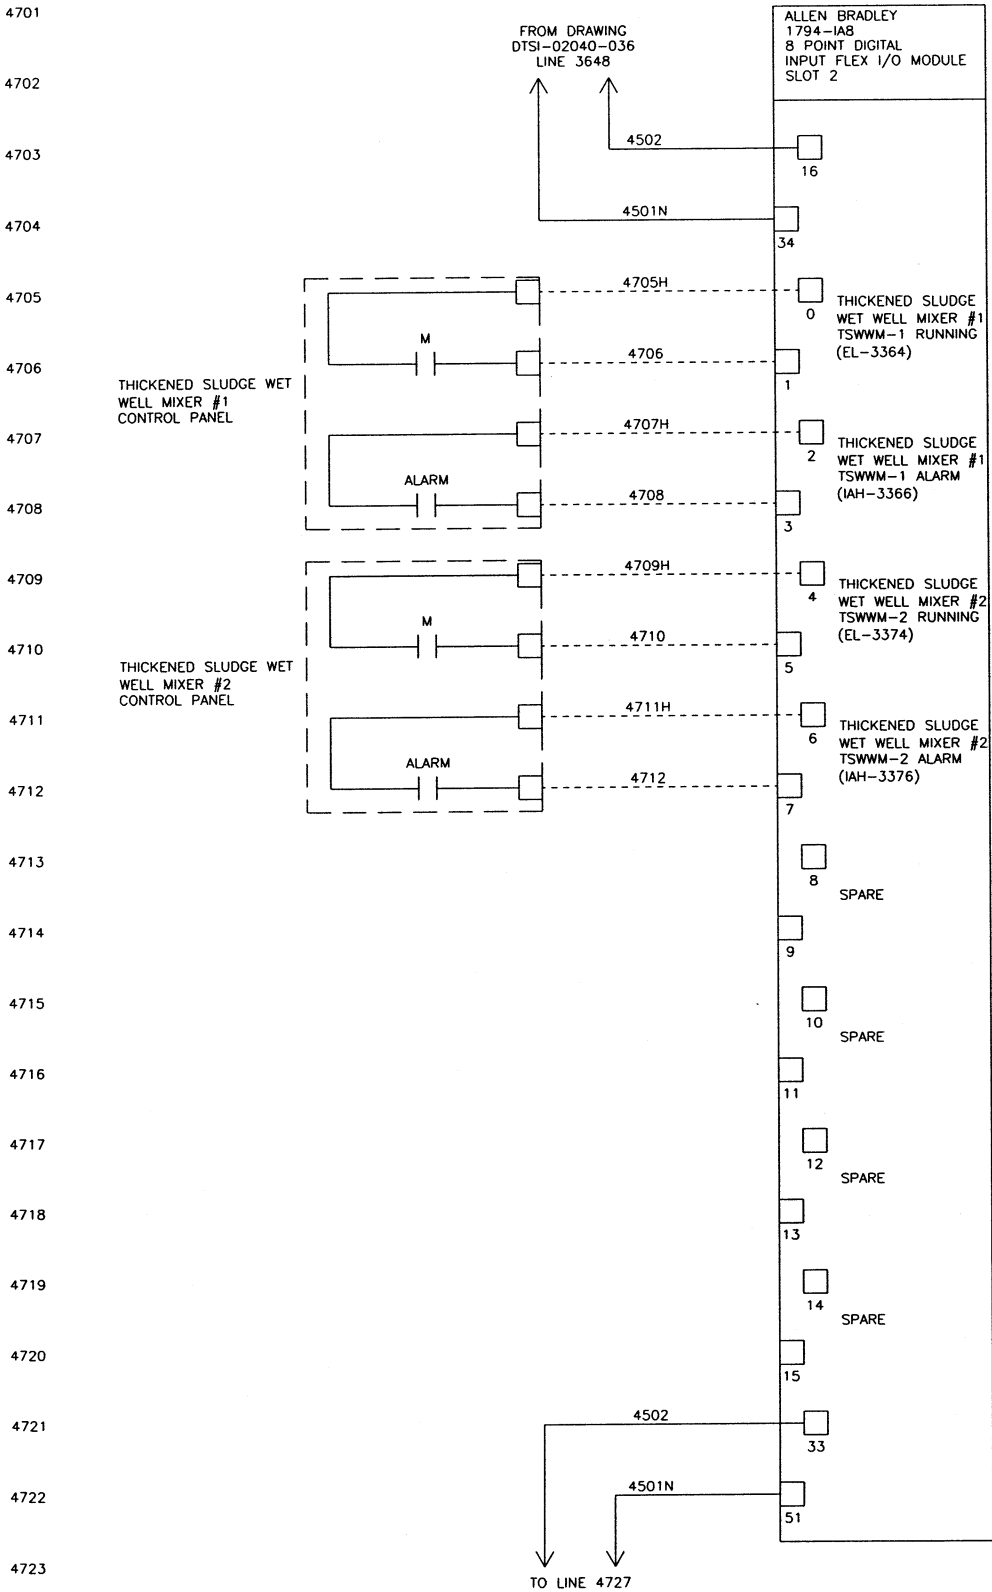

10/29/02 11:53

WIRE LUGS - NO ☒ YES ☐

INSULATION: NYLON ☐ PVC ☒

WIRE SPECIFICATIONS:

USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN.	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FOREIGN	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THHN

WIRE LUGS - NO ☒ YES ☐

INSULATION: NYLON ☐ PVC ☒

WIRE SPECIFICATIONS:

USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN.	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FOREIGN	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THHN

STATE OF OHIO

ROBERT A. LANDTHORN

E-37992

REGISTERED PROFESSIONAL ENGINEER

KOKOSING CONSTRUCTION CO.

P.O. #

DUBLIN TECHNICAL SYSTEMS INC.

PROJECT # 02040

TOLERANCES

+	DECIMAL	± .03
+	FRACTIONAL	± 1/32"
+	ANGULAR	± 1°

DUBLIN TECHNICAL SYSTEMS, INC.

CITY OF MASSILLON, OHIO	SCALE	DRAWN BY	HR
REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000	NONE	APPROVED BY	BS
PROJECT NO. E9031			

TITLE

TRANS D2A NODE 6 DIGESTER AREA I/O WIRING DIAGRAM SLOTS 2 & 3

DATE

4/08/02

DRAWING NUMBER

DTSI - 02040 - 047