
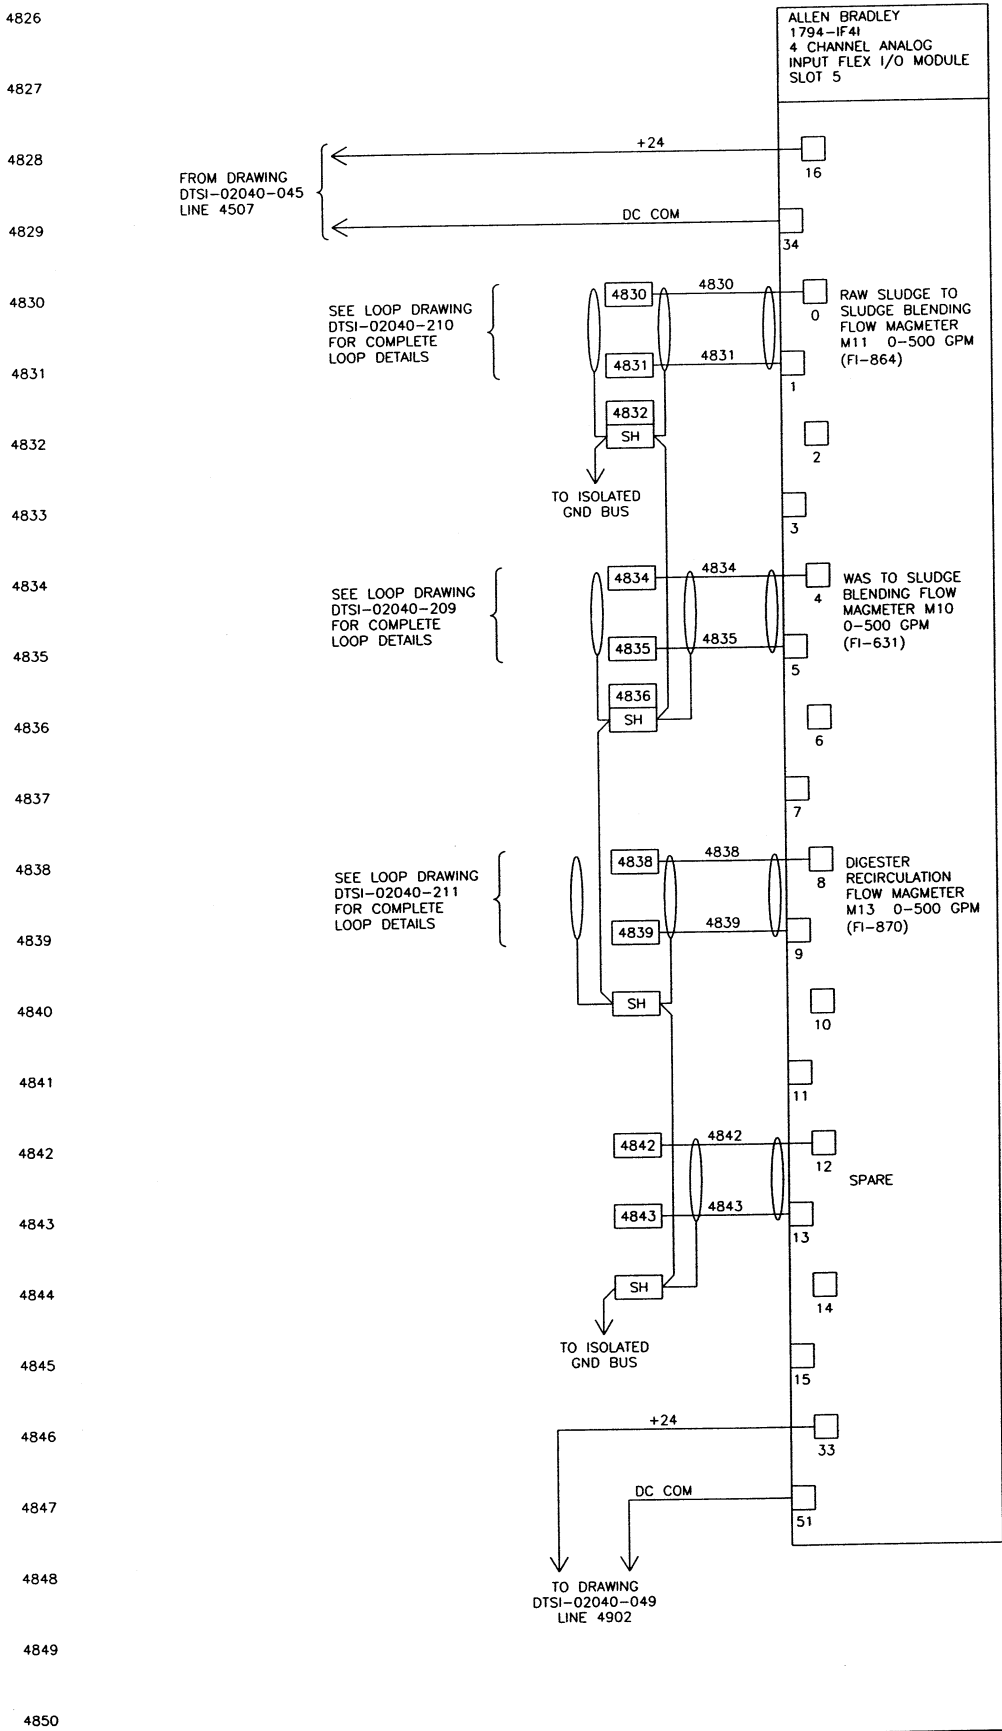


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

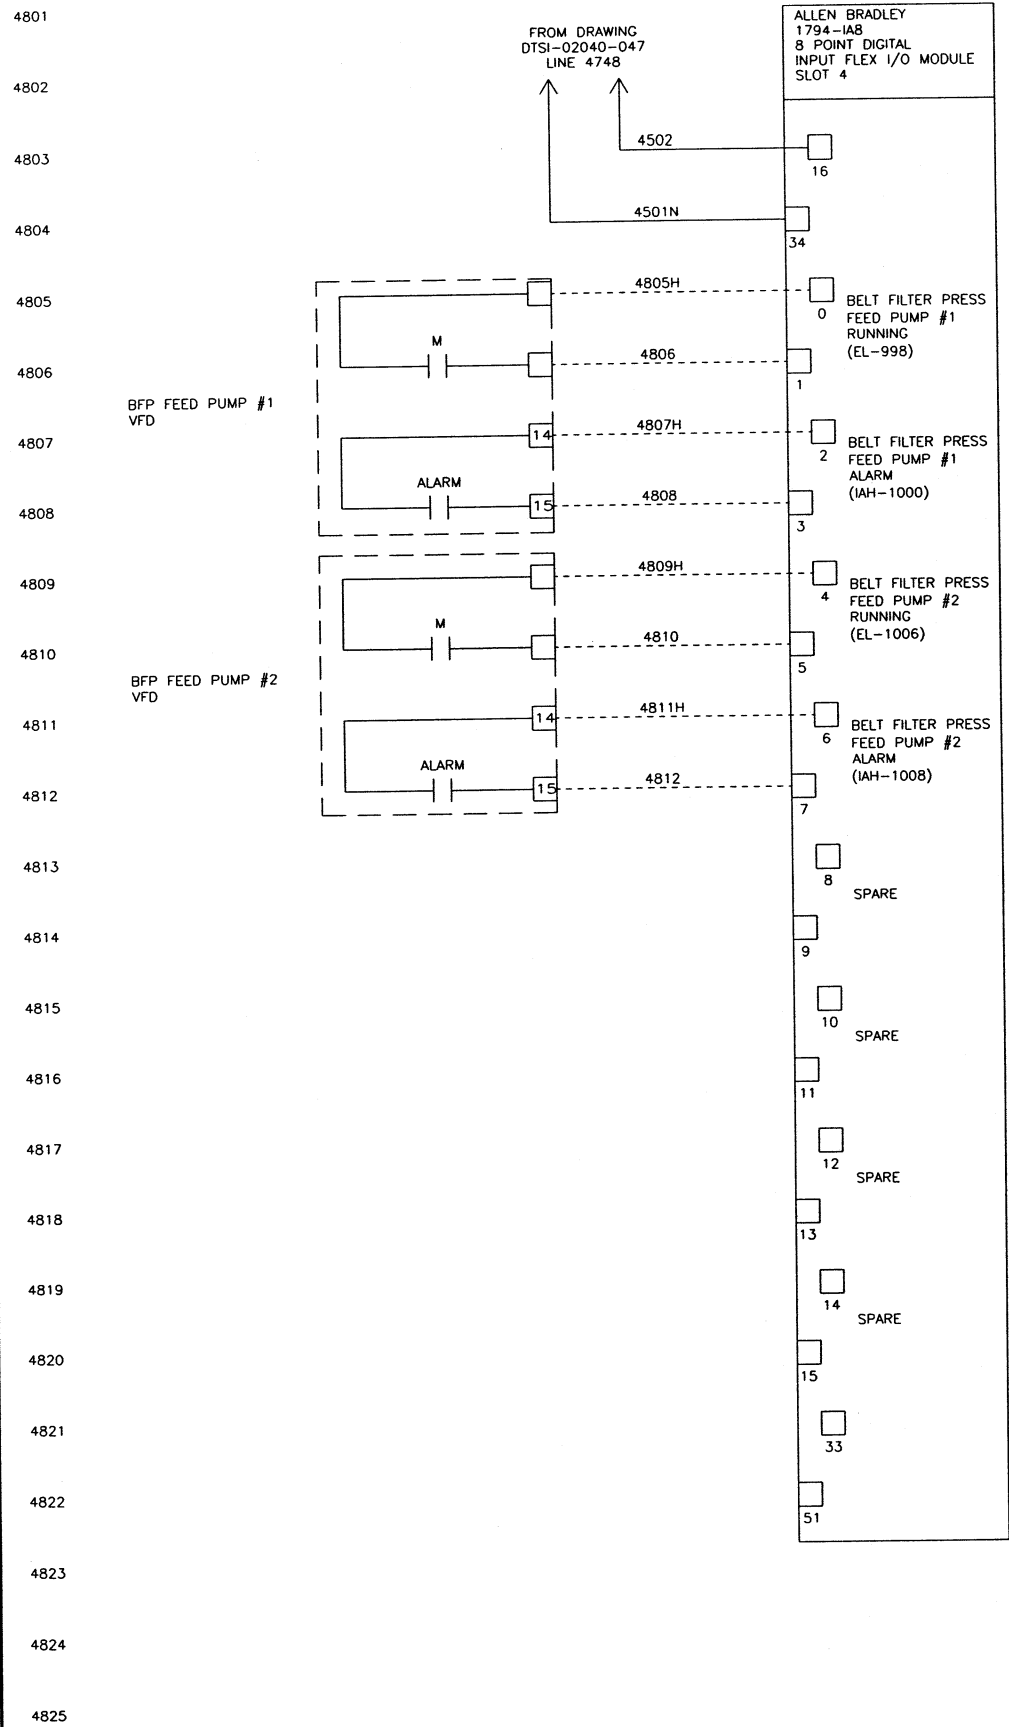

10/29/02 12:00	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. #	+ DECIMAL ± .03 FRACTIONAL ± 1/32" ANGULAR ± 1"	 DUBLIN TECHNICAL SYSTEMS, INC.			
	INSULATION: NYLON ☐ PVC ☒								CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031	SCALE NONE	DRAWN BY HR
	WIRE SPECIFICATIONS:								TITLE TRANS D2A NODE 6 DIGESTER AREA I/O WIRING DIAGRAM SLOTS 4 & 5		
	USAGE	SIZE	COLOR	INSULATION							DRAWING NUMBER DTSI - 02040 - 048
	AC PANEL POWER	AWG #12	BLK.	THW/THHN							
	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN							
	AC PANEL GROUND	AWG #12	GRN.	THW/THHN							
	AC CONTROL POWER	AWG #14	RED	THW/THHN							
	AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN							
	AC FOREIGN	AWG #14	YELLOW	THW/THHN							
DC POWER	AWG #18	BLUE	THW/THHN								
DC CONTROL	AWG #18	BLUE	THW/THHN								
SIGNAL/INSTRUMENTS	AWG #18	2 CONDUCTOR SHLD	THW/THHN								