
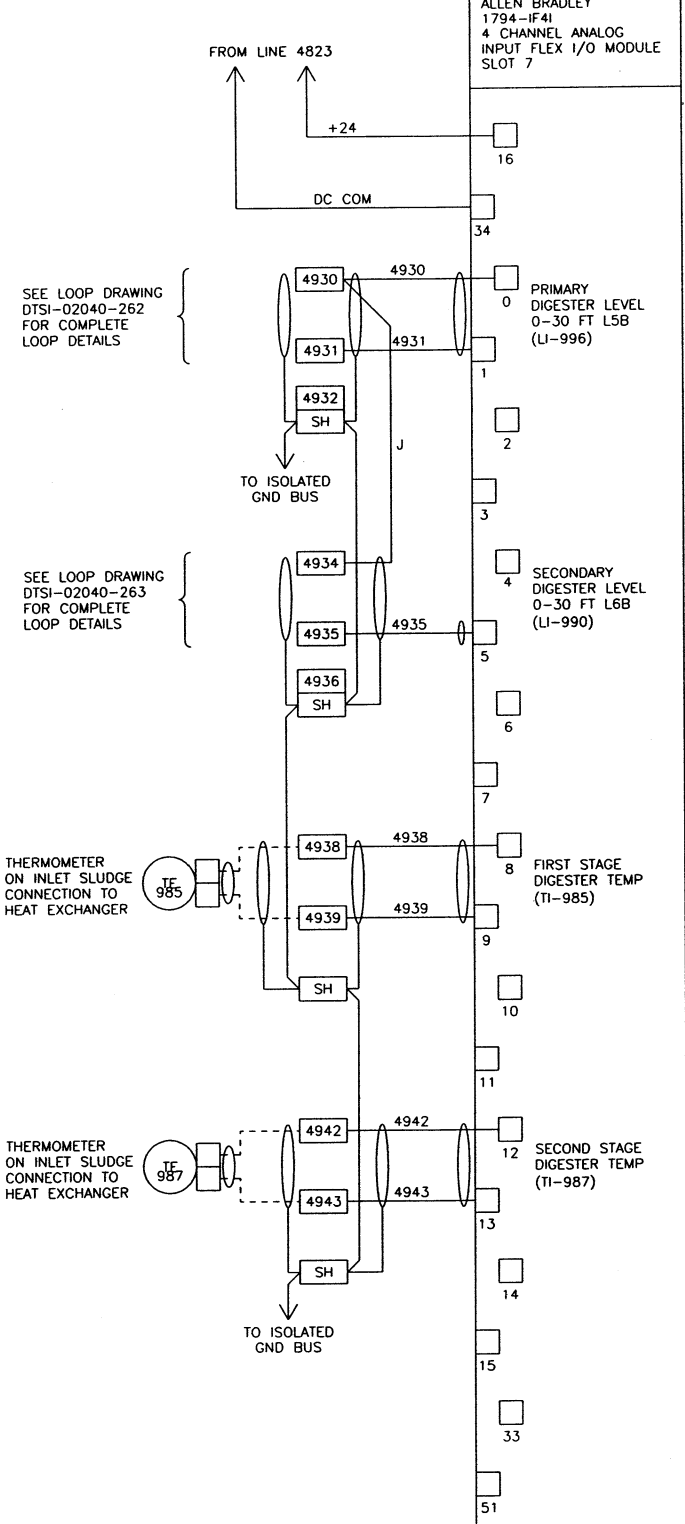


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

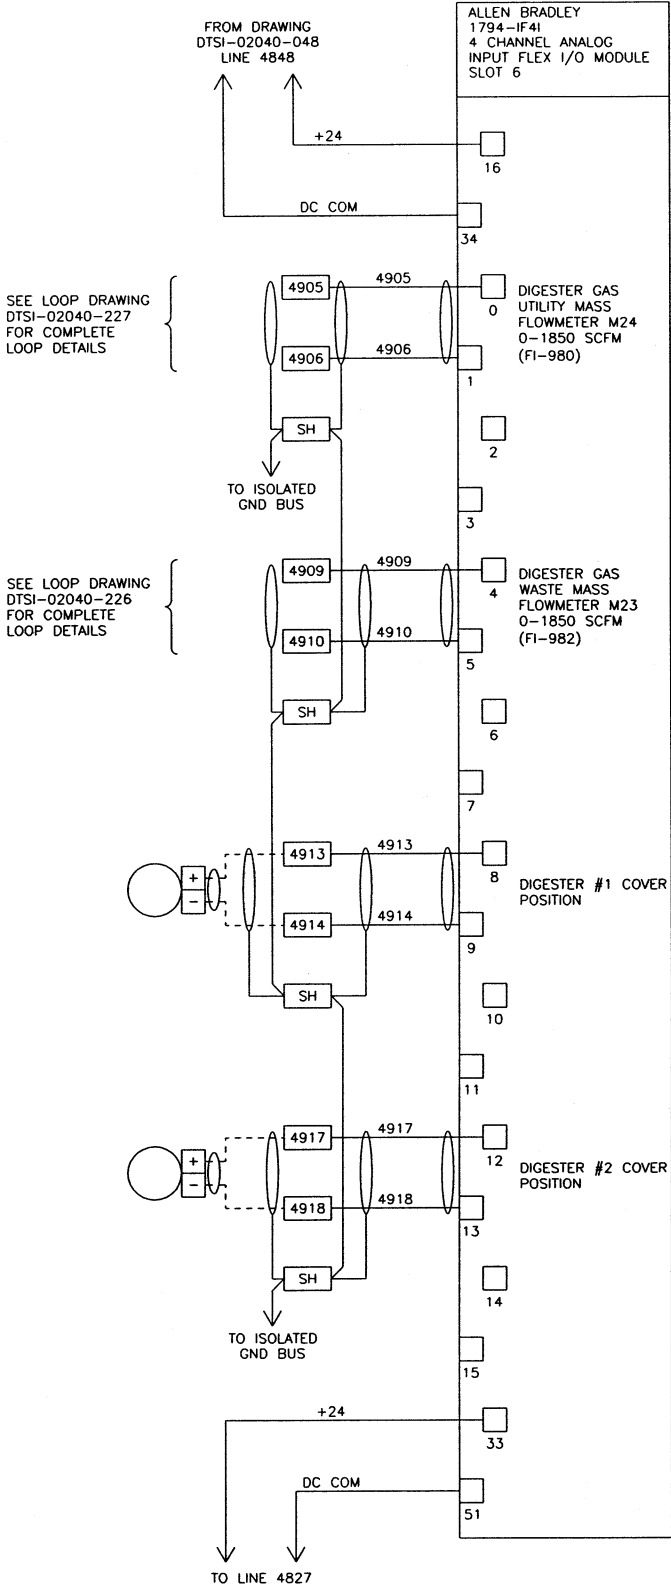

10/29/02 09:59	WIRE LUGS - NO ☒ YES ☐ RING ☐ LOCKING SPADE ☐ INSULATION: NYLON ☐ PVC ☒ WIRE SPECIFICATIONS: USAGE SIZE COLOR INSULATION AC PANEL POWER AWG #12 BLK. THW/THHN AC PANEL NEUTRAL AWG #12 WHT. THW/THHN AC PANEL GROUND AWG #12 GRN. THW/THHN AC CONTROL POWER AWG #14 RED THW/THHN AC CONTROL NEUTRAL AWG #14 WHT. THW/THHN AC FOREIGN AWG #14 YELLOW THW/THHN DC POWER AWG #16 BLUE THW/THHN DC CONTROL SIGNAL/INSTRUMENTS AWG #16 BLUE THW/THHN 2 CONDUCTOR SHLD	STATE OF OHIO ROBERT A. LANDTHORN E-37992 REGISTERED PROFESSIONAL ENGINEER	KOKOSING CONSTRUCTION CO. P.O. # DUBLIN TECHNICAL SYSTEMS, INC. PROJECT # 02040	TOLERANCES DECIMAL + .03 FRACTIONAL + 1/32" ANGULAR + 1"	DUBLIN TECHNICAL SYSTEMS, INC. CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031 TITLE TRANS D2A NODE 6 DIGESTER AREA I/O WIRING DIAGRAM SLOTS 6 & 7 DATE 4/08/02 DRAWING NUMBER DTSI - 02040 - 049	SCALE NONE DRAWN BY HR APPROVED BY BS
----------------	--	---	--	--	--	--