


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

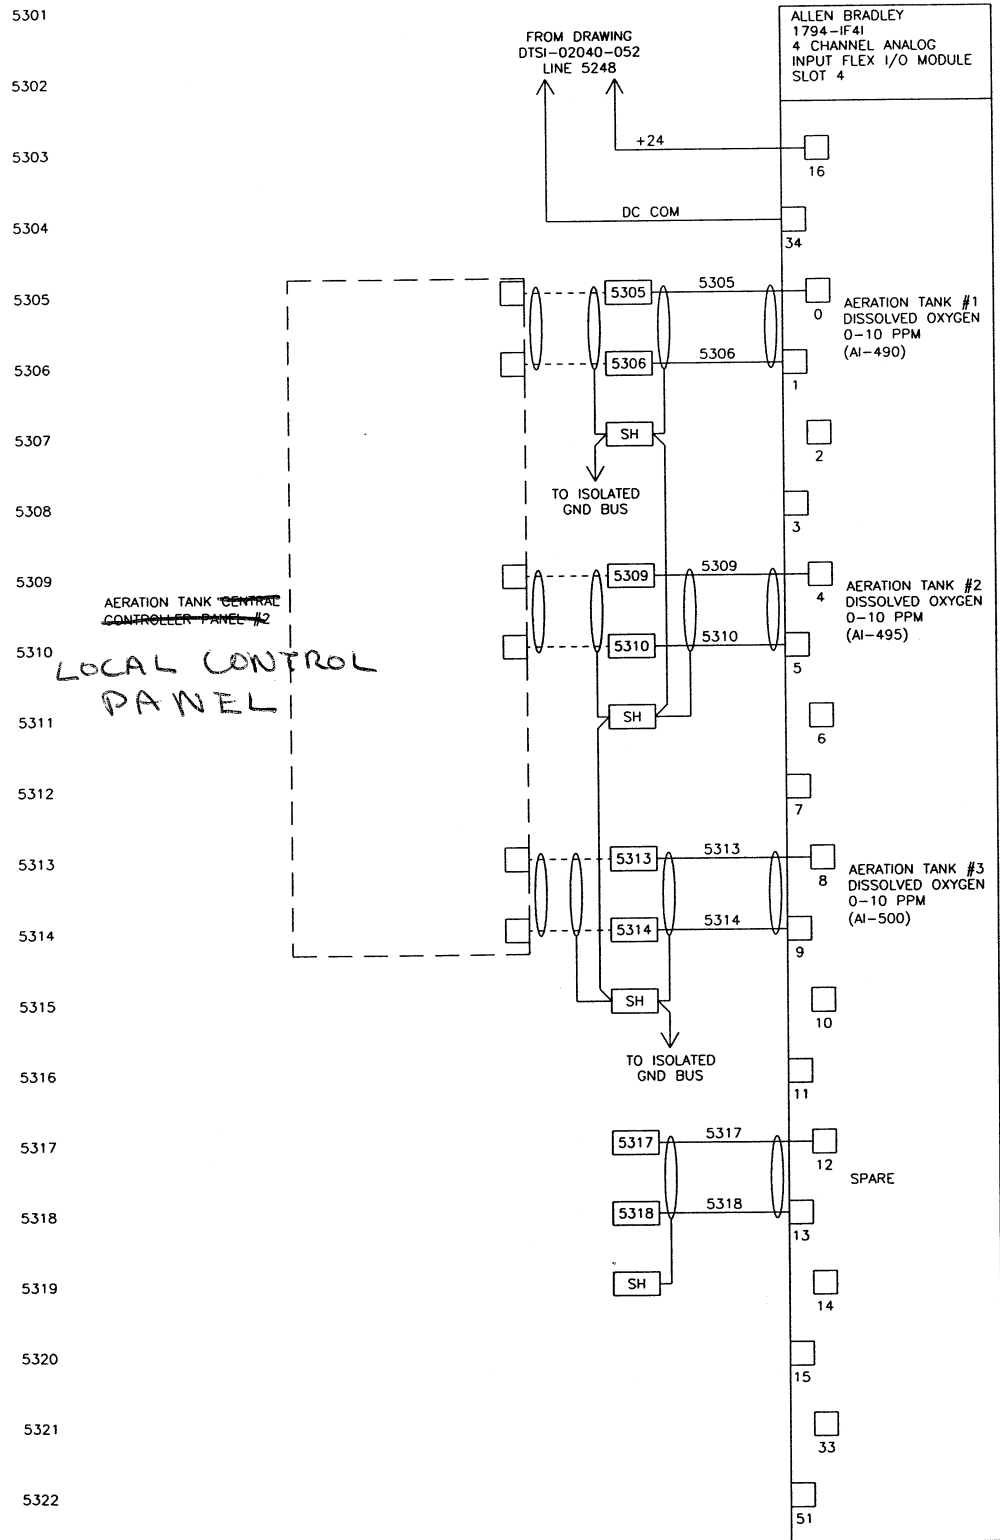

5326

5327

5328

5329

5330

5331

5332

5333

5334

5335

5336

5337

5338

5339

5340

5341

5342

5343

5344

5345


5346

5347

5348

5349

5350

06/03/03 10:18	WIRE LUGS - NO ☒ YES ☐ RING ☐ LOCKING SPADE ☐		 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES		 DUBLIN TECHNICAL SYSTEMS, INC.
	INSULATION: NYLON ☐ PVC ☒			DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. 63031	
	WIRE SPECIFICATIONS:			FRACTIONAL	TITLE	
	USAGE	SIZE	COLOR	INSULATION	TRANS E1 & E2 NODE 7 BLOWER BUILDING I/O WIRING DIAGRAM SLOT 4	
	AC PANEL POWER	AWG #12	BLK.	THW/THHN		
	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN		
	AC PANEL GROUND	AWG #12	GRN.	THW/THHN		
	AC CONTROL POWER	AWG #14	RED	THW/THHN		
	AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN		
	AC FOREIGN	AWG #14	YELLOW	THW/THHN		
	DC POWER	AWG #18	BLUE	THW/THHN		
	DC CONTROL SIGNAL/INSTRUMENTS	AWG #18	BLUE	THW/THHN		
		AWG #16	2 CONDUCTOR SHLD	THW/THHN		
					DATE	DRAWING NUMBER
					4/08/02	DTSI - 02040 - 053