


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS

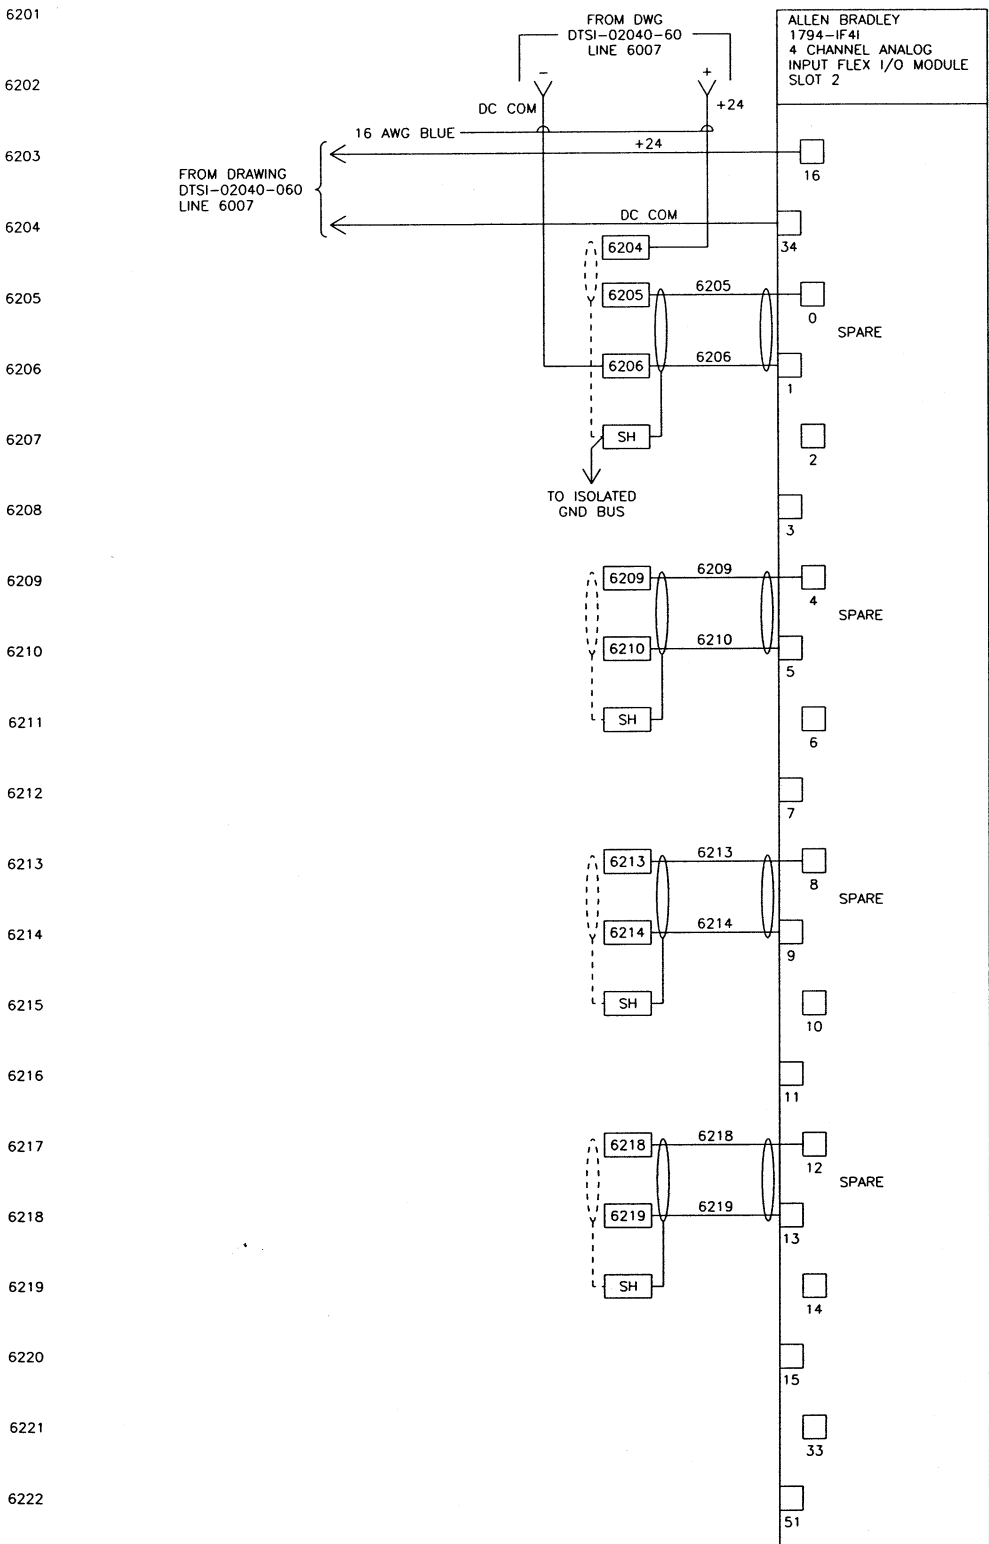

6226

6227

6228

6229

6230

6231

6232

6233

6234

6235

6236

6237

6238

6239

6240

6241

6242

6243

6244

6245

6246


6247

6248

6249

6250

06/03/03 10:29	WIRE LUGS - NO ☒ YES ☐	RING ☐ LOCKING SPADE ☐	TOLERANCES		DUBLIN TECHNICAL SYSTEMS, INC.	
	INSULATION: NYLON ☐ PVC ☒		DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031	SCALE NONE	DRAWN BY HR
WIRE SPECIFICATIONS:		SIZE	COLOR	INSULATION	APPROVED BY BS	
AC PANEL POWER		AWG #12	BLK.	THW/THHN	TITLE TRANS A NODE 9 ADMINISTRATION BUILDING I/O WIRING DIAGRAM SLOT 2	
AC PANEL NEUTRAL		AWG #12	WHT.	THW/THHN	DATE 4/08/02	
AC PANEL GROUND		AWG #12	GRN.	THW/THHN	DRAWING NUMBER DTSI - 02040 - 062	
AC CONTROL POWER		AWG #14	RED	THW/THHN		
AC CONTROL NEUTRAL		AWG #14	WHT.	THW/THHN		
AC FOREIGN		AWG #14	YELLOW	THW/THHN		
DC POWER		AWG #16	BLUE	THW/THHN		
DC CONTROL		AWG #16	BLUE	THW/THHN		
SIGNAL/INSTRUMENTS		AWG #16	2 CONDUCTOR SHLD'D	THW/THHN		





DUBLIN TECHNICAL SYSTEMS, INC.
PROJECT # 02040