
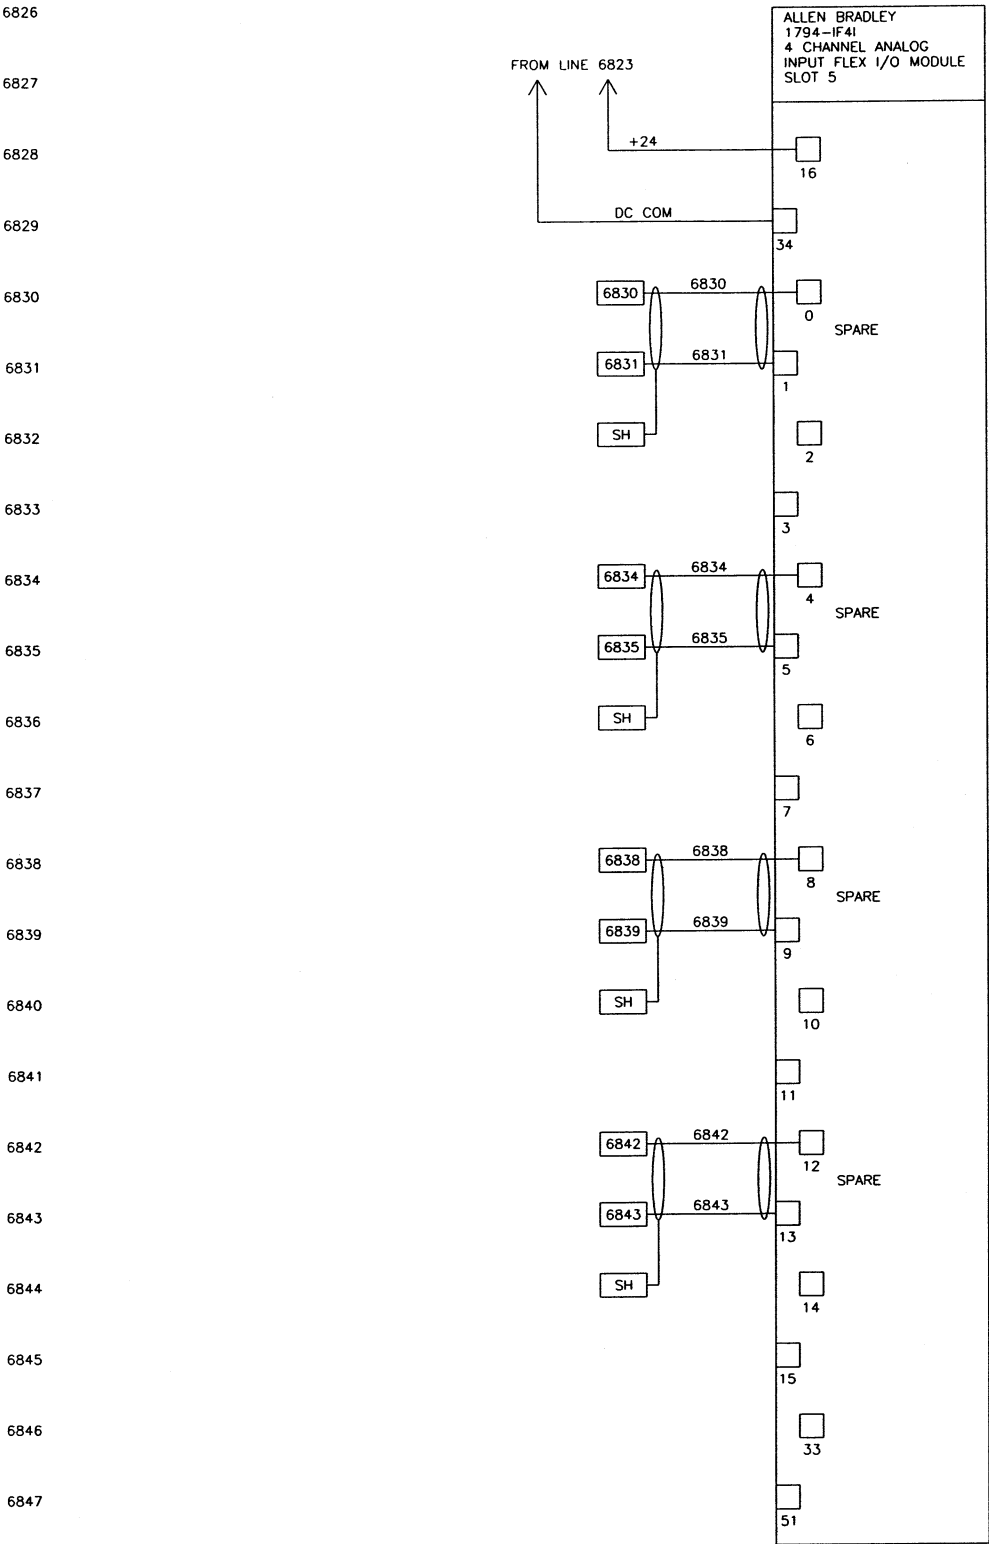
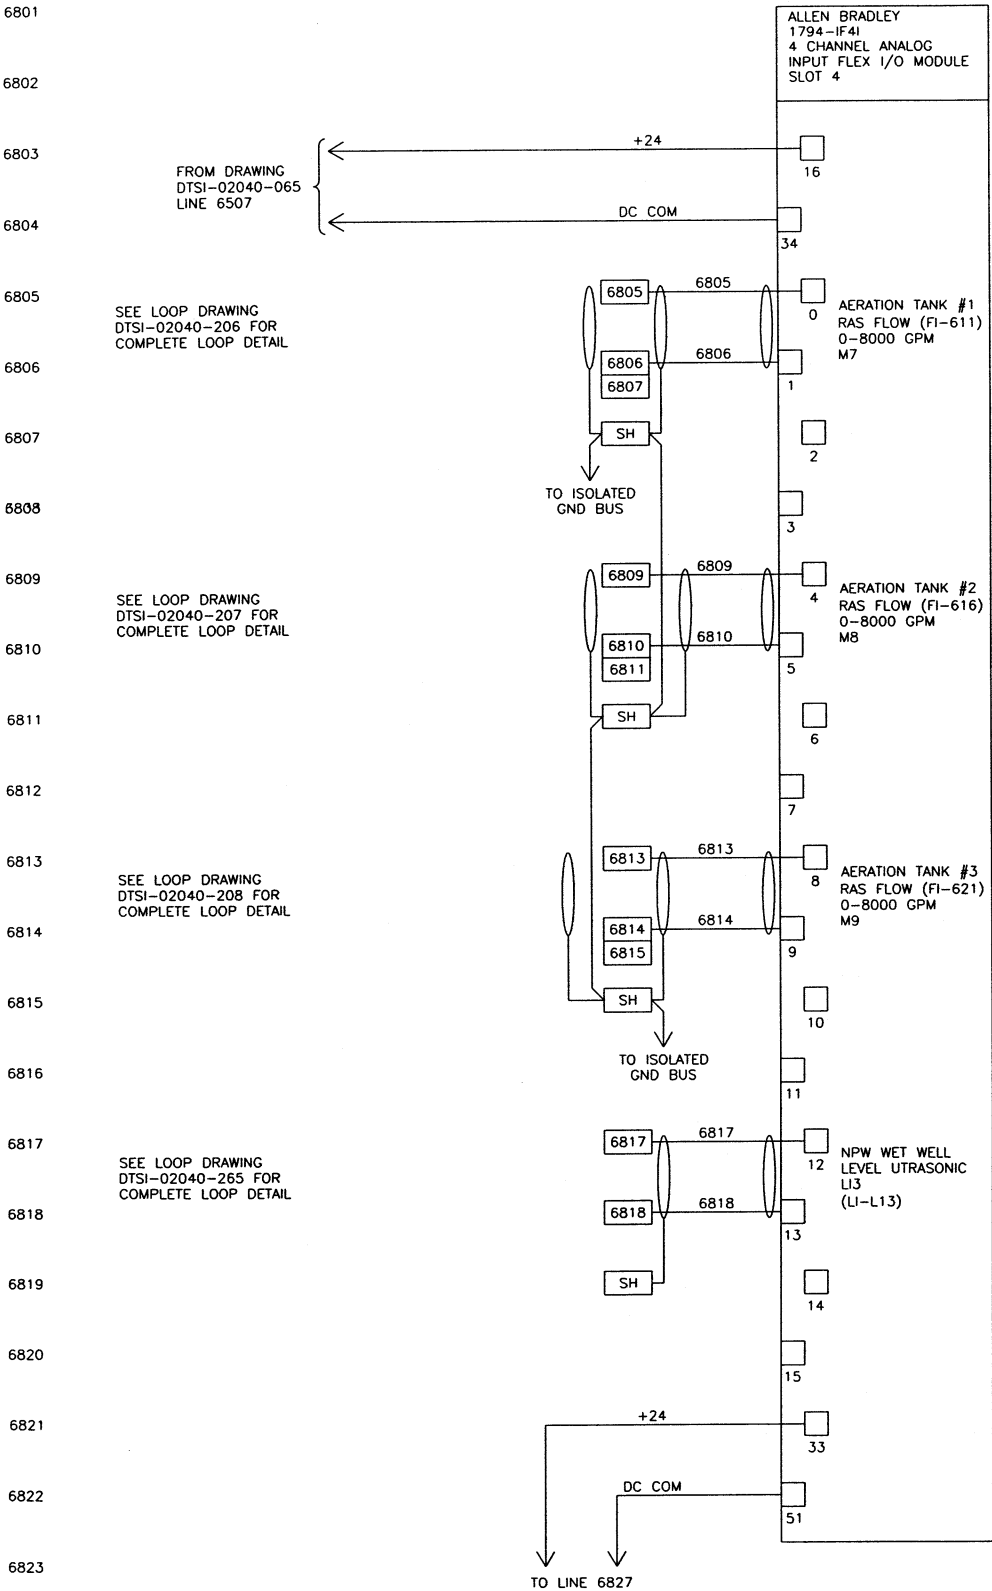


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS



06/03/03 10:43	WIRE LUGS - NO ☒ YES ☐	RING ☐ LOCKING SPADE ☐		 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES	 DUBLIN TECHNICAL SYSTEMS, INC.
	INSULATION: NYLON ☐ PVC ☒	WIRE SPECIFICATIONS:			DECIMAL	
	USAGE	SIZE	COLOR	INSULATION	FRACTIONAL	TITLE
	AC PANEL POWER	AWG #12	BLK.	THW/THHN	1/32"	TRANS D2B NODE 10 RAS & SEC CLARIFIER
	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN		I/O WIRING DIAGRAM SLOTS 4 & 5
	AC PANEL GROUND	AWG #12	GRN.	THW/THHN		
	AC CONTROL POWER	AWG #14	RED	THW/THHN		
	AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN		
	AC FOREIGN	AWG #14	YELLOW	THW/THHN		
	DC POWER	AWG #16	BLUE	THW/THHN		
	DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	2 CONDUCTOR SHLD	1"	
						DATE 4/08/02
						DRAWING NUMBER DTSI - 02040 - 068