
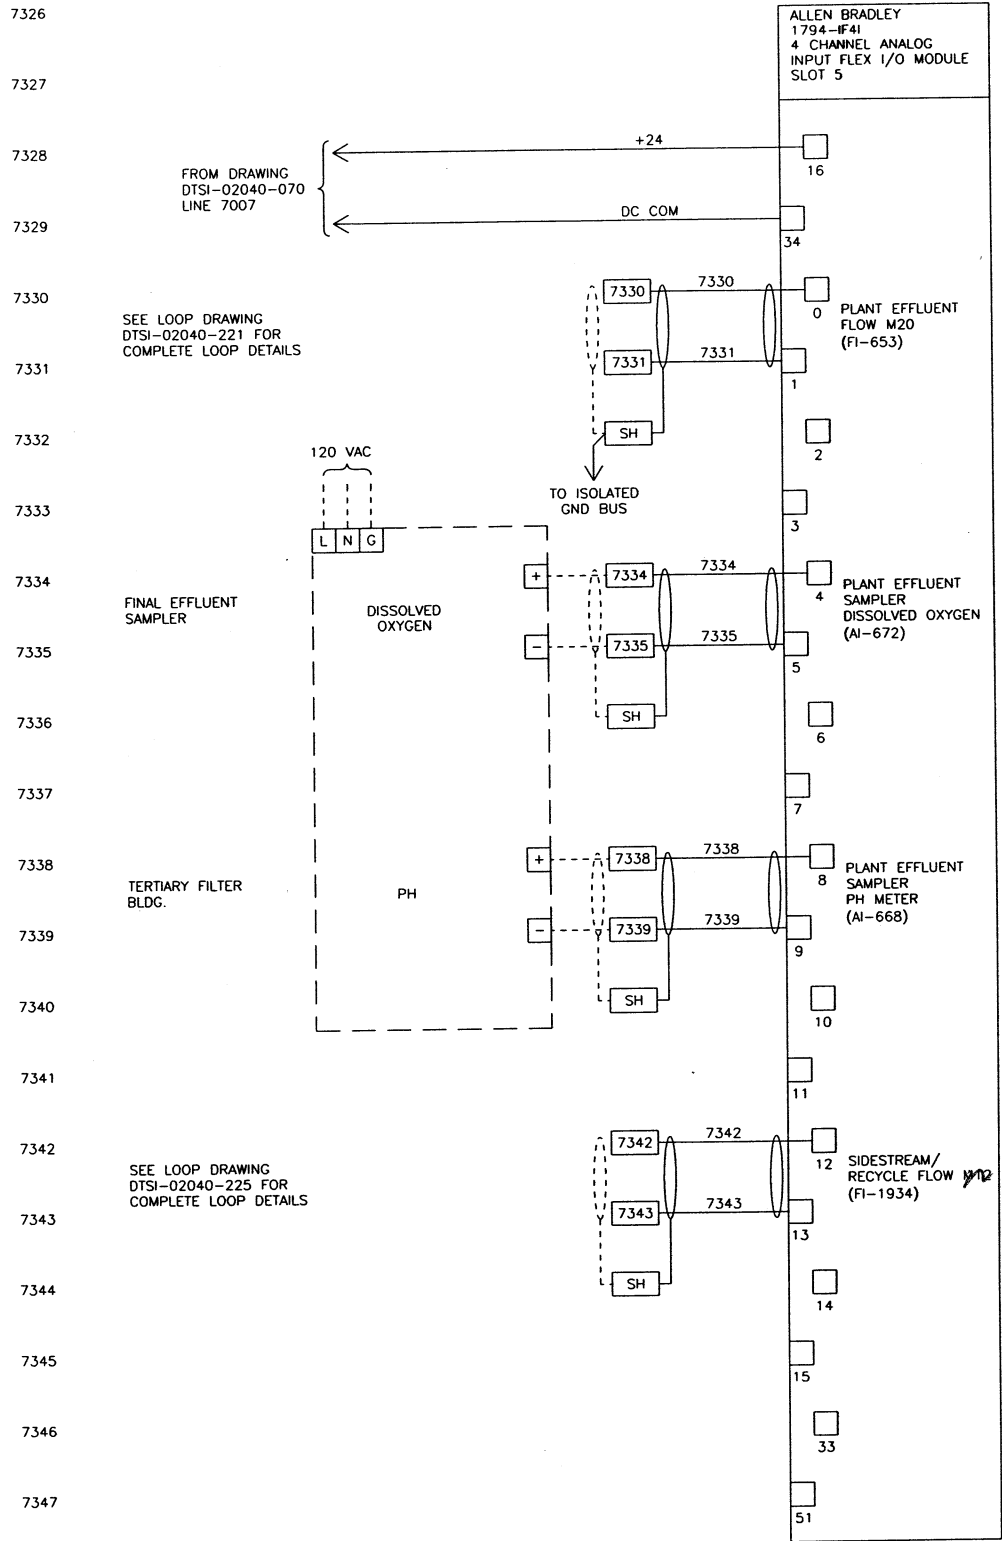
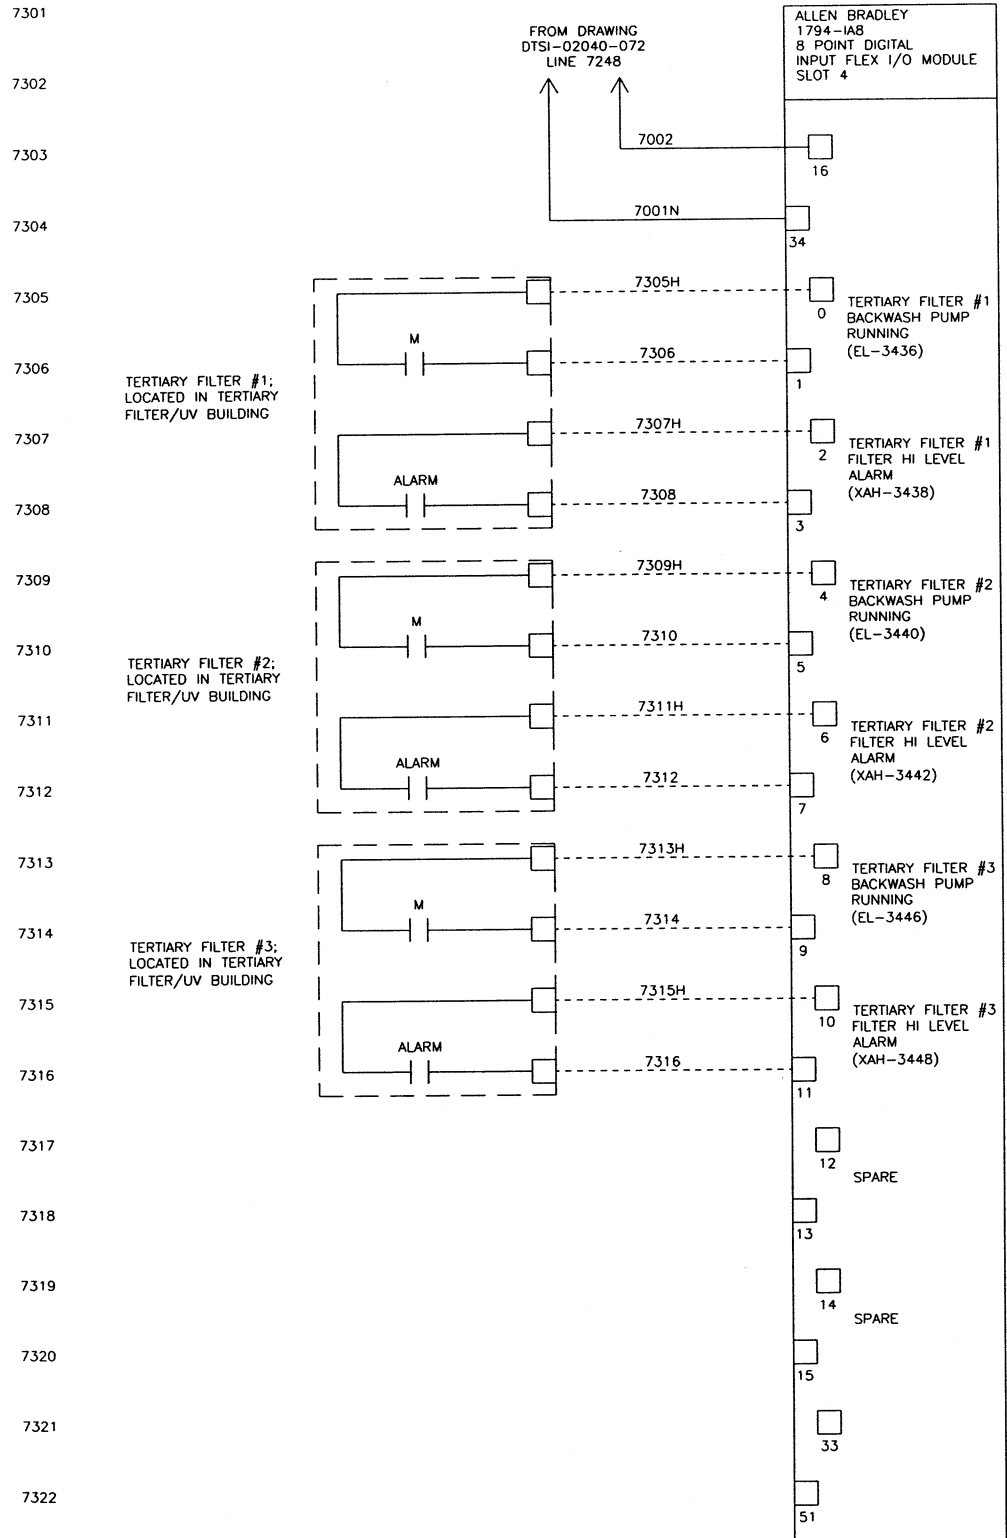


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	HR	BS



06/03/03 11:48	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES		 DUBLIN TECHNICAL SYSTEMS, INC.		
	INSULATION: NYLON ☐ PVC ☒						DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031	SCALE	DRAWN BY <i>HR</i>	
	WIRE SPECIFICATIONS:						+ 0.3		NONE	APPROVED BY <i>BS</i>	
	USAGE		SIZE	COLOR			INSULATION	FRACTIONAL	TITLE		
	AC PANEL POWER		AWG #12	BLK.			THW/THHN	+ 1/32"	TRANS D1 NODE 11 TERTIARY FILTER & UV I/O WIRING DIAGRAM SLOTS 4 & 5		
	AC PANEL NEUTRAL		AWG #12	WHT.			THW/THHN		DATE		
	AC PANEL GROUND		AWG #12	GRN.			THW/THHN		DRAWING NUMBER		
	AC CONTROL POWER		AWG #14	RED			THW/THHN		4/08/02		
	AC CONTROL NEUTRAL		AWG #14	WHT.			THW/THHN		DTSI - 02040 - 073		
	AC FOREIGN		AWG #14	YELLOW			THW/THHN	ANGULAR			
DC POWER		AWG #16	BLUE	THW/THHN	+ 1"						
DC CONTROL		AWG #16	BLUE	THW/THHN							
SIGNAL/INSTRUMENTS		AWG #18	2 CONDUCTOR SHLD	THW/THHN							