


DATE	SYM	REVISION RECORD	AUTH	OR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

M12 FIELD

PLC PANEL NODE 5

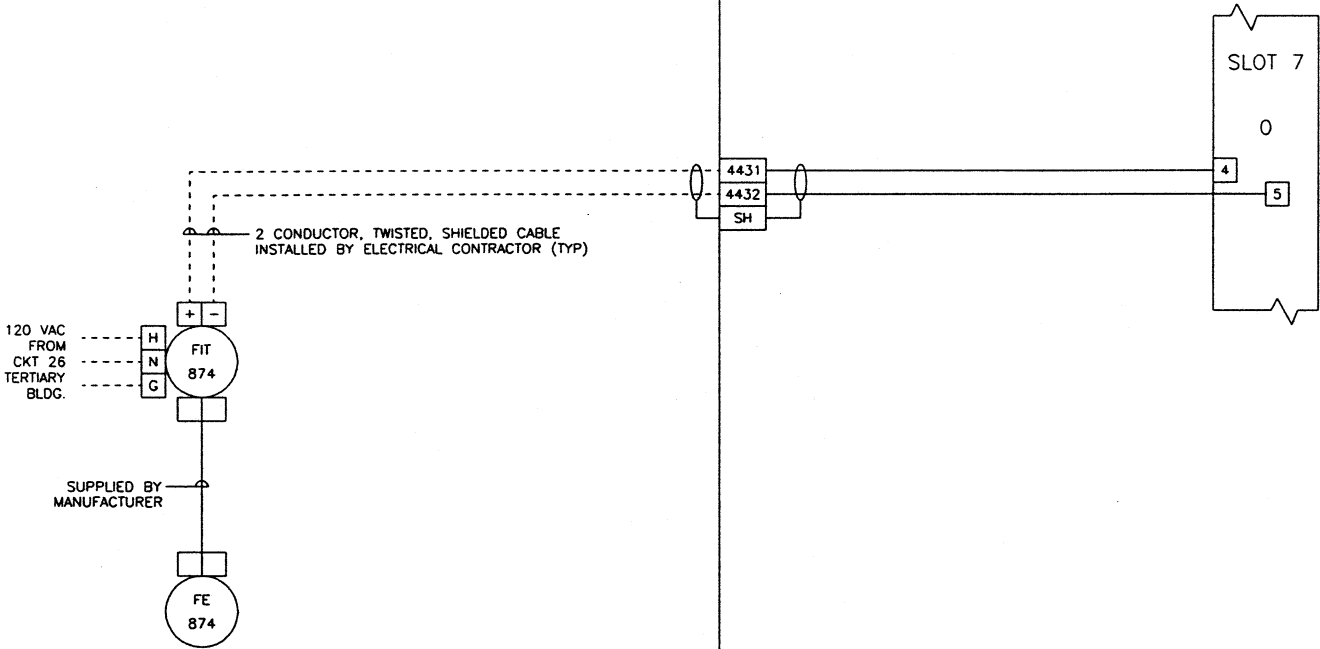


TAG: FE-/FIT-874

MANUFACTURER: ABB
MODEL: 10DX3111(SEE ISA SHEET)
POWER: 120 VAC/60 HZ
ENCLOSURE: NEMA 4X
CALIBRATION RANGE: 0-100GPM

06/03/03 14:59

WIRE LUGS - NO ☐ YES ☐		RING ☐ LOCKING SPADE ☐	
INSULATION: NYLON ☐ PVC ☒			
WIRE SPECIFICATIONS:			
<u>USAGE</u>	<u>SIZE</u>	<u>COLOR</u>	<u>INSULATION</u>
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FORECH	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL	AWG #16	BLUE	THW/THHN
SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD.	THW/THHN



KOKOSING
CONSTRUCTION CO.
P.O. #

DUBLIN TECHNICAL SYSTEMS INC.
PROJECT # 02040

TOLERANCES		DUBLIN TECHNICAL SYSTEMS, INC.	
DECIMAL	± .03	CITY OF WASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031	SCALE NONE
FRACTIONAL	± 1/32"	TITLE DIGESTER FEED FLOW, M12	DRAWN BY TL
ANGULAR	± 1°	DATE 9/18/02	APPROVED BY JK
		DRAWING NUMBER DTSI - 02040 - 212	