


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

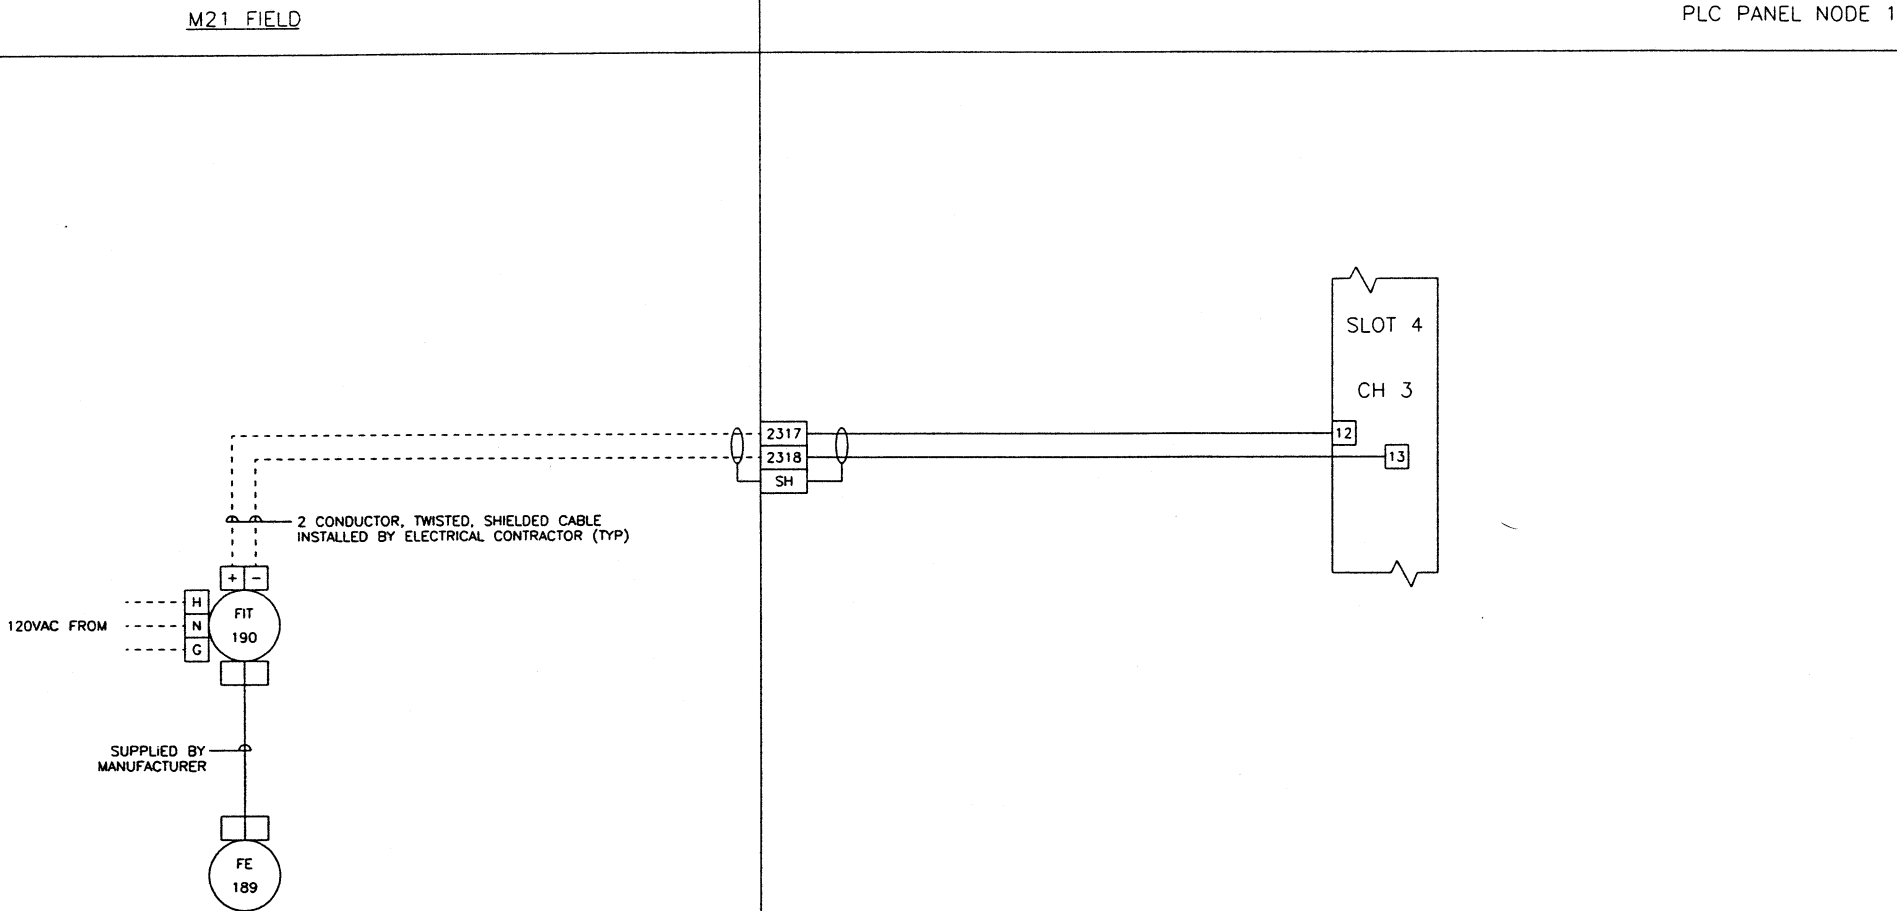

TAG: FE-/FIT-189
MANUFACTURER: SIEMENS MILLTRONICS
MODEL: OCM III
POWER: 120 VAC/60 HZ
ENCLOSURE: NEMA 4X
CALIBRATION RANGE: 0-42.6 MGD

06/04/03 12:29

WIRE LUGS - NO ☒ YES ☐

INSULATION: NYLON ☐ PVC ☒

WIRE SPECIFICATIONS:

USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN.	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FOREIGN	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL	AWG #16	BLUE	THW/THHN
SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD'D	THW/THHN

RING ☐ LOCKING SPADE ☐

STATE OF OHIO
PROFESSIONAL ENGINEER
ROBERT A. LANDTMOHN
E-37992

KOKOSING
CONSTRUCTION CO.
P.O. #

DUBLIN TECHNICAL
SYSTEMS INC.
PROJECT # 02040

TOLERANCES
DECIMAL
± .03
FRACTIONAL
± 1/32"
ANGULAR
± 1°

DUBLIN TECHNICAL SYSTEMS, INC.

CITY OF MASSILLON, OHIO
REGIONAL WASTEWATER TREATMENT
PLANT - UPGRADE 2000
PROJECT NO. E2031

SCALE
NONE

DRAWN BY
TL
APPROVED BY
JK

TITLE
SECONDARY BYPASS FLOW, M21

DATE
9/18/02

DRAWING NUMBER
DTSI - 02040 - 222