


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

M24 FIELD

PLC PANEL NODE 6

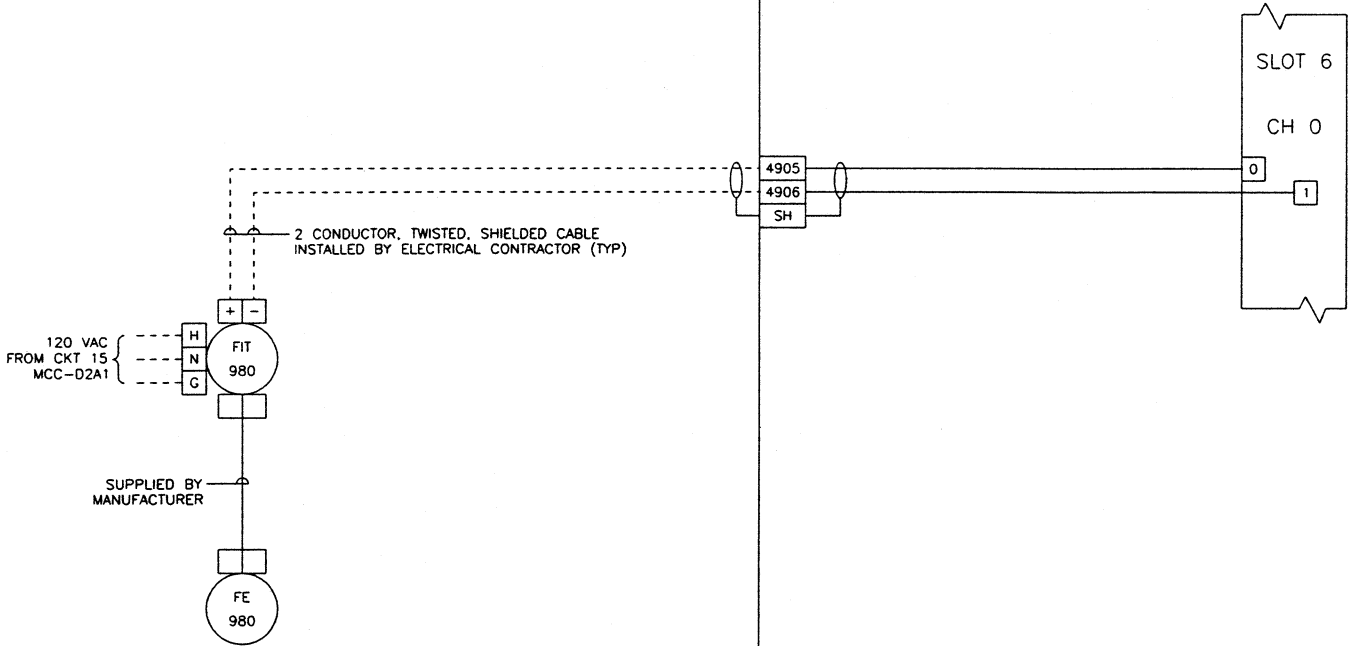

TAG: FE/FIT-980
MANUFACTURER: FCI
MODEL: ST98-13CT02DAAFF
POWER: 120 VAC/60 HZ
ENCLOSURE: NEMA 7
CALIBRATION RANGE: 0-1850 SCFM

10/29/02 10:54

WIRE LUGS - NO ☒ YES ☐	RING ☐ LOCKING SPADE ☐
INSULATION: NYLON ☐ PVC ☒	
WIRE SPECIFICATIONS:	
AC PANEL POWER	SIZE AWG #12 BLK. COLOR THW/THHN
AC PANEL NEUTRAL	SIZE AWG #12 WHT. COLOR THW/THHN
AC PANEL GROUND	SIZE AWG #12 GRN. COLOR THW/THHN
AC CONTROL POWER	SIZE AWG #14 RED. COLOR THW/THHN
AC CONTROL NEUTRAL	SIZE AWG #14 WHT. COLOR THW/THHN
AC FOREIGN	SIZE AWG #14 YELLOW. COLOR THW/THHN
DC POWER	SIZE AWG #16 BLUE. COLOR THW/THHN
DC CONTROL	SIZE AWG #16 BLUE. COLOR THW/THHN
SIGNAL/INSTRUMENTS	SIZE AWG #16 2 CONDUCTOR SHLD. COLOR THW/THHN



KOKOSING CONSTRUCTION CO. P.O. #

DUBLIN TECHNICAL SYSTEMS INC. PROJECT # 02040

TOLERANCES	DUBLIN TECHNICAL SYSTEMS, INC.
DECIMAL	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. 03031
FRACTIONAL	SCALE NONE
ANGULAR	DRAWN BY TL
DATE	APPROVED BY JK
DRAWING NUMBER	TITLE DIGESTER UTILITY GAS FLOW, M24
	9/18/02 DTSI - 02040 - 227