


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

FIELD

OPERATOR'S LABORATORY ENCLOSURE

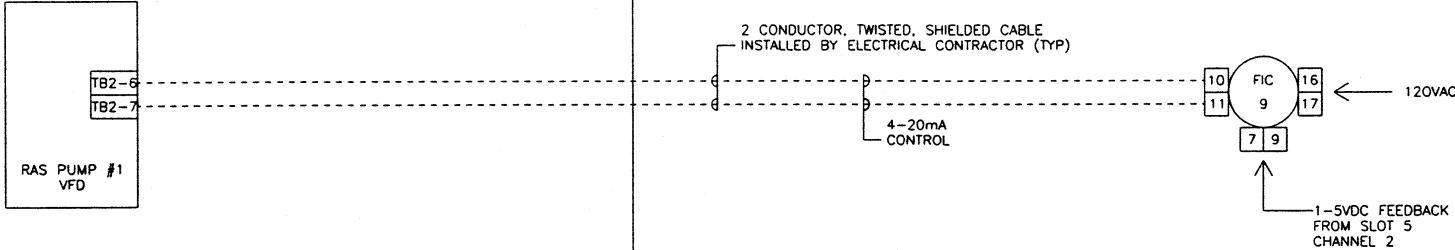

08/28/02 09:07	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. 1	TOLERANCES		DUBLIN TECHNICAL SYSTEMS, INC.			
	INSULATION: NYLON ☐ PVC ☒						DECIMAL	SCALE	DRAWN BY	TL		
							ANGULAR	NONE	APPROVED BY	JK		
							FRACTIONAL	TITLE RAS PUMP #1 VFD SPEED CONTROL				
							DATE	DRAWING NUMBER				
							9/18/02	DTSI - 02040 - 230				

WIRE SPECIFICATIONS:	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	TW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	TW/THHN
AC PANEL GROUND	AWG #12	GRN.	TW/THHN
AC CONTROL POWER	AWG #14	RED	TW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	TW/THHN
AC FOREIGN	AWG #14	YELLOW	TW/THHN
DC POWER	AWG #16	BLUE	TW/THHN
DC CONTROL	AWG #16	BLUE	TW/THHN
SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD	TW/THHN